

Rooftop with 3 dampers Technical data book UATYA-BFC3Y1



UATYA25BFC3Y1
UATYA30BFC3Y1
UATYA40BFC3Y1
UATYA50BFC3Y1
UATYA60BFC3Y1
UATYA70BFC3Y1
UATYA80BFC3Y1
UATYA90BFC3Y1
UATYA100BFC3Y1
UATYA110BFC3Y1
UATYA120BFC3Y1
UATYA140BFC3Y1
UATYA150BFC3Y1
UATYA160BFC3Y1
UATYA180BFC3Y1
UATYA190BFC3Y1

Table of contents

UATYA-BFC3Y1

1	Features	4
	UATYA-BFC3Y1	4
2	Specifications	5
3	Features and advantages	13
4	Options	15
5	Capacity tables	16
	Cooling Capacity Tables	16
6	Dimensional drawings	32
7	Piping diagrams	37
8	Wiring diagrams	39
	Wiring Diagrams - Single Phase	39
9	Sound data	40
	Sound Level Data	40
10	Fan characteristics	41
11	Operation range	43

1 Features

1 - 1 UATYA-BFC3Y1

Integrated fresh air solution with extraction damper and thermodynamic heat recovery

1

- › Integrated extraction damper and fan ensures an optimal pressure balance inside the building
- › Thermo dynamic heat recovery, recovers waste heat through the outdoor heat exchanger
- › Free cooling with up to 100% fresh air intake, saving on energy consumption and improving indoor air quality
- › Reduced CO2 equivalent thanks to the use of lower GWP R-32 refrigerant
- › Highly efficient ERP compliant models, meeting the latest eco-design requirements
- › Easy to install 'plug and play' concept; no additional piping is required since this is a packaged unit
- › Available as Made-To-Stock units and Made-To-Order units with extensive option package
- › Demand controlled fresh air management thanks to the CO2 sensor connection available as accessory
- › 25mm double skinned panels ensure long-lasting life and provide good thermal and sound insulation
- › Latest pCO2 controller allows direct integration with Daikin BMS, or third party BMS via BACnet or Modbus
- › Clogged filter alarm indicates when filter requires cleaning, improving air quality and efficiency
- › Flexible supply and return air connection
- › Wide operation range in cooling (-15 ~ 48°C) and heating (-15 ~ 20°C)



Inverter



2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1	
Cooling capacity	Nom.		kW	25.8 (1)	33.4 (1)	38.7 (1)	45.7 (1)	
	With 30% fresh air		kW	27.8 (1)	36.1 (1)	42.5 (1)	49.6 (1)	
Heating capacity	Nom.		kW	25.3 (2)	31.1 (2)	36.3 (2)	46.2 (2)	
	With 30% fresh air		kW	26.0 (2)	32.4 (2)	38.3 (2)	47.7 (2)	
Power input	Cooling	Nom.	kW	9.1 (1)	10.8 (1)	12.7 (1)	15.4 (1)	
	Heating	Nom.	kW	7.8 (2)	9.4 (2)	11.1 (2)	14.2 (2)	
EER				2.83 (1) / 2.96 (3)	3.09 (1) / 3.20 (3)	3.06 (1) / 3.27 (3)	2.96 (1) / 3.12 (3)	
COP				3.22 (2) / 3.38 (3)	3.31 (2) / 3.48 (3)	3.26 (2) / 3.51 (3)	3.24 (2) / 3.46 (3)	
Space cooling	Capacity	Pdesign	kW	25.8	33.4	38.7	45.7	
	SEER			4.62 (4)	4.89 (4)	5.48 (4)	5.34 (4)	
	ηs,c		%	181.6	192.6	216.1	210.5	
	Annual energy consumption		kWh/a	3,378	4,101	4,238	5,139	
Space heating (Average climate)	Capacity	Pdesign	kW	25.3	31.1	36.3	46.2	
	SCOP/A			3.35 (5)	3.38 (5)	3.67 (5)	3.65 (5)	
	ηs,h		%	131.0	132.2	143.8	143.0	
	Pdh Heating capacity at -10°		kW	15.2	20.1	21.9	28.0	
	Annual energy consumption		kWh/a	7,210	9,558	9,427	12,223	
	Required back up heating cap at design conditions		kW	0.00				
Space cooling	A	Pdc	kW	25.8	33.4	38.7	45.7	
	Condition	EERd		2.83	3.09	3.06	2.96	
	(35°C - 27/19)	Power input	kW	9.1	10.8	12.7	15.4	
	B	Pdc	kW	19.1	24.5	28.5	33.6	
	Condition	EERd		4.06	4.38	4.52	4.42	
	(30°C - 27/19)	Power input	kW	4.7	5.6	6.3	7.6	
	C	Pdc	kW	12.6	15.7	18.3	21.6	
	Condition	EERd		5.73	6.04	6.78	6.75	
	(25°C - 27/19)	Power input	kW	2.2	2.6	2.7	3.2	
	D	Pdc	kW	12.9	14.0	14.5	20.4	
	Condition	EERd		6.79	7.37	8.53	8.16	
	(20°C - 27/19)	Power input	kW	1.9		1.7	2.5	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-10				
		Pdh (declared heating cap)	kW	15.2	20.1	21.9	28.0	
		COPd (declared COP)		1.95	2.01	1.99	2.01	
		Power input	kW	7.8	10.0	11.0	13.9	
	TBivalent	Tbiv (bivalent temperature) °C		-8				
Space heating (Average climate)		Pdh (declared heating cap)	kW	15.9	21.3	22.8	29.4	
	TBivalent	COPd (declared COP)		2.01	2.11	2.07	2.10	
		Power input	kW	7.9	10.1	11.0	14.0	
	A	Pdh (declared heating cap)		15.3	20.4	21.8	28.1	
	Condition	COPd (declared COP)		2.14	2.24	2.20	2.21	
	(-7°C)	Power input	kW	7.1	9.1	9.9	12.7	
	B	Pdh (declared heating cap)		9.4	12.5	13.4	17.2	
	Condition	COPd (declared COP)		3.62	3.57	3.94	3.91	
	(2°C)	Power input	kW	2.6	3.5	3.4	4.4	
	C	Pdh (declared heating cap)		9.3	10.5	9.9	14.2	
	Condition	COPd (declared COP)		4.23	4.20	4.50	4.58	
	(7°C)	Power input	kW	2.2	2.5	2.2	3.1	
	D	Pdh (declared heating cap)		10.6	11.9	11.2	16.1	
	Condition	COPd (declared COP)		5.05	4.96	5.60	5.55	
	(12°C)	Power input	kW	2.1	2.4	2.0	2.9	
	Evaporator	Control	Air discharge		Ducted			
		Supply side	Air discharge direction		Frontal / Left			
		Fan	Type	Radial plug fan				
Quantity			1					
Air flow rate			m³/h	4,500	5,800	7,500	9,000	
Nominal ESP			Pa	300 (4.000)				
Filter			Type	G4				
Return side		Fan	Thickness	mm	98			
			Type	Radial plug fan				
			Quantity	1				
		Air flow rate	m³/min	4,500	5,800	7,500	9,000	
		Nominal ESP	Pa	300 (4.000)				
		Air intake direction		Rear				
		Thermodynamic heat recovery		Yes				
Fresh air		Standard		Yes				
	Ratio	Standard	%	30				
		In free cooling	%	100				

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1
Condenser	Air flow rate	Cooling	m³/h	15,725	16,038	16,374	16,341
	Fan	Type		Axial			
		Motor	Quantity	1			
	Compressor	Quantity		1			
		Type		Scroll			
Condenser	Refrigerant	Type		R-32			
	Refrigerant	GWP		675			
		Charge	TCO2Eq	4,725	6,750	8,100	10,125
		Charge	kg	7.0	10.0	12.0	15.0
		Control		Electronic expansion valve			
	Refrigerant oil	Circuits	Quantity	1			
		Type		NXG5020			
		Charged volume	l	2	3		
Dimensions	Unit	Height	mm	1,924	2,374		
		Width	mm	2,250			
		Depth	mm	3,514			
Weight	Unit		kg	1,166	1,196	1,310	1,329
Casing	Colour				RAL 7035		
	Material				Polyester painted galvanised steel plate		
Sound pressure level	Cooling		dB(A)	63.9 (6)	66.0 (6)	68.0 (6)	67.3 (6)
Sound power level	Cooling		dB(A)	82.2 (7)	84.3 (7)	86.8 (7)	86.1 (7)
Operation range	Cooling	Min.	°CDB	-10			
		Max.	°CDB	48			
	Heating	Min.	°CWB	-15			
		Max.	°CWB	26			
Indication if the heater is equipped with a supplementary heater (pair application)				No			
Supplementary heater (pair application)	Type of energy input			No			
Cooling	Cdc (Degradation cooling)			0.25			
Heating	Cdh (Degradation heating)			0.25			

Technical specifications				UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1
Cooling capacity	Nom.		kW	58.8 (1)	65.3 (1)	74.8 (1)	89.8 (1)
	With 30% fresh air		kW	63.7 (1)	70.5 (1)	81.3 (1)	96.8 (1)
Heating capacity	Nom.		kW	55.1 (2)	64.9 (2)	68.5 (2)	84.2 (2)
	With 30% fresh air		kW	57.1 (2)	68.6 (2)	71.6 (2)	87.2 (2)
Power input	Cooling	Nom.	kW	18.8 (1)	22.4 (1)	24.2 (1)	29.4 (1)
	Heating	Nom.	kW	16.9 (2)	20.2 (2)	20.3 (2)	26.1 (2)
EER				3.12 (1) / 3.23 (3)	2.92 (1) / 3.00 (3)	3.09 (1) / 3.21 (3)	3.06 (1) / 3.22 (3)
COP				3.25 (2) / 3.40 (3)	3.21 (2) / 3.39 (3)	3.37 (2) / 3.56 (3)	3.22 (2) / 3.45 (3)
Space cooling	Capacity	Pdesign	kW	58.8	65.3	74.8	89.8
	SEER			5.50 (4)	4.53 (4)	5.56 (4)	5.47 (4)
	ηs,c		%	217.1	178.1	219.4	215.8
	Annual energy consumption		kWh/a	6,411	8,652	8,124	9,852
Space heating (Average climate)	Capacity	Pdesign	kW	55.1	64.9	68.5	84.2
	SCOP/A			3.47 (5)	3.41 (5)	3.70 (5)	3.65 (5)
	ηs,h		%	135.6	133.5	145.2	143.0
	PdH Heating capacity at -10°		kW	33.2	38.3	40.1	51.5
	Annual energy consumption		kWh/a	15,091	17,811	17,498	22,119
	Required back up heating cap at design conditions		kW	0.00			
Space cooling	A	Pdc	kW	58.8	65.3	74.8	89.8
		Condition		3.12	2.92	3.09	3.06
		(35°C - 27/19)					
	B	Power input	kW	18.8	22.4	24.2	29.4
		Condition		43.2	48.1	55.4	66.1
		(30°C - 27/19)					
	C	Power input	kW	9.2	12.4	14.0	15.2
		Condition		27.7	30.6	35.6	42.5
		(25°C - 27/19)					
	D	Power input	kW	4.1	5.4	5.3	6.4
		Condition		6.76	5.67	6.72	6.64
		(20°C - 27/19)					

2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications					UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1		
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C			-10					
		Pdh (declared heating cap) kW			33.2	38.3	40.1	51.5		
		COPd (declared COP)			1.96	1.93		1.96		
		Power input kW			16.9	19.9	20.8	26.3		
Space heating (Average climate)	TBivalent	Tbiv (bivalent temperature) °C			-8					
		Pdh (declared heating cap) kW			34.5	40.1	42.7	53.2		
	TBivalent	COPd (declared COP)			2.04	2.02	2.04	2.03		
		Power input kW			16.9	19.9	20.9	26.2		
	A	Pdh (declared heating cap) kW			33.0	42.3	44.5	55.3		
		COPd (declared COP)			2.17	2.12	2.13	2.10		
	Condition (-7°C)	Power input kW			15.2	20.0	20.9	26.3		
		Pdh (declared heating cap) kW			20.3	23.5	25.0	19.6		
	Condition (2°C)	COPd (declared COP)			3.69	3.67	3.91	3.77		
		Power input kW			5.5	6.4		5.2		
	C	Pdh (declared heating cap) kW			14.9	16.0	15.3	22.4		
		COPd (declared COP)			4.26	4.10	4.64	4.87		
	Condition (7°C)	Power input kW			3.5	3.9	3.3	4.6		
		Pdh (declared heating cap) kW			16.9	18.4	17.7	25.4		
	Condition (12°C)	COPd (declared COP)			5.12	4.84	5.71	5.77		
		Power input kW			3.3	3.8	3.1	4.4		
Evaporator	Control	Air discharge			Ducted					
	Supply side	Air discharge direction			Bottom / Right / Left / Frontal					
	Fan	Type			Radial plug fan					
		Quantity			1		2			
		Air flow rate m³/h			11,000	13,000	14,500	16,500		
		Nominal ESP Pa			300 (4.000)					
		Filter	Type			G4				
			Thickness mm			98				
	Return side		Fan	Type			Radial plug fan			
				Quantity			1		2	
		Air flow rate m³/min			11,000	13,000	14,500	16,500		
		Nominal ESP Pa			300 (4.000)					
		Air intake direction			Right					
		Thermodynamic heat recovery			Yes					
	Fresh air	Standard			Yes					
		Ratio	Standard	%	30					
			In free cooling	%	100					
	Condenser	Air flow rate	Cooling	m³/h		31,183	32,203	35,774	37,285	
Fan		Type			Axial					
		Motor	Quantity			2				
Compressor		Quantity			1	2				
Refrigerant		Type			Scroll					
	Type			R-32						
Condenser	Refrigerant	GWP			675					
		Charge	TCO2Eq		12,150	15,525		16,200		
		Charge	kg		18.0	23.0		24.0		
		Control			Electronic expansion valve					
	Refrigerant oil	Circuits	Quantity		1					
		Type			NXG5020					
		Charged volume l			3	6				
		Dimensions	Unit	Height	mm	1,924		2,374		
Width	mm			2,250						
Depth	mm			6,317						
Weight	Unit			kg	1,996	2,094	2,336	2,382		
Casing	Colour	RAL 7035								
	Material	Polyester painted galvanised steel plate								
Sound pressure level	Cooling	dB(A)			69.0 (6)	68.1 (6)	72.6 (6)	68.7 (6)		
Sound power level	Cooling	dB(A)			88.5 (7)	87.5 (7)	92.5 (7)	88.6 (7)		
Operation range	Cooling	Min.	°CDB		-10					
		Max.	°CDB		48					
	Heating	Min.	°CWB		-15					
		Max.	°CWB		26					
Power consumption in other than active mode	Thermostat-off mode	Cooling	PTO	kW	1	-				
		Heating	PTO	kW	1	-				
Indication if the heater is equipped with a supplementary heater (pair application)					No					
Supplementary heater (pair application)	Type of energy input				No					
Cooling	Cdc (Degradation cooling)				0.25					
Heating	Cdh (Degradation heating)				0.25					

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications				UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1
Cooling capacity	Nom.		kW	95.8 (1)	108.9 (1)	115.0 (1)	133.4 (1)
	With 30% fresh air		kW	104.3 (1)	118.0 (1)	124.5 (1)	145.6 (1)
Heating capacity	Nom.		kW	92.8 (2)	101.5 (2)	108.0 (2)	123.1 (2)
	With 30% fresh air		kW	97.9 (2)	107.0 (2)	112.3 (2)	132.0 (2)
Power input	Cooling	Nom.	kW	32.3 (1)	36.4 (1)	39.5 (1)	42.5 (1)
	Heating	Nom.	kW	29.0 (2)	30.3 (2)	33.2 (2)	35.8 (2)
EER				2.97 (1) / 3.14 (3)	2.99 (1) / 3.11 (3)	2.91 (1) / 3.01 (3)	3.14 (1) / 3.26 (3)
COP				3.20 (2) / 3.42 (3)	3.35 (2) / 3.57 (3)	3.25 (2) / 3.40 (3)	3.44 (2) / 3.62 (3)
Space cooling	Capacity	Pdesign	kW	95.8	108.9	115.0	133.4
	SEER			5.17 (4)	5.29 (4)	5.15 (4)	4.38 (4)
	ηs,c		%	203.7	208.6	203.0	172.1
	Annual energy consumption		kWh/a	11,122	12,348	13,397	18,280
Space heating (Average climate)	Capacity	Pdesign	kW	92.8	101.5	108.0	123.1
	SCOP/A			3.62 (5)	3.56 (5)	3.53 (5)	3.39 (5)
	ηs,h		%	141.6	139.3	138.3	132.5
	Pdh Heating capacity at -10°		kW	54.7	59.8	64.3	71.6
	Annual energy consumption		kWh/a	24,538	27,186	29,413	39,459
	Required back up heating cap at design conditions		kW	0.00			
Space cooling	A	Pdc	kW	95.8	108.9	115.0	133.4
	Condition	EERd		2.97	2.99	2.91	3.14
	(35°C - 27/19)	Power input	kW	32.3	36.4	39.5	42.5
	B	Pdc	kW	69.9	80.1	84.6	98.3
	Condition	EERd		3.97	4.09	3.90	4.15
	(30°C - 27/19)	Power input	kW	17.6	19.6	21.7	23.7
	C	Pdc	kW	45.3	51.4	54.3	63.2
	Condition	EERd		6.29	6.27	6.17	5.02
	(25°C - 27/19)	Power input	kW	7.2	8.2	8.8	12.6
	D	Pdc	kW	35.5	37.0	37.3	45.4
	Condition	EERd		8.66	9.25	9.10	5.47
	(20°C - 27/19)	Power input	kW	4.1	4.0	4.1	8.3
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10			
		Pdh (declared heating cap)	kW	54.7	59.8	64.3	71.6
		COPd (declared COP)		1.56	2.01	1.98	1.91
		Power input	kW	35.0	29.8	32.5	37.4
	TBivalent	Tbiv (bivalent temperature)	°C	-8			
		Pdh (declared heating cap)	kW	58.5	63.8	68.5	80.8
Space heating (Average climate)	TBivalent	COPd (declared COP)		1.71	2.10	2.08	2.15
		Power input	kW	34.3	30.4	33.0	37.6
	A	Pdh (declared heating cap)	kW	60.1	66.0	70.2	80.0
	Condition	COPd (declared COP)		1.78	2.18	2.13	2.12
	(-7°C)	Power input	kW	33.8	30.3	32.9	37.7
	B	Pdh (declared heating cap)	kW	34.3	37.3	40.1	51.5
	Condition	COPd (declared COP)		3.94	3.52		3.68
	(2°C)	Power input	kW	8.7	10.6	11.4	14.0
	C	Pdh (declared heating cap)	kW	22.5	22.6	22.7	34.4
	Condition	COPd (declared COP)		4.79	4.81	4.73	4.15
	(7°C)	Power input	kW	4.7		4.8	8.3
	D	Pdh (declared heating cap)	kW	25.5	25.6	25.8	38.3
	Condition	COPd (declared COP)		5.67	5.69	5.73	4.67
	(12°C)	Power input	kW	4.5			8.2
Evaporator	Control	Air discharge		Ducted			
	Supply side	Air discharge direction		Bottom / Right / Left / Frontal			
	Fan	Type		Radial plug fan			
		Quantity		2			3
		Air flow rate	m³/h	18,000	19,800	21,600	25,000
		Nominal ESP	Pa	300 (4)			
	Filter	Type		G4			
		Thickness	mm	98			
	Return side	Type		Radial plug fan			
		Quantity		2			
		Air flow rate	m³/min	18,000	19,800	21,600	25,000
		Nominal ESP	Pa	300 (4)			
	Fresh air	Air intake direction		Right			
		Thermodynamic heat recovery		Yes			
		Standard		Yes			
		Ratio	Standard	30			
		In free cooling	%	100			

2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications					UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1	
Condenser	Air flow rate	Cooling	m³/h		36,195	38,143	36,865	70,704	
	Fan	Type			Axial				
		Motor	Quantity	2				4	
	Compressor	Quantity	2				4		
		Type	Scroll						
Condenser	Refrigerant	Type	R-32						
	Refrigerant	GWP	675						
		Charge	TCO2Eq	18,900	20,250	24,300	25,650		
		Charge	kg	28.0	30.0	36.0	38.0		
		Control	Electronic expansion valve						
	Refrigerant oil	Circuits	Quantity	1				2	
		Type	NXG5020						
		Charged volume	l	6	8	14			
	Dimensions	Unit	Height	mm	2,374				
Width			mm	2,250					
Depth			mm	6,317				7,117	
Weight	Unit		kg	2,452	2,548	2,558	3,024		
Casing	Colour	RAL 7035							
	Material	Polyester painted galvanised steel plate							
Sound pressure level	Cooling		dB	69.9 (6)	70.6 (6)	74.2 (6)	68.3 (6)		
Sound power level	Cooling		dB	89.8 (7)	90.5 (7)	94.1 (7)	88.6 (7)		
Operation range	Cooling	Min.	°CDB	-10					
		Max.	°CDB	48					
	Heating	Min.	°CWB	-15					
		Max.	°CWB	26					
Power consumption in other than active mode	Thermostat-off mode	Cooling	PTO	kW	-	1			
		Heating	PTO	kW	-	1			
Indication if the heater is equipped with a supplementary heater (pair application)					No				
Supplementary heater (pair application)		Type of energy input			No				
Cooling	Cdc (Degradation cooling)			0.25					
Heating	Cdh (Degradation heating)			0.25					

Technical specifications					UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1
Cooling capacity	Nom.		kW		144.7 (1)	154.6 (1)	171.9 (1)	187.0 (1)
	With 30% fresh air		kW		156.8 (1)	168.3 (1)	186.5 (1)	204.4 (1)
Heating capacity	Nom.		kW		136.4 (2)	147.1 (2)	157.1 (2)	176.9 (2)
	With 30% fresh air		kW		147.5 (2)	160.0 (2)	173.5 (2)	191.6 (2)
Power input	Cooling	Nom.	kW		47.9 (1)	50.7 (1)	56.1 (1)	62.9 (1)
	Heating	Nom.	kW		40.9 (2)	45.1 (2)	47.2 (2)	54.2 (2)
EER					3.02 (1) / 3.14 (3)	3.05 (1) / 3.18 (3)	3.07 (1) / 3.21 (3)	2.97 (1) / 3.14 (3)
COP					3.33 (2) / 3.57 (3)	3.26 (2) / 3.49 (3)	3.33 (2) / 3.63 (3)	3.27 (2) / 3.50 (3)
Space cooling	Capacity	Pdesign	kW		144.7	154.6	171.9	187.0
	SEER				4.26 (4)	4.27 (4)	4.15 (4)	4.08 (4)
	ηs,c		%		167.2	167.6	162.8	160.2
	Annual energy consumption		kWh/a		20,374	21,779	24,876	27,540
Space heating (Average climate)	Capacity	Pdesign	kW		136.4	147.1	157.1	176.9
	SCOP/A				3.36 (5)	3.34 (5)	3.31 (5)	3.34 (5)
	ηs,h		%		131.4	130.8	129.5	130.6
	Pdh Heating capacity at -10°		kW		80.3	85.9	95.5	105.9
	Annual energy consumption		kWh/a		44,258	47,649	51,965	56,838
	Required back up heating cap at design conditions		kW		0.00			
Space cooling	A	Pdc	kW		144.7	154.6	171.9	187.0
	Condition	EERd			3.02	3.05	3.07	2.97
	(35°C - 27/19)	Power input	kW		47.9	50.7	56.1	62.9
	B	Pdc	kW		106.5	114.1	126.7	138.0
	Condition	EERd			4.05	3.98	4.05	3.84
	(30°C - 27/19)	Power input	kW		26.3	28.7	31.3	35.9
	C	Pdc	kW		68.5	73.3	81.4	88.7
	Condition	EERd			4.86	4.92	4.82	
	(25°C - 27/19)	Power input	kW		14.1	14.9	16.9	18.4
	D	Pdc	kW		49.7	50.2	58.3	58.5
	Condition	EERd			5.29	5.34	5.03	5.00
	(20°C - 27/19)	Power input	kW		9.4		11.6	11.7

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications					UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C			-10				
		Pdh (declared heating cap) kW			80.3	85.9	95.5	105.9	
		COPd (declared COP)			1.91	1.88	1.97	1.98	
	Power input kW			42.0	45.8	48.4	53.4		
TBivalent	Tbiv (bivalent temperature) °C			-6					
	Pdh (declared heating cap) kW			89.9	96.3	104.0	114.7		
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.12	2.08	2.14	2.13	
		Power input kW			42.5	46.4	48.7	53.9	
	A	Pdh (declared heating cap) kW			86.4	93.6	103.4	113.7	
		COPd (declared COP)			2.03		2.11		
	Condition (-7°C)	Power input kW			42.5	46.2	49.1	53.8	
		Pdh (declared heating cap) kW			57.3	61.3	66.3	80.0	
	Condition (2°C)	COPd (declared COP)			3.67		3.60		
		Power input kW			15.6	16.7	18.4	21.8	
	C	Pdh (declared heating cap) kW			38.3	38.5	45.0	45.3	
		COPd (declared COP)			4.12	4.10	4.02	4.01	
	Condition (7°C)	Power input kW			9.3	9.4	11.2	11.3	
		Pdh (declared heating cap) kW			42.3		48.9	49.2	
	Condition (12°C)	COPd (declared COP)			4.60	4.55	4.45	4.43	
		Power input kW			9.2	9.3	11.0	11.1	
	Evaporator	Control	Air discharge			Ducted			
		Supply side	Air discharge direction			Bottom / Right / Left / Frontal			
Fan		Type			Radial plug fan				
		Quantity			3				
		Air flow rate m³/h			26,500	28,000	30,500	31,500	
		Nominal ESP Pa			300 (4)				
		Filter	Type			G4			
Thickness mm			98						
Return side			Fan	Type			Radial plug fan		
		Quantity			2				
		Air flow rate m³/min			26,500	28,000	30,500	31,500	
		Nominal ESP Pa			300 (4)				
		Air intake direction			Right				
Fresh air		Thermodynamic heat recovery			Yes				
		Standard			Yes				
		Ratio	Standard	%	30				
			In free cooling	%	100				
Condenser		Air flow rate	Cooling	m³/h		72,395	67,733	70,200	72,005
	Fan	Type			Axial				
		Motor	Quantity		4				
	Compressor	Quantity			4				
		Type			Scroll				
	Condenser	Refrigerant	Type			R-32			
			GWP			675			
Refrigerant		Charge	TCO2Eq		25,650	31,050	33,750		
		Charge	kg		38.0	46.0	50.0		
		Control			Electronic expansion valve				
Refrigerant oil		Circuits	Quantity		2				
		Type			NXG5020				
	Charged volume l			14		16			
Dimensions	Unit	Height	mm		2,374				
		Width	mm		2,250				
		Depth	mm		7,117				
Weight	Unit	kg			3,035	3,074	3,192	3,271	
Casing	Colour	RAL 7035							
	Material	Polyester painted galvanised steel plate							
Sound pressure level	Cooling	dB(A)			68.3 (6)	68.7 (6)	69.1 (6)	70.0 (6)	
Sound power level	Cooling	dB(A)			88.6 (7)	89.0 (7)	89.3 (7)	90.2 (7)	
Operation range	Cooling	Min.	°CDB		-10				
		Max.	°CDB		48				
	Heating	Min.	°CWB		-15				
		Max.	°CWB		26				
Power consumption in other than active mode	Thermostat-off mode	Cooling	PTO	kW	1			2	
		Heating	PTO	kW	1				
Indication if the heater is equipped with a supplementary heater (pair application)					No				
Supplementary heater (pair application)	Type of energy input				No				
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				

2 Specifications

1 - 1 UATYA-BFC3Y1

Electrical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency		Hz	50			
	Voltage		V	400			
Current	Nominal running current (RLA)	Cooling	A	15.4	24.7	27.6	35.8
	Recommended fuses		A	25	40	50	
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency		Hz	50			
	Voltage		V	400			
Current	Nominal running current (RLA)	Cooling	A	38.7	47.4	55.3	73.4
	Recommended fuses		A	50	63	80	100
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency		Hz	50			
	Voltage		V	400			
Current	Nominal running current (RLA)	Cooling	A	73.4	76.8	107.0	
	Recommended fuses		A	100	160		
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency		Hz	50			
	Voltage		V	400			
Current	Nominal running current (RLA)	Cooling	A	118.2	126.8	140.0	146.0
	Recommended fuses		A	160	200		
Wiring connections	For power supply	Quantity		4G			

(1)Conditions for calculation: Ambient air 27°C DB, 19°C WB; External air 35°C DB, 24°C WB. 100% recirculating air; calculated according to EN 14511/2018 |

(2)Conditions for calculation: Ambient air 20°C DB, 15°C WB; External air 7°C DB, 6°C WB. 100% recirculating air; calculated according to EN 14511/2018 |

(3)With 30% fresh air |

(4)Indoor temperature: 27°CDB, 19°CWB; Outdoor temperature: 29°CDB |

(5)Cooling seasonal performance factor for hot climates at T3 condition per ISO 16358-1:2013/AMD 1:2019 |

(6)RLA is based on following conditions: indoor temp. 29°CDB, 19°CWB; outdoor temp. 46°C |

(7)Sound power level in free field calculated according to standard ISO 3744. Values refer only to the base unit version

2 Specifications


1 - 1 UATYA-BFC3Y1

3 Features and advantages

3 - 1 Features and Advantages

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1


Made-To-Stock units (MTS)

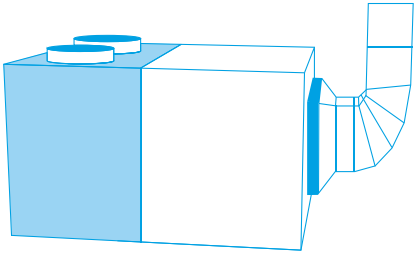

48 predefined units readily available from stock

- › Fast delivery
- › 3 versions: Base, 2 dampers and 3 dampers
 - › Thermodynamic heat recovery available on full FC3 range
- › Extended capacity up to 190 kW!
- › Comes with a wide range of standard integrated features

Made-To-Order units (MTO)

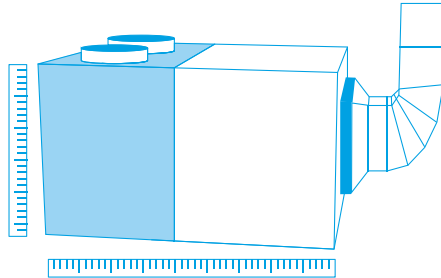

Fully customizable units for maximum flexibility

- › Almost infinite configuration possibilities thanks to wide choice of options
- › 4 versions: Base, 2 dampers, 3 dampers and 4 dampers
 - › Thermodynamic heat recovery available on full FC3 range
 - › Premium efficiency plate heat exchanger available on RS4 range
- › Extended capacity up to 190 kW!
- › Comes with a wide range of standard integrated features
- › Easy selection via selection software: rooftop.daikin.eu

ECPEN21-117

3 Features and advantages


3 - 1 Features and Advantages

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1

Standard integrated features on all Made-To-Stock and Made-To-Order units

1 R-32 refrigerant

- › Top sustainability thanks to the use of low GWP (675) refrigerant
- › Single component refrigerant, easy to re-use and recycle



2 Inverter driven compressors

- › Great year-round seasonal efficiency
- › Available up to 120 kW models

3 Increased capacity range up to 190 kW!

- › More flexibility to tackle larger projects with a small footprint



4 25 mm double skinned panels

- › Ensuring long-lasting life and providing good thermal and sound insulation

5 Full color touch display

- › Intuitive to use
- › Better visualisation of unit parameters



6 Integrated connectivity

- › Direct integration into Daikin intelligent Touch Manager BMS (via BACNET protocol)
- › Easy integration in 3rd party BMS systems via Ethernet port (BACnet TCP/IP & Modbus TCP/IP) or 3-cable port (Modbus over RS485)



7 Selection software

- › Easy selection of the correction unit and options based on location conditions
- › Direct availability of technical drawings

More standard integrated features

- › ISO Coarse 75% filter (G4) (standard for MTS only)
- › Standard clogged filter alarm
- › Flexible air delivery
- › Hydrophilic aluminum fins on indoor and outdoor unit side
- › Mesh coil guard on outdoor heat exchanger
- › Factory mounted drain pan with heater
- › Single operation voltage-free contact
- › Power supply connection safety through max/min voltage relay and reversed phase connection

ECPEN21-117

Options

Options

UATYA-BBAY1 UATYA-BFC2Y1 UATYA-BFC3Y1

	MTS - BASE series - UATYA-BBAY1					MTS - FC2 series - UATYA-BFC2Y1					MTS - FC3 series - UATYA-BFC3Y1				
	25-30	40-50	60-70	80-120	140-190	25-30	40	50	60-70	80-190	25-30	40-50	60-70	80-120	140-190
Air treatment	Filter ISO Coarse 75% (G4)	2x UATYAC7SA + 2x UATYAC7SB (Standard)	3x UATYAC7SA + 3x UATYAC7SB (Standard)	6x UATYAC7SB (Standard)	12x UATYAC7SC (Standard)	12x UATYAC7SC (Standard)	2x UATYAC7SA + 2x UATYAC7SB (Standard)	3x UATYAC7SA + 3x UATYAC7SB (Standard)	3x UATYAC7SA + 3x UATYAC7SB (Standard)	6x UATYAC7SB (Standard)	12x UATYAC7SC (Standard)	2x UATYAC7SA + 2x UATYAC7SB (Standard)	3x UATYAC7SA + 3x UATYAC7SB (Standard)	6x UATYAC7SB (Standard)	12x UATYAC7SC (Standard)
	Filter ISO ePM10 50% (M5/F5)	2x UATY-AEPM1050A + 2x UATYAEPM1050B	3x UATY-AEPM1050A + 3x UATYAEPM1050B	6x UATY-AEPM1050B	12x UATY-AEPM1050C	12x UATY-AEPM1050C	2x UATY-AEPM1050A + 2x UATYAEPM1050B	3x UATY-AEPM1050A + 3x UATYAEPM1050B	3x UATY-AEPM1050A + 3x UATYAEPM1050B	6x UATY-AEPM1050B	12x UATY-AEPM1050C	2x UATY-AEPM1050A + 2x UATYAEPM1050B	3x UATY-AEPM1050A + 3x UATYAEPM1050B	6x UATY-AEPM1050B	12x UATY-AEPM1050C
	Filter ISO ePM10 70% (M6)	2x UATY-AEPM1070A + 2x UATYAEPM1070B	3x UATY-AEPM1070A + 3x UATYAEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C	12x UATY-AEPM1070C	2x UATY-AEPM1070A + 2x UATYAEPM1070B	3x UATY-AEPM1070A + 3x UATYAEPM1070B	3x UATY-AEPM1070A + 3x UATYAEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C	2x UATY-AEPM1070A + 2x UATYAEPM1070B	3x UATY-AEPM1070A + 3x UATYAEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C
	Rigid bag filter ISO ePM1 50% (F7)	2x UATY-AEPM150A + 2x UATYAEPM150B	3x UATY-AEPM150A + 3x UATYAEPM150B	6x UATYAEPM150B	12x UATY-AEPM150C	12x UATY-AEPM150C	2x UATY-AEPM150A + 2x UATYAEPM150B	3x UATY-AEPM150A + 3x UATYAEPM150B	3x UATY-AEPM150A + 3x UATYAEPM150B	6x UATYAEPM150B	12x UATY-AEPM150C	2x UATY-AEPM150A + 2x UATYAEPM150B	3x UATY-AEPM150A + 3x UATYAEPM150B	6x UATYAEPM150B	12x UATY-AEPM150C
	Rigid bag filter ISO ePM1 85% (F9)	2x UATY-AEPM185A + 2x UATYAEPM185B	3x UATY-AEPM185A + 3x UATYAEPM185B	6x UATYAEPM185B	12x UATY-AEPM185C	12x UATY-AEPM185C	2x UATY-AEPM185A + 2x UATYAEPM185B	3x UATY-AEPM185A + 3x UATYAEPM185B	3x UATY-AEPM185A + 3x UATYAEPM185B	6x UATYAEPM185B	12x UATY-AEPM185C	2x UATY-AEPM185A + 2x UATYAEPM185B	3x UATY-AEPM185A + 3x UATYAEPM185B	6x UATYAEPM185B	12x UATY-AEPM185C
Control	UATYAC2P - Duct air quality CO2 probe	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYACAP - Constant air pressure control airflow transducer	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYAWRC - Remote touch screen wired remote controller	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYARRP - Room temperature return probe (incl. housing)	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYASA - Fire and smoke alarm	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Other	Rubber antivibration mounts	2x UATYAAM1	1x UATYAAM1 + 1x UATYAAM2	2x UATYAAM1 + 1x UATYAAM2	4x UATYAAM1	2x UATYAAM1 + 2x UATYAAM2	2x UATYAAM1	2x UATYAAM1	1x UATYAAM1 + 1x UATYAAM2	3x UATYAAM1 + 1x UATYAAM2	2x UATYAAM1 + 2x UATYAAM2	1x UATYAAM1 + 1x UATYAAM2	1x UATYAAM1 + 2x UATYAAM2	2x UATYAAM1 + 2x UATYAAM2	3x UATYAAM1 + 2x UATYAAM2
	Rainproof hood with anti-intrusion grille					UATYARPH1	UATYARPH2	UATYARPH2	UATYARPH3	UATYARPH4	2x UATYARPH1	2x UATYARPH2	2x UATYARPH3	2x UATYARPH4	2x UATYARPH4

ECPEN21-117

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA25BBAY1
UATYA25BFC2Y1
UATYA25BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			25			30			35			40		
[m³/h]	[°C]	[°C]	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
4500	24	17	26,3	18,7	7,3	25,8	18,5	7,8	25,1	18,4	8,4	24,3	17,9	9,0	23,5	17,6	9,6	
	25	18	27,1	18,6	7,3	26,5	18,4	7,8	25,9	18,3	8,4	25,0	17,8	9,0	24,2	17,5	9,7	
	26	18	27,2	20,2	7,3	26,5	19,9	7,8	25,8	19,6	8,4	25,1	18,8	9,1	24,4	18,6	9,7	
	27	19	28,1	20,0	7,4	27,3	19,6	7,9	26,6	19,5	8,5	25,8	19,3	9,1	25,0	19,0	9,8	
	28	20	28,9	19,7	7,5	28,2	19,6	8,0	27,4	19,1	8,6	26,6	19,1	9,2	25,8	18,8	9,9	
	30	22	30,6	19,2	7,6	29,9	18,9	8,1	29,2	18,9	8,8	28,3	18,4	9,4	27,4	18,3	10,0	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
4500	-15	-16	14,0	6,4	13,9	6,5	14,3	6,8	13,9	7,0	14,2	7,2	14,4	7,4	14,3	7,6	14,0	7,8
	-10	-11	16,1	6,6	16,5	6,9	16,2	7,1	16,6	7,4	16,7	7,6	16,7	7,8	17,1	8,1	16,9	8,3
	-7	-8	17,9	6,8	18,0	7,0	17,8	7,2	18,0	7,4	18,1	7,7	18,0	7,9	17,7	8,1	18,2	8,4
	-3	-4	20,0	6,7	19,9	7,0	19,9	7,2	20,1	7,4	19,9	7,6	20,1	7,8	20,3	8,1	20,1	8,3
	0	-1	21,7	6,7	21,7	6,9	21,4	7,1	21,8	7,3	21,5	7,5	21,5	7,7	21,3	8,0	21,7	8,2
	2	1	22,6	6,7	22,7	6,8	22,7	7,1	22,7	7,3	22,6	7,5	22,5	7,7	22,4	7,9	22,5	8,2
	7	6	25,8	6,8	25,7	7,0	25,5	7,2	25,4	7,4	25,4	7,6	25,3	7,9	25,3	8,1	25,1	8,3
	12	11	28,7	7,1	28,7	7,3	28,4	7,5	28,1	7,7	28,2	8,0	28,1	8,2	28,2	8,5	27,9	8,7

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
4500	-15	-16	12,7	6,4	12,6	6,5	13,0	6,8	12,7	7,0	12,9	7,2	13,1	7,4	13,0	7,6	12,8	7,8
	-10	-11	14,6	6,6	15,0	6,9	14,7	7,1	15,1	7,4	15,2	7,6	15,2	7,8	15,5	8,1	15,4	8,3
	-7	-8	16,3	6,8	16,4	7,0	16,2	7,2	16,3	7,4	16,5	7,7	16,4	7,9	16,1	8,1	16,5	8,4
	-3	-4	18,2	6,7	18,1	7,0	18,1	7,2	18,3	7,4	18,1	7,6	18,3	7,8	18,4	8,1	18,3	8,3
	0	-1	19,8	6,7	19,8	6,9	19,5	7,1	19,8	7,3	19,6	7,5	19,6	7,7	19,4	8,0	19,7	8,2
	2	1	20,6	6,7	20,6	6,8	20,6	7,1	20,6	7,3	20,5	7,5	20,5	7,7	20,4	7,9	20,4	8,2
	7	6	25,8	6,8	25,7	7,0	25,5	7,2	25,4	7,4	25,4	7,6	25,3	7,9	25,3	8,1	25,1	8,3
	12	11	28,7	7,1	28,7	7,3	28,4	7,5	28,1	7,7	28,2	8,0	28,1	8,2	28,2	8,5	27,9	8,7

Data calculated in accordance with EN 14511

UATYA25BBAY1
UATYA25BFC2Y1
UATYA25BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA30BBAY1
UATYA30BFC2Y1
UATYA30BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			30			30			35			40		
(m³/h)	(°C)	(°C)	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
5800	24	17	33,9	23,7	8,4	33,2	23,5	9,1	32,3	23,1	9,8	31,4	22,9	10,6	30,4	21,8	11,6	
	30	18	35,0	23,4	8,5	34,3	23,2	9,1	33,4	22,8	9,9	32,4	22,6	10,7	31,3	22,2	11,6	
	26	18	35,1	25,7	8,5	34,3	24,7	9,2	33,4	25,1	9,9	32,3	24,5	10,7	31,5	23,9	11,7	
	27	19	36,2	25,1	8,6	35,5	25,1	9,2	34,4	24,6	10,0	33,5	24,6	10,8	32,3	24,0	11,7	
	28	20	37,3	25,0	8,7	36,5	24,4	9,3	35,5	24,4	10,1	34,5	24,0	10,9	33,4	23,6	11,8	
	30	22	39,8	24,2	8,8	38,9	23,8	9,4	37,8	23,8	10,2	36,8	23,6	11,1	35,4	23,0	12,0	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
5800	-15	-16	17,2	7,6	17,4	7,9	17,2	8,1	17,5	8,4	17,4	8,7	17,9	9,0	18,0	9,3	18,0	9,7
	-10	-11	20,2	8,0	19,7	8,2	19,8	8,5	20,4	8,8	20,4	9,2	20,9	9,5	21,1	9,9	21,0	10,3
	-7	-8	22,0	8,0	22,2	8,3	22,3	8,6	22,2	8,9	22,2	9,3	22,0	9,6	22,6	10,0	21,9	10,3
	-3	-4	24,3	8,0	24,4	8,2	24,6	8,6	24,6	8,8	24,7	9,2	24,6	9,6	24,8	9,9	24,7	10,3
	0	-1	26,5	7,8	26,4	8,1	26,5	8,4	26,2	8,8	26,7	9,0	26,6	9,4	26,6	9,8	26,5	10,1
	2	1	28,2	7,7	27,8	8,0	27,8	8,3	27,8	8,6	27,8	8,9	27,9	9,2	28,0	9,6	27,8	10,0
	7	6	31,4	7,8	31,2	8,1	31,2	8,4	31,2	8,7	31,2	9,0	31,2	9,4	31,0	9,7	31,2	10,2
	12	11	34,7	8,0	34,6	8,4	34,5	8,7	34,4	9,0	34,3	9,4	34,2	9,7	34,2	10,1	34,2	10,5

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
5800	-15	-16	15,7	7,6	15,9	7,9	15,7	8,1	15,9	8,4	15,8	8,7	16,2	9,0	16,3	9,3	16,4	9,7
	-10	-11	18,4	8,0	17,9	8,2	18,0	8,5	18,6	8,8	18,6	9,2	19,0	9,5	19,2	9,9	19,1	10,3
	-7	-8	20,0	8,0	20,2	8,3	20,3	8,6	20,2	8,9	20,2	9,3	20,0	9,6	20,6	10,0	20,0	10,3
	-3	-4	22,1	8,0	22,2	8,2	22,4	8,6	22,4	8,8	22,4	9,2	22,4	9,6	22,5	9,9	22,4	10,3
	0	-1	24,1	7,8	24,0	8,1	24,1	8,4	23,8	8,8	24,3	9,0	24,2	9,4	24,2	9,8	24,1	10,1
	2	1	25,7	7,7	25,2	8,0	25,2	8,3	25,3	8,6	25,3	8,9	25,3	9,2	25,5	9,6	25,3	10,0
	7	6	31,4	7,8	31,2	8,1	31,2	8,4	31,2	8,7	31,2	9,0	31,2	9,4	31,0	9,7	31,2	10,2
	12	11	34,7	8,0	34,6	8,4	34,5	8,7	34,4	9,0	34,3	9,4	34,2	9,7	34,2	10,1	34,2	10,5

Data calculated in accordance with EN 14511

UATYA30BBAY1
UATYA30BFC2Y1
UATYA30BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA40BBAY1
UATYA40BFC2Y1
UATYA40BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																					
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil																	
	TDB	TWB		20			40			30			35			40			40		
	[m³/h]	[°C]	[°C]	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI			
7500	24	17		39,2	27,6	10,1	38,4	27,1	10,8	37,4	26,8	11,6	36,5	26,5	12,4	35,2	26,0	13,4			
	40	18		40,5	27,1	10,2	39,7	26,9	10,9	38,7	26,6	11,7	37,6	26,1	12,6	36,4	25,9	13,5			
	26	18		40,4	29,3	10,2	39,6	29,3	10,9	39,0	28,8	11,7	37,6	28,0	12,6	36,4	27,2	13,6			
	27	19		41,7	29,1	10,3	40,9	28,9	11,0	39,8	28,6	11,8	38,8	28,4	12,7	37,4	27,8	13,7			
	28	20		43,1	28,7	10,3	42,2	28,4	11,1	41,2	28,2	11,9	40,1	27,9	12,8	38,8	27,7	13,8			
	30	22		45,8	28,1	10,6	44,8	27,6	11,3	44,0	27,6	12,1	42,5	26,8	13,0	41,1	26,8	14,0			

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
7500	-15	-16	19,8	8,7	20,0	9,1	19,8	9,3	20,3	9,7	20,1	9,9	20,7	10,4	20,5	10,7	20,9	11,1
	-10	-11	23,2	9,2	23,2	9,5	23,3	9,9	23,8	10,2	24,0	10,7	24,0	11,0	24,2	11,4	24,5	11,8
	-7	-8	25,5	9,3	25,1	9,6	25,2	10,0	25,7	10,3	25,4	10,7	25,8	11,1	25,8	11,5	26,0	11,9
	-3	-4	28,9	9,4	28,7	9,7	28,8	10,0	28,9	10,3	28,9	10,7	28,5	11,2	28,5	11,6	28,9	11,9
	0	-1	31,0	9,3	30,6	9,7	31,3	9,9	31,3	10,2	31,2	10,7	31,1	11,0	31,1	11,4	30,9	11,8
	2	1	32,8	9,2	32,6	9,5	32,6	9,9	32,5	10,2	32,4	10,5	32,5	11,0	32,4	11,3	32,4	11,7
	7	6	36,9	9,4	36,7	9,7	36,7	10,0	36,5	10,4	36,5	10,8	36,3	11,1	36,2	11,6	36,2	12,0
	12	11	40,5	9,8	40,3	10,1	40,2	10,5	40,0	10,8	39,8	11,2	39,7	11,6	39,5	12,0	39,4	12,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
7500	-15	-16	18,0	8,7	18,2	9,1	18,0	9,3	18,4	9,7	18,2	9,9	18,8	10,4	18,7	10,7	19,0	11,1
	-10	-11	21,1	9,2	21,1	9,5	21,2	9,9	21,7	10,2	21,8	10,7	21,9	11,0	22,0	11,4	22,3	11,8
	-7	-8	23,2	9,3	22,8	9,6	22,9	10,0	23,3	10,3	23,1	10,7	23,5	11,1	23,5	11,5	23,6	11,9
	-3	-4	26,3	9,4	26,1	9,7	26,2	10,0	26,3	10,3	26,2	10,7	25,9	11,2	26,0	11,6	26,3	11,9
	0	-1	28,2	9,3	27,8	9,7	28,5	9,9	28,5	10,2	28,3	10,7	28,3	11,0	28,3	11,4	28,1	11,8
	2	1	29,8	9,2	29,7	9,5	29,6	9,9	29,5	10,2	29,5	10,5	29,6	11,0	29,4	11,3	29,4	11,7
	7	6	36,9	9,4	36,7	9,7	36,7	10,0	36,5	10,4	36,5	10,8	36,3	11,1	36,2	11,6	36,2	12,0
	12	11	40,5	9,8	40,3	10,1	40,2	10,5	40,0	10,8	39,8	11,2	39,7	11,6	39,5	12,0	39,4	12,4

Data calculated in accordance with EN 14511

UATYA40BBAY1
UATYA40BFC2Y1
UATYA40BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA50BBAY1
UATYA50BFC2Y1
UATYA50BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																	
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil														
	T DB [°C]	TWB [°C]	20			40			30			35			40		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
9000	24	17	46,3	31,9	12,2	45,2	31,5	13,1	44,2	31,2	14,1	43,0	30,6	15,2	42,1	30,9	16,4
	40	18	47,7	31,3	12,4	46,7	30,7	13,2	45,8	30,7	14,2	44,3	29,8	15,3	43,8	31,0	16,5
	26	18	47,8	34,6	12,4	46,6	33,6	13,2	45,6	33,6	14,2	44,4	33,0	15,3	43,3	33,0	16,5
	27	19	49,1	33,4	12,5	48,1	33,4	13,4	47,0	32,8	14,3	45,7	32,5	15,4	44,4	32,5	16,7
	28	20	50,5	32,6	12,6	49,6	32,6	13,5	48,4	32,0	14,5	47,1	32,0	15,6	45,8	32,0	16,8
	30	22	53,6	32,5	12,8	52,5	32,5	13,7	51,3	31,9	14,7	49,9	31,2	15,8	48,1	30,3	17,1

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
9000	-15	-16	24,9	10,5	25,3	11,0	25,4	11,4	25,5	11,7	25,6	12,1	25,8	12,6	25,8	13,0	26,2	13,6
	-10	-11	30,0	11,5	29,8	11,9	29,9	12,3	30,2	12,8	30,4	13,3	30,8	13,9	31,1	14,5	31,6	15,0
	-7	-8	32,6	11,5	32,6	12,1	32,8	12,5	32,6	13,1	32,9	13,6	33,2	14,1	33,0	14,6	33,8	15,2
	-3	-4	36,6	11,7	36,4	12,1	36,3	12,6	36,8	13,2	36,3	13,6	36,6	14,1	37,1	14,6	37,3	15,2
	0	-1	39,5	11,7	39,5	12,1	39,5	12,6	39,5	13,1	39,6	13,6	39,7	14,0	39,7	14,6	39,8	15,2
	2	1	41,3	11,6	41,3	12,1	41,3	12,5	41,4	13,0	41,3	13,5	41,4	14,0	41,5	14,5	41,5	15,0
	7	6	46,4	11,7	46,3	12,2	46,3	12,7	46,3	13,2	46,2	13,7	46,2	14,2	45,7	14,7	45,9	15,3
	12	11	50,4	12,2	50,4	12,7	50,1	13,2	50,0	13,7	50,0	14,2	49,9	14,8	49,8	15,3	49,5	15,8

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
9000	-15	-16	22,7	10,5	23,0	11,0	23,1	11,4	23,2	11,7	23,3	12,1	23,5	12,6	23,5	13,0	23,8	13,6
	-10	-11	27,3	11,5	27,1	11,9	27,2	12,3	27,4	12,8	27,6	13,3	28,0	13,9	28,3	14,5	28,7	15,0
	-7	-8	29,6	11,5	29,7	12,1	29,9	12,5	29,6	13,1	30,0	13,6	30,1	14,1	30,0	14,6	30,7	15,2
	-3	-4	33,3	11,7	33,1	12,1	33,0	12,6	33,4	13,2	33,0	13,6	33,2	14,1	33,7	14,6	33,9	15,2
	0	-1	35,9	11,7	35,9	12,1	35,9	12,6	36,0	13,1	36,0	13,6	36,1	14,0	36,1	14,6	36,2	15,2
	2	1	37,5	11,6	37,6	12,1	37,6	12,5	37,6	13,0	37,6	13,5	37,6	14,0	37,7	14,5	37,7	15,0
	7	6	46,4	11,7	46,3	12,2	46,3	12,7	46,3	13,2	46,2	13,7	46,2	14,2	45,7	14,7	45,9	15,3
	12	11	50,4	12,2	50,4	12,7	50,1	13,2	50,0	13,7	50,0	14,2	49,9	14,8	49,8	15,3	49,5	15,8

Data calculated in accordance with EN 14511

UATYA50BBAY1
UATYA50BFC2Y1
UATYA50BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA60BBAY1
UATYA60BFC2Y1
UATYA60BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																	
Air Flow (m³/h)	Air Condition on Supply Coil		Air conditions on External Coil														
	T DB [°C]	TWB [°C]	20			40			30			35			40		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
11000	24	17	59,9	40,9	14,8	58,7	40,1	15,9	56,9	39,4	17,1	55,2	39,0	18,5	53,6	38,6	20,1
	40	18	62,0	41,0	15,0	60,4	39,9	16,0	58,7	39,1	17,3	56,9	38,8	18,7	54,9	37,6	20,2
	26	18	61,8	43,8	14,9	60,3	43,0	16,0	58,8	42,7	17,2	56,8	41,9	18,7	55,0	41,2	20,2
	27	19	63,8	43,2	15,1	62,4	42,4	16,2	60,6	42,1	17,4	58,8	41,3	18,8	56,8	40,9	20,4
	28	20	66,0	43,0	15,2	64,5	42,2	16,3	62,7	41,4	17,5	60,8	41,1	19,0	58,5	40,3	20,5
	30	22	70,3	42,5	15,5	68,6	42,1	16,7	66,5	41,3	17,9	64,4	40,6	19,3	62,3	39,8	20,9

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
11000	-15	-16	30,3	13,7	29,6	13,9	30,2	14,5	30,4	15,0	30,6	15,5	31,0	16,0	31,1	16,6	31,6	17,1
	-10	-11	35,3	14,2	35,8	14,8	34,7	15,2	35,5	15,8	36,3	16,4	36,5	17,0	36,6	17,4	37,1	18,1
	-7	-8	38,5	14,4	38,7	14,9	38,2	15,4	38,8	15,9	39,2	16,5	38,3	17,0	38,6	17,5	38,9	18,1
	-3	-4	43,2	14,4	43,4	14,9	43,5	15,4	43,6	15,8	43,1	16,4	43,8	16,9	43,7	17,5	43,6	18,0
	0	-1	47,4	14,2	47,0	14,6	46,6	15,1	47,1	15,6	46,1	16,2	46,9	16,7	46,6	17,2	46,8	17,8
	2	1	49,4	14,1	49,3	14,5	49,5	14,9	48,6	15,5	48,9	16,0	48,9	16,5	48,8	17,1	49,0	17,6
	7	6	56,1	14,4	55,6	14,8	55,6	15,3	55,3	15,8	55,2	16,4	55,0	16,9	54,8	17,5	54,7	18,0
	12	11	61,8	14,9	61,5	15,4	61,3	16,0	61,1	16,5	60,5	17,0	60,3	17,6	60,1	18,2	60,0	18,8

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
11000	-15	-16	27,5	13,7	26,9	13,9	27,5	14,5	27,6	15,0	27,8	15,5	28,2	16,0	28,3	16,6	28,7	17,1
	-10	-11	32,1	14,2	32,5	14,8	31,5	15,2	32,3	15,8	33,0	16,4	33,2	17,0	33,3	17,4	33,7	18,1
	-7	-8	35,0	14,4	35,2	14,9	34,7	15,4	35,3	15,9	35,6	16,5	34,8	17,0	35,1	17,5	35,4	18,1
	-3	-4	39,3	14,4	39,5	14,9	39,6	15,4	39,6	15,8	39,2	16,4	39,8	16,9	39,8	17,5	39,6	18,0
	0	-1	43,1	14,2	42,8	14,6	42,4	15,1	42,8	15,6	41,9	16,2	42,6	16,7	42,3	17,2	42,6	17,8
	2	1	45,0	14,1	44,9	14,5	45,0	14,9	44,2	15,5	44,4	16,0	44,4	16,5	44,4	17,1	44,6	17,6
	7	6	56,1	14,4	55,6	14,8	55,6	15,3	55,3	15,8	55,2	16,4	55,0	16,9	54,8	17,5	54,7	18,0
	12	11	61,8	14,9	61,5	15,4	61,3	16,0	61,1	16,5	60,5	17,0	60,3	17,6	60,1	18,2	60,0	18,8

Data calculated in accordance with EN 14511

UATYA60BBAY1
UATYA60BFC2Y1
UATYA60BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA70BBAY1
UATYA70BFC2Y1
UATYA70BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil		Air conditions on External Coil															
	T DB	TWB	20			40			30			35			40			
(m³/h)	(°C)	(°C)	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
13000	24	17	66,6	45,1	17,6	65,2	44,2	18,9	63,4	43,8	20,3	61,3	43,4	22,0	59,2	42,0	23,8	
	40	18	68,7	45,3	17,8	67,3	44,4	19,0	65,2	43,1	20,5	63,2	42,6	22,2	61,1	41,7	24,0	
	26	18	68,6	48,1	17,8	67,2	47,7	19,0	65,4	47,2	20,5	63,3	46,8	22,2	61,1	46,3	24,0	
	27	19	70,9	47,8	18,0	69,3	47,4	19,2	67,7	46,9	20,7	65,4	46,0	22,4	63,0	45,6	24,2	
	28	20	73,1	47,5	18,2	71,5	46,6	19,4	69,7	45,7	20,9	67,6	45,3	22,6	64,9	44,4	24,4	
	30	22	77,9	46,9	18,5	76,0	46,0	19,8	73,7	45,6	21,3	71,5	44,2	22,9	69,2	44,2	24,8	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
13000	-15	-16	36,3	16,2	36,3	16,7	36,0	17,1	36,4	17,8	36,1	18,4	35,7	18,9	36,4	19,3	36,5	19,9
	-10	-11	42,3	16,8	43,4	17,4	43,5	18,0	42,6	18,6	41,5	19,1	42,2	19,8	43,6	20,6	42,1	21,2
	-7	-8	47,2	17,0	45,1	17,5	46,4	18,1	45,0	18,7	46,0	19,4	46,8	20,1	45,1	20,6	46,5	21,4
	-3	-4	50,0	17,1	51,9	17,6	50,4	18,3	50,4	18,8	50,4	19,5	50,4	20,2	52,3	20,9	50,5	21,6
	0	-1	55,2	16,9	55,2	17,4	54,9	18,0	54,2	18,7	54,7	19,3	55,1	19,9	54,5	20,6	54,9	21,2
	2	1	58,4	16,8	58,8	17,3	58,3	17,9	58,3	18,5	59,1	19,2	58,1	19,8	58,3	20,5	57,9	21,1
	7	6	65,8	17,0	65,7	17,6	65,5	18,2	65,3	18,9	65,1	19,5	64,6	20,1	65,0	20,9	64,3	21,5
	12	11	72,4	17,7	72,1	18,3	72,1	19,0	71,8	19,7	71,5	20,3	71,2	21,0	71,0	21,7	70,8	22,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
13000	-15	-16	33,0	16,2	33,0	16,7	32,7	17,1	33,1	17,8	32,8	18,4	32,5	18,9	33,1	19,3	33,2	19,9
	-10	-11	38,4	16,8	39,4	17,4	39,5	18,0	38,7	18,6	37,8	19,1	38,3	19,8	39,7	20,6	38,3	21,2
	-7	-8	43,0	17,0	41,0	17,5	42,2	18,1	41,0	18,7	41,9	19,4	42,6	20,1	41,0	20,6	42,2	21,4
	-3	-4	45,5	17,1	47,2	17,6	45,8	18,3	45,8	18,8	45,8	19,5	45,8	20,2	47,5	20,9	45,9	21,6
	0	-1	50,2	16,9	50,2	17,4	49,9	18,0	49,2	18,7	49,7	19,3	50,1	19,9	49,6	20,6	49,9	21,2
	2	1	53,1	16,8	53,4	17,3	53,0	17,9	53,0	18,5	53,8	19,2	52,8	19,8	53,0	20,5	52,6	21,1
	7	6	65,8	17,0	65,7	17,6	65,5	18,2	65,3	18,9	65,1	19,5	64,6	20,1	65,0	20,9	64,3	21,5
	12	11	72,4	17,7	72,1	18,3	72,1	19,0	71,8	19,7	71,5	20,3	71,2	21,0	71,0	21,7	70,8	22,4

Data calculated in accordance with EN 14511

UATYA70BBAY1
UATYA70BFC2Y1
UATYA70BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA80BBAY1
UATYA80BFC2Y1
UATYA80BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			40			30			35			40		
[m³/h]	[°C]	[°C]		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14500	24	17		76,0	55,3	19,3	74,4	54,8	20,6	72,7	54,3	22,1	70,3	53,3	23,8	67,8	52,8	25,7
	40	18		78,5	54,5	19,5	77,7	55,5	21,0	74,9	53,5	22,3	72,7	53,0	24,0	70,1	52,0	26,0
	26	18		78,3	59,7	19,5	76,6	58,7	20,8	74,6	58,2	22,3	73,0	57,2	24,0	70,4	56,2	26,0
	27	19		81,0	59,4	19,7	79,4	59,4	21,0	77,2	57,9	22,5	74,6	56,9	24,2	72,1	56,4	26,2
	28	20		83,5	58,6	19,9	81,7	57,6	21,2	79,7	57,6	22,7	77,6	57,6	24,5	74,6	56,1	26,4
	30	22		89,1	56,9	20,4	86,9	56,4	21,7	84,9	56,4	23,1	82,2	55,4	24,9	79,4	54,9	26,9

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
14500	-15	-16	38,2	17,4	36,8	17,7	37,4	18,3	38,4	19,1	38,3	19,7	38,4	20,3	38,7	21,2	38,0	21,7
	-10	-11	43,8	17,8	43,7	18,3	44,3	18,9	45,0	19,5	43,5	20,2	44,1	20,8	44,1	21,5	44,2	22,3
	-7	-8	48,0	17,8	47,7	18,4	48,3	19,0	47,6	19,6	48,1	20,2	47,4	20,8	47,8	21,6	47,7	22,3
	-3	-4	54,1	17,9	55,4	18,3	53,1	19,0	53,6	19,6	53,9	20,2	54,1	20,9	53,6	21,6	53,4	22,3
	0	-1	59,4	17,6	59,4	18,1	58,9	18,7	58,6	19,3	58,2	19,9	58,7	20,4	58,8	21,1	58,7	21,8
	2	1	61,2	17,4	61,1	18,0	60,9	18,5	60,7	19,1	60,3	19,7	60,6	20,4	61,5	20,9	61,4	21,6
	7	6	70,0	17,3	69,0	17,9	69,4	18,5	69,2	19,1	68,9	19,7	68,5	20,3	68,6	21,1	67,8	21,7
	12	11	75,9	17,7	75,6	18,3	75,2	18,9	75,0	19,5	74,7	20,2	74,4	20,8	74,2	21,5	73,8	22,2

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
14500	-15	-16	34,8	17,4	33,5	17,7	34,0	18,3	34,9	19,1	34,9	19,7	34,9	20,3	35,2	21,2	34,5	21,7
	-10	-11	39,8	17,8	39,7	18,3	40,2	18,9	40,9	19,5	39,6	20,2	40,1	20,8	40,1	21,5	40,2	22,3
	-7	-8	43,6	17,8	43,4	18,4	43,9	19,0	43,2	19,6	43,7	20,2	43,1	20,8	43,4	21,6	43,4	22,3
	-3	-4	49,1	17,9	50,4	18,3	48,3	19,0	48,7	19,6	49,0	20,2	49,2	20,9	48,7	21,6	48,6	22,3
	0	-1	54,0	17,6	54,0	18,1	53,5	18,7	53,3	19,3	52,9	19,9	53,3	20,4	53,5	21,1	53,4	21,8
	2	1	55,7	17,4	55,6	18,0	55,4	18,5	55,2	19,1	54,8	19,7	55,1	20,4	55,9	20,9	55,8	21,6
	7	6	70,0	17,3	69,0	17,9	69,4	18,5	69,2	19,1	68,9	19,7	68,5	20,3	68,6	21,1	67,8	21,7
	12	11	75,9	17,7	75,6	18,3	75,2	18,9	75,0	19,5	74,7	20,2	74,4	20,8	74,2	21,5	73,8	22,2

Data calculated in accordance with EN 14511

UATYA80BBAY1
UATYA80BFC2Y1
UATYA80BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA90BBAY1
UATYA90BFC2Y1
UATYA90BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow (m³/h)	Air Condition on Supply Coil		Air conditions on External Coil															
	T DB	TWB	20			40			30			35			40			
	°C	°C	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
16500	24	17	90,9	61,8	23,2	89,1	60,7	24,9	87,0	59,5	26,7	84,2	59,0	28,9	81,4	57,8	31,3	
	40	18	93,8	62,0	23,4	91,8	60,9	25,1	89,8	59,7	27,0	86,8	58,6	29,1	84,0	57,5	31,5	
	26	18	93,7	66,2	23,4	91,9	65,1	25,1	89,7	65,1	26,9	87,1	63,9	29,1	84,1	63,4	31,6	
	27	19	96,9	65,3	23,6	94,8	64,2	25,3	92,5	64,2	27,2	89,8	63,0	29,4	86,8	61,9	31,8	
	28	20	100,1	65,5	23,8	98,3	64,9	25,6	95,5	63,2	27,4	92,7	62,6	29,6	89,3	60,9	32,0	
	30	22	106,3	64,2	24,2	104,0	63,1	25,9	101,4	61,9	27,9	98,1	61,3	30,1	95,0	60,8	32,6	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
16500	-15	-16	46,1	20,6	46,2	21,3	46,4	22,0	47,0	22,7	47,0	23,8	47,5	24,7	47,7	25,6	47,5	26,6
	-10	-11	55,5	21,8	55,7	22,6	55,8	23,5	56,4	24,5	56,0	25,3	56,7	26,3	56,7	27,3	56,9	28,3
	-7	-8	59,3	21,9	59,9	22,8	60,0	23,7	61,2	24,6	59,9	25,4	59,3	26,2	60,7	27,3	60,7	28,3
	-3	-4	67,0	22,2	67,0	23,1	66,9	23,9	66,0	24,7	68,0	25,6	68,4	26,6	68,2	27,5	67,6	28,5
	0	-1	72,9	21,9	71,4	22,7	69,8	23,6	72,4	24,4	72,4	25,2	70,8	26,2	70,6	27,1	72,5	28,1
	2	1	75,7	21,7	75,6	22,5	75,9	23,4	76,2	24,2	75,8	25,2	75,0	25,9	75,7	26,8	75,6	27,7
	7	6	85,6	22,0	85,3	22,6	84,1	23,4	83,8	24,2	83,6	25,1	84,2	26,1	83,7	27,0	83,0	27,9
	12	11	91,4	22,4	91,5	23,0	92,0	24,2	90,2	25,1	90,7	26,0	90,8	26,9	90,7	27,8	90,1	29,0

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
16500	-15	-16	41,9	20,6	42,0	21,3	42,2	22,0	42,7	22,7	42,8	23,8	43,2	24,7	43,4	25,6	43,2	26,6
	-10	-11	50,5	21,8	50,6	22,6	50,8	23,5	51,2	24,5	50,9	25,3	51,5	26,3	51,6	27,3	51,8	28,3
	-7	-8	53,9	21,9	54,4	22,8	54,6	23,7	55,7	24,6	54,5	25,4	53,9	26,2	55,2	27,3	55,2	28,3
	-3	-4	60,9	22,2	60,9	23,1	60,8	23,9	60,0	24,7	61,8	25,6	62,2	26,6	62,0	27,5	61,4	28,5
	0	-1	66,3	21,9	64,9	22,7	63,5	23,6	65,8	24,4	65,8	25,2	64,4	26,2	64,1	27,1	65,9	28,1
	2	1	68,8	21,7	68,7	22,5	69,0	23,4	69,3	24,2	68,9	25,2	69,1	25,9	68,8	26,8	68,8	27,7
	7	6	85,6	22,0	85,3	22,6	84,1	23,4	83,8	24,2	83,6	25,1	84,2	26,1	83,7	27,0	83,0	27,9
	12	11	91,4	22,4	91,5	23,0	92,0	24,2	90,2	25,1	90,7	26,0	90,8	26,9	90,7	27,8	90,1	29,0

Data calculated in accordance with EN 14511

UATYA90BBAY1
UATYA90BFC2Y1
UATYA90BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{exhaust} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA100BBAY1
UATYA100BFC2Y1
UATYA100BFC3Y1

5

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil															
	T DB	TWB	20			40			30			35			40			
	[°C]	[°C]	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
18000	24	17	96,6	65,3	26,0	94,7	64,7	27,7	93,0	64,1	29,5	90,6	63,5	31,7	87,1	61,6	34,3	
	40	18	99,8	64,9	26,2	97,7	64,3	27,9	95,5	63,1	29,9	92,5	61,8	32,0	89,8	61,2	34,4	
	26	18	99,9	70,1	26,2	98,0	69,5	27,8	96,3	70,1	29,8	93,5	68,2	32,2	90,3	68,2	34,6	
	27	19	102,9	69,1	26,5	100,9	67,8	28,2	98,6	67,8	30,1	96,0	67,2	32,3	92,7	66,0	34,8	
	28	20	106,2	69,3	26,7	104,1	68,1	28,4	101,6	66,8	30,4	98,9	66,2	32,6	95,4	64,3	35,1	
	30	22	113,2	66,6	27,2	110,7	66,6	28,9	108,0	65,4	30,9	105,0	64,1	33,2	101,1	63,5	35,8	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
18000	-15	-16	49,1	29,6	49,0	30,6	49,0	31,7	49,4	32,9	49,4	33,9	49,6	35,2	50,1	36,5	50,1	37,8
	-10	-11	58,4	29,4	59,3	30,4	58,7	31,6	59,7	32,6	59,4	33,7	60,2	35,0	60,3	36,3	60,3	37,6
	-7	-8	65,8	28,4	65,7	29,5	64,6	30,6	65,8	31,7	65,8	32,7	66,1	34,0	65,1	35,0	66,6	36,5
	-3	-4	73,4	27,0	73,1	27,9	73,6	28,9	73,8	29,9	73,6	30,9	72,8	31,9	74,0	33,1	74,5	34,2
	0	-1	81,2	25,4	80,9	26,4	80,8	27,2	80,6	28,2	80,7	29,1	80,7	30,1	80,7	31,1	80,6	32,4
	2	1	85,5	24,4	85,3	25,3	85,3	26,1	84,9	27,1	84,8	28,0	84,8	28,9	84,8	29,8	84,8	30,9
	7	6	95,7	24,7	95,4	25,6	95,1	26,4	94,8	27,4	94,6	28,3	92,8	28,9	94,0	30,2	91,9	30,9
	12	11	102,4	25,4	102,4	26,4	102,0	27,2	101,7	28,2	101,2	29,1	101,0	30,1	100,7	31,1	100,4	32,1

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
18000	-15	-16	44,6	29,6	44,5	30,6	44,5	31,7	44,9	32,9	44,9	33,9	45,1	35,2	45,5	36,5	45,6	37,8
	-10	-11	53,1	29,4	53,9	30,4	53,3	31,6	54,2	32,6	54,0	33,7	54,7	35,0	54,8	36,3	54,8	37,6
	-7	-8	59,8	28,4	59,7	29,5	58,8	30,6	59,8	31,7	59,8	32,7	60,1	34,0	59,2	35,0	60,6	36,5
	-3	-4	66,7	27,0	66,5	27,9	66,9	28,9	67,1	29,9	66,9	30,9	66,2	31,9	67,3	33,1	67,7	34,2
	0	-1	73,8	25,4	73,5	26,4	73,5	27,2	73,3	28,2	73,3	29,1	73,3	30,1	73,4	31,1	73,3	32,4
	2	1	77,7	24,4	77,6	25,3	77,6	26,1	77,2	27,1	77,1	28,0	77,1	28,9	77,1	29,8	77,1	30,9
	7	6	95,7	24,7	95,4	25,6	95,1	26,4	94,8	27,4	94,6	28,3	92,8	28,9	94,0	30,2	91,9	30,9
	12	11	102,4	25,4	102,4	26,4	102,0	27,2	101,7	28,2	101,2	29,1	101,0	30,1	100,7	31,1	100,4	32,1

Data calculated in accordance with EN 14511

UATYA100BBAY1
UATYA100BFC2Y1
UATYA100BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA110BBAY1
UATYA110BFC2Y1
UATYA110BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			40			30			35			40		
(m³/h)	(°C)	(°C)	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
19800	24	17	110,6	76,7	29,4	108,6	76,7	31,2	105,8	75,3	33,2	102,6	74,7	35,7	99,7	74,7	38,6	
	40	18	114,2	76,9	29,8	111,6	74,9	31,6	109,1	74,9	33,6	106,0	74,2	36,1	102,2	72,9	38,9	
	26	18	113,9	82,6	29,7	112,6	84,0	31,7	109,7	83,3	33,9	105,6	80,6	36,1	102,8	81,3	39,0	
	27	19	117,6	82,2	30,1	115,2	81,5	31,8	112,1	80,9	34,0	108,9	80,2	36,4	105,3	78,8	39,3	
	28	20	121,3	81,1	30,4	118,9	80,5	32,2	115,7	79,8	34,4	112,4	79,1	36,8	108,2	77,7	39,8	
	30	22	129,6	80,3	31,0	126,7	78,9	32,9	123,2	77,6	35,1	119,5	76,2	37,6	115,1	76,2	40,6	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
19800	-15	-16	55,1	24,1	56,0	25,0	56,0	25,3	56,4	26,7	55,8	27,3	56,9	28,4	57,3	29,5	57,3	30,5
	-10	-11	65,2	25,2	65,2	26,0	65,4	26,9	65,2	27,9	64,9	28,8	65,2	29,8	65,2	30,7	66,8	32,0
	-7	-8	72,2	25,7	72,8	26,5	71,8	27,4	71,3	28,3	73,1	29,4	73,4	30,4	72,5	31,4	74,0	32,6
	-3	-4	77,9	25,9	81,7	26,8	81,4	27,7	80,8	28,5	81,2	29,6	81,1	30,6	81,3	31,7	81,3	32,7
	0	-1	87,6	25,7	87,5	26,6	87,4	27,6	87,3	28,3	85,1	29,3	87,1	30,3	87,0	31,4	84,7	32,5
	2	1	89,0	26,1	91,7	26,4	91,6	27,3	91,3	28,2	91,3	29,2	91,1	30,1	91,0	31,2	90,9	32,2
	7	6	103,1	25,6	102,7	26,5	102,4	27,4	102,1	28,3	101,8	29,2	101,5	30,3	101,3	31,4	101,1	32,5
	12	11	111,1	26,4	110,0	27,3	109,6	28,2	109,4	29,1	109,5	30,1	108,5	31,2	108,3	32,3	107,8	33,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
19800	-15	-16	50,1	24,1	50,9	25,0	50,9	25,3	51,3	26,7	50,7	27,3	51,7	28,4	52,1	29,5	52,1	30,5
	-10	-11	59,3	25,2	59,3	26,0	59,5	26,9	59,2	27,9	59,0	28,8	59,2	29,8	59,3	30,7	60,7	32,0
	-7	-8	65,6	25,7	66,1	26,5	65,3	27,4	64,8	28,3	66,5	29,4	66,7	30,4	65,9	31,4	67,3	32,6
	-3	-4	70,8	25,9	74,3	26,8	74,0	27,7	73,4	28,5	73,8	29,6	73,7	30,6	73,9	31,7	73,9	32,7
	0	-1	79,6	25,7	79,5	26,6	79,4	27,6	79,3	28,3	77,4	29,3	79,2	30,3	79,1	31,4	77,0	32,5
	2	1	80,9	26,1	83,3	26,4	83,3	27,3	83,0	28,2	83,0	29,2	82,8	30,1	82,7	31,2	82,7	32,2
	7	6	103,1	25,6	102,7	26,5	102,4	27,4	102,1	28,3	101,8	29,2	101,5	30,3	101,3	31,4	101,1	32,5
	12	11	111,1	26,4	110,0	27,3	109,6	28,2	109,4	29,1	109,5	30,1	108,5	31,2	108,3	32,3	107,8	33,4

Data calculated in accordance with EN 14511

UATYA110BBAY1
UATYA110BFC2Y1
UATYA110BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA120BBAY1
UATYA120BFC2Y1
UATYA120BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			40			30			35			40		
[m ³ /h]	[°C]	[°C]	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
21600	24	17	117,0	82,3	32,1	114,3	81,5	34,0	111,1	80,8	36,3	108,2	80,1	38,6	104,5	78,6	41,5	
	40	18	120,6	81,8	32,5	117,8	81,1	34,4	114,7	79,6	36,7	111,5	78,8	39,1	107,9	77,4	42,0	
	26	18	120,9	90,3	32,6	117,3	88,1	34,4	117,6	90,3	37,0	111,3	85,8	39,1	107,9	85,8	42,1	
	27	19	124,1	88,4	32,9	121,4	86,9	34,8	118,6	86,9	37,1	114,7	85,4	39,5	111,1	84,6	42,5	
	28	20	128,0	87,2	33,3	125,3	85,7	35,2	122,0	84,9	37,5	118,5	84,1	40,0	114,4	83,4	43,0	
	30	22	136,5	85,5	34,1	133,2	83,9	36,1	129,9	83,2	38,3	126,1	82,4	40,8	121,5	80,9	43,6	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
21600	-15	-16	59,2	25,9	58,6	27,1	59,1	28,0	60,2	29,1	60,4	29,8	60,7	31,1	60,9	32,0	61,4	33,2
	-10	-11	69,3	27,5	69,4	28,4	70,4	29,4	69,5	30,4	69,7	31,5	70,1	32,5	70,1	33,4	69,9	34,5
	-7	-8	76,6	28,1	76,8	29,0	77,5	29,9	75,6	30,9	77,5	31,9	75,8	33,0	76,1	34,1	77,2	35,3
	-3	-4	84,7	28,5	84,3	29,4	86,4	30,3	86,5	31,2	86,4	32,3	86,6	33,5	87,0	34,6	87,2	35,8
	0	-1	93,4	28,3	93,3	29,2	92,9	30,1	92,9	31,1	92,9	32,1	91,7	33,3	92,9	34,5	92,5	35,4
	2	1	97,1	28,2	97,6	29,1	97,4	30,0	97,2	31,0	97,1	32,0	97,1	33,1	96,6	34,2	97,0	35,4
	7	6	109,1	28,2	96,6	28,9	108,5	30,0	108,6	31,1	108,3	32,1	108,0	33,2	107,8	34,3	107,5	35,5
	12	11	118,1	29,2	117,6	30,1	117,2	31,1	116,7	32,1	116,2	33,2	115,9	34,3	114,9	35,4	114,9	36,5

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
21600	-15	-16	53,8	25,9	53,3	27,1	53,7	28,0	54,7	29,1	54,9	29,8	55,2	31,1	55,3	32,0	55,8	33,2
	-10	-11	63,0	27,5	63,1	28,4	64,0	29,4	63,2	30,4	63,4	31,5	63,7	32,5	63,7	33,4	63,6	34,5
	-7	-8	69,7	28,1	69,8	29,0	70,5	29,9	68,8	30,9	70,5	31,9	68,9	33,0	69,2	34,1	70,2	35,3
	-3	-4	77,0	28,5	76,6	29,4	78,6	30,3	78,6	31,2	78,6	32,3	78,8	33,5	79,1	34,6	79,3	35,8
	0	-1	84,9	28,3	84,8	29,2	84,5	30,1	84,4	31,1	84,5	32,1	83,4	33,3	84,4	34,5	84,1	35,4
	2	1	88,2	28,2	88,7	29,1	88,5	30,0	88,4	31,0	88,3	32,0	88,3	33,1	87,9	34,2	88,2	35,4
	7	6	109,1	28,2	96,6	28,9	108,5	30,0	108,6	31,1	108,3	32,1	108,0	33,2	107,8	34,3	107,5	35,5
	12	11	118,1	29,2	117,6	30,1	117,2	31,1	116,7	32,1	116,2	33,2	115,9	34,3	114,9	35,4	114,9	36,5

Data calculated in accordance with EN 14511

UATYA120BBAY1
UATYA120BFC2Y1
UATYA120BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA140BBAY1
UATYA140BFC2Y1
UATYA140BFC3Y1

5

Cooling Capacity and Power Input Table (EN 14511)																				
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil																	
	T DB [°C]	TWB [°C]	20			40			30			35			40			40		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI			
25000	24	17	136,2	98,0	33,1	133,6	97,1	35,5	129,7	95,4	38,4	125,7	94,5	41,7	121,1	92,8	45,4			
	40	18	141,1	97,4	33,3	138,2	97,4	35,8	133,8	94,0	38,8	129,6	94,0	42,2	124,9	92,3	45,8			
	26	18	140,6	105,5	33,3	137,3	104,7	35,7	133,5	103,0	38,7	129,7	98,6	42,2	125,7	103,8	46,2			
	27	19	144,9	104,2	33,6	142,2	105,0	36,1	138,2	103,3	39,2	133,5	100,7	42,5	128,6	99,8	46,2			
	28	20	149,8	103,6	33,8	146,0	102,8	36,4	142,4	101,9	39,1	137,5	100,2	42,9	133,0	100,2	46,8			
	30	22	159,4	100,8	34,2	155,6	99,9	36,9	151,7	99,9	40,1	146,4	98,2	43,6	140,8	96,4	47,3			

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
25000	-15	-16	66,3	30,1	67,3	31,2	66,7	32,0	66,5	33,2	68,6	34,5	66,9	35,5	67,5	37,0	67,4	38,2
	-10	-11	79,3	31,8	80,1	32,7	80,3	33,8	79,3	35,0	78,5	36,2	78,8	37,4	79,7	38,7	79,4	40,1
	-7	-8	86,9	32,0	87,0	33,0	86,5	34,0	86,4	35,1	87,5	36,4	88,7	37,6	84,9	38,9	86,3	40,3
	-3	-4	100,2	31,8	98,8	32,9	95,0	34,1	98,0	35,1	98,1	36,1	97,2	37,4	96,8	38,7	95,1	40,1
	0	-1	104,1	31,7	103,0	32,7	106,0	33,1	105,8	34,1	105,6	35,4	102,5	37,0	105,5	37,7	102,1	39,6
	2	1	109,4	30,9	109,4	31,7	109,5	32,8	107,7	34,0	107,9	35,0	107,4	36,4	107,7	37,4	108,2	38,7
	7	6	125,4	30,3	124,6	31,3	124,0	32,4	123,4	33,5	123,3	34,8	123,1	35,8	122,6	37,0	122,1	38,4
	12	11	135,3	30,7	134,5	31,8	134,4	32,8	132,5	34,0	133,7	35,1	133,1	36,3	132,5	37,6	131,9	38,9

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
25000	-15	-16	60,3	30,1	61,2	31,2	60,6	32,0	60,5	33,2	62,3	34,5	60,9	35,5	61,4	37,0	61,3	38,2
	-10	-11	72,1	31,8	72,8	32,7	73,0	33,8	72,1	35,0	71,4	36,2	71,6	37,4	72,4	38,7	72,2	40,1
	-7	-8	79,0	32,0	79,1	33,0	78,7	34,0	78,6	35,1	79,6	36,4	80,6	37,6	77,2	38,9	78,4	40,3
	-3	-4	91,1	31,8	89,8	32,9	86,4	34,1	89,1	35,1	89,2	36,1	88,4	37,4	88,0	38,7	86,5	40,1
	0	-1	94,6	31,7	93,6	32,7	96,3	33,1	96,2	34,1	96,0	35,4	93,2	37,0	95,9	37,7	92,8	39,6
	2	1	99,5	30,9	99,4	31,7	99,5	32,8	97,9	34,0	98,1	35,0	97,6	36,4	97,9	37,4	98,4	38,7
	7	6	125,4	30,3	124,6	31,3	124,0	32,4	123,4	33,5	123,3	34,8	123,1	35,8	122,6	37,0	122,1	38,4
	12	11	135,3	30,7	134,5	31,8	134,4	32,8	132,5	34,0	133,7	35,1	133,1	36,3	132,5	37,6	131,9	38,9

Data calculated in accordance with EN 14511

UATYA140BBAY1
UATYA140BFC2Y1
UATYA140BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA150BBAY1
UATYA150BFC2Y1
UATYA150BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																							
Air Flow	Air Condition on Supply Coil					Air conditions on External Coil																	
	T DB		T WB			20			40			60			80			100			120		
	[°C]	[°C]	TC	SHC		PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI		
26500	24	17	147,6	104,5	37,4	144,3	103,6	40,2	140,3	102,7	43,4	136,1	100,9	47,1	131,5	100,0	51,1						
	40	18	152,4	104,0	37,8	148,8	103,1	40,6	145,1	102,1	43,9	140,5	100,3	47,5	135,6	98,5	51,6						
	26	18	152,5	113,6	37,7	149,0	111,7	40,5	145,1	111,7	43,9	140,3	108,9	47,5	137,3	108,0	51,7						
	27	19	157,2	112,1	38,1	153,5	110,2	40,9	150,6	113,0	44,2	144,9	108,4	48,0	139,3	106,5	52,1						
	28	20	162,1	110,6	38,4	158,2	109,7	41,3	153,7	107,8	44,6	149,1	106,9	48,3	143,6	105,9	52,4						
	30	22	172,5	108,5	38,9	168,3	106,7	42,0	163,5	105,7	45,4	158,4	104,8	49,2	152,8	102,9	53,0						

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB [°C]	T WB [°C]	10		12		14		16		18		20		22		24	
			PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
26500	-15	-16	74,8	33,5	75,0	34,6	75,8	35,9	74,7	36,8	74,9	38,1	74,3	39,4	74,4	40,7	77,1	43,0
	-10	-11	89,0	35,3	87,6	36,4	89,2	37,7	89,7	39,2	89,2	40,6	88,3	42,0	87,4	43,5	87,6	45,1
	-7	-8	97,5	36,0	96,6	37,1	96,5	38,3	93,9	39,6	97,8	41,2	95,0	42,5	96,9	44,1	96,4	45,5
	-3	-4	108,5	36,1	108,4	37,2	105,0	38,3	105,1	39,6	106,1	41,0	108,0	42,4	109,0	43,8	108,1	45,3
	0	-1	116,6	35,5	114,6	36,7	115,0	37,8	116,7	39,1	113,7	40,6	115,8	41,7	113,7	43,4	114,7	44,7
	2	1	123,6	34,8	123,5	36,0	122,8	37,1	123,1	38,3	121,0	39,7	122,1	40,9	122,0	42,4	119,0	44,1
	7	6	138,8	34,7	138,3	35,8	138,0	37,0	136,1	38,2	136,6	39,5	136,4	40,9	136,0	42,4	136,4	44,0
	12	11	150,0	35,3	150,1	36,6	149,7	37,8	147,3	39,0	147,3	40,4	145,3	41,6	146,6	43,4	146,4	44,9

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB [°C]	T WB [°C]	10		12		14		16		18		20		22		24	
			PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
26500	-15	-16	68,0	33,5	68,2	34,6	68,9	35,9	67,9	36,8	68,1	38,1	67,6	39,4	67,6	40,7	70,1	43,0
	-10	-11	80,9	35,3	79,7	36,4	81,1	37,7	81,5	39,2	81,1	40,6	80,3	42,0	79,4	43,5	79,7	45,1
	-7	-8	88,6	36,0	87,8	37,1	87,8	38,3	85,3	39,6	88,9	41,2	86,3	42,5	88,1	44,1	87,7	45,5
	-3	-4	98,7	36,1	98,6	37,2	95,5	38,3	95,6	39,6	96,5	41,0	98,1	42,4	99,1	43,8	98,3	45,3
	0	-1	106,0	35,5	104,2	36,7	104,5	37,8	106,1	39,1	103,4	40,6	105,3	41,7	103,4	43,4	104,3	44,7
	2	1	112,4	34,8	112,3	36,0	111,6	37,1	111,9	38,3	110,0	39,7	111,0	40,9	110,9	42,4	108,2	44,1
	7	6	138,8	34,7	138,3	35,8	138,0	37,0	136,1	38,2	136,6	39,5	136,4	40,9	136,0	42,4	136,4	44,0
	12	11	150,0	35,3	150,1	36,6	149,7	37,8	147,3	39,0	147,3	40,4	145,3	41,6	146,6	43,4	146,4	44,9

Data calculated in accordance with EN 14511

UATYA150BBAY1
UATYA150BFC2Y1
UATYA150BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA160BBAY1
UATYA160BFC2Y1
UATYA160BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			40			30			35			40		
[m³/h]	[°C]	[°C]		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
28000	24	17		157,5	110,0	40,3	153,8	109,0	43,0	151,6	111,0	46,2	145,7	107,1	50,0	140,6	105,2	54,3
	40	18		162,1	109,4	40,6	159,2	108,4	43,3	155,9	108,4	46,6	150,7	106,5	50,4	144,9	103,6	54,8
	26	18		162,4	119,5	40,6	158,5	117,5	43,2	154,5	116,6	46,6	149,8	114,6	50,3	144,7	113,7	54,7
	27	19		166,0	116,0	40,8	163,9	117,0	43,6	160,4	116,0	46,9	154,6	114,0	50,7	149,2	113,1	55,2
	28	20		172,4	116,4	41,2	169,7	116,4	43,9	164,6	114,4	47,4	160,3	114,4	51,2	154,4	112,5	55,5
	30	22		184,2	115,2	41,8	180,1	113,2	44,6	174,9	110,3	48,2	169,7	109,3	52,0	163,8	108,3	56,3

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
28000	-15	-16	81,5	36,7	79,6	37,8	81,5	39,2	82,8	40,9	81,0	42,0	81,2	43,6	80,9	45,2	80,3	46,6
	-10	-11	93,8	38,3	98,2	39,9	94,0	41,0	95,0	42,6	94,5	44,9	94,7	45,8	94,5	47,5	95,1	49,3
	-7	-8	105,7	39,1	103,1	40,2	103,5	41,6	103,6	43,1	105,1	44,8	102,9	46,2	103,1	47,9	106,1	49,8
	-3	-4	115,9	39,6	119,6	40,6	114,6	42,0	113,3	43,4	115,9	45,1	115,5	46,6	114,8	48,5	114,8	49,9
	0	-1	124,3	39,0	123,9	40,2	125,8	41,3	125,6	42,7	125,5	44,2	127,3	45,5	125,4	47,2	125,1	48,7
	2	1	134,5	38,3	133,5	39,5	133,1	40,8	132,9	42,1	132,7	43,6	132,3	45,1	131,7	46,8	132,4	48,1
	7	6	149,8	38,2	149,4	39,5	148,7	41,0	147,3	42,0	148,0	43,7	147,5	45,2	146,8	46,7	146,9	48,6
	12	11	161,7	39,1	160,8	40,4	160,1	41,7	159,5	43,1	158,7	44,6	158,4	46,1	157,3	47,8	157,4	49,3
	17	16	174,1	39,6	173,1	40,9	172,4	42,2	171,7	43,5	171,0	44,8	170,3	46,1	169,6	47,4	169,9	49,6
	22	21	186,5	40,1	185,5	42,1	184,8	43,2	184,1	44,5	183,4	45,8	182,7	47,1	182,0	48,4	182,3	50,1
	27	26	198,9	40,6	197,9	42,6	197,2	43,7	196,5	45,0	195,8	46,3	195,1	47,6	194,4	48,9	194,7	50,6

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	°C	°C	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
28000	-15	-16	74,1	36,7	72,4	37,8	74,1	39,2	75,3	40,9	73,6	42,0	73,9	43,6	73,5	45,2	73,0	46,6
	-10	-11	85,2	38,3	89,3	39,9	85,5	41,0	86,4	42,6	85,9	44,9	86,1	45,8	85,9	47,5	86,5	49,3
	-7	-8	96,1	39,1	93,8	40,2	94,1	41,6	94,2	43,1	95,6	44,8	93,6	46,2	93,8	47,9	96,5	49,8
	-3	-4	105,4	39,6	108,7	40,6	104,2	42,0	103,0	43,4	105,4	45,1	105,0	46,6	104,4	48,5	104,4	49,9
	0	-1	113,0	39,0	112,6	40,2	114,4	41,3	114,2	42,7	114,1	44,2	115,7	45,5	114,0	47,2	113,7	48,7
	2	1	122,3	38,3	121,4	39,5	121,0	40,8	120,8	42,1	120,6	43,6	120,3	45,1	119,7	46,8	120,4	48,1
	7	6	149,8	38,2	149,4	39,5	148,7	41,0	147,3	42,0	148,0	43,7	147,5	45,2	146,8	46,7	146,9	48,6
	12	11	161,7	39,1	160,8	40,4	160,1	41,7	159,5	43,1	158,7	44,6	158,4	46,1	157,3	47,8	157,4	49,3
	17	16	174,1	39,6	173,1	40,9	172,4	42,2	171,7	43,5	171,0	44,8	170,3	46,1	169,6	47,4	169,9	49,6
	22	21	186,5	40,1	185,5	42,1	184,8	43,2	184,1	44,5	183,4	45,8	182,7	47,1	182,0	48,4	182,3	50,1
	27	26	198,9	40,6	197,9	42,6	197,2	43,7	196,5	45,0	195,8	46,3	195,1	47,6	194,4	48,9	194,7	50,6

Data calculated in accordance with EN 14511

UATYA160BBAY1
UATYA160BFC2Y1
UATYA160BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA180BBAY1
UATYA180BFC2Y1
UATYA180BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WS		20			40			50			65			80		
[m³/h]	[°C]	[°C]	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
30500	24	17	175,1	122,7	44,7	171,2	121,7	47,4	167,0	119,6	51,1	162,2	119,6	55,2	155,9	116,5	59,8	
	25	18	180,7	122,1	44,9	176,8	120,0	47,8	172,2	119,0	51,6	167,1	118,0	55,6	160,9	114,9	60,4	
	26	18	180,4	131,9	45,0	176,5	130,8	47,9	171,9	129,8	51,5	166,9	127,7	55,6	161,3	122,5	60,4	
	27	19	186,2	130,2	45,4	182,3	130,2	48,2	177,6	128,1	52,0	173,4	129,2	56,2	165,8	126,1	60,8	
	28	20	192,2	129,6	45,7	187,4	127,5	48,7	183,2	127,5	52,5	177,8	126,5	56,6	170,8	124,4	61,3	
	30	22	204,7	126,3	46,1	200,0	126,3	49,6	194,4	123,1	53,4	188,9	123,1	57,3	181,2	121,0	62,4	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB [°C]	T WB [°C]	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
30500	-15	-16	88,1	38,6	88,2	39,8	88,3	41,1	88,4	42,8	86,7	43,8	86,8	45,4	88,5	47,5	86,2	48,4
	-10	-11	103,1	40,5	102,9	41,8	103,9	43,4	102,1	44,8	102,4	46,6	105,1	48,4	105,2	50,2	101,3	52,0
	-7	-8	111,4	40,9	110,0	42,3	110,6	43,7	115,1	45,4	115,2	47,0	113,4	48,7	110,1	50,4	105,8	51,9
	-3	-4	122,1	41,3	129,6	42,6	122,1	44,0	122,0	45,5	123,9	47,1	123,0	48,8	122,2	50,5	121,9	52,3
	0	-1	133,5	41,1	136,4	42,2	137,7	43,5	136,4	45,0	134,9	46,6	135,5	48,4	134,2	49,9	133,9	51,7
	2	1	143,0	40,3	142,2	41,6	141,9	43,0	143,4	44,4	141,6	45,8	142,3	47,3	137,9	49,4	138,4	51,0
	7	6	162,1	39,9	162,0	41,3	160,0	42,7	160,3	44,3	159,2	45,5	157,2	47,2	159,1	48,8	156,5	50,5
	12	11	172,7	40,6	172,4	42,0	171,7	43,4	171,0	44,9	170,2	46,6	169,7	48,0	168,9	49,7	168,2	51,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB [°C]	T WB [°C]	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
30500	-15	-16	80,1	38,6	80,2	39,8	80,3	41,1	80,4	42,8	78,8	43,8	78,9	45,4	80,4	47,5	78,4	48,4
	-10	-11	93,7	40,5	93,6	41,8	94,4	43,4	92,9	44,8	93,1	46,6	95,5	48,4	95,6	50,2	92,1	52,0
	-7	-8	101,3	40,9	100,0	42,3	100,5	43,7	104,6	45,4	104,7	47,0	103,1	48,7	100,1	50,4	96,2	51,9
	-3	-4	111,0	41,3	117,8	42,6	111,0	44,0	110,9	45,5	112,6	47,1	111,8	48,8	111,1	50,5	110,8	52,3
	0	-1	121,4	41,1	124,0	42,2	125,2	43,5	124,0	45,0	122,6	46,6	123,2	48,4	122,0	49,9	121,7	51,7
	2	1	130,0	40,3	129,3	41,6	129,0	43,0	130,4	44,4	128,7	45,8	129,4	47,3	125,4	49,4	125,8	51,0
	7	6	162,1	39,9	162,0	41,3	160,0	42,7	160,3	44,3	159,2	45,5	157,2	47,2	159,1	48,8	156,5	50,5
	12	11	172,7	40,6	172,4	42,0	171,7	43,4	171,0	44,9	170,2	46,6	169,7	48,0	168,9	49,7	168,2	51,4

Data calculated in accordance with EN 14511

UATYA180BBAY1
UATYA180BFC2Y1
UATYA180BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

5 Capacity tables

5 - 1 Cooling Capacity Tables

UATYA190BBAY1
UATYA190BFC2Y1
UATYA190BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																			
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil															
	T DB	T WB		20			40			30			35			40			
[m³/h]	[°C]	[°C]		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	
31500	24	17		190,2	134,0	50,4	186,2	131,8	53,5	181,5	130,7	57,3	176,5	129,6	61,8	169,9	127,4	67,0	
	40	18		196,3	133,3	50,8	192,0	131,1	54,0	187,2	130,0	57,9	181,9	127,9	62,3	174,9	125,7	67,6	
	26	18		196,5	143,6	50,8	191,5	140,4	53,7	187,6	141,4	57,7	181,4	138,2	62,3	175,5	139,3	67,8	
	27	19		202,2	141,9	51,3	197,7	140,8	54,5	193,8	140,8	58,6	187,0	136,4	62,9	180,3	136,4	68,3	
	28	20		209,1	141,3	51,7	204,1	139,1	55,1	198,9	136,9	59,1	192,6	135,8	63,7	184,8	132,5	69,0	
	30	22		222,1	138,9	52,7	217,1	136,7	56,2	211,4	134,4	60,3	204,4	132,2	65,1	196,8	131,1	70,3	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
31500	-15	-16	97,9	42,9	99,5	44,3	98,0	45,7	96,6	46,9	99,8	49,1	97,2	50,2	98,6	52,2	98,1	54,1
	-10	-11	114,8	45,0	114,6	46,4	113,3	47,9	112,5	49,4	113,5	51,4	112,8	53,1	111,5	54,7	113,2	57,0
	-7	-8	126,3	45,7	123,0	47,0	125,2	48,7	127,1	50,4	124,4	51,9	125,1	53,9	123,1	55,7	125,0	57,7
	-3	-4	140,9	46,3	136,3	47,5	138,3	49,4	140,7	51,1	141,1	52,6	139,6	54,5	139,7	56,6	139,0	58,6
	0	-1	152,8	46,0	149,5	47,6	147,4	50,0	153,2	50,5	152,9	52,5	148,6	54,4	151,0	55,9	151,0	57,7
	2	1	157,6	45,7	159,1	47,3	160,1	48,6	159,1	50,1	157,3	52,1	155,8	53,8	153,3	55,6	155,4	57,5
	7	6	181,0	45,5	180,3	47,0	180,5	48,6	179,9	50,3	178,3	51,9	177,1	54,2	174,4	55,2	176,8	57,8
	12	11	193,2	46,7	193,4	48,4	191,3	49,6	192,0	51,6	189,8	53,2	190,3	55,4	190,0	57,2	189,3	59,3

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
31500	-15	-16	89,0	42,9	90,5	44,3	89,1	45,7	87,9	46,9	90,7	49,1	88,3	50,2	89,6	52,2	89,2	54,1
	-10	-11	104,4	45,0	104,2	46,4	103,0	47,9	102,3	49,4	103,2	51,4	102,5	53,1	101,4	54,7	102,9	57,0
	-7	-8	114,8	45,7	111,8	47,0	113,8	48,7	115,5	50,4	113,1	51,9	113,7	53,9	111,9	55,7	113,6	57,7
	-3	-4	128,1	46,3	123,9	47,5	125,7	49,4	127,9	51,1	128,3	52,6	126,9	54,5	127,0	56,6	126,4	58,6
	0	-1	138,9	46,0	135,9	47,6	134,0	50,0	139,3	50,5	139,0	52,5	135,1	54,4	137,3	55,9	137,3	57,7
	2	1	143,3	45,7	144,6	47,3	145,5	48,6	144,6	50,1	143,0	52,1	141,6	53,8	139,4	55,6	141,3	57,5
	7	6	181,0	45,5	180,3	47,0	180,5	48,6	179,9	50,3	178,3	51,9	177,1	54,2	174,4	55,2	176,8	57,8
	12	11	193,2	46,7	193,4	48,4	191,3	49,6	192,0	51,6	189,8	53,2	190,3	55,4	190,0	57,2	189,3	59,3

Data calculated in accordance with EN 14511

UATYA190BBAY1
UATYA190BFC2Y1
UATYA190BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)


$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA20-30BFC3Y1

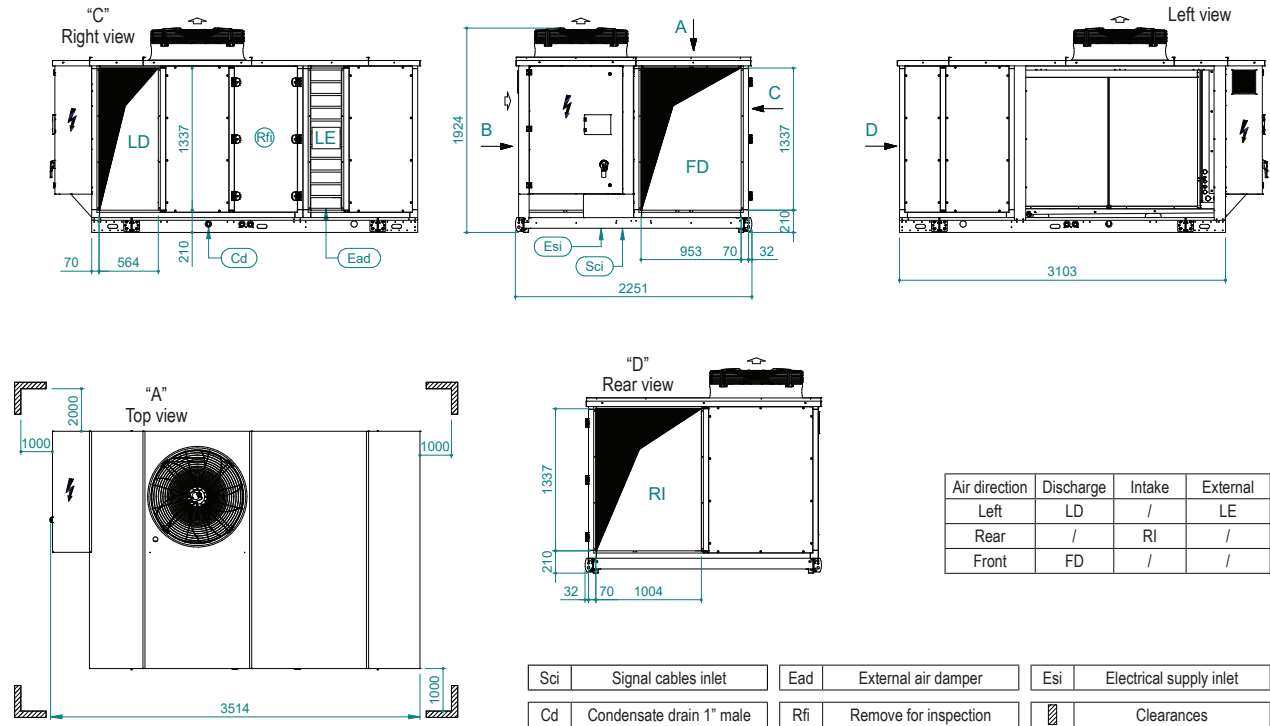

DDIM000961A

UATYA20-30BFC3Y1

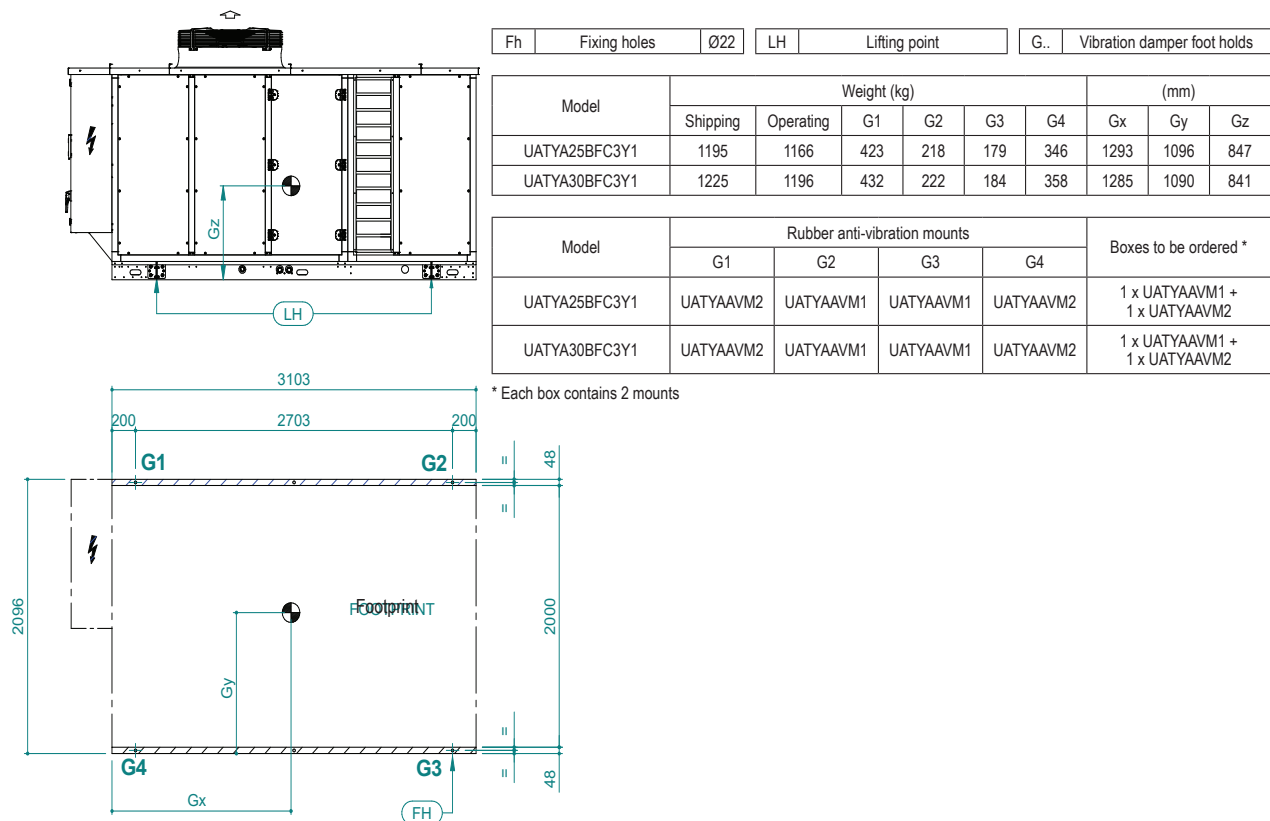


DDIM000961A

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA40-50BFC3Y1

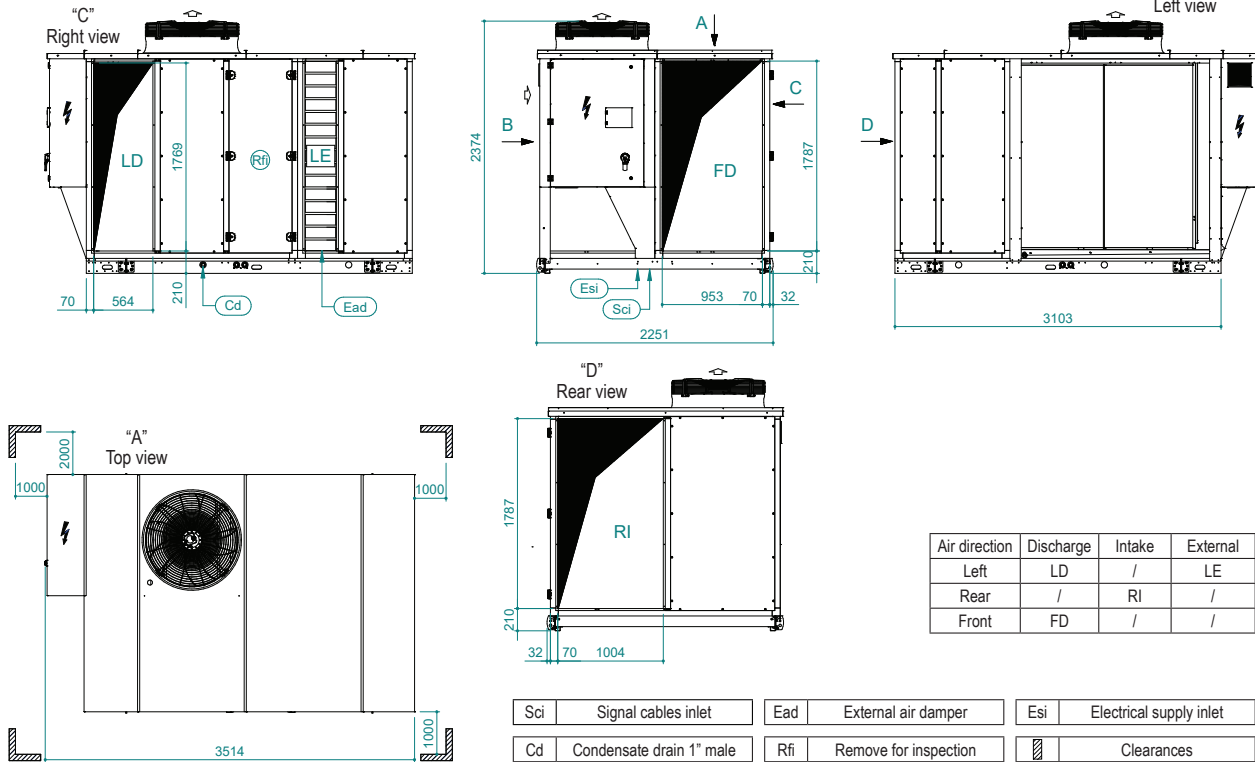

DDIM000962A

UATYA40-50BFC3Y1

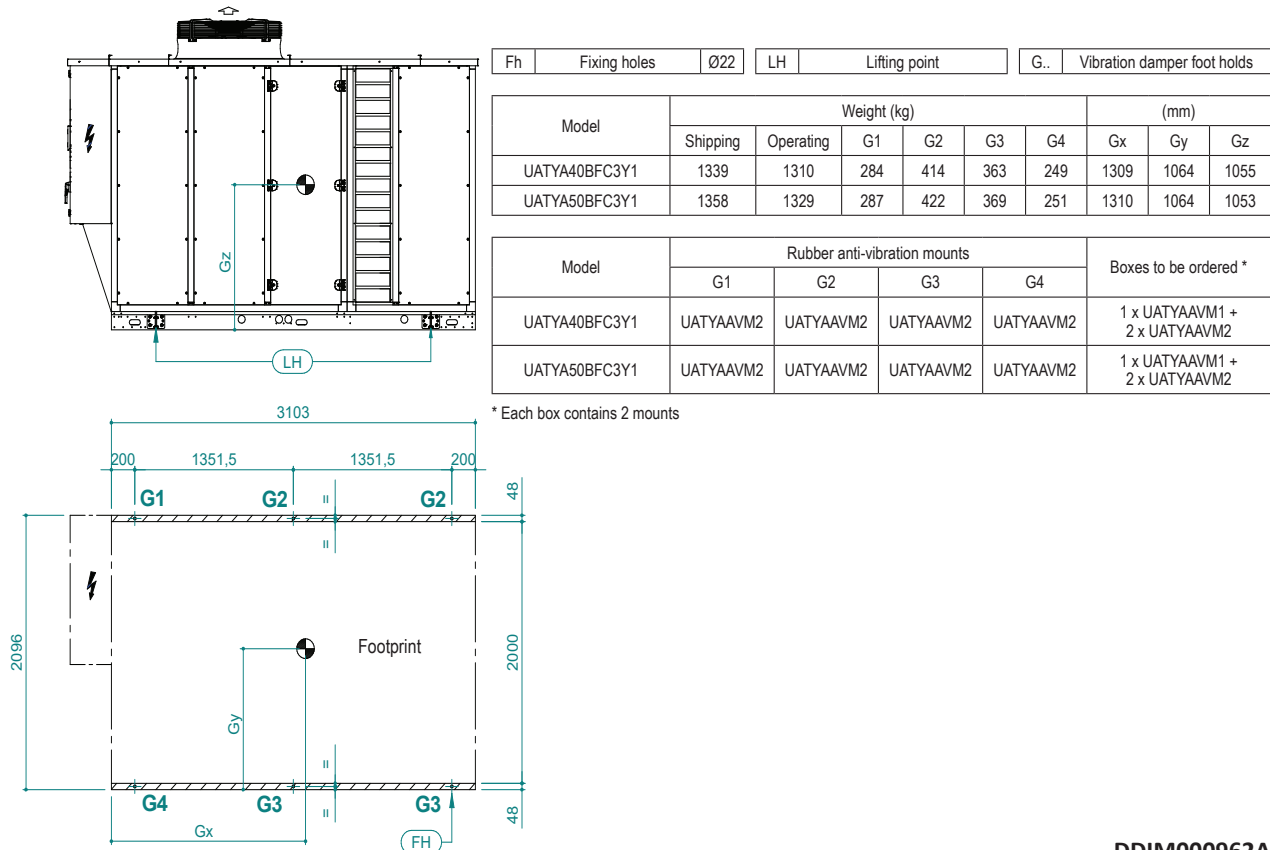


DDIM000962A

6 Dimensional drawings

6 - 1 Dimensional Drawings


6

UATYA60-70BFC3Y1

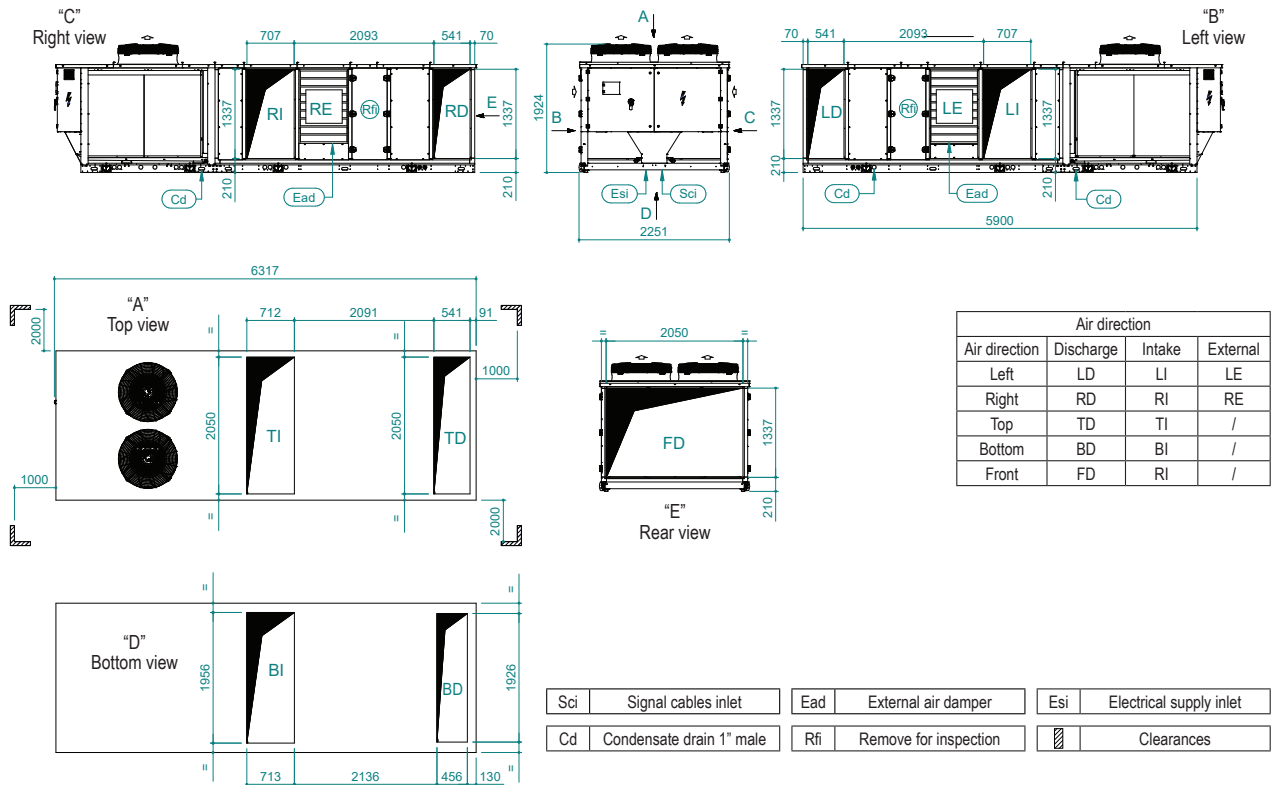

DDIM000963A

UATYA60-70BFC3Y1

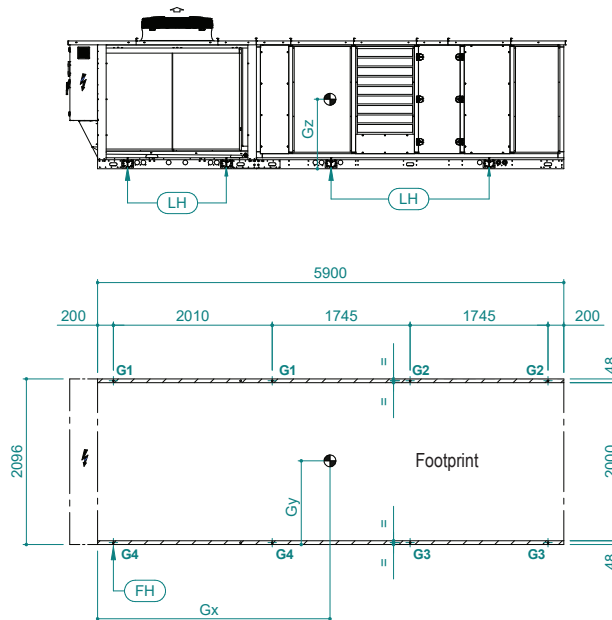

Fh	Fixing holes	Ø22	LH	Lifting point		G..	Vibration damper foot holds		
Model	Weight (kg)						(mm)		
	Shipping	Operating	G1	G2	G3	G4	Gx	Gy	Gz
UATYA60BFC3Y1	2035	1996	358	178	153	309	2739	1137	838
UATYA70BFC3Y1	2133	2094	399	185	147	316	2661	1185	841
Model	Rubber anti-vibration mounts					Boxes to be ordered *			
	G1	G2	G3	G4					
UATYA60BFC3Y1	UATYAAVM2	UATYAAVM1	UATYAAVM1	UATYAAVM1		3 x UATYAAVM1 + 1 x UATYAAVM2			
UATYA70BFC3Y1	UATYAAVM2	UATYAAVM1	UATYAAVM1	UATYAAVM1		3 x UATYAAVM1 + 1 x UATYAAVM2			


* Each box contains 2 mounts

DDIM000963A

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA80-120BFC3Y1

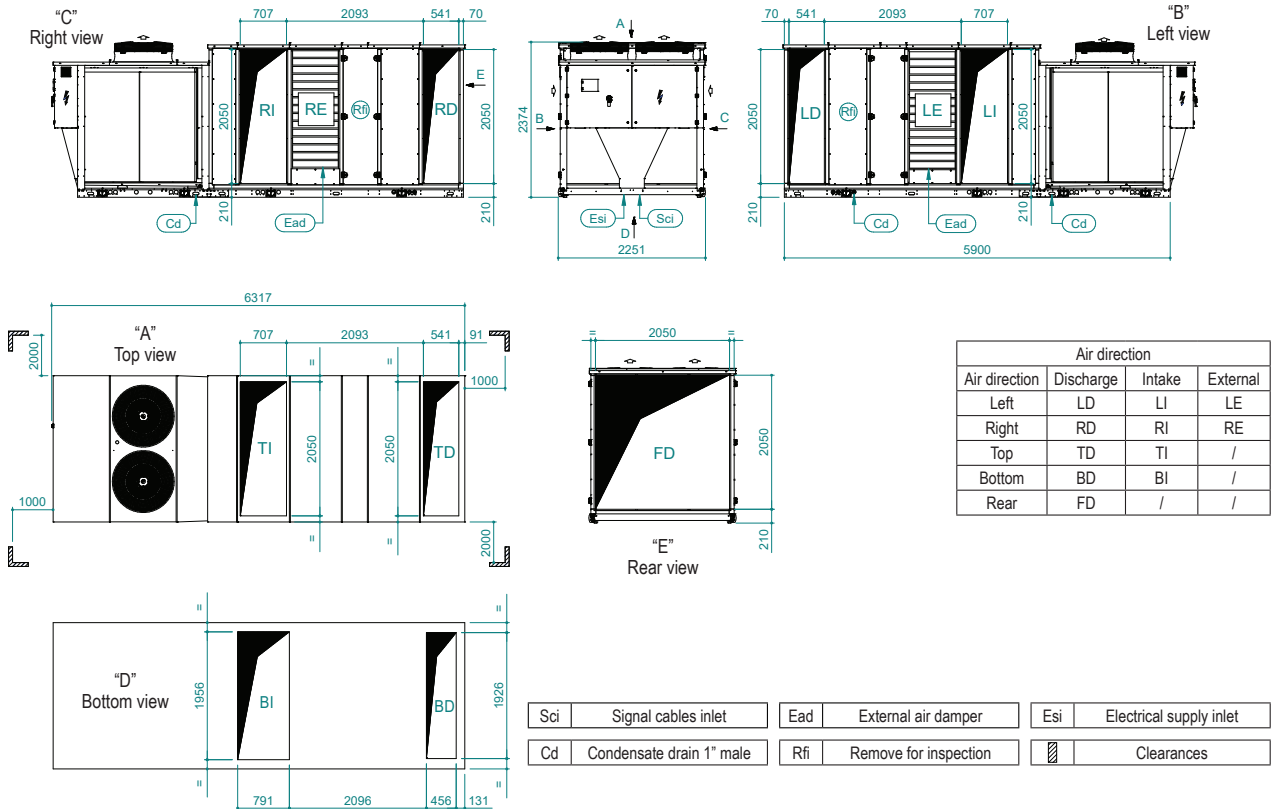

DDIM000964A

UATYA80-120BFC3Y1

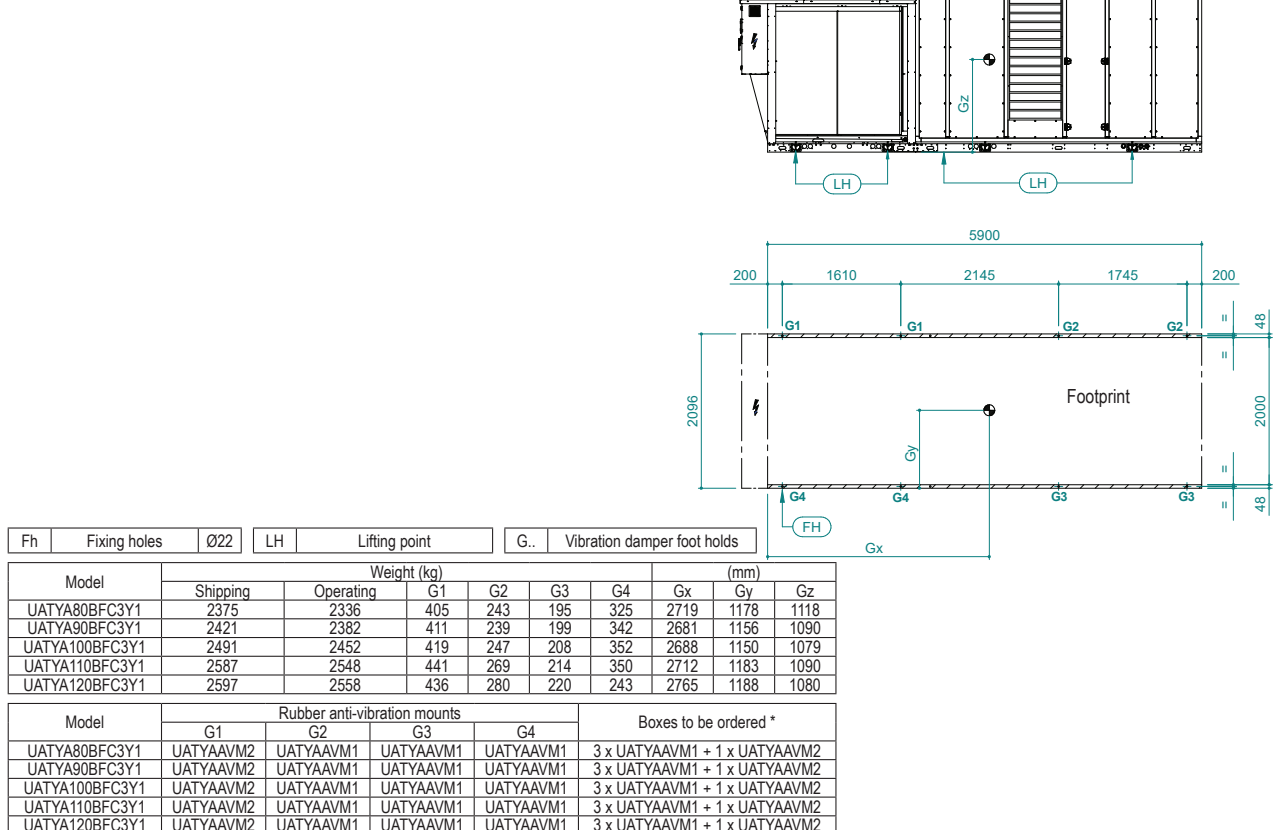

* Each box contains 2 mount


DDIM000964A

6 Dimensional drawings

6 - 1 Dimensional Drawings


6

UATYA140-190BFC3Y1

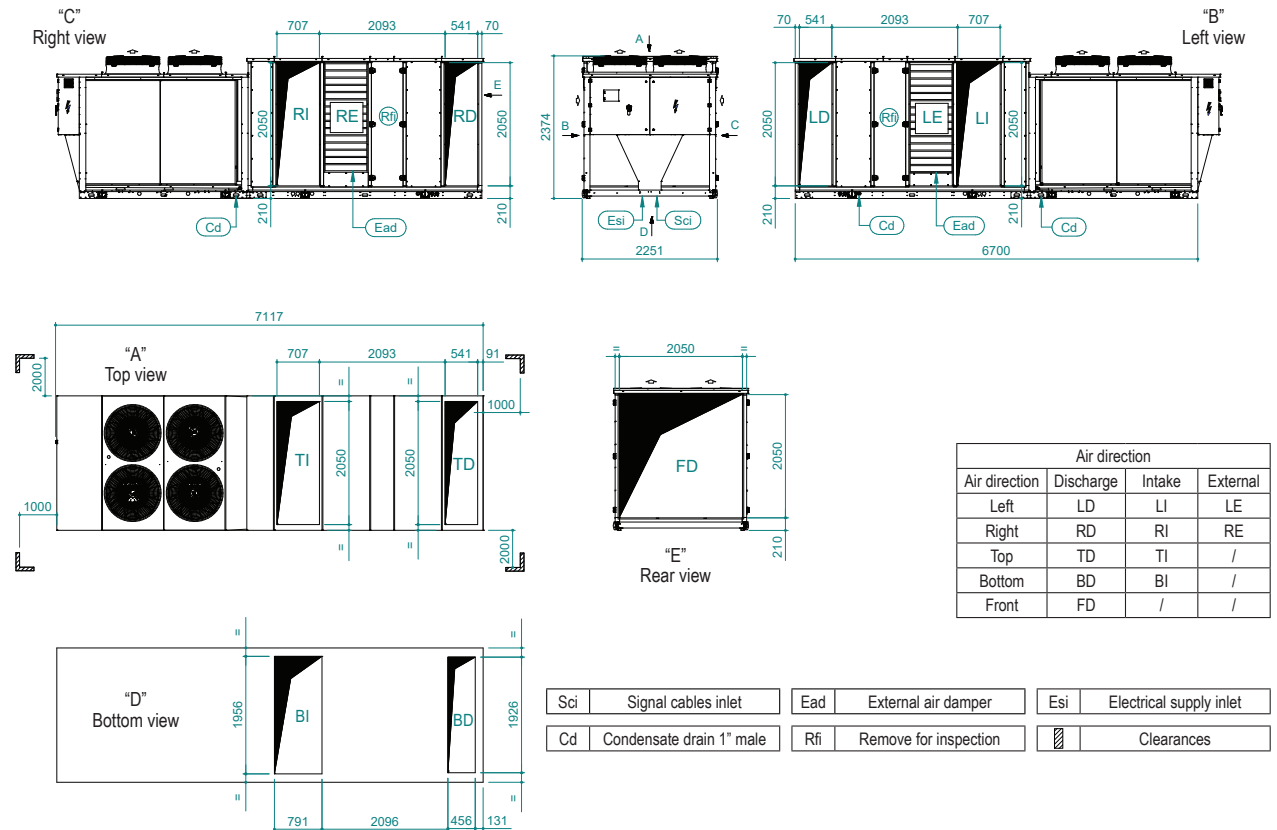

DDIM000965A

UATYA140-190BFC3Y1

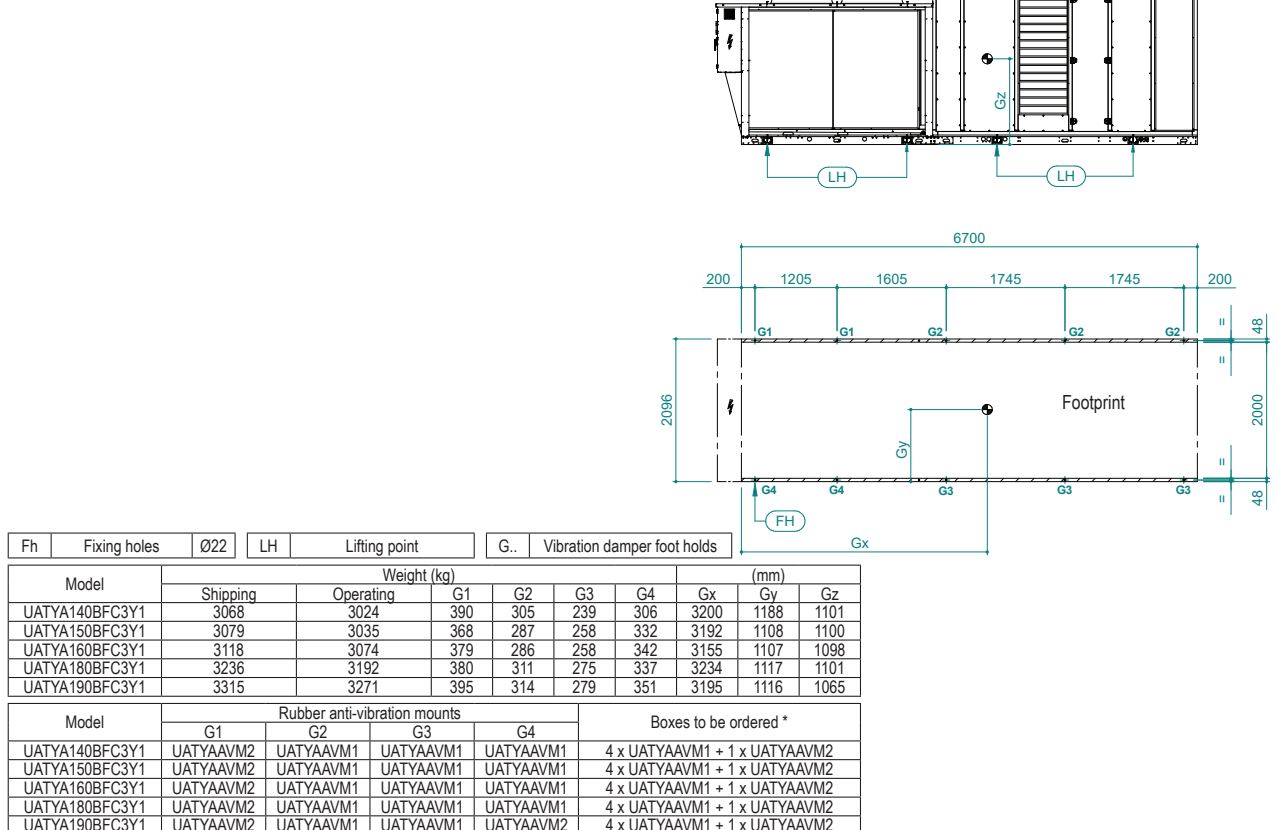

* Each box contains 2 mounts

DDIM000965A

7 - 1 Piping Diagrams

7

(1) Only in unit with ØAC larger or equal to 35mm



7 - 1 Piping Diagrams

7

[illegible]

(1) Only in unit with ØAC larger or equal to 35mm

38

8 Wiring diagrams

8 - 1 Wiring Diagrams - Single Phase

UATYA-BBAY1

UATYA-BFC2Y1

UATYA-BFC3Y1

All wiring diagrams can be downloaded from the Daikin Europe Portal (my.daikin.eu) or your local country portal.

9 Sound data

9 - 1 Sound Level Data

9

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1

MODEL	Octave Bands [dB]																TOT dB(A)	
	63 Hz		125 Hz		250 Hz		500 Hz		1000 Hz		2000 Hz		4000 Hz		8000 Hz			
	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp		
UATYA25	87	69	84	66	79	60	75	57	72	54	68	50	64	46	55	37	82	64
UATYA30	88	69	85	66	80	61	79	61	79	60	78	60	76	58	70	52	84	66
UATYA40	85	66	82	63	83	64	77	59	81	63	80	62	79	60	65	47	87	68
UATYA50	88	69	85	66	79	61	80	61	80	62	81	62	77	59	73	54	86	67
UATYA60	91	71	88	68	83	64	81	61	82	62	81	62	83	64	75	55	89	69
UATYA70	92	72	89	69	85	66	81	61	82	63	81	62	79	60	67	48	88	68
UATYA80	97	77	94	74	88	69	84	64	85	65	82	62	89	69	77	57	93	73
UATYA90	97	77	94	74	85	65	83	63	83	63	82	62	79	59	73	53	89	69
UATYA100	97	77	94	74	85	66	83	63	84	64	82	63	83	63	75	55	90	70
UATYA110	97	77	94	74	86	66	83	63	84	64	84	64	84	64	75	55	90	71
UATYA120	97	77	94	74	88	68	85	65	87	67	86	66	90	70	79	59	94	74
UATYA140	100	80	97	77	87	67	84	64	84	63	79	59	77	56	68	48	89	68
UATYA150	100	80	97	77	88	67	84	64	83	63	79	59	77	56	68	47	89	68
UATYA160	100	80	97	77	88	67	85	64	84	63	80	60	77	57	69	49	89	69
UATYA180	100	80	97	77	88	67	85	64	84	64	81	61	78	57	71	50	89	69
UATYA190	100	80	97	77	88	67	85	65	84	64	84	64	78	58	70	50	90	70

Lw: Sound power level in free field calculated according to standard ISO 3744. Values refer only to the base unit version

Lp: Average sound pressure level, at 1 meter from the unit, in free field on a reflective surface. Not binding value derived from the sound power level

10 Fan characteristics

10 - 1 Fan Characteristics

UATYA25-80BBAY1

UATYA25-80BFC2Y1

UATYA25-80BFC3Y1

		UATYA25			UATYA30			UATYA40			UATYA50			UATYA60			UATYA70			UATYA80		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
DECLARED AIR FLOW	[mc/h]	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950

SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)																						
Available Pressure																						
50	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
100	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
150	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
200	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
250	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14062	11600	14500	15950
300	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	13742	11600	14500	15950

RETURN FAN (only for version UATYA***BFC3Y1)																						
Available Pressure																						
50	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
100	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
150	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
200	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
250	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
300	Pa	3600	4500	4950	4640	5800	6211	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14221	11600	14500	15950

* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

UATYA90-120BBAY1

UATYA90-120BFC2Y1

UATYA90-120BFC3Y1

DECLARED AIR FLOW	[mc/h]	UATYA90			UATYA100			UATYA110			UATYA120		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
		13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)													
Available Pressure													
50	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
100	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
150	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
200	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
250	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
300	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
RETURN FAN (only for version UATYA***BFC3Y1)													
Available Pressure													
50	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
100	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
150	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
200	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
250	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
300	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760

* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

10 Fan characteristics

10 - 1 Fan Characteristics

10

UATYA140-190BBAY1
UATYA140-190BFC2Y1
UATYA140-190BFC3Y1

		UATYA140			UATYA150			UATYA160			UATYA180			UATYA190		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
DECLARED AIR FLOW	[mc/h]	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)																
Available Pressure																
50	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
100	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
150	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
200	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
250	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
300	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
RETURN FAN (only for version UATYA***BFC3Y1)																
Available Pressure																
50	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
100	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
150	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30792	24400	30500	32940	25200	31500	33075
200	Pa	20000	25000	27500	21200	26500	29150	22400	28000	29911	24400	30500	32940	25200	31500	33075
250	Pa	20000	25000	26738	21200	26500	29138	22400	28000	29138	24400	30500	32940	25200	31500	33075
300	Pa	20000	25000	25690	21200	26500	28442	22400	28000	28442	24400	30500	32940	25200	31500	33036


* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

11 Operation range

11 - 1 Operation Range


UATYA25BBAY1
UATYA25BFC2Y1
UATYA25BFC3Y1

11

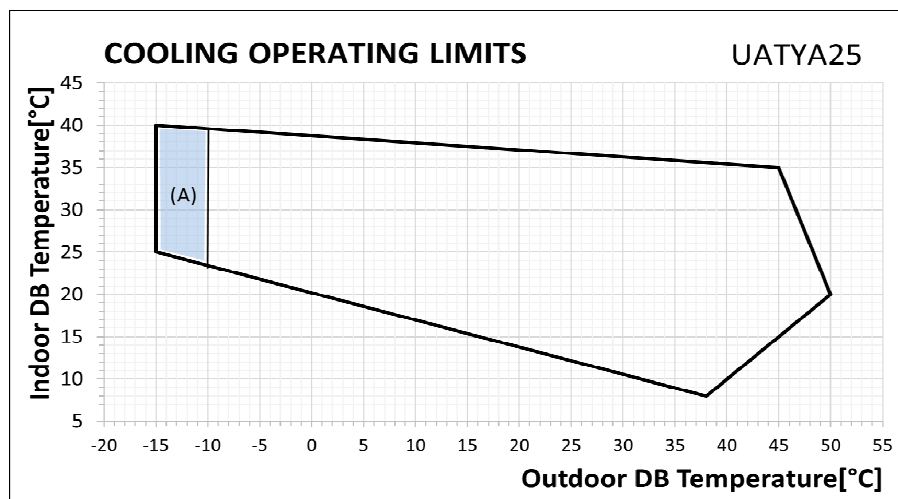

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

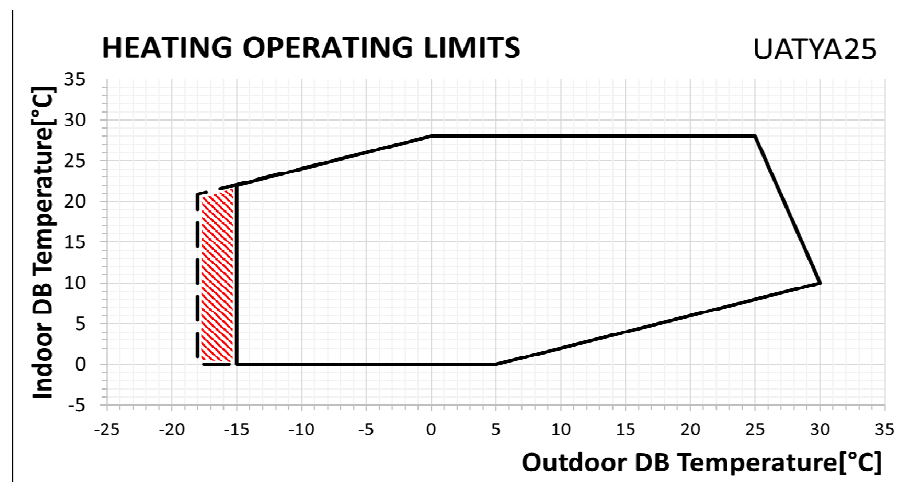

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.




Operation guaranteed (HEATING OPERATION).

11 Operation range

11 - 1 Operation Range


11

UATYA30-70BBAY1
UATYA90-110BBAY1
UATYA30-70BFC2Y1
UATYA90-110BFC2Y1
UATYA30-70BFC3Y1
UATYA90-110BFC3Y1

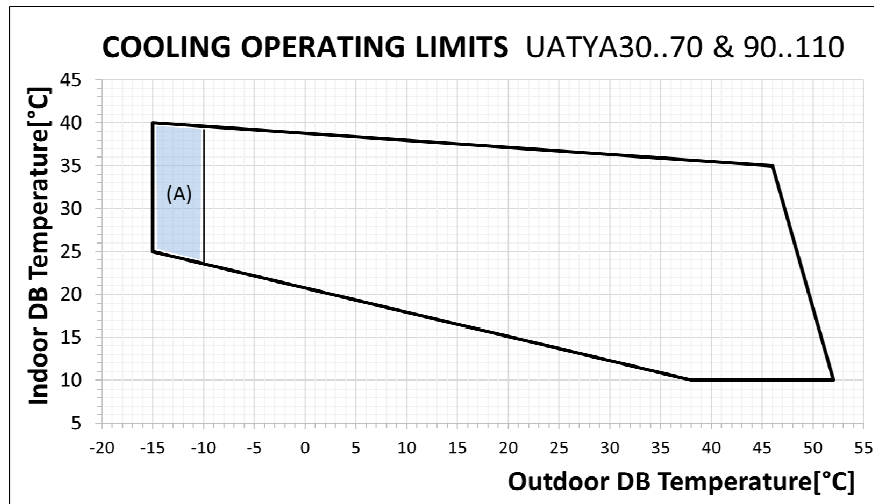

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

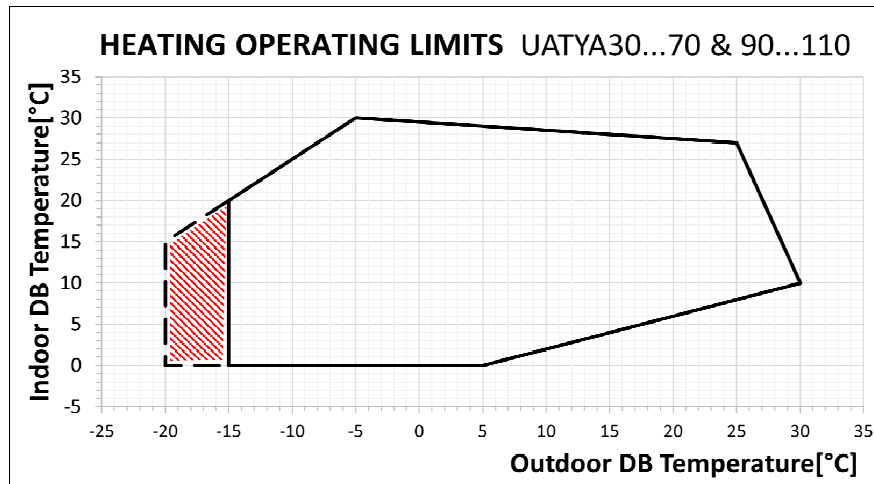

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.




Operation guaranteed (HEATING OPERATION).

11 Operation range

11 - 1 Operation Range


UATYA80BBAY1
UATYA120BBAY1
UATYA80BFC2Y1
UATYA120BFC2Y1
UATYA80BFC3Y1
UATYA120BFC3Y1

11

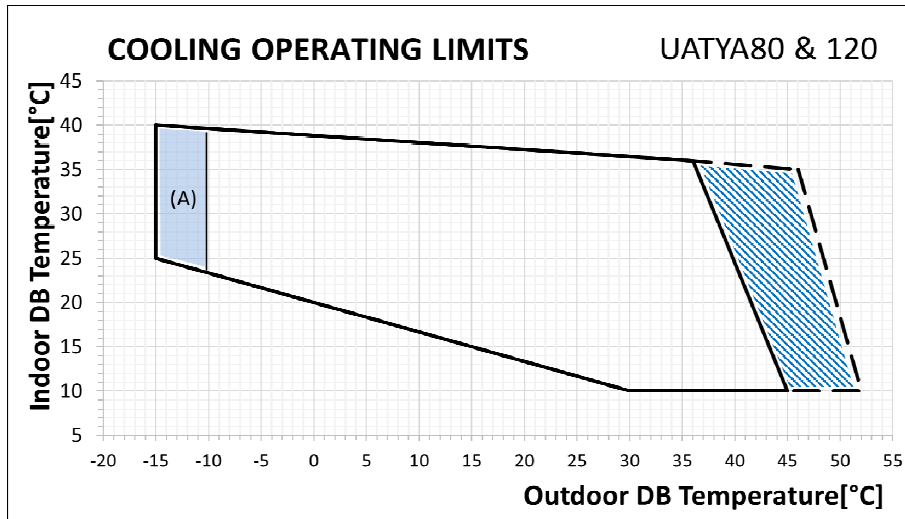

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

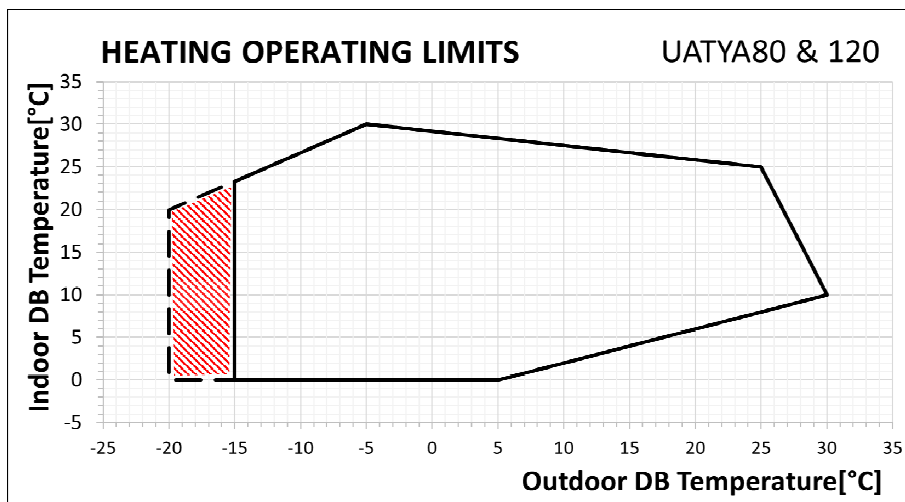

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb)

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.




Operation guaranteed (HEATING OPERATION).

11 Operation range

11 - 1 Operation Range


UATYA140-190BBAY1
UATYA140-190BFC2Y1
UATYA140-190BFC3Y1

11

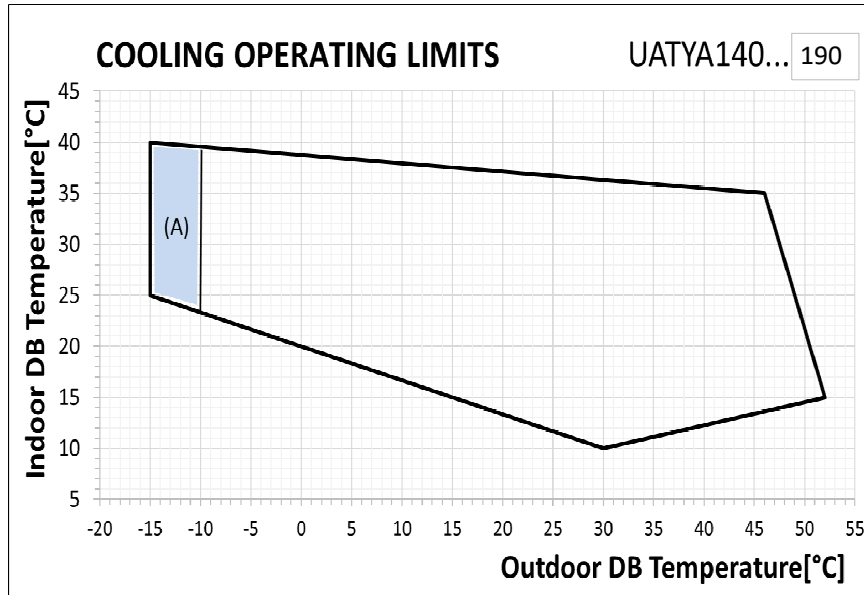

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

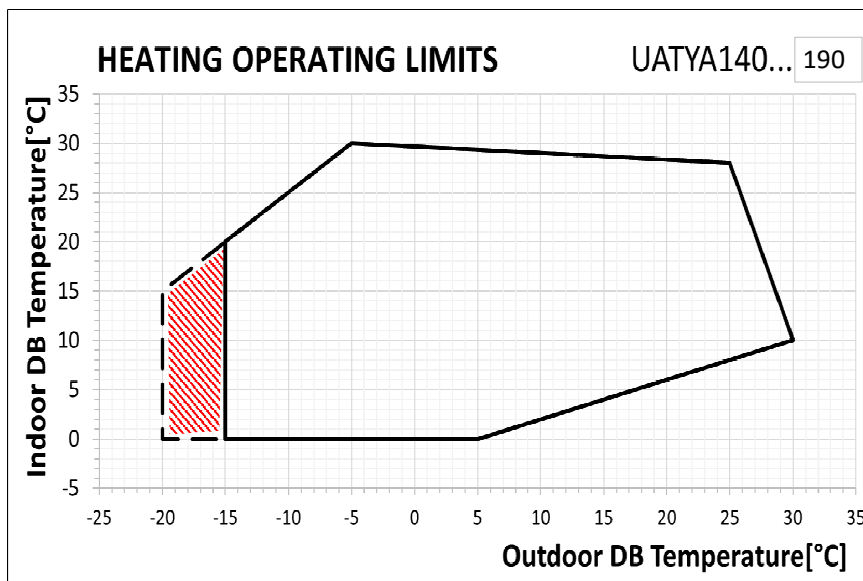

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.




Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.



Operation guaranteed (HEATING OPERATION).



EEDEN20

12/2020



The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. / Daikin Central Europe HandelsGmbH. Daikin Europe N.V. / Daikin Central Europe HandelsGmbH have compiled the content of this publication to the best of their knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. / Daikin Central Europe HandelsGmbH explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V.