

VRV IV+ heat pump, with continuous heating Air Conditioning Technical Data RYYQ-U

RYYQ8U7Y1B
RYYQ10U7Y1B
RYYQ12U7Y1B
RYYQ14U7Y1B
RYYQ16U7Y1B
RYYQ18U7Y1B
RYYQ20U7Y1B
RYYQ22U7Y1B
RYYQ24U7Y1B
RYYQ26U7Y1B
RYYQ28U7Y1B
RYYQ30U7Y1B
RYYQ32U7Y1B
RYYQ34U7Y1B
RYYQ36U7Y1B
RYYQ38U7Y1B
RYYQ40U7Y1B
RYYQ42U7Y1B
RYYQ44U7Y1B
RYYQ46U7Y1B
RYYQ48U7Y1B
RYYQ50U7Y1B
RYYQ52U7Y1B
RYYQ54U7Y1B
RYMQ10U7Y1B
RYMQ12U7Y1B
RYMQ16U7Y1B
RYMQ8U7Y1B
RYMQ14U7Y1B
RYMQ18U7Y1B
RYMQ20U7Y1B



TABLE OF CONTENTS

RYYQ-U

1	Features	4
	RYYQ-U	4
2	Specifications	5
3	Options	28
4	Combination table	29
5	Capacity tables	32
	Capacity Table Legend	32
	Capacity Correction Factor	33
6	Dimensional drawings	46
7	Centre of gravity	47
8	Piping diagrams	48
9	Wiring diagrams	50
	Wiring Diagrams - Three Phase	50
10	External connection diagrams	53
11	Sound data	55
	Sound Power Spectrum	55
	Sound Pressure Spectrum	59
	Sound Pressure Spectrum Quiet Mode Level 1	63
	Sound Pressure Spectrum Quiet Mode Level 2	65
	Sound Pressure Spectrum Quiet Mode Level 3	67
12	Installation	69
	Installation Method	69
	Fixation and Foundation of Units	70
	Refrigerant Pipe Selection	71
13	Operation range	74
14	Appropriate Indoors	75

1 Features

1 - 1 RYYQ-U

Daikin's optimum solution with top comfort

1

- › By choosing this product with LOOP by Daikin you support the reuse of refrigerant
- › Covers all thermal needs of a building via a single point of contact: accurate temperature control, ventilation, hot water, air handling units and Biddle air curtains
- › Wide range of indoor units: possibility to combine VRV with stylish indoor units (Daikin Emura, Perfera)
- › Incorporates VRV IV standards & technologies: Variable Refrigerant Temperature, continuous heating, VRV configurator, 7 segment display and full inverter compressors, 4-side heat exchanger, refrigerant cooled PCB, new DC fan motor
- › Customize your VRV for best seasonal efficiency & comfort with the weather dependant Variable Refrigerant Temperature function. Increased seasonal efficiency with up to 28%. No more cold draft by supply of high outblow temperatures
- › Continuous comfort: Unique continuous heating technology makes VRV IV the best alternative to traditional heating systems
- › Free combination of outdoor units to meet installation space or efficiency requirements
- › Fits any building as also indoor installation is possible as a result of high external static pressure of up to 78.4 Pa. Indoor installation leads to less piping length, lower installation costs, increased efficiency and better visual aesthetics
- › Simplified installation & guaranteed optimal efficiency with automatic charging & testing
- › Easy compliance with F-gas regulation thanks to automated refrigerant containment check
- › Wide piping flexibility: 30m indoor height difference, maximum piping length: 190m, total piping length: 1,000m
- › The ability to control each conditioned zone individually keeps VRV system running costs to an absolute minimum
- › Spread your installation cost by phased installation
- › Keep your system in top condition via the Daikin Cloud Service: 24/7 monitoring for maximum efficiency, extended lifetime and immediate service support thanks to failure prediction
- › Available as heating only by irreversible field setting



Inverter



2 Specifications

1 - 1 RYYQ-U

Technical Specifications					RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U	
Recommended combination					4 x FXFQ50AVEB	4 x FXFQ63AVEB	6 x FXFQ50AVEB	1 x FXFQ50AVEB + 5 x FXFQ63AVEB	
Recommended combination 2					4 x FXSQ50A2VEB	4 x FXSQ63A2VEB	6 x FXSQ50A2VEB	1 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	
Recommended combination 3					4 x FXMQ50P7VEB	4 x FXMQ63P7VEB	6 x FXMQ50P7VEB	1 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	
Continuous heating					Yes				
Cooling capacity		Prated,c	kW	22.4 (1)	28.0 (1)	33.5 (1)	40.0 (1)		
Heating capacity	Nom.	6°CWB	kW	22.4 (2)	28.0 (2)	33.5 (2)	40.0 (2)		
	Prated,h		kW	22.4 (2)	28.0 (2)	33.5 (2)	40.0 (2)		
	Max.	6°CWB	kW	25.0 (2)	31.5 (2)	37.5 (2)	45.0 (2)		
Power input - 50Hz		Heating	Nom.	6°CWB	kW	5.40 (2)	7.58 (2)	9.65 (2)	10.69 (2)
COP at nom. capacity		6°CWB	kW/kW	4.15 (2)	3.69 (2)	3.47 (2)	3.74 (2)		
ESEER - Automatic					7.53	7.20	6.96	6.83	
ESEER - Standard					6.37	5.67	5.50	5.31	
SCOP					4.3		4.1	4.0	
SCOP recommended combination 2					4.2	4.3	4.1	4.0	
SCOP recommended combination 3					4.2	4.1		4.0	
SEER					7.6	6.8	6.3		
SEER recommended combination 2					6.9	6.8	5.9	6.3	
SEER recommended combination 3					7.5	6.8	6.2		
ηs,c			%	302.4	267.6	247.8	250.7		
ηs,c recommended combination 2					273.6	270.5	233.5	250.0	
ηs,c recommended combination 3					295.2	267.1	246.3	246.7	
ηs,h			%	167.9	168.2	161.4	155.4		
ηs,h recommended combination 2					165.4	170.6	161.3	157.2	
ηs,h recommended combination 3					165.6	162.0	160.6	155.7	
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc	kW		3.0	2.3	2.4	2.6	
					22.4	28.0	33.5	40.0	
					5.2	4.7	4.3	4.1	
					16.5	20.6	24.7	29.5	
					9.5	8.3	7.7	7.8	
Space cooling recommended combination 2	B Condi- tion (30°C - 27/19)	EERd Pdc	kW		10.6	13.3	15.9	18.9	
					18.8	17.0	13.9	14.3	
					8.0	9.3	9.4	8.4	
					2.6	2.4		2.6	
					22.4	28.0	33.5	40.0	
Space cooling recommended combination 2	C Condi- tion (25°C - 27/19)	EERd Pdc	kW		4.9	4.7	4.0	4.1	
					16.5	20.6	24.7	29.5	
					8.8	8.5	7.1	7.9	
					10.6	13.3	15.9	18.9	
					15.1	17.2	13.1	14.0	
Space cooling recommended combination 2	D Condi- tion (20°C - 27/19)	EERd Pdc	kW		8.8	9.3	9.1	8.4	
					3.0	2.3	2.4	2.6	
					22.4	28.0	33.5	40.0	
					5.1	4.7	4.2	4.0	
					16.5	20.6	24.7	29.5	
Space cooling recommended combination 3	E Condi- tion (15°C - 27/19)	EERd Pdc	kW		9.6	8.4	7.7	7.9	
					10.6	13.3	15.9	18.9	
					16.0	16.9	13.7	14.0	
					9.1	9.3	9.4	8.4	
					3.0	2.3	2.4	2.6	

2 Specifications

1 - 1 RYYQ-U

2

Technical Specifications				RYYQ8U		RYYQ10U		RYYQ12U		RYYQ14U				
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.5		2.4		2.0		2.3				
		Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tbiv (bivalent temperature) °C		-10										
	TOL	COPd (declared COP)		2.5		2.4		2.0		2.3				
		Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tol (temperature operating limit) °C		-10										
	A Con- dition (-7°C)	COPd (declared COP)		2.7		2.6		2.4		2.6				
		Pdh (declared heating cap) kW		12.1		14.2		16.3		18.2				
	B Condi- tion (2°C)	COPd (declared COP)		3.9									3.5	
	C Condi- tion (7°C)	Pdh (declared heating cap) kW		7.4		8.6		9.9		11.1				
Space heating (Average climate) recommended combination 2	C Condi- tion (7°C)	COPd (declared COP)		6.3		6.4		6.1						
		Pdh (declared heating cap) kW		5.0		5.5		6.4		7.1				
		COPd (declared COP)		7.9		8.2		7.9		8.5				
	D Con- dition (12°C)	Pdh (declared heating cap) kW		5.9				6.3		4.9				
		COPd (declared COP)		2.7									2.6	
	A Con- dition (-7°C)	Pdh (declared heating cap) kW		12.1		14.2		16.3		18.2				
		COPd (declared COP)		3.9		4.0		3.9		3.5				
	B Condi- tion (2°C)	Pdh (declared heating cap) kW		7.4		8.6		9.9		11.1				
	C Condi- tion (7°C)	COPd (declared COP)		6.3		6.5		6.1						
		Pdh (declared heating cap) kW		5.0		5.5		6.4		7.1				
Space heating (Average climate) recommended combination 3	D Con- dition (12°C)	COPd (declared COP)		7.8		8.3		7.9		8.6				
		Pdh (declared heating cap) kW		5.9		6.0		6.4		4.9				
		COPd (declared COP)		2.4									2.3	
	TBivalent	Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tbiv (bivalent temperature) °C		-10										
		COPd (declared COP)		2.4									2.3	
	TOL	Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tol (temperature operating limit) °C		-10										
		COPd (declared COP)		2.4									2.3	
	Space heating (Average climate) recommended combination 2	TOL	Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6			
Tol (temperature operating limit) °C			-10											
COPd (declared COP)			2.4									2.3		
A Con- dition (-7°C)		Pdh (declared heating cap) kW		12.1		14.2		16.3		18.2				
		COPd (declared COP)		2.7		2.6		2.4		2.6				
		Pdh (declared heating cap) kW		7.4		8.6		9.9		11.1				
B Condi- tion (2°C)		COPd (declared COP)		3.9		3.7		3.9		3.5				
		Pdh (declared heating cap) kW		6.2		6.4		6.0		6.1				
		COPd (declared COP)		4.9		5.5		6.4		7.1				
C Condi- tion (7°C)		Pdh (declared heating cap) kW		5.8		5.9		6.2		4.9				
	COPd (declared COP)		7.8		8.1		7.8		8.5					
	Pdh (declared heating cap) kW		5.9		6.0		6.4		4.9					
Capacity range PED	TBivalent	COPd (declared COP)		2.5		2.4		2.0		2.3				
		Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tbiv (bivalent temperature) °C		-10										
	TOL	COPd (declared COP)		2.5		2.4		2.0		2.3				
		Pdh (declared heating cap) kW		13.7		16.0		18.4		20.6				
		Tol (temperature operating limit) °C		-10										
	Capacity range			HP		8		10		12		14		
	Category				Category II									
		Most critical part	Name		Accumulator									
			Ps*V	Bar*I	325						415			
Maximum number of connectable indoor units				64 (3)										
Indoor index connection	Min.			100.0		125.0		150.0		175.0				
	Max.			260.0		325.0		390.0		455.0				
Dimensions	Unit	Height	mm	1,685										
		Width	mm	930						1,240				
		Depth	mm	765										
	Packed unit	Height	mm	1,820										
		Width	mm	995						1,305				
		Depth	mm	860										
Weight	Unit	kg		252						319				
	Packed unit	kg		265						335				
Packing	Material			Carton										
	Weight			kg						1.8		2.2		
Packing 2	Material			Wood										
	Weight			kg						11.0		14.0		
Packing 3	Material			Plastic										
Packing 3	Weight			kg						0.5		0.6		

2 Specifications

1 - 1 RYYQ-U

Technical Specifications					RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U
Casing	Colour				Daikin White			
	Material				Painted galvanized steel plate			
Heat exchanger	Type				Cross fin coil			
	Indoor side				Air			
	Outdoor side				Air			
	Air flow rate	Cooling	Rated	m³/h	9,720	10,500	11,100	13,380
	Heating	Rated	m³/h	9,720	10,500	11,100	13,380	
Fan	Quantity				1			2
	External static pressure	Max.	Pa	78				
Fan motor	Quantity				1			2
	Type				DC motor			
	Output				550			750
Compressor	Quantity				1			2
	Type				Hermetically sealed scroll compressor			
	Crankcase heater				33			
Operation range	Cooling	Min.	°CDB		-5.0			
		Max.	°CDB		43.0			
	Heating	Min.	°CWB		-20.0			
		Max.	°CWB		15.5			
Sound power level	Cooling	Nom.	dBA		78.0 (4)	79.1 (4)	83.4 (4)	80.9 (4)
	Heating	Prated,h	dBA		79.6 (4)	80.9 (4)	83.5 (4)	83.1 (4)
Sound pressure level	Cooling	Nom.	dBA		57.0 (5)		61.0 (5)	60.0 (5)
Refrigerant	Type				R-410A			
	GWP				2,087.5			
	Charge				12.3	12.5	13.2	21.5
	Charge				5.9	6.0	6.3	10.3
Refrigerant oil	Type				Synthetic (ether) oil FVC68D			
Piping connections	Liquid	Type			Braze connection			
		OD	mm		9.52		12.7	
	Gas	Type			Braze connection			
		OD	mm		19.1	22.2		28.6
	Total piping length	System	Actual	m	1,000 (6)			
Defrost method					Reversed cycle			
Capacity control	Method				Inverter controlled			
Indication if the heater is equipped with a supplementary heater					no			
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0			
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000			
		Heating	PCK	kW	0.052			0.077
	Off mode	Cooling	POFF	kW	0.041			0.074
		Heating	POFF	kW	0.052			0.077
	Standby mode	Cooling	PSB	kW	0.041			0.074
		Heating	PSB	kW	0.052			0.077
	Thermo-stat-off mode	Cooling	PTO	kW	0.005			0.010
		Heating	PTO	kW	0.056			0.097
Cooling	Cdc (Degradation cooling)				0.25			
Heating	Cdh (Degradation heating)				0.25			
Safety devices	Item	01			High pressure switch			
		02			Fan driver overload protector			
		03			Inverter overload protector			
		04			PC board fuse			
		05			Leakage current detector			

Technical Specifications					RYYQ16U	RYYQ18U	RYYQ20U
Recommended combination					4 x FXFQ63AVEB + 2 x FXFQ80AVEB	3 x FXFQ50AVEB + 5 x FXFQ63AVEB	2 x FXFQ50AVEB + 6 x FXFQ63AVEB
Recommended combination 2					4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	2 x FXSQ50A2VEB + 6 x FXSQ63A2VEB
Recommended combination 3					4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	3 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	2 x FXMQ50P7VEB + 6 x FXMQ63P7VEB
Continuous heating					Yes		
Cooling capacity	Prated,c	kW			45.0 (1)	50.4 (1)	52.0 (1)
	Nom.	6°CWB			45.0 (2)	50.4 (2)	56.0 (2)
Heating capacity	Prated,h	kW			45.0 (2)	50.4 (2)	56.0 (2)
	Max.	6°CWB			50.0 (2)	56.5 (2)	63.0 (2)

2 Specifications

1 - 1 RYYQ-U

2

Technical Specifications					RYYQ16U	RYYQ18U	RYYQ20U
Power input - 50Hz Heating	Nom.	6°CWB	kW		12.54 (2)	14.22 (2)	17.47 (2)
COP at nom. capacity		6°CWB	kW/kW		3.59 (2)	3.54 (2)	3.20 (2)
ESEER - Automatic					6.50	6.38	5.67
ESEER - Standard					5.05	4.97	4.42
SCOP					4.0	4.2	4.0
SCOP recommended combination 2					4.1	4.2	4.0
SCOP recommended combination 3					4.0	4.1	3.9
SEER					6.0		5.9
SEER recommended combination 2					5.9	6.0	5.9
SEER recommended combination 3					5.8	6.0	5.9
ηs,c			%		236.5	238.3	233.7
ηs,c recommended combination 2					234.2	236.8	233.9
ηs,c recommended combination 3					230.4	238.2	233.1
ηs,h			%		157.8	163.1	156.6
ηs,h recommended combination 2					159.5	164.8	158.2
ηs,h recommended combination 3					156.8	159.6	153.4
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc	kW		2.1	1.9	
					45.0	50.4	52.0
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW		3.9	3.8	3.7
					33.2	37.1	38.3
Space cooling recommended combination 2	C Condi- tion (25°C - 27/19)	EERd Pdc	kW		7.7	7.5	7.3
					21.3	23.9	24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW		14.2	18.3	
					9.5	11.5	
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	EERd Pdc	kW		2.1	1.9	
					45.0	50.4	52.0
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW		3.8	3.7	3.6
					33.2	37.1	38.3
Space cooling recommended combination 2	C Condi- tion (25°C - 27/19)	EERd Pdc	kW		7.6	7.5	7.3
					21.3	23.9	24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW		14.0	18.1	18.9
					9.5	11.4	10.9
Space cooling recommended combination 3	A Condi- tion (35°C - 27/19)	EERd Pdc	kW		2.1	1.9	
					45.0	50.4	52.0
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW		3.7		3.6
					33.2	37.1	38.3
Space cooling recommended combination 3	C Condi- tion (25°C - 27/19)	EERd Pdc	kW		7.4	7.6	7.3
					21.3	23.9	24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW		14.1	18.3	
					9.5	11.6	
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.2	1.9	1.8
		Pdh (declared heating cap)	kW		23.2	27.9	31.0
		Tbiv (bivalent temperature)	°C			-10	
	TOL	COPd (declared COP)			2.2	1.9	1.8
		Pdh (declared heating cap)	kW		23.2	27.9	31.0
		Tol (temperature operating limit)	°C			-10	
	A Con- dition (-7°C)	COPd (declared COP)			2.6	2.4	2.1
		Pdh (declared heating cap)	kW		20.5	24.7	27.4
	B Condi- tion (2°C)	COPd (declared COP)			3.5	3.7	3.6
		Pdh (declared heating cap)	kW		12.5	15.0	16.7
	C Condi- tion (7°C)	COPd (declared COP)			6.3	6.7	6.5
		Pdh (declared heating cap)	kW		8.0	9.7	10.7
	D Con- dition (12°C)	COPd (declared COP)			8.6	9.0	9.1
		Pdh (declared heating cap)	kW		4.9	7.1	

2 Specifications

1 - 1 RYYQ-U

Technical Specifications					RYYQ16U		RYYQ18U		RYYQ20U		
Space heating (Average climate) recommended combination 2	A Con- dition (-7°C)	COPd (declared COP)			2.6		2.4		2.2		
		Pd _h (declared heating cap) kW			20.5		24.7		27.4		
	B Condi- tion (2°C)	COPd (declared COP)			3.5		3.8		3.7		
		Pd _h (declared heating cap) kW			12.2		15.0		16.7		
	C Condi- tion (7°C)	COPd (declared COP)			6.3		6.8		6.5		
		Pd _h (declared heating cap) kW			8.0		9.7		10.7		
	D Con- dition (12°C)	COPd (declared COP)			8.7		9.1		9.2		
		Pd _h (declared heating cap) kW			5.0		7.2				
	TBivalent		COPd (declared COP)			2.2		1.9		1.8	
		Pd _h (declared heating cap) kW			23.2		27.9		31.0		
		Tbiv (bivalent temperature) °C					-10				
Space heating (Average climate) recommended combination 2	TOL	COPd (declared COP)			2.2		1.9		1.8		
		Pd _h (declared heating cap) kW			23.2		27.9		31.0		
		Tol (temperature operating limit)					-10				
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)			2.6		2.4		2.1		
		Pd _h (declared heating cap) kW			20.5		24.7		27.4		
	B Condi- tion (2°C)	COPd (declared COP)			3.5		3.7		3.6		
		Pd _h (declared heating cap) kW			12.5		15.0		16.7		
	C Condi- tion (7°C)	COPd (declared COP)			6.2		6.5		6.3		
		Pd _h (declared heating cap) kW			8.0		9.7		10.7		
	D Con- dition (12°C)	COPd (declared COP)			8.6		8.7				
		Pd _h (declared heating cap) kW			4.9		6.9				
	TBivalent		COPd (declared COP)			2.2		1.9		1.8	
			Pd _h (declared heating cap) kW			23.2		27.9		31.0	
			Tbiv (bivalent temperature) °C					-10			
	TOL		COPd (declared COP)			2.2		1.9		1.8	
			Pd _h (declared heating cap) kW			23.2		27.9		31.0	
			Tol (temperature operating limit)					-10			
	Capacity range				HP	16		18		20	
PED	Category				Category II						
	Most critical part	Name Ps*V									

2 Specifications

1 - 1 RYYQ-U

2

Technical Specifications					RYYQ16U	RYYQ18U	RYYQ20U
Operation range	Cooling	Min.	°CDB			-5.0	
		Max.	°CDB			43.0	
	Heating	Min.	°CWB			-20.0	
		Max.	°CWB			15.5	
Sound power level	Cooling	Nom.	dBA		85.6 (4)	83.8 (4)	87.9 (4)
	Heating	Prated,h	dBA		86.5 (4)	85.3 (4)	89.8 (4)
Sound pressure level	Cooling	Nom.	dBA		63.0 (5)	62.0 (5)	65.0 (5)
Refrigerant	Type					R-410A	
	GWP					2,087.5	
	Charge		TCO2Eq		21.7	24.4	24.6
	Charge		kg		10.4	11.7	11.8
Refrigerant oil	Type					Synthetic (ether) oil FVC68D	
Piping connections	Liquid	Type				Braze connection	
		OD	mm		12.7	15.9	
	Gas	Type				Braze connection	
		OD	mm			28.6	
	Total piping length	System	Actual	m		1,000 (6)	
Defrost method						Reversed cycle	
Capacity control	Method					Inverter controlled	
Indication if the heater is equipped with a supplementary heater						no	
Supplementary heater	Back-up capacity	Heating	elbu	kW		0.0	
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW		0.000	
		Heating	PCK	kW	0.077	0.089	
	Off mode	Cooling	POFF	kW	0.074	0.075	
		Heating	POFF	kW	0.077	0.089	
	Standby mode	Cooling	PSB	kW	0.074	0.075	
		Heating	PSB	kW	0.077	0.089	
	Thermo-stat-off mode	Cooling	PTO	kW		0.010	
		Heating	PTO	kW	0.097	0.098	
Cooling	Cdc (Degradation cooling)					0.25	
Heating	Cdh (Degradation heating)					0.25	
Safety devices	Item	01				High pressure switch	
		02				Fan driver overload protector	
		03				Inverter overload protector	
		04				PC board fuse	
		05				Leakage current detector	

Standard accessories: Installation manual; Quantity: 1;

Standard accessories: Operation manual; Quantity: 1;

Standard accessories: Connection pipes; Quantity: 1;

Electrical Specifications					RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U
Power supply	Name					Y1		
	Phase					3N~		
	Frequency		Hz			50		
	Voltage		V			380-415		
Power supply intake						Both indoor and outdoor unit		
Voltage range	Min.		%			-10		
	Max.		%			10		
Current	Nominal running current (RLA)	Cooling	A		7.2 (7)	10.2 (7)	12.7 (7)	15.4 (7)
Current - 50Hz	Nominal running current (RLA)	Combina-tion A	Cooling			-		
		Combina-tion B	Cooling			-		
	Starting current (MSC) - remark					See note 8		
	Zmax List					No requirements		
	Minimum Ssc value		kVa		4,050 (8)	5,535 (8)	6,038 (8)	6,793 (8)
	Minimum circuit amps (MCA)		A		16.1 (9)	22.0 (9)	24.0 (9)	27.0 (9)
	Maximum fuse amps (MFA)		A		20 (10)	25 (10)	32 (10)	
	Full load amps (FLA)	Total	A		1.2 (11)	1.3 (11)	1.5 (11)	1.8 (11)

2 Specifications

1 - 1 RYYQ-U

Electrical Specifications			RYYQ8U	RYYQ10U	RYYQ12U	RYYQ14U
Power Performance	Power factor	Combina- 35°C ISO - Full load				
		tion B 46°C ISO - Full load				
Wiring connections - 50Hz	For power supply	Quantity	5G			
	For connection with indoor	Quantity	2			
		Remark	F1,F2			

Electrical Specifications			RYYQ16U	RYYQ18U	RYYQ20U
Power supply	Name		Y1		
	Phase		3N~		
	Frequency	Hz	50		
	Voltage	V	380-415		
Power supply intake			Both indoor and outdoor unit		
Voltage range	Min.	%	-10		
	Max.	%	10		
Current	Nominal running current (RLA)	Cooling A	18.0 (7)	20.8 (7)	26.9 (7)
Current - 50Hz	Nominal running current (RLA)	Combina- Cooling tion A	-		
		Combina- Cooling tion B	-		
	Starting current (MSC) - remark		See note 8		
	Zmax	List	No requirements		
	Minimum Ssc value	kVa	7,547 (8)	8,805 (8)	9,812 (8)
	Minimum circuit amps (MCA)	A	31.0 (9)	35.0 (9)	39.0 (9)
	Maximum fuse amps (MFA)	A	40 (10)		50 (10)
	Full load amps (FLA)	Total A	2.6 (11)		
Power Performance	Power factor	Combina- 35°C ISO - Full load	-		
		tion B 46°C ISO - Full load	-		
Wiring connections - 50Hz	For power supply	Quantity	5G		
	For connection with indoor	Quantity	2		
		Remark	F1,F2		

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

(3)Actual number of connectable indoor units depends on the indoor unit type (VRV indoor, Hydrobox, RA indoor, etc.) and the connection ratio restriction for the system (50% <= CR <= 130%) |

(4)Sound power level is an absolute value that a sound source generates. |

(5)Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings. |

(6)Refer to refrigerant pipe selection or installation manual |

(7)RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB |

(8)In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Ssc ≥ minimum Ssc value |

(9)MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current. |

(10)MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

(11)FLA means the nominal running current of the fan |

MSC means the maximum current during start up of the compressor. This unit uses only inverter compressors. Starting current is always ≤ max. running current. |

Maximum allowable voltage range variation between phases is 2%. |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

The AUTOMATIC ESEER value corresponds with normal VRV4 Heat Pump operation, taking into account advanced energy saving operation functionality (variable refrigerant temperature) |

The STANDARD ESEER value corresponds with normal VRV4 Heat Pump operation, not taking into account advanced energy saving operation functionality |

Sound values are measured in a semi-anechoic room. |

Soundpressure system [dBA] = 10*log[10^(A/10)+10^(B/10)+10^(C/10)] , with Unit A = A dBA, Unit B = B dBA, Unit C = C dBA |

EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current > 16A and ≤ 75A per phase |

Ssc: Short-circuit power |

For detailed contents of standard accessories, see installation/operation manual |

Multi combination (22~54HP) data is corresponding with the standard multi combination

Technical specifications System		RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U
System	Outdoor unit module 1	RYMQ10U	RYMQ8U	RYMQ12U		
	Outdoor unit module 2	RYMQ12U	RYMQ16U	RYMQ14U	RYMQ16U	RYMQ18U
Recommended combination		6 x FXFQ50AVEB + 4 x FXFQ63AVEB	4 x FXFQ50AVEB + 4 x FXFQ63AVEB + 2 x FXFQ80AVEB	7 x FXFQ50AVEB + 5 x FXFQ63AVEB	6 x FXFQ50AVEB + 4 x FXFQ63AVEB + 2 x FXFQ80AVEB	9 x FXFQ50AVEB + 5 x FXFQ63AVEB
Recommended combination 2		6 x FXSQ50A2VEB + 4 x FXSQ63A2VEB	4 x FXSQ50A2VEB + 4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	7 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	6 x FXSQ50A2VEB + 4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	9 x FXSQ50A2VEB + 5 x FXSQ63A2VEB

2 Specifications

1 - 1 RYYQ-U

2

Technical specifications System				RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U	
Recommended combination 3				6 x FXMQ50P7VEB + 4 x FXMQ63P7VEB	4 x FXMQ50P7VEB + 4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	7 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	6 x FXMQ50P7VEB + 4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	9 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	
Continuous heating				Yes					
Cooling capacity	Prated,c		kW	61.5 (1)	67.4 (1)	73.5 (1)	78.5 (1)	83.9 (1)	
Heating capacity	Nom.	6°CWB	kW	61.5 (2)	67.4 (2)	73.5 (2)	78.5 (2)	83.9 (2)	
	Prated,h		kW	61.5 (2)	67.4 (2)	73.5 (2)	78.5 (2)	83.9 (2)	
	Max.	6°CWB	kW	69.0 (2)	75.0 (2)	82.5 (2)	87.5 (2)	94.0 (2)	
Power input - 50Hz	Heating	Nom.	6°CWB	kW	17.23 (2)	17.94 (2)	20.33 (2)	22.19 (2)	23.87 (2)
COP at nom. capacity	6°CWB		kW/kW	3.57 (2)	3.76 (2)	3.61 (2)	3.54 (2)	3.51 (2)	
ESEER - Automatic				7.07	6.81	6.89	6.69	6.60	
ESEER - Standard				5.58	5.42	5.39	5.23	5.17	
SCOP				4.4	4.3	4.2		4.3	
SCOP recommended combination 2				4.4	4.3	4.2		4.3	
SCOP recommended combination 3				4.3	4.2				4.3
SEER				6.9	6.8	6.7	6.5		
SEER recommended combination 2				6.7	6.6	6.5	6.3		
SEER recommended combination 3				6.9	6.7	6.6	6.4	6.5	
ηs,c			%	274.5	269.9	264.2	257.8	256.8	
ηs,c recommended combination 2				266.5	262.6	256.1	249.3	249.8	
ηs,c recommended combination 3				273.3	265.3	261.1	253.1	256.1	
ηs,h			%	171.2	167.0	164.6	166.0	169.8	
ηs,h recommended combination 2				172.3	167.1	165.4	166.8	170.6	
ηs,h recommended combination 3				170.2	165.5	164.5	165.0	167.0	
Space cooling	A Condi- tion (35°C Pdc - 27/19)	EERd	kW	2.6	2.5	2.6	2.3	2.1	
				61.5	67.4	73.5	78.5	83.9	
	B Condi- tion (30°C Pdc - 27/19)	EERd	kW	4.8	4.6		4.4	4.3	
				45.3	49.7	54.2	57.8	61.8	
	C Condi- tion (25°C Pdc - 27/19)	EERd	kW	8.5	8.6	8.2	8.1	8.2	
			29.1	31.9	34.8	37.2	39.7		
	D Condi- tion (20°C Pdc - 27/19)	EERd	kW	16.0	15.2	14.2	14.3	16.8	
			kW	18.8	15.8	16.2	16.5	21.0	
Space cooling recommended combination 2	A Condi- tion (35°C Pdc - 27/19)	EERd	kW	2.6	2.4	2.6	2.3	2.1	
				61.5	67.4	73.5	78.5	83.9	
	B Condi- tion (30°C Pdc - 27/19)	EERd	kW	4.6	4.5	4.4	4.3	4.2	
				45.3	49.7	54.1	57.8	61.8	
	C Condi- tion (25°C Pdc - 27/19)	EERd	kW	8.2	8.4	7.9	7.8	7.9	
			29.1	31.9	34.8	37.2	39.7		
	D Condi- tion (20°C Pdc - 27/19)	EERd	kW	15.6	14.7	13.6	13.8	16.1	
			kW	18.4	15.4	15.7	16.5	20.5	
Space cooling recommended combination 3	A Condi- tion (35°C Pdc - 27/19)	EERd	kW	2.5			2.3	2.1	
				61.5	67.4	73.5	78.5	83.9	
	B Condi- tion (30°C Pdc - 27/19)	EERd	kW	4.8	4.5		4.3		
				45.3	49.7	54.2	57.8	61.8	
	C Condi- tion (25°C Pdc - 27/19)	EERd	kW	8.5	8.4	8.1	8.0	8.2	
			29.1	31.9	34.8	37.2	39.7		
	D Condi- tion (20°C Pdc - 27/19)	EERd	kW	15.8	15.2	14.0	14.1	16.6	
			kW	18.8	15.7	16.0	16.6	21.0	

2 Specifications

1 - 1 RYYQ-U

Technical specifications System				RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.3	2.5	2.3	2.2	2.1
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
		Tbiv (bivalent temperature) °C		-10				
	TOL	COPd (declared COP)		2.3	2.5	2.3	2.2	2.1
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
		Tol (temperature operating limit) °C		-10				
	A Con- dition (-7°C)	COPd (declared COP)		2.6	2.8	2.6		
		Pdh (declared heating cap) kW		30.4	32.6	34.5	36.8	41.0
	B Condi- tion (2°C)	COPd (declared COP)		4.0	3.7	3.8		
		Pdh (declared heating cap) kW		18.5	19.9	21.0	22.4	24.9
Space heating (Average climate) recommended combination 2	C Condi- tion (7°C)	COPd (declared COP)		6.3		6.1	6.2	6.5
		Pdh (declared heating cap) kW		11.9	13.0	13.5	14.4	16.0
	D Con- dition (12°C)	COPd (declared COP)		8.2	8.9	8.8	9.0	
		Pdh (declared heating cap) kW		6.0	5.7	6.0	6.4	7.1
	A Con- dition (-7°C)	COPd (declared COP)		2.6	2.7	2.6		
		Pdh (declared heating cap) kW		30.4	32.6	34.5	36.8	41.0
	B Condi- tion (2°C)	COPd (declared COP)		4.1	3.7	3.8		
		Pdh (declared heating cap) kW		18.5	19.9	21.0	22.4	24.9
	C Condi- tion (7°C)	COPd (declared COP)		6.3		6.1	6.3	6.6
		Pdh (declared heating cap) kW		11.9	13.1		14.4	16.0
Space heating (Average climate) recommended combination 2	D Con- dition (12°C)	COPd (declared COP)		8.4	9.0	8.9	9.1	
		Pdh (declared heating cap) kW		6.0	5.7	6.0	6.4	7.2
	TBivalent	COPd (declared COP)		2.2	2.4	2.2		
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
	TOL	Tbiv (bivalent temperature) °C		-10				
		COPd (declared COP)		2.2	2.4	2.2		
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
	TOL	Tol (temperature operating limit) °C		-10				
		COPd (declared COP)		2.3	2.4	2.2		
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)		2.6	2.7	2.6		
		Pdh (declared heating cap) kW		30.4	32.6	34.5	36.8	41.0
	B Condi- tion (2°C)	COPd (declared COP)		4.0	3.7	3.8		
		Pdh (declared heating cap) kW		18.5	19.9	21.0	22.4	24.9
	C Condi- tion (7°C)	COPd (declared COP)		6.2	6.3	6.1	6.2	6.3
		Pdh (declared heating cap) kW		11.9	12.9	13.5	14.4	16.0
	D Con- dition (12°C)	COPd (declared COP)		8.2	8.9	8.8	9.0	8.6
		Pdh (declared heating cap) kW		6.0	5.7	6.0	6.4	7.1
	TBivalent	COPd (declared COP)		2.3	2.4	2.2		
		Pdh (declared heating cap) kW		34.4	36.9	39.0	41.6	46.3
		Tbiv (bivalent temperature) °C		-10				
Capacity range	PED	Category		Category II				
		Maximum number of connectable indoor units		64 (3)				
		Indoor index		275.0	300.0	325.0	350.0	375.0
	connection	Max.		715.0	780.0	845.0	910.0	975.0
		Indoor side		Air				
		Outdoor side		Air				
	Air flow rate	Cooling	Rated	m ³ /h	21,600	25,320	24,480	26,700
		Heating	Rated	m ³ /h	21,600	25,320	24,480	26,700
	Sound power level	Cooling	Nom.	dBA	84.8 (4)	86.3 (4)	85.3 (4)	87.6 (4)
		Heating	Prated,h	dBA	85.4 (4)	87.3 (4)	86.3 (4)	88.3 (4)
Sound pressure level	Cooling	Nom.		dBA	62.5 (5)	64.0 (5)	63.5 (5)	65.1 (5)
		Prated,h		dBA	62.5 (5)	64.0 (5)	63.5 (5)	65.1 (5)
	Refrigerant	Type		R-410A				
		GWP		2,087.5				
	Refrigerant oil	Type		Synthetic (ether) oil FVC68D				
		Piping connections		Braze connection				
	Liquid	Type		Braze connection				
		OD		mm				
	Gas	Type		Braze connection				
		OD		mm				

Specifications

1 - 1 RYYQ-U

2

Technical specifications System					RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U
Piping connections	Gas	OD	mm		28.6			34.9	
	Total	System	Actual	m			1,000 (6)		
	piping								
	length								
Indication if the heater is equipped with a supplementary heater							no		
Supplementary heater	Back-up capacity	Heating	elbu	kW			0.0		
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW			0.000		
		Heating	PCK	kW	0.103		0.129		0.141
	Off mode	Cooling	POFF	kW	0.081		0.115		0.116
		Heating	POFF	kW	0.103		0.129		0.141
	Standby mode	Cooling	PSB	kW	0.081		0.115		0.116
		Heating	PSB	kW	0.103		0.129		0.141
	Thermo-stat-off mode	Cooling	PTO	kW	0.009		0.014		
		Heating	PTO	kW	0.113		0.154		0.155
Cooling	Cdc (Degradation cooling)						0.25		
Heating	Cdh (Degradation heating)						0.25		

Technical specifications System					RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
System	Outdoor unit module 1					RYMQ16U		RYMQ8U	RYMQ10U
	Outdoor unit module 2				RYMQ16U	RYMQ18U	RYMQ20U	RYMQ10U	RYMQ12U
	Outdoor unit module 3					-		RYMQ20U	RYMQ18U
Recommended combination					8 x FXFQ63AVEB + 4 x FXFQ80AVEB	3 x FXFQ50AVEB + 9 x FXFQ63AVEB + 2 x FXFQ80AVEB	2 x FXFQ50AVEB + 10 x FXFQ63AVEB + 2 x FXFQ80AVEB	6 x FXFQ50AVEB + 10 x FXFQ63AVEB	9 x FXFQ50AVEB + 9 x FXFQ63AVEB
Recommended combination 2					8 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 9 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	2 x FXSQ50A2VEB + 10 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	6 x FXSQ50A2VEB + 10 x FXSQ63A2VEB	9 x FXSQ50A2VEB + 9 x FXSQ63A2VEB
Recommended combination 3					8 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	3 x FXMQ50P7VEB + 9 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	2 x FXMQ50P7VEB + 10 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	6 x FXMQ50P7VEB + 10 x FXMQ63P7VEB	9 x FXMQ50P7VEB + 9 x FXMQ63P7VEB
Continuous heating					Yes				
Cooling capacity	Prated,c			kW	90.0 (1)	95.4 (1)	97.0 (1)	102.4 (1)	111.9 (1)
Heating capacity	Nom.	6°CWB		kW	90.0 (2)	95.4 (2)	101.0 (2)	106.4 (2)	111.9 (2)
	Prated,h			kW	90.0 (2)	95.4 (2)	101.0 (2)	106.4 (2)	111.9 (2)
	Max.	6°CWB		kW	100.0 (2)	106.5 (2)	113.0 (2)	119.5 (2)	125.5 (2)
Power input - 50Hz	Heating	Nom.	6°CWB	kW	25.08 (2)	26.76 (2)	30.02 (2)	30.45 (2)	31.45 (2)
COP at nom. capacity	6°CWB			kW/kW	3.59 (2)	3.56 (2)	3.36 (2)	3.49 (2)	3.56 (2)
ESEER - Automatic					6.50	6.44	6.02	6.36	6.74
ESEER - Standard					5.05	5.01	4.68	5.03	5.29
SCOP					4.2		4.1	4.3	
SCOP recommended combination 2					4.2	4.3	4.2	4.3	4.4
SCOP recommended combination 3					4.1	4.2	4.1	4.2	4.3
SEER					6.4		6.3	6.9	6.7
SEER recommended combination 2					6.3			6.8	6.6
SEER recommended combination 3							6.3	6.9	6.7
ηs,c				%	251.7	253.3	250.8	272.4	263.5
ηs,c recommended combination 2					248.3	250.9	248.7	269.2	259.2
ηs,c recommended combination 3					244.2	249.8	247.2	272.2	263.2
ηs,h				%	163.1	166.2	162.4	167.5	170.0
ηs,h recommended combination 2					164.6	167.7	164.1	168.4	171.3
ηs,h recommended combination 3					161.9	164.2	159.9	164.8	167.8
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc		kW	2.3	2.1		2.4	2.2
					90.0	95.4	97.0	102.4	111.9
	B Condi- tion (30°C - 27/19)	EERd Pdc		kW	4.3	4.2	4.1	4.5	
					66.3	70.3	71.5	75.5	82.5
	C Condi- tion (25°C - 27/19)	EERd Pdc		kW	8.1		7.9	8.5	8.3
					42.6	45.2	45.9	48.5	53.0
	D Condi- tion (20°C - 27/19)	EERd Pdc		kW	14.3	16.8	16.7	17.9	16.0
					19.0	20.1	20.4	21.6	23.6
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	EERd			2.2	2.1		2.3	2.2

2 Specifications

1 - 1 RYYQ-U

Technical specifications System				RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	Pdc	kW	90.0	95.4	97.0	102.4	111.9
	B Condi- tion (30°C - 27/19)	EERd		4.2		4.1	4.5	4.4
		Pdc	kW	66.3	70.3	71.5	75.4	82.4
	C Condi- tion (25°C - 27/19)	EERd		8.0	8.1	7.9	8.4	8.1
		Pdc	kW	42.6	45.2	45.9	48.5	53.0
Space cooling recommended combination 3	D Condi- tion (20°C - 27/19)	EERd		14.0	16.5		17.8	15.9
		Pdc	kW	18.9	20.1	20.4	21.6	23.6
	A Condi- tion (35°C - 27/19)	EERd		2.2	2.1		2.4	2.2
		Pdc	kW	90.0	95.4	97.0	102.4	111.9
	B Condi- tion (30°C - 27/19)	EERd		4.1		4.0	4.5	4.4
Space heating (Average climate)		Pdc	kW	66.3	70.3	71.5	75.5	82.5
	C Condi- tion (25°C - 27/19)	EERd		7.8	8.0	7.8	8.5	8.4
		Pdc	kW	42.6	45.2	45.9	48.5	53.0
	D Condi- tion (20°C - 27/19)	EERd		13.8	16.6	16.5	17.9	16.1
		Pdc	kW	19.0	20.1	20.4	21.6	23.6
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.4	2.2	2.1	2.2	
		Pdh (declared heating cap)	kW	46.4	51.1	54.2	60.7	62.3
		Tbiv (bivalent temperature)	°C					
				-10				
	TOL	COPd (declared COP)		2.4	2.2	2.1	2.2	
		Pdh (declared heating cap)	kW	46.4	51.1	54.2	60.7	62.3
		Tol (temperature operating limit)	°C					
				-10				
	A Condi- tion (-7°C)	COPd (declared COP)		2.7	2.6	2.5		2.6
		Pdh (declared heating cap)	kW	41.0	45.2	47.9	53.7	55.1
	B Condi- tion (2°C)	COPd (declared COP)		3.6	3.7		3.9	4.0
		Pdh (declared heating cap)	kW	25.0	27.5	29.2	32.7	33.5
	C Condi- tion (7°C)	COPd (declared COP)		6.3	6.5	6.4	6.5	
		Pdh (declared heating cap)	kW	16.1	17.7	18.8	21.3	21.6
	D Con- dition (12°C)	COPd (declared COP)		9.0	8.8	8.6	8.7	
		Pdh (declared heating cap)	kW	7.1	7.9	8.3	13.1	
Space heating (Average climate) recommended combination 2	A Condi- tion (-7°C)	COPd (declared COP)		2.7	2.6	2.5		2.6
		Pdh (declared heating cap)	kW	41.0	45.2	47.9	53.7	55.1
	B Condi- tion (2°C)	COPd (declared COP)		3.6	3.8	3.7	3.9	4.0
		Pdh (declared heating cap)	kW	25.0	27.5	29.2	32.7	33.5
	C Condi- tion (7°C)	COPd (declared COP)		6.3	6.6	6.5		
		Pdh (declared heating cap)	kW	16.1	17.7	18.8	21.3	21.6
	D Con- dition (12°C)	COPd (declared COP)		9.1	8.9	8.8		
		Pdh (declared heating cap)	kW	7.1	7.9	8.3	13.2	
Space heating (Average climate) recommended combination 2	TBivalent	COPd (declared COP)		2.4	2.2		2.3	2.2
		Pdh (declared heating cap)	kW	46.4	51.1	54.2	60.7	62.3
		Tbiv (bivalent temperature)	°C					
				-10				
	TOL	COPd (declared COP)		2.4	2.2		2.3	2.2
		Pdh (declared heating cap)	kW	46.4	51.1	54.2	60.7	62.3
		Tol (temperature operating limit)	°C					
				-10				

2 Specifications

1 - 1 RYYQ-U

2

Technical specifications System					RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)			2.7	2.6	2.4	2.5	2.6
		Pd _h (declared heating cap) kW			41.0	45.2	47.9	53.7	55.1
	B Condi- tion (2°C)	COPd (declared COP)			3.6	3.7	3.6	3.8	3.9
		Pd _h (declared heating cap) kW			25.0	27.5	29.2	32.7	33.5
	C Condi- tion (7°C)	COPd (declared COP)			6.3	6.4	6.3		6.4
		Pd _h (declared heating cap) kW			16.1	17.7	18.8	21.2	21.6
	D Con- dition (12°C)	COPd (declared COP)			9.0	8.9	8.3	8.5	8.4
		Pd _h (declared heating cap) kW			7.1	7.9	8.3	12.9	12.8
	TBivalent	COPd (declared COP)			2.4	2.2	2.1	2.2	
		Pd _h (declared heating cap) kW			46.4	51.1	54.2	60.7	62.3
		Tbiv (bivalent temperature) °C			-10				
	TOL	COPd (declared COP)			2.4	2.2	2.1	2.2	
Pd _h (declared heating cap) kW			46.4	51.1	54.2	60.7	62.3		
Tol (temperature operating limit)			-10						
Capacity range				HP	32	34	36	38	40
PED	Category				Category II				
Maximum number of connectable indoor units					64 (3)				
Indoor index connection	Min.				400.0	425.0	450.0	475.0	500.0
	Max.				1,040.0	1,105.0	1,170.0	1,235.0	1,300.0
Heat exchanger	Indoor side				Air				
	Outdoor side				Air				
	Air flow rate	Cooling	Rated	m³/h	31,200	30,660	31,260	35,880	36,660
		Heating	Rated	m³/h	31,200	30,660	31,260	35,880	36,660
Sound power level	Cooling	Nom.		dBA	88.6 (4)	87.8 (4)	89.9 (4)	88.8 (4)	87.3 (4)
	Heating	Prated,h		dBA	89.5 (4)	88.9 (4)	91.5 (4)	90.7 (4)	88.4 (4)
Sound pressure level	Cooling	Nom.		dBA	66.0 (5)	65.5 (5)	67.1 (5)	66.2 (5)	65.2 (5)
Refrigerant	Type				R-410A				
	GWP				2,087.5				
Refrigerant oil	Type				Synthetic (ether) oil FVC68D				
Piping connections Liquid	Type	Brazing connection			19.1				
		OD			mm				
Piping connections Gas	Type	Brazing connection			41.3				
		OD			mm				
	Total piping length	System	Actual	m	1,000 (6)				
						34.9			
Indication if the heater is equipped with a supplementary heater					no				
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0				
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW	0.000				
		Heating	PCK	kW	0.154	0.166		0.192	
	Off mode	Cooling	POFF	kW	0.149	0.150		0.157	
		Heating	POFF	kW	0.154	0.166		0.192	
	Standby mode	Cooling	PSB	kW	0.149	0.150		0.157	
		Heating	PSB	kW	0.154	0.166		0.192	
	Thermo- stat-off mode	Cooling	PTO	kW	0.019				
		Heating	PTO	kW	0.195	0.196		0.211	
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				

Technical specifications System			RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U
System	Outdoor unit module 1		RYMQ10U	RYMQ12U	RYMQ14U	RYMQ16U	
	Outdoor unit module 2		RYMQ16U				
	Outdoor unit module 3		RYMQ16U				RYMQ18U
Recommended combination			12 x FXFQ63AVEB + 4 x FXFQ80AVEB	6 x FXFQ50AVEB + 8 x FXFQ63AVEB + 4 x FXFQ80AVEB	1 x FXFQ50AVEB + 13 x FXFQ63AVEB + 4 x FXFQ80AVEB	12 x FXFQ63AVEB + 6 x FXFQ80AVEB	3 x FXFQ50AVEB + 13 x FXFQ63AVEB + 4 x FXFQ80AVEB
Recommended combination 2			12 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	6 x FXSQ50A2VEB + 8 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	1 x FXSQ50A2VEB + 13 x FXSQ63A2VEB + 4 x FXSQ80A2VEB	12 x FXSQ63A2VEB + 6 x FXSQ80A2VEB	3 x FXSQ50A2VEB + 13 x FXSQ63A2VEB + 4 x FXSQ80A2VEB
Recommended combination 3			12 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	6 x FXMQ50P7VEB + 8 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	1 x FXMQ50P7VEB + 13 x FXMQ63P7VEB + 4 x FXMQ80P7VEB	12 x FXMQ63P7VEB + 6 x FXMQ80P7VEB	3 x FXMQ50P7VEB + 13 x FXMQ63P7VEB + 4 x FXMQ80P7VEB
Continuous heating			Yes				
Cooling capacity	Prated,c	kW	118.0 (1)	123.5 (1)	130.0 (1)	135.0 (1)	140.4 (1)

2 Specifications

1 - 1 RYYQ-U

Technical specifications System				RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U
Heating capacity	Nom.	6°CWB	kW	118.0 (2)	123.5 (2)	130.0 (2)	135.0 (2)	140.4 (2)
	Prated,h		kW	118.0 (2)	123.5 (2)	130.0 (2)	135.0 (2)	140.4 (2)
	Max.	6°CWB	kW	131.5 (2)	137.5 (2)	145.0 (2)	150.0 (2)	156.5 (2)
Power input - 50Hz	Heating	Nom.	6°CWB	32.66 (2)	34.73 (2)	35.77 (2)	37.62 (2)	39.30 (2)
COP at nom.	6°CWB		kW/kW	3.61 (2)	3.56 (2)	3.63 (2)	3.59 (2)	3.57 (2)
capacity								
ESEER - Automatic				6.65	6.62	6.60	6.50	6.46
ESEER - Standard				5.19	5.17	5.13	5.05	5.02
SCOP				4.2			4.1	4.2
SCOP recommended combination 2				4.3			4.2	
SCOP recommended combination 3				4.2			4.1	4.2
SEER				6.6	6.5		6.4	
SEER recommended combination 2				6.6	6.3	6.4		6.3
SEER recommended combination 3				6.5	6.3		6.2	6.3
ηs,c			%	261.2	255.9	254.9	251.7	252.8
ηs,c recommended combination 2				259.3	249.2	252.2	248.3	250.0
ηs,c recommended combination 3				255.4	250.1	248.3	244.2	248.0
ηs,h			%	165.5	164.5	162.0	162.8	165.2
ηs,h recommended combination 2				167.3	165.6	163.5	164.3	166.7
ηs,h recommended combination 3				164.4	163.5	161.3	161.7	163.2
Space cooling	A Condi- EERd			2.3		2.4	2.3	2.1
	tion (35°C Pdc - 27/19)		kW	118.0	123.5	130.0	135.0	140.4
	B Condi- EERd			4.4			4.3	4.2
	tion (30°C Pdc - 27/19)		kW	86.9	91.0	95.8	99.5	103.4
	C Condi- EERd			8.2		8.1		
Space cooling recommended combination 2	tion (25°C Pdc - 27/19)		kW	55.9	58.5	61.6	64.0	66.5
	D Condi- EERd			15.4	14.4	14.3		15.9
	tion (20°C Pdc - 27/19)		kW	24.8	26.0	27.4	28.4	29.6
	A Condi- EERd			2.3			2.2	2.1
	tion (35°C Pdc - 27/19)		kW	118.0	123.5	130.0	135.0	140.4
Space cooling recommended combination 3	B Condi- EERd			4.4	4.3		4.2	
	tion (30°C Pdc - 27/19)		kW	86.9	91.0	95.8	99.5	103.5
	C Condi- EERd			8.2	7.9	8.1	8.0	
	tion (25°C Pdc - 27/19)		kW	55.9	58.5	61.6	63.9	66.5
	D Condi- EERd			15.3	14.0			15.6
Space cooling recommended combination 3	tion (20°C Pdc - 27/19)		kW	24.8	26.0	27.4	28.4	29.6
	A Condi- EERd			2.3			2.2	2.1
	tion (35°C Pdc - 27/19)		kW	118.0	123.5	130.0	135.0	140.4
	B Condi- EERd			4.3		4.2	4.1	
	tion (30°C Pdc - 27/19)		kW	87.0	91.0	95.8	99.5	103.5
Space cooling recommended combination 3	C Condi- EERd			8.0	7.9		7.8	7.9
	tion (25°C Pdc - 27/19)		kW	55.9	58.5	61.6	63.9	66.5
	D Condi- EERd			15.2	14.2	13.9	13.8	15.6
	tion (20°C Pdc - 27/19)		kW	24.8	26.0	27.4	28.4	29.6

2 Specifications

1 - 1 RYYQ-U

2

Technical specifications System					RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U	
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.4	2.3	2.4		2.3	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tbiv (bivalent temperature) °C			-10					
	TOL	COPd (declared COP)			2.4	2.3	2.4		2.3	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tol (temperature operating limit) °C			-10					
	A Con- dition (-7°C)	COPd (declared COP)			2.7					
		Pdh (declared heating cap) kW			55.2	57.3	59.3	61.6	65.7	
	B Condi- tion (2°C)	COPd (declared COP)			3.7		3.6		3.7	
		Pdh (declared heating cap) kW			33.6	34.9	36.1	37.5	40.0	
C Condi- tion (7°C)	COPd (declared COP)			6.3		6.2		6.3	6.5	
	Pdh (declared heating cap) kW			21.6	22.4	23.2	24.1	25.7		
D Con- dition (12°C)	COPd (declared COP)			8.6		8.7		8.8	8.9	
	Pdh (declared heating cap) kW			9.9	10.0	10.3	10.7	12.0		
Space heating (Average climate) recommended combination 2	A Con- dition (-7°C)	COPd (declared COP)			2.7					
		Pdh (declared heating cap) kW			55.2	57.3	59.3	61.6	65.7	
	B Condi- tion (2°C)	COPd (declared COP)			3.7		3.6		3.7	
		Pdh (declared heating cap) kW			33.6	34.9	36.1	37.5	40.0	
	C Condi- tion (7°C)	COPd (declared COP)			6.4		6.3		6.5	
		Pdh (declared heating cap) kW			21.6	22.4	22.8	24.1	25.7	
	D Con- dition (12°C)	COPd (declared COP)			8.7		8.8		8.9	9.0
		Pdh (declared heating cap) kW			10.0		10.3		10.7	12.2
Space heating (Average climate) recommended combination 2	TBivalent	COPd (declared COP)			2.4	2.3	2.4		2.3	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tbiv (bivalent temperature) °C			-10					
	TOL	COPd (declared COP)			2.4	2.3	2.4		2.3	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tol (temperature operating limit) °C			-10					
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)			2.7	2.6	2.7		2.6	
		Pdh (declared heating cap) kW			55.2	57.3	59.3	61.6	65.7	
	B Condi- tion (2°C)	COPd (declared COP)			3.7		3.6			
		Pdh (declared heating cap) kW			33.6	34.9	36.1	37.5	40.0	
	C Condi- tion (7°C)	COPd (declared COP)			6.3		6.2		6.4	
		Pdh (declared heating cap) kW			21.6	22.4	23.2	24.1	25.7	
	D Con- dition (12°C)	COPd (declared COP)			8.6		8.7		8.8	8.7
		Pdh (declared heating cap) kW			9.9	10.0	10.3	10.7	11.8	
	TBivalent	COPd (declared COP)			2.4	2.3	2.4		2.2	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tbiv (bivalent temperature) °C			-10					
	TOL	COPd (declared COP)			2.4	2.3	2.4		2.2	
		Pdh (declared heating cap) kW			62.4	64.8	67.0	69.6	74.3	
		Tol (temperature operating limit) °C			-10					
Capacity range				HP	42	44	46	48	50	
PED				Category	Category II					
Maximum number of connectable indoor units					64 (3)					
Indoor index connection	Min.				525.0	550.0	575.0	600.0	625.0	
	Max.				1,365.0	1,430.0	1,495.0	1,560.0	1,625.0	
Heat exchanger	Indoor side				Air					
	Outdoor side				Air					
	Air flow rate	Cooling	Rated	m³/h	41,700	42,300	44,580	46,800	46,260	
		Heating	Rated	m³/h	41,700	42,300	44,580	46,800	46,260	
Sound power level	Cooling	Nom.		dBA	89.1 (4)	89.8 (4)	89.3 (4)	90.4 (4)	89.8 (4)	
	Heating	Prated,h		dBA	90.1 (4)	90.5 (4)	90.4 (4)	91.3 (4)	90.9 (4)	
Sound pressure level	Cooling	Nom.		dBA	66.5 (5)	67.2 (5)	67.0 (5)	67.8 (5)	67.5 (5)	
Refrigerant	Type				R-410A					
	GWP				2,087.5					
Refrigerant oil	Type				Synthetic (ether) oil FVC68D					
Piping connections	Liquid	Type			Braze connection					
		OD			19.1					

2 Specifications

1 - 1 RYYQ-U

Technical specifications System					RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U
Piping connections Gas	Type				Braze connection				
	OD	mm			41.3				
	Total piping length	System	Actual	m	1,000 (6)				
Indication if the heater is equipped with a supplementary heater					no				
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0				
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000				
		Heating	PCK	kW	0.206		0.231		0.243
	Off mode	Cooling	POFF	kW	0.190		0.223		0.224
		Heating	POFF	kW	0.206		0.231		0.243
	Standby mode	Cooling	PSB	kW	0.190		0.223		0.224
		Heating	PSB	kW	0.206		0.231		0.243
	Thermo-stat-off mode	Cooling	PTO	kW	0.024		0.029		
		Heating	PTO	kW	0.251		0.292		0.293
	Cooling	Cdc (Degradation cooling)				0.25			
Heating	Cdh (Degradation heating)				0.25				

Technical specifications System					RYYQ52U		RYYQ54U	
System	Outdoor unit module 1				RYMQ16U		RYMQ18U	
	Outdoor unit module 2				RYMQ18U		RYMQ18U	
	Outdoor unit module 3				RYMQ18U		RYMQ18U	
Recommended combination					6 x FXFQ50AVEB + 14 x FXFQ63AVEB + 2 x FXFQ80AVEB		9 x FXFQ50AVEB + 15 x FXFQ63AVEB	
Recommended combination 2					6 x FXSQ50A2VEB + 14 x FXSQ63A2VEB + 2 x FXSQ80A2VEB		9 x FXSQ50A2VEB + 15 x FXSQ63A2VEB	
Recommended combination 3					6 x FXMQ50P7VEB + 14 x FXMQ63P7VEB + 2 x FXMQ80P7VEB		9 x FXMQ50P7VEB + 15 x FXMQ63P7VEB	
Continuous heating					Yes			
Cooling capacity	Prated,c			kW	145.8 (1)		151.2 (1)	
Heating capacity	Nom.	6°CWB		kW	145.8 (2)		151.2 (2)	
	Prated,h			kW	145.8 (2)		151.2 (2)	
	Max.	6°CWB		kW	163.0 (2)		169.5 (2)	
Power input - 50Hz	Heating	Nom.	6°CWB	kW	40.98 (2)		42.66 (2)	
COP at nom. capacity	6°CWB			kW/kW	3.56 (2)		3.54 (2)	
ESEER - Automatic					6.42		6.38	
ESEER - Standard					4.99		4.97	
SCOP					4.3		4.3	
SCOP recommended combination 2					4.3		4.2	
SCOP recommended combination 3					4.2		6.4	
SEER					6.4		6.4	
SEER recommended combination 2					6.4		6.4	
SEER recommended combination 3					6.4			
ηs,c				%	253.7		254.1	
ηs,c recommended combination 2					251.6		252.5	
ηs,c recommended combination 3					251.5		253.9	
ηs,h				%	167.2		169.4	
ηs,h recommended combination 2					168.7		170.8	
ηs,h recommended combination 3					164.4		166.0	
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc		kW	2.0		1.9	
					145.8		151.2	
	B Condi- tion (30°C - 27/19)	EERd Pdc		kW	4.2		4.1	
					107.4		111.4	
	C Condi- tion (25°C - 27/19)	EERd Pdc		kW	69.1		71.6	
					17.6		19.1	
D Condi- tion (20°C - 27/19)	EERd Pdc		kW	30.7		34.4		
				2.0		1.9		
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	EERd			2.0		1.9	

2 Specifications

1 - 1 RYYQ-U

Technical specifications System			RYYQ52U	RYYQ54U
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	Pdc	145.8	151.2
	B Condi- tion (30°C - 27/19)	EERd Pdc	4.1	111.4
	C Condi- tion (25°C - 27/19)	EERd Pdc	8.1	71.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	17.4 30.7	18.9 34.1
Space cooling recommended combination 3	A Condi- tion (35°C - 27/19)	EERd Pdc	2.0 145.8	1.9 151.2
	B Condi- tion (30°C - 27/19)	EERd Pdc	4.1	111.4
	C Condi- tion (25°C - 27/19)	EERd Pdc	8.0 69.1	8.2 71.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	17.5 30.7	19.1 34.7
Space heating (Average climate)	TBivalent	COPd (declared COP)	2.2	2.1
		Pdh (declared heating cap) kW	79.0	83.7
		Tbiv (bivalent temperature) °C	-10	
	TOL	COPd (declared COP)	2.2	2.1
		Pdh (declared heating cap) kW	79.0	83.7
		Tol (temperature operating limit) °C	-10	
	A Condi- tion (-7°C)	COPd (declared COP) Pdh (declared heating cap) kW	2.6 69.9	74.0
	B Condi- tion (2°C)	COPd (declared COP) Pdh (declared heating cap) kW	3.8 42.5	3.9 45.1
	C Condi- tion (7°C)	COPd (declared COP) Pdh (declared heating cap) kW	6.6 27.4	6.8 29.0
	D Con- dition (12°C)	COPd (declared COP) Pdh (declared heating cap) kW	9.0 14.2	
Space heating (Average climate) recommended combination 2	A Condi- tion (-7°C)	COPd (declared COP) Pdh (declared heating cap) kW	2.6 69.9	74.0
	B Condi- tion (2°C)	COPd (declared COP) Pdh (declared heating cap) kW	3.8 42.6	3.9 45.1
	C Condi- tion (7°C)	COPd (declared COP) Pdh (declared heating cap) kW	6.7 27.4	6.8 29.0
	D Con- dition (12°C)	COPd (declared COP) Pdh (declared heating cap) kW	9.1 14.4	
Space heating (Average climate) recommended combination 2	TBivalent	COPd (declared COP)	2.2	2.1
		Pdh (declared heating cap) kW	79.0	83.7
		Tbiv (bivalent temperature) °C	-10	
	TOL	COPd (declared COP)	2.2	2.1
		Pdh (declared heating cap) kW	79.0	83.7
		Tol (temperature operating limit) °C	-10	

2 Specifications

1 - 1 RYYQ-U

Technical specifications System					RYYQ52U			RYYQ54U			
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)			2.6			2.5			
		Pd _h (declared heating cap) kW			69.9			74.0			
	B Condi- tion (2°C)	COPd (declared COP)			3.7			3.8			
		Pd _h (declared heating cap) kW			42.5			45.1			
	C Condi- tion (7°C)	COPd (declared COP)			6.4			6.5			
		Pd _h (declared heating cap) kW			27.3			29.0			
	D Con- dition (12°C)	COPd (declared COP)			8.7						
		Pd _h (declared heating cap) kW			13.7						
	TBivalent	COPd (declared COP)			2.2			2.1			
		Pd _h (declared heating cap) kW			79.0			83.7			
		Tbiv (bivalent temperature) °C			-10						
	TOL	COPd (declared COP)			2.2			2.1			
		Pd _h (declared heating cap) kW			79.0			83.7			
		Tol (temperature operating limit)			-10						
Capacity range				HP	52			54			
PED	Category				Category II						
Maximum number of connectable indoor units					64 (3)						
Indoor index connection	Min.				650.0			675.0			
	Max.				1,690.0			1,755.0			
Heat exchanger	Indoor side				Air						
	Outdoor side				Air						
	Air flow rate	Cooling	Rated	m³/h	45,720			45,180			
		Heating	Rated	m³/h	45,720			45,180			
Sound power level	Cooling	Nom.		dBA	89.3 (4)			88.6 (4)			
	Heating	Prated,h		dBA	90.5 (4)			90.1 (4)			
Sound pressure level	Cooling	Nom.		dBA	67.1 (5)			66.8 (5)			
Refrigerant	Type				R-410A						
	GWP				2,087.5						
Refrigerant oil	Type				Synthetic (ether) oil FVC68D						
Piping connections Liquid	Type				Braze connection						
		OD			19.1						
Piping connections Gas	Type				Braze connection						
		OD			41.3						
	Total piping length	System	Actual	m	1,000 (6)						
Indication if the heater is equipped with a supplementary heater					no						
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0						
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW	0.000						
		Heating	PCK	kW	0.255			0.267			
	Off mode	Cooling	POFF	kW	0.225			0.226			
		Heating	POFF	kW	0.255			0.267			
	Standby mode	Cooling	PSB	kW	0.225			0.226			
		Heating	PSB	kW	0.255			0.267			
	Thermo- stat-off mode	Cooling	PTO	kW	0.029						
		Heating	PTO	kW	0.294						
Cooling	Cdc (Degradation cooling)				0.25						
Heating	Cdh (Degradation heating)				0.25						
Electrical specifications System					RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U		
Power supply	Name				Y1						
	Phase				3N~						
	Frequency				50						
	Voltage				380-415						
Power supply intake					Both indoor and outdoor unit						
Voltage range	Min.				-10						
	Max.				10						
Current	Nominal running current (RLA)	Cooling	A		22.9 (7)	25.2 (7)	28.1 (7)	30.7 (7)	33.5 (7)		

2 Specifications

1 - 1 RYYQ-U

2

Electrical specifications System			RYYQ22U	RYYQ24U	RYYQ26U	RYYQ28U	RYYQ30U
Current - 50Hz	Nominal running current (RLA)	Combina- Cooling tion A Combina- Cooling tion B	-				
	Starting current (MSC) - remark		See note 8				
	Zmax List		No requirements				
	Minimum Ssc value	kVa	11,573 (8)	11,597 (8)	12,831 (8)	13,585 (8)	14,843 (8)
	Minimum circuit amps (MCA)	A	46.0 (9)		51.0 (9)	55.0 (9)	59.0 (9)
	Maximum fuse amps (MFA)	A	63 (10)				80 (10)
Power Performance	Power factor	Combina- 35°C ISO - Full load tion B 46°C ISO - Full load	-				
	Wiring connections - 50Hz	For power supply For connection with indoor	5G				
	For power supply	Quantity	2				
	For connection with indoor	Quantity Remark	F1,F2				

Electrical specifications System				RYYQ32U	RYYQ34U	RYYQ36U	RYYQ38U	RYYQ40U
Power supply	Name			Y1				
	Phase			3N~				
	Frequency Hz			50				
	Voltage V			380-415				
Power supply intake				Both indoor and outdoor unit				
Voltage range	Min. %			-10				
	Max. %			10				
Current	Nominal running current (RLA)	Cooling	A	36.0 (7)	38.8 (7)	44.9 (7)	44.3 (7)	43.7 (7)
Current - 50Hz	Nominal running current (RLA)	Combina- Cooling	tion A	-				
		Combina- Cooling						
	Starting current (MSC) - remark			See note 8				
	Zmax List			No requirements				
	Minimum Ssc value kVa			15,094 (8)	16,352 (8)	17,359 (8)	19,397 (8)	20,378 (8)
	Minimum circuit amps (MCA) A			62.0 (9)	66.0 (9)	70.0 (9)	76.0 (9)	81.0 (9)
	Maximum fuse amps (MFA) A			80 (10)			100 (10)	
Power Performance	Power factor	Combina- 35°C ISO - Full load	-					
		tion B 46°C ISO - Full load						
Wiring connections - 50Hz	For power supply	Quantity			5G			
	For connection with indoor	Quantity			2			
		Remark			F1,F2			

Electrical specifications System			RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U
Power supply	Name		Y1				
	Phase		3N~				
	Frequency	Hz	50				
	Voltage	V	380-415				
Power supply intake			Both indoor and outdoor unit				
Voltage range	Min.	%	-10				
	Max.	%	10				
Current	Nominal running current (RLA)	Cooling A	46.2 (7)	48.7 (7)	51.4 (7)	54.0 (7)	56.8 (7)
Current - 50Hz	Nominal running current (RLA)	Combina- Cooling tion A	-				
		Combina- Cooling tion B	-				
	Starting current (MSC) - remark		See note 8				
	Zmax List		No requirements				
	Minimum Ssc value	kVa	20,629 (8)	21,132 (8)	21,887 (8)	22,641 (8)	23,899 (8)
	Minimum circuit amps (MCA)	A	84.0 (9)	86.0 (9)	89.0 (9)	93.0 (9)	97.0 (9)
	Maximum fuse amps (MFA)	A	100 (10)			125 (10)	
Power Performance	Power factor	Combina- 35°C ISO - Full load tion B 46°C ISO - Full load	-				
			-				

2 Specifications

1 - 1 RYYQ-U

Electrical specifications System			RYYQ42U	RYYQ44U	RYYQ46U	RYYQ48U	RYYQ50U
Wiring connections - 50Hz	For power supply	Quantity	5G				
	For connection with indoor	Quantity	2				
	Remark		F1,F2				

Electrical specifications System				RYYQ52U		RYYQ54U	
Power supply	Name			Y1			
	Phase			3N~			
	Frequency		Hz	50			
	Voltage		V	380-415			
Power supply intake				Both indoor and outdoor unit			
Voltage range	Min.		%	-10			
	Max.		%	10			
Current	Nominal running current (RLA)	Cooling	A	59.6 (7)		62.4 (7)	
Current - 50Hz	Nominal running current (RLA)	Combina- tion A	Cooling	-			
	Nominal running current (RLA)	Combina- tion B	Cooling	-			
	Starting current (MSC) - remark			See note 8			
	Zmax	List		No requirements			
	Minimum Ssc value		kVa	25,157 (8)		26,415 (8)	
	Minimum circuit amps (MCA)		A	101.0 (9)		105.0 (9)	
	Maximum fuse amps (MFA)		A	125 (10)			
Power Performance	Power factor	Combina- tion B	35°C ISO - Full load	-			
			46°C ISO - Full load	-			
Wiring connections - 50Hz	For power supply	Quantity		5G			
	For connection with indoor	Quantity		2			
		Remark		F1,F2			

Technical specifications Module				RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U
Recommended combination				4 x FXFQ63AVEB	6 x FXFQ50AVEB	4 x FXFQ63AVEB + 2 x FXFQ80AVEB	4 x FXFQ50AVEB	1 x FXFQ50AVEB + 5 x FXFQ63AVEB	3 x FXFQ50AVEB + 5 x FXFQ63AVEB	2 x FXFQ50AVEB + 6 x FXFQ63AVEB
Recommended combination 2				4 x FXSQ63A2VEB	6 x FXSQ50A2VEB	4 x FXSQ63A2VEB + 2 x FXSQ80A2VEB	4 x FXSQ50A2VEB	1 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	3 x FXSQ50A2VEB + 5 x FXSQ63A2VEB	2 x FXSQ50A2VEB + 6 x FXSQ63A2VEB
Recommended combination 3				4 x FXMQ63P7VEB	6 x FXMQ50P7VEB	4 x FXMQ63P7VEB + 2 x FXMQ80P7VEB	4 x FXMQ50P7VEB	1 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	3 x FXMQ50P7VEB + 5 x FXMQ63P7VEB	2 x FXMQ50P7VEB + 6 x FXMQ63P7VEB
Cooling capacity	Prated,c		kW	28.0 (1)	33.5 (1)	45.0 (1)	22.4 (1)	40.0 (1)	50.4 (1)	52.0 (1)
Heating capacity	Nom.	6°CWB	kW	28.0 (2)	33.5 (2)	45.0 (2)	22.4 (2)	40.0 (2)	50.4 (2)	56.0 (2)
	Prated,h		kW	28.0 (2)	33.5 (2)	45.0 (2)	22.4 (2)	40.0 (2)	50.4 (2)	56.0 (2)
	Max.	6°CWB	kW	31.5 (2)	37.5 (2)	50.0 (2)	25.0 (2)	45.0 (2)	56.5 (2)	63.0 (2)
Power input - 50Hz	Heating	Nom.	6°CWB	kW	7.58 (2)	9.65 (2)	12.54 (2)	5.40 (2)	10.69 (2)	14.22 (2)
COP at nom. capacity	6°CWB		kW/kW	3.69 (2)	3.47 (2)	3.59 (2)	4.15 (2)	3.74 (2)	3.54 (2)	3.20 (2)
ESEER - Automatic				7.20	6.96	6.50	7.53	6.83	6.38	5.67
ESEER - Standard				5.67	5.50	5.05	6.37	5.31	4.97	4.42
SCOP				4.3	4.1	4.0	4.3	4.0	4.2	4.0
SCOP recommended combination 2				4.3		4.1	4.2	4.0	4.2	4.0
SCOP recommended combination 3					4.1	4.0	4.2	4.0	4.1	3.9
SEER				6.8	6.3	6.0	7.6	6.3	6.0	5.9
SEER recommended combination 2				6.8		5.9	6.9	6.3	6.0	5.9
SEER recommended combination 3				6.8	6.2	5.8	7.5	6.2	6.0	5.9
ηs,c			%	267.6	247.8	236.5	302.4	250.7	238.3	233.7
ηs,c recommended combination 2				270.5	233.5	234.2	273.6	250.0	236.8	233.9
ηs,c recommended combination 3				267.1	246.3	230.4	295.2	246.7	238.2	233.1
ηs,h			%	168.2	161.4	157.8	167.9	155.4	163.1	156.6
ηs,h recommended combination 2				170.6	161.3	159.5	165.4	157.2	164.8	158.2
ηs,h recommended combination 3				162.0	160.6	156.8	165.6	155.7	159.6	153.4

2 Specifications

1 - 1 RYYQ-U

2

Technical specifications Module				RYYMQ10U	RYYMQ12U	RYYMQ16U	RYYMQ8U	RYYMQ14U	RYYMQ18U	RYYMQ20U
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc	kW	2.3 28.0	2.4 33.5	2.1 45.0	3.0 22.4	2.6 40.0	1.9 50.4 52.0	
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW	4.7 20.6	4.3 24.7	3.9 33.2	5.2 16.5	4.1 29.5	3.8 37.1	3.7 38.3
	C Condi- tion (25°C - 27/19)	EERd Pdc	kW	8.3 13.3	7.7 15.9		9.5 10.6	7.8 18.9	7.5 23.9	7.3 24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW	17.0 9.3	13.9 9.4	14.2 9.5	18.8 8.0	14.3 8.4	18.3 11.5	
				2.4		2.1	2.6		1.9	
Space cooling recommended combination 2	A Condi- tion (35°C - 27/19)	EERd Pdc	kW	28.0	33.5	45.0	22.4	40.0	50.4	52.0
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW	4.7 20.6	4.0 24.7	3.8 33.2	4.9 16.5	4.1 29.5	3.7 37.1	3.6 38.3
	C Condi- tion (25°C - 27/19)	EERd Pdc	kW	8.5	7.1	7.6	8.8	7.9	7.5	7.3
Space cooling recommended combination 2	C Condi- tion (25°C - 27/19)	Pdc	kW	13.3	15.9	21.3	10.6	18.9	23.9	24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW	17.2 9.3	13.1 9.1	14.0 9.5	15.1 8.8	14.0 8.4	18.1 11.4	18.9 10.9
	A Condi- tion (35°C - 27/19)	EERd Pdc	kW	2.3 28.0	2.4 33.5	2.1 45.0	3.0 22.4	2.6 40.0	1.9 50.4 52.0	
Space cooling recommended combination 3	B Condi- tion (30°C - 27/19)	EERd Pdc	kW	4.7 20.6	4.2 24.7	3.7 33.2	5.1 16.5	4.0 29.5	3.7 37.1	3.6 38.3
	C Condi- tion (25°C - 27/19)	EERd Pdc	kW	8.4 13.3	7.7 15.9	7.4 21.3	9.6 10.6	7.7 19.0	7.6 23.9	7.3 24.6
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW	16.9 9.3	13.7 9.4	14.1 9.5	16.0 9.1	14.0 8.4	18.3 11.6	
				2.4		2.0	2.2	2.5	2.3	1.9 1.8
				16.0		18.4	23.2	13.7	20.6	27.9 31.0
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.4	2.0	2.2	2.5	2.3	1.9	1.8
		Pdh (declared heating cap)	kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0
		Tbiv (bivalent temperature)	°C	-10						
	TOL	COPd (declared COP)		2.4	2.0	2.2	2.5	2.3	1.9	1.8
		Pdh (declared heating cap)	kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0
		Tol (temperature operating limit)	°C	-10						
	A Con- dition (-7°C)	COPd (declared COP)		2.6	2.4	2.6	2.7	2.6	2.4	2.1
		Pdh (declared heating cap)	kW	14.2	16.3	20.5	12.1	18.2	24.7	27.4
	B Condi- tion (2°C)	COPd (declared COP)		3.9		3.5	3.9	3.5	3.7	3.6
		Pdh (declared heating cap)	kW	8.6	9.9	12.5	7.4	11.1	15.0	16.7
	C Condi- tion (7°C)	COPd (declared COP)		6.4	6.1	6.3		6.1	6.7	6.5
		Pdh (declared heating cap)	kW	5.5	6.4	8.0	5.0	7.1	9.7	10.7
	D Con- dition (12°C)	COPd (declared COP)		8.2	7.9	8.6	7.9	8.5	9.0	9.1
		Pdh (declared heating cap)	kW	5.9	6.3	4.9	5.9	4.9	7.1	
Space heating (Average climate) recommended combination 2	A Con- dition (-7°C)	COPd (declared COP)		2.7	2.4	2.6	2.7	2.6	2.4	2.2
		Pdh (declared heating cap)	kW	14.2	16.3	20.5	12.1	18.2	24.7	27.4
	B Condi- tion (2°C)	COPd (declared COP)		4.0	3.9	3.5	3.9	3.5	3.8	3.7
		Pdh (declared heating cap)	kW	8.6	9.9	12.2	7.4	11.1	15.0	16.7
	C Condi- tion (7°C)	COPd (declared COP)		6.5	6.1	6.3		6.1	6.8	6.5
		Pdh (declared heating cap)	kW	5.5	6.4	8.0	5.0	7.1	9.7	10.7
	D Con- dition (12°C)	COPd (declared COP)		8.3	7.9	8.7	7.8	8.6	9.1	9.2
		Pdh (declared heating cap)	kW	6.0	6.4	5.0	5.9	4.9	7.2	
	TBivalent	COPd (declared COP)		2.4	1.9	2.2	2.4	2.3	1.9	1.8
		Pdh (declared heating cap)	kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0
Space heating (Average climate) recommended combination 2		Tbiv (bivalent temperature)	°C	-10						
	TOL	COPd (declared COP)		2.4	1.9	2.2	2.4	2.3	1.9	1.8
		Pdh (declared heating cap)	kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0
Space heating (Average climate) recommended combination 2	TOL	Pdh (declared heating cap)	kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0
		Tol (temperature operating limit)	°C	-10						

2 Specifications

1 - 1 RYYQ-U

Technical specifications Module					RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U		
Space heating (Average climate) recommended combination 3	A Con- dition (-7°C)	COPd (declared COP)			2.6	2.4	2.6	2.7	2.6	2.4	2.1		
		Pd _h (declared heating cap)		kW	14.2	16.3	20.5	12.1	18.2	24.7	27.4		
	B Condi- tion (2°C)	COPd (declared COP)			3.7	3.9	3.5	3.9	3.5	3.7	3.6		
		Pd _h (declared heating cap)		kW	8.6	9.9	12.5	7.4	11.1	15.0	16.7		
	C Condi- tion (7°C)	COPd (declared COP)			6.4	6.0	6.2		6.1	6.5	6.3		
		Pd _h (declared heating cap)		kW	5.5	6.4	8.0	4.9	7.1	9.7	10.7		
	D Con- dition (12°C)	COPd (declared COP)			8.1	7.8	8.6	7.8	8.5	8.7			
		Pd _h (declared heating cap)		kW	5.9	6.2	4.9	5.8	4.9	6.9			
	TBivalent	COPd (declared COP)			2.4	2.0	2.2	2.5	2.3	1.9	1.8		
		Pd _h (declared heating cap)		kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0		
		Tbiv (bivalent temperature)			°C								
	TOL	COPd (declared COP)			2.4	2.0	2.2	2.5	2.3	1.9	1.8		
		Pd _h (declared heating cap)		kW	16.0	18.4	23.2	13.7	20.6	27.9	31.0		
		Tol (temperature operating limit)			°C								
Capacity range				HP	10	12	16	8	14	18	20		
PED	Category				Category II								
	Most critical part	Name			Accumulator								
					325		415	325	415	493			
Maximum number of connectable indoor units					64 (3)								
Indoor index connection	Min.				125.0	150.0	200.0	100.0	175.0	225.0	250.0		
	Max.				325.0	390.0	520.0	260.0	455.0	585.0	650.0		
Dimensions	Unit	Height	mm		1,685								
		Width	mm		930		1,240	930	1,240				
		Depth	mm		765								
	Packed unit	Height	mm		1,820								
		Width	mm		995		1,305	995	1,305				
		Depth	mm		860								
Weight	Unit	kg		198		275	198	275	308				
	Packed unit	kg		211		291	211	291	324				
Packing	Material				Carton								
	Weight				1.8		2.2	1.8	2.2				
Packing 2	Material				Wood								
	Weight				11.0		14.0	11.0	14.0				
Packing 3	Material				Plastic								
	Weight				0.5		0.6	0.5	0.6				
Casing	Colour				Daikin White								
	Material				Painted galvanized steel plate								
Heat exchanger	Type				Cross fin coil								
	Indoor side				Air								
	Outdoor side				Air								
	Air flow rate	Cooling	Rated	m³/h	10,500	11,100	15,600	9,720	13,380	15,060	15,660		
Fan	Quantity				1		2	1	2				
	External static pressure	Max.			Pa		78						
Fan motor	Quantity				1		2	1	2				
	Type				DC motor								
Compressor	Output				W		550	750	550	750			
	Quantity				1		2	1	2				
Operation range	Type				Hermetically sealed scroll compressor								
	Crankcase heater				W		33						
	Cooling	Min.	°CDB		-5.0								
		Max.	°CDB		43.0								
Sound power level	Cooling	Min.	°CWB		-20.0								
		Max.	°CWB		15.5								
Sound pressure level	Cooling	Nom.	dBA		79.1 (4)	83.4 (4)	85.6 (4)	78.0 (4)	80.9 (4)	83.8 (4)	87.9 (4)		
		Prated,h	dBA		80.9 (4)	83.5 (4)	86.5 (4)	79.6 (4)	83.1 (4)	85.3 (4)	89.8 (4)		
Refrigerant	Cooling	Nom.	dBA		57.0 (5)	61.0 (5)	63.0 (5)	57.0 (5)	60.0 (5)	62.0 (5)	65.0 (5)		
		Prated,h	dBA		57.0 (5)	61.0 (5)	63.0 (5)	57.0 (5)	60.0 (5)	62.0 (5)	65.0 (5)		
Refrigerant oil	Type				R-410A								
	GWP				2,087.5								
	Charge				TCO2Eq		12.5	13.2	23.6	12.3	21.5	24.4	24.6
Refrigerant oil	Charge				kg		6.0	6.3	11.3	5.9	10.3	11.7	11.8
	Type				Synthetic (ether) oil FVC68D								

2 Specifications

1 - 1 RYYQ-U

2

Technical specifications Module					RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U	
Piping connections	Liquid	Type				Braze connection						
		OD	mm	9.52			12.7		9.52		12.7	15.9
	Gas	Type				Braze connection						
		OD	mm	22.2			28.6		19.1		28.6	
	Equalizing	Type				Braze connection						
		OD	mm	22.2					19.1		22.2	28.6
Total piping length	System	Actual	m	1,000 (6)								
Defrost method					Reversed cycle							
Capacity control	Method				Inverter controlled							
Indication if the heater is equipped with a supplementary heater					no							
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0							
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000							
		Heating	PCK	kW	0.052		0.077		0.052		0.077	0.089
	Off mode	Cooling	POFF	kW	0.041		0.074		0.041		0.074	0.075
		Heating	POFF	kW	0.052		0.077		0.052		0.077	0.089
	Standby mode	Cooling	PSB	kW	0.041		0.074		0.041		0.074	0.075
		Heating	PSB	kW	0.052		0.077		0.052		0.077	0.089
	Thermo-stat-off mode	Cooling	PTO	kW	0.005		0.010		0.005		0.010	
		Heating	PTO	kW	0.056		0.097		0.056		0.097	0.098
Cooling	Cdc (Degradation cooling)				0.25							
Heating	Cdh (Degradation heating)				0.25							
Safety devices	Item	01			High pressure switch							
		02			Fan driver overload protector							
		03			Inverter overload protector							
		04			PC board fuse							
		05			Leakage current detector							

Electrical specifications Module				RYMQ10U	RYMQ12U	RYMQ16U	RYMQ8U	RYMQ14U	RYMQ18U	RYMQ20U
Power supply	Name			Y1						
	Phase			3N~						
	Frequency Hz			50						
	Voltage V			380-415						
Power supply intake				Both indoor and outdoor unit						
Voltage range	Min. %			-10						
	Max. %			10						
Current	Nominal running current (RLA)	Cooling	A	10.2 (7)	12.7 (7)	18.0 (7)	7.2 (7)	15.4 (7)	20.8 (7)	26.9 (7)
Current - 50Hz	Nominal running current (RLA)	Combina- tion A	Cooling	-						
		Combina- tion B	Cooling	-						
	Starting current (MSC) - remark			See note 8						
	Zmax List			No requirements						
	Minimum Ssc value kVa			5,535 (8)	6,038 (8)	7,547 (8)	4,050 (8)	6,793 (8)	8,805 (8)	9,812 (8)
	Minimum circuit amps (MCA) A			22.0 (9)	24.0 (9)	31.0 (9)	16.1 (9)	27.0 (9)	35.0 (9)	39.0 (9)
	Maximum fuse amps (MFA) A			25 (10)	32 (10)	40 (10)	20 (10)	32 (10)	40 (10)	50 (10)
	Full load amps (FLA)	Total	A	1.3 (11)	1.5 (11)	2.6 (11)	1.2 (11)	1.8 (11)	2.6 (11)	
Power Performance	Power factor	Combina- tion B	35°C ISO - Full load	-						
			46°C ISO - Full load	-						
Wiring connections - 50Hz	For power supply	Quantity			5G					
	For connection with indoor	Quantity			2					
		Remark			F1,F2					

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

(3)Actual number of connectable indoor units depends on the indoor unit type (VRV indoor, Hydrobox, RA indoor, etc.) and the connection ratio restriction for the system (50% <= CR <= 130%) |

(4)Sound power level is an absolute value that a sound source generates. |

(5)Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings. |

(6)Refer to refrigerant pipe selection or installation manual |

(7)RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB |

(8)In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Ssc ≥ minimum Ssc value |

(9)MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current. |

2 Specifications

1 - 1 RYYQ-U

(10)MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

(11)FLA means the nominal running current of the fan |

MSC means the maximum current during start up of the compressor. This unit uses only inverter compressors. Starting current is always $\leq$ max. running current. |

Maximum allowable voltage range variation between phases is 2%. |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

The AUTOMATIC ESEER value corresponds with normal VRV4 Heat Pump operation, taking into account advanced energy saving operation functionality (variable refrigerant temperature) |

The STANDARD ESEER value corresponds with normal VRV4 Heat Pump operation, not taking into account advanced energy saving operation functionality |

Sound values are measured in a semi-anechoic room. |

Soundpressure system [dBA] = $10 \cdot \log[10^{A/10} + 10^{B/10} + 10^{C/10}]$, with Unit A = A dBA, Unit B = B dBA, Unit C = C dBA |

EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current $> 16A$ and $\leq 75A$ per phase |

Ssc: Short-circuit power |

For detailed contents of standard accessories, see installation/operation manual |

Multi combination (22~54HP) data is corresponding with the standard multi combination

3 Options

3 - 1 Options

RXYQ-U
RYYQ-U
RYMQ-U
RXYQQ-U

No	Item	RXYQ8U RYYQ8U RXYQQ8U	RXYQ10-12U RYYQ10-12U RXYQQ10-12U	RXYQ14-18U RYYQ14-18U RXYQQ14-18U	RXYQ20U RYYQ20U RXYQQ20U	RYYQ22~54U RXYQ22~54U RXYQQ22~42U		
I.	Refnet header	KHRQ22M29H						
		KHRQ22M64H						
		---	---	---	KHRQ22M75H			
II.	Refnet joint	KHRQ22M20T						
		KHRQ22M29T9						
		KHRQ22M64T						
		---	---	---	KHRQ22M75T			
III.	Outdoor multi-connection kit	See note -2-.	---	---	---	---	BHFQ22P1007	
IV.	Outdoor multi-connection kit	See note -2-.	---	---	---	---	BHFQ22P1517	
No	Item	8HP	10HP	12HP	14HP	16HP	18HP	20HP
1a	Cool/heat selector (switch)	See note -3-.	KRC19-26A					
1b	Cool/heat selector (PCB)	BRP2A81						
1c	Cool/heat selector (fixing box)	KJB111A						
2	VRV configurator	EKPCCAB*						
3	Heater tape kit PCB	EKBPH012T7A			EKBPH020T7A			
4	Demand PCB	See	DTA104A61/62*					
5	Demand PCB mounting plate	See note -4-.	---			KKS26B1*		

Notes

- All options are kits
- Only for multi units
- To mount option -1a-, option -1c- is required.
- To install the demand PCB on the large casing type, the demand PCB mounting plate is required.

Medium casing type -VRV4- heat pump: modules -8~12-HP

Large casing type -VRV4- heat pump: modules -14~20-HP

3D120006B

4 Combination table

4 - 1 Combination Table

REMQ5U

REYQ8-20U

RXYQQ8-20U

RXYTQ8-16UYF

RYYQ8-20U

RYMQ8-20U

Unit combination restrictions: VRV4 outdoor units (all models) + 15-class indoor units

Units in scope: FXZQ15A and FXAQ15A.

- In case the system contains these indoor units and the total connection ratio (CR) $\leq 100\%$: no special restrictions.
Follow the restrictions that apply to regular VRV DX indoor units.
- In case the system contains these indoor units and the total connection ratio (CR) $> 100\%$: special restrictions apply.
 - When the connection ratio (CR1) of the sum of all FXZQ15A and/or FXAQ15A units in the system $\leq 70\%$, and ALL other VRV DX indoor units have an individual capacity class > 50 : no special restrictions.
 - When the connection ratio (CR1) of the sum of all FXZQ15A and/or FXAQ15A units in the system $\leq 70\%$, and NOT ALL other VRV DX indoor units have an individual capacity class > 50 : the restrictions below apply.
 - $100\% < CR \leq 105\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 70\%$.
 - $105\% < CR \leq 110\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 60\%$.
 - $110\% < CR \leq 115\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 40\%$.
 - $115\% < CR \leq 120\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 25\%$.
 - $120\% < CR \leq 125\% \rightarrow$ CR1 of the sum of all FXZQ15A and/or FXAQ15A indoor units in the system must be $\leq 10\%$.
 - $125\% < CR \leq 130\% \rightarrow$ FXZQ15A and FXAQ15A cannot be used

REMARK

Only the 15-class indoor units explicitly mentioned on this page are in scope. Other indoor units follow the rules that apply to regular VRV DX indoor units.

3D104665

RXYQQ-U

RXYQ-U

RYYQ-U

RYMQ-U

Heat pump VRV4
Multi-unit standard combinations table

		1HP	1.5HP	2HP	2.5HP	3HP	3.5HP	4HP
Heat pump	RXYQ8* / RYQ8* / RYQ8*	1						
	RXYQ10* / RYQ10* / RYQ10*		1					
	RXYQ12* / RYQ12* / RYQ12*			1				
	RXYQ14* / RYQ14* / RYQ14*				1			
	RXYQ16* / RYQ16* / RYQ16*					1		
	RXYQ18* / RYQ18* / RYQ18*						1	
	RXYQ20* / RYQ20* / RYQ20*							1
	RXYQ22* / RYQ22* / RYQ22*		1	1				
	RXYQ24* / RYQ24* / RYQ24*				1			
	RXYQ26* / RYQ26* / RYQ26*			1	1			
Multi-combination with 2 outdoor units	RXYQ28* / RYQ28* / RYQ28*				1	1		
	RXYQ30* / RYQ30* / RYQ30*						1	
	RXYQ32* / RYQ32* / RYQ32*							1
	RXYQ34* / RYQ34* / RYQ34*						1	1
	RXYQ36* / RYQ36* / RYQ36*							1
	RXYQ38* / RYQ38* / RYQ38*							
	RXYQ40* / RYQ40* / RYQ40*							
	RXYQ42* / RYQ42* / RYQ42*							
	RXYQ44* / RYQ44* / RYQ44*							
	RXYQ46* / RYQ46* / RYQ46*							
Multi-combination with 3 outdoor units	RXYQ48* / RYQ48* / RYQ48*							
	RXYQ50* / RYQ50* / RYQ50*							
	RXYQ52* / RYQ52* / RYQ52*							
	RXYQ54* / RYQ54* / RYQ54*							
	RXYQ56* / RYQ56* / RYQ56*							
	RXYQ58* / RYQ58* / RYQ58*							
	RXYQ60* / RYQ60* / RYQ60*							
	RXYQ62* / RYQ62* / RYQ62*							
	RXYQ64* / RYQ64* / RYQ64*							
	RXYQ66* / RYQ66* / RYQ66*							

Remark

RYYQ8-20 = Single continuous heating

RYYQ22-54 Multi continuous heating

RXYQ8-20 = Single non-continuous heating

RXYQ22-54 Multi non-continuous heating

RXYQ8-20 Single non-continuous heating replacement (VRV4-Q)

RXYQ22-54 Multi non-continuous heating replacement (VRV4-Q)

1) For single unit installation RYYQ* units (continuous heating) and RXYQ* units (non-continuous heating)

2) "Non-continuous heating" multi-outdoor-unit combinations consist of RXYQ8-20 units (e.g. RXYQ36*=RXYQ16*+RXYQ20*).

3) "Continuous heating" multi-outdoor-unit combinations consist of RYMQ8-20 units (e.g. RYYQ36*=RYMQ16*+RYMQ20*).

→ RYMQ* units can only be used in multi-outdoor-unit combinations and cannot be used as standalone units.

4) RYYQ8-20 units cannot be used in multi-outdoor-unit combinations.

5) RYYQ8-20 "Continuous heating" multi-outdoor-unit combinations cannot contain RXYQ* units.

6) RXYQ8-20 "Non-continuous heating" multi-outdoor-unit combinations cannot contain RYMQ* units.

7) Multi "Non-continuous heating" replacement models only consist of RXYQ8-20 modules (e.g. RXYQ36*=RXYQ16*+RXYQ20*).

8) Replacement units cannot be combined with other units.

9) T-series outdoor units and U-series outdoor units cannot share the same refrigerant circuit. When combining these units, make sure they are part of separate refrigerant circuits.

3D120060

4 Combination table

4 - 1 Combination Table

RXYQ-U
RYYQ-U
RYMQ-U

VRV4
Heat pump
Indoor unit combination restrictions
(1/2)

Indoor unit combination pattern	VRV* DX indoor unit	RA DX indoor unit	Hydrobox unit	Air handling unit (AHU) ⁽³⁾
VRV* DX indoor unit	O	O	O	O
RA DX indoor unit	O	O	X	X
Hydrobox unit	O	X	O ₁	X
Air handling unit ⁽³⁾	O	X	X	O ₂

O: Allowed
X: Not allowed

Notes

- VRV* DX indoor unit
 - When combining VRV DX indoor units with other types of indoor units, respect the following combination patterns:
 - Example
Allowed : [VRV DX indoor unit + Hydrobox unit] or [VRV DX indoor unit + RA DX indoor unit] or [VRV DX indoor unit + AHU]
Not allowed : [VRV DX indoor unit + (RA DX indoor unit & (Hydrobox unit or AHU))] or [VRV DX indoor unit + (Hydrobox unit & (RA DX indoor unit or AHU))]
- O₁
 - Only connect Hydrobox units to a VRV IV Heat Pump in combination with a VRV DX indoor unit.
 - Refer to the connection ratio restrictions (3D079540 & 3D117169).
 - Connection with only Hydrobox units: refer to the Daikin Altherma solutions.
 - Only connect Hydrobox units of the HXY* series.
 - HXHD* series Hydrobox units are not allowed.
- O₂
 - Combination of AHU only + control box EKEQFA (the combination with VRV DX indoor units is not allowed; maximum 54HP for 400 + 2x500 class EKEQV kit)
 - X-control is possible (up to 3x [EKEQV+EKEQFA* boxes] can be connected to one outdoor unit (system)). No Variable Refrigerant Temperature control possible.
 - Y-control is possible (up to 3x [EKEQV+EKEQFA* boxes] can be connected to one outdoor unit (system)). No Variable Refrigerant Temperature control possible.
 - W-control is possible (up to 3x [EKEQV+EKEQFA* boxes] can be connected to one outdoor unit (system)). No Variable Refrigerant Temperature control possible.
 - Combination of AHU only + control box EKEQMA (not combined with VRV DX indoor units)
 - Z-control is possible (the allowed number of [EKEQV + EKEQMA boxes] is determined by the connection ratio (90-110%) and the capacity of the outdoor unit).
- Combination of AHU and VRV DX indoor units
 - Z-control is possible (EKEQMA* boxes are allowed, but with a limited connection ratio).
- The combination of AHU with Hydrobox units or RA DX indoor units is not allowed.
- (3) The following units are considered AHUs:
 - EKEQV + EKEQ(MA/FA) + AHU coil
 - Biddle air curtain
 - FXMQ_MF units

Information

- VKM units are considered to be regular VRV DX indoor units.

3D079543F

RXYQ-U
RYYQ-U
RYMQ-U

VRV4
Heat pump
Indoor unit combination restrictions
(2/2)

Combination table	RYYQ*	RYYQ*	RXYQ* RXMLQ* RXYLQ*	RXYQ* RXMLQ* RXYLQ*
	Single continuous heating	Multi continuous heating	Single non-continuous heating	Multi non-continuous heating
VRV* DX indoor unit	O	O	O	O
RA DX indoor unit	O	X	O	X
Hydrobox unit	O	O ₁	O	O ₁
Air handling unit (AHU) ⁽²⁾	O	O	O	O

O: Allowed
X: Not allowed

Notes

- O₁
 - Available upon request through the SPN procedure.
- (2) The following units are considered AHUs:
 - EKEQV + EKEQ(MA/FA) + AHU coil
 - Biddle air curtain
 - FXMQ_MF units

3D079543F

4 Combination table

4 - 1 Combination Table

RYYQ-U

RYYQ-U

Compatibility list: ·VRV4· heat pump - ·RA DX· indoor unit

Wall mounted type	Emura	FTXJ20M FTXJ25M FTXJ35M FTXJ50M
	Stylish	FTXA20 FTXA25 FTXA35 FTXA42 FTXA50
	FTXM	FTXM20R FTXM25R FTXM35R FTXM42R FTXM50R FTXM60R FTXM71R
Ceiling/wall mounted	Flex	FLXS25B FLXS35B FLXS50B FLXS60B
Floor standing type	FVXM	FVXM25F FVXM35F FVXM50F FVXM25A FVXM35A FVXM50A CVXM20A
	Nexura	FVXG25K FVXG35K FVXG50K

Remark

The limitations on the use of ·RA DX· indoor units with the ·VRV4· Heat Pump are subject to the rules set out in drawings ·3D079543· and ·3D079540·.

If you want to connect ·RA·/·SA· ·DX· cassette, ceiling-mounted, or duct indoor units, use their ·VRV DX· indoor unit equivalents instead.

3D082373G

5 Capacity tables


5 - 1 Capacity Table Legend

5

In order to fulfill more your requirements on quick access of data in the format you require, we have developed a tool to consult capacity tables.

Below you can find the link to the capacity table database and an overview of all the tools we have to help you select the correct product:

- **Capacity table database:** lets you find back and export quickly the capacity information you are looking for based upon unit model, refrigerant temperature and connection ratio.
- You can access the capacity table viewer here:
https://my.daikin.eu/content/denv/en_US/home/applications/software-finder/capacity-table-viewer.html



- An overview of **all software tools** that we offer can be found here:
https://my.daikin.eu/denv/en_US/home/applications/software-finder.html



5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ-U
RXYQ-U
RYYQ-U
RYMQ-U

VRV4 Heat pump Integrated heating capacity coefficient

The heating capacity tables do not take into account the capacity reduction in case of frost accumulation or defrost operation.
The capacity values that take these factors into account, or in other words, the integrated heating capacity values, can be calculated as follows:

Formula

A = Integrated heating capacity
B = Capacity characteristics value (see table)
C = Integrated correction factor for frost accumulation (see table)
 $A = B \cdot C$

Inlet air temperature of heat exchanger


[°C DB/°C WB]	1/7/7.6 or less	-5/-5.6	-3/-3.7	0/-0.7	3/2.2	5/4.1	7/6
Integrated correction factor for frost accumulation C							
8HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
10HP	0.95	0.93	0.87	0.79	0.80	0.88	1.00
12HP	0.95	0.92	0.87	0.75	0.76	0.85	1.00
14HP	0.95	0.92	0.86	0.72	0.73	0.84	1.00
16HP	0.95	0.92	0.86	0.72	0.72	0.83	1.00
18HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
20HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00
22HP	0.95	0.92	0.87	0.77	0.78	0.86	1.00
24HP	0.95	0.92	0.87	0.75	0.76	0.85	1.00
26HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
28HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
30HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
32HP	0.95	0.92	0.86	0.71	0.72	0.83	1.00
34HP	0.95	0.92	0.87	0.78	0.79	0.87	1.00
36HP	0.95	0.92	0.87	0.78	0.79	0.87	1.00
38HP	0.95	0.93	0.88	0.83	0.84	0.89	1.00
40HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
42HP	0.95	0.92	0.86	0.73	0.74	0.84	1.00
44HP	0.95	0.92	0.86	0.72	0.73	0.84	1.00
46HP	0.95	0.92	0.86	0.72	0.72	0.83	1.00
48HP	0.95	0.92	0.86	0.71	0.72	0.83	1.00
50HP	0.95	0.92	0.87	0.76	0.77	0.86	1.00
52HP	0.95	0.93	0.87	0.80	0.81	0.88	1.00
54HP	0.95	0.93	0.88	0.84	0.85	0.90	1.00

Notes

The figure shows the integrated heating capacity for a single cycle (from one defrost operation to the next).

When there is an accumulation of snow against the outdoor unit heat exchanger, there will always be a temporary reduction in capacity depending on the outdoor temperature (°C DB), relative humidity (RH) and the amount of frosting which occurs.

The multi-combination data 22~54HP corresponds with the standard multi-combination of drawing 3D079534.


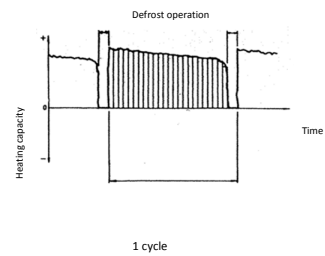


3D079898A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ8U
RXYQ8U
RYYQ8U
RYMQ8U

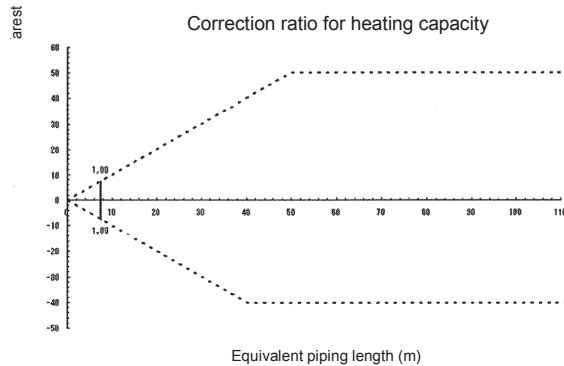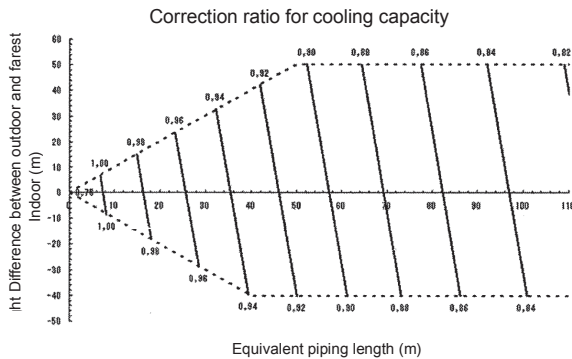

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.

- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.

- Method of calculating the capacity of the outdoor units

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\begin{array}{|c|} \hline \text{Maximum capacity of outdoor units} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction ratio of piping to furthest indoor} \\ \hline \end{array}$$

Condition: Indoor connection ratio exceeds 100%.

$$\begin{array}{|c|} \hline \text{Maximum capacity of outdoor units} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Capacity of outdoor units from capacity table at installed connection ratio} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction ratio of piping to furthest indoor} \\ \hline \end{array}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
8HP	22.2	12.7

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
8HP	19.1	9.5


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{array}{|c|} \hline \text{Equivalent piping length} \\ \hline \end{array} = \begin{array}{|c|} \hline \text{Equivalent length of main pipe} \\ \hline \end{array} \times \begin{array}{|c|} \hline \text{Correction factor} \\ \hline \end{array} + \begin{array}{|c|} \hline \text{Equivalent length of branch pipes} \\ \hline \end{array}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

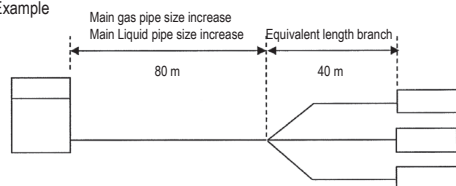



In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.86
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

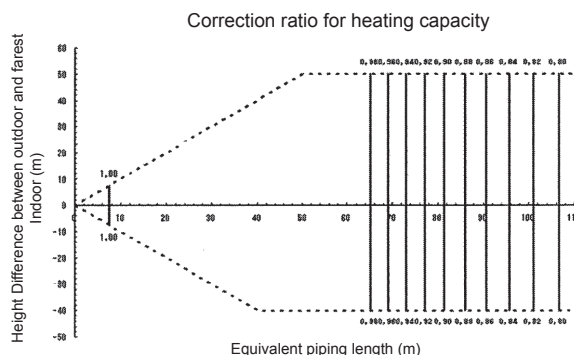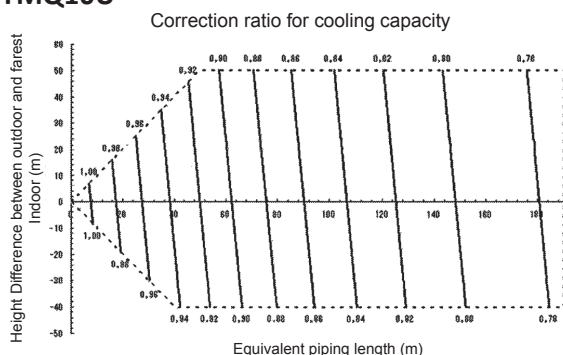

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.

- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.

Method of calculating the capacity of the outdoor units

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
RXYQ10P	25.4*	12.7

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
10 HP	22.2	9.5


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

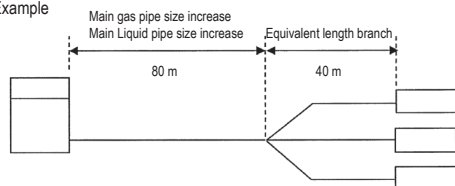

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m

The rate of change in cooling capacity when height difference = 0 is thus approximately 0.87
heating capacity when height difference = 0 is thus approximately 0.90



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

5

RXYQQ12,14,16,24,36U
RXYQ12,14,24,36U
RYYQ12,14,24,36U
RYMQ12,14U

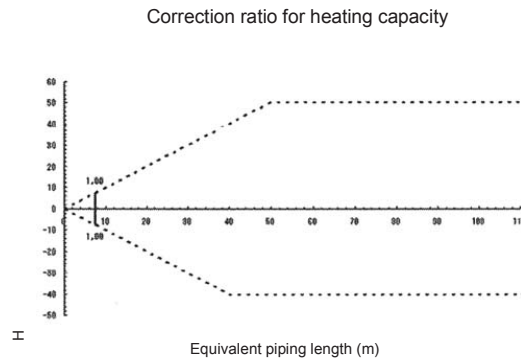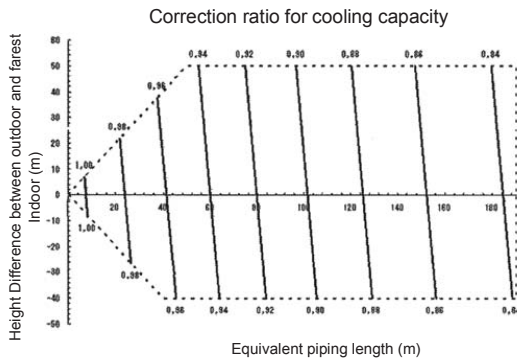

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

Condition: Indoor connection ratio exceeds 100%.

$$\begin{aligned} \text{Maximum capacity of outdoor units} &= \text{Capacity of outdoor units from capacity table at installed connection ratio} \\ &\times \text{Correction ratio of piping to furthest indoor} \end{aligned}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
12 HP	28.6	15.9
14 HP	28.6	15.9
24 HP	34.9	19.1
36 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
12 HP	28.6	12.7
14 HP	28.6	12.7
24 HP	34.9	15.9
36 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.89
Heating (liquid pipe)	1.0	0.5

Example

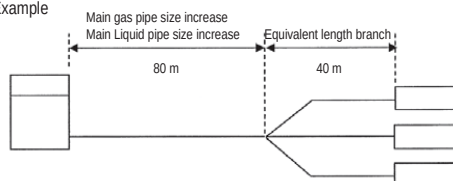

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m



The rate of change in cooling capacity when height difference = 0 is thus approximately 0.89
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

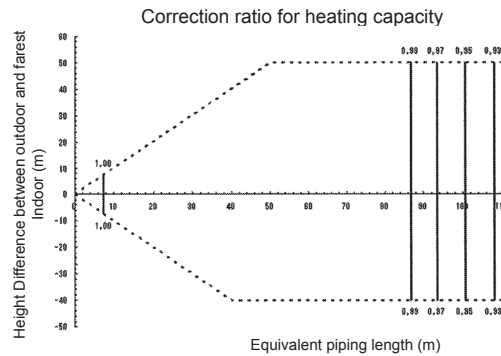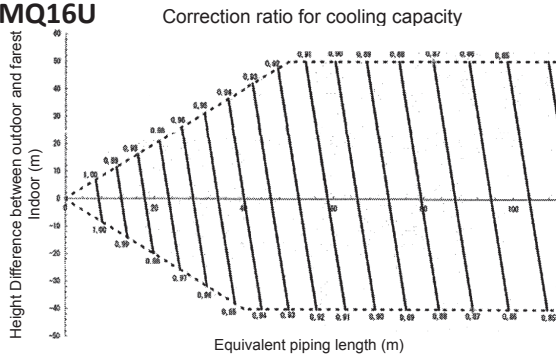

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
16 HP	31.8"	15.9

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
16 HP	28.6	12.7


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

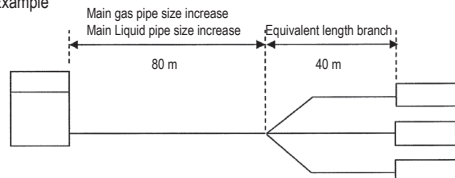

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.88
heating capacity when height difference = 0 is thus approximately 0.99



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

5

RXYQQ18,26,28,30,38,40,42,44U
RXYQ18,26,28,30,38,40,42,44U
RYYQ18,26,28,30,38,40,42,44U
RYYMQ18U

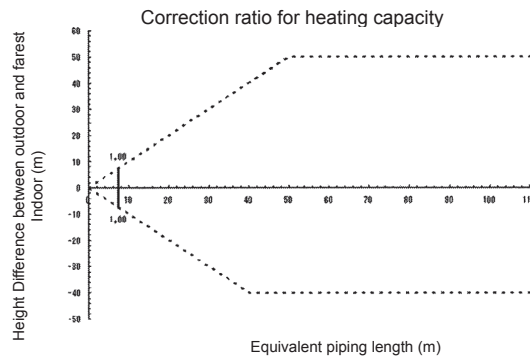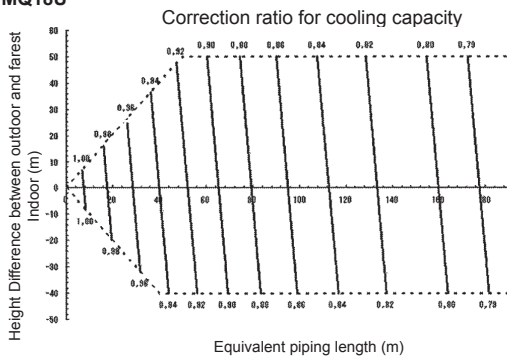

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
18 HP	31.8*	19.1
26~30 HP	38.1*	22.2
38~44 HP	41.3	22.2

*If not available on site, do not increase. If not increased correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
18 HP	28.6	15.9
26~30 HP	34.9	19.1
38~44 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ &\text{Equivalent length of main pipe} \times \text{Correction factor} \\ &+ \\ &\text{Equivalent length of branch pipes} \end{aligned}$$

Choose the correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

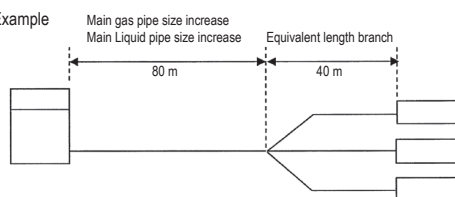

In the above case (for RXYQ38-44) (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m

(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m


The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83 heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYQQ20,32,34U
RXYQ20,32,34U
RYYQ20,32,34U
RYMQ20,32,34U


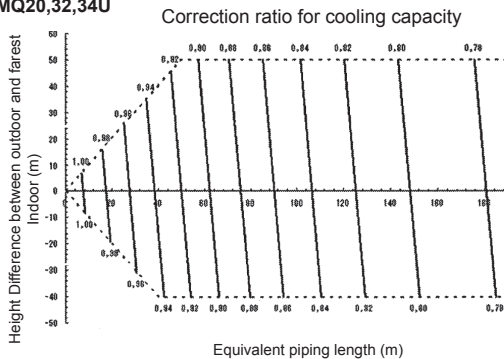


5 Capacity tables

5 - 2 Capacity Correction Factor

5

RXYQQ22U
RXYQ22U
RYYQ22U
RYMQ22U

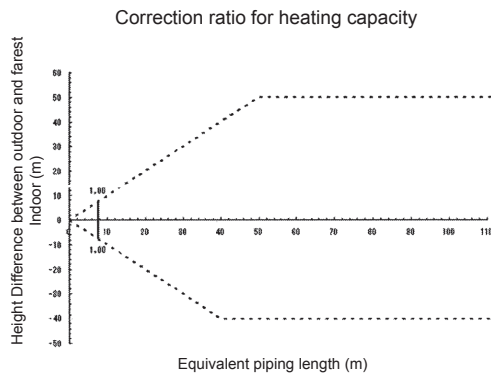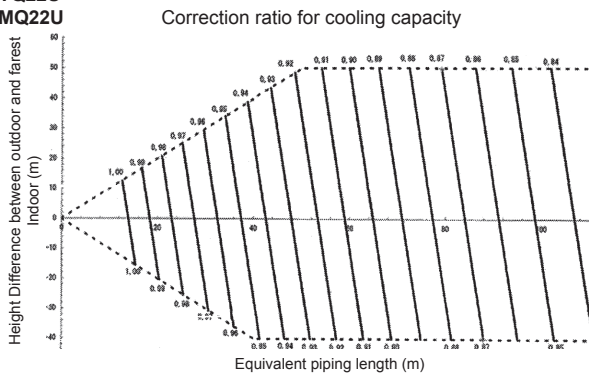

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
22 HP	31.8*	19.1

* If not available on site, do not increase, if not increased, no correction factor should be applied to the equivalent length (see note 6).

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
22 HP	28.6	15.9


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Overall equivalent length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	0.5
Heating (liquid pipe)	1.0	0.5

Example

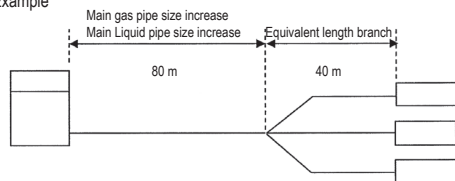

In the above case (Cooling) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m

The rate of change in cooling capacity when height difference = 0 is thus approximately 0.88
heating capacity when height difference = 0 is thus approximately 1.0



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ46U

RXYQ46U

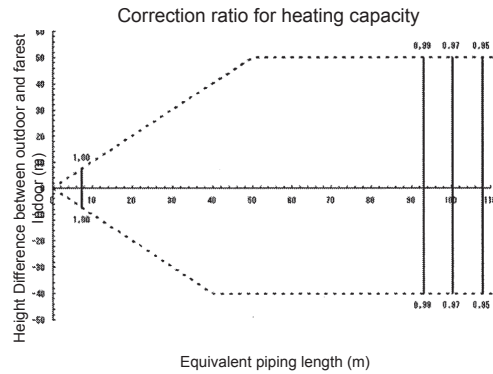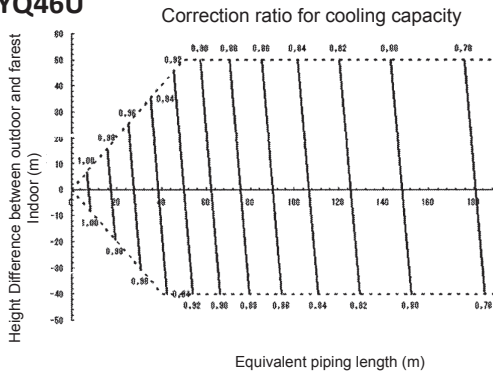

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
46 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
46 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\begin{aligned} \text{Equivalent piping length} &= \\ \text{Equivalent length of main pipe} &\times \text{Correction factor} \\ + \\ \text{Equivalent length of branch pipes} \end{aligned}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

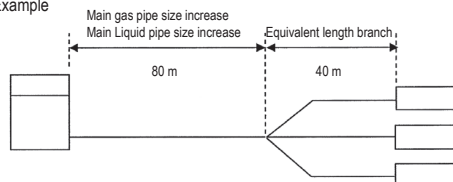

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m

The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 1.0

3D079897A

5 Capacity tables



5 - 2 Capacity Correction Factor

RYYQ48U

RXYQQ48U

RXYQ48U

5

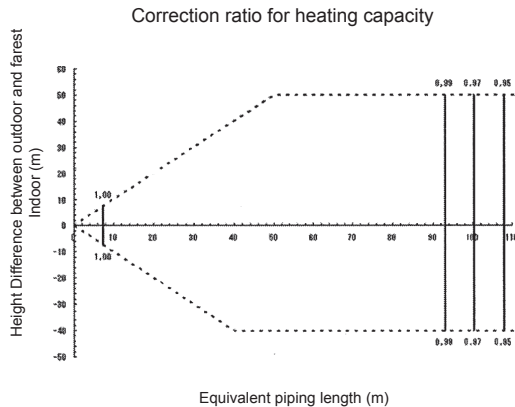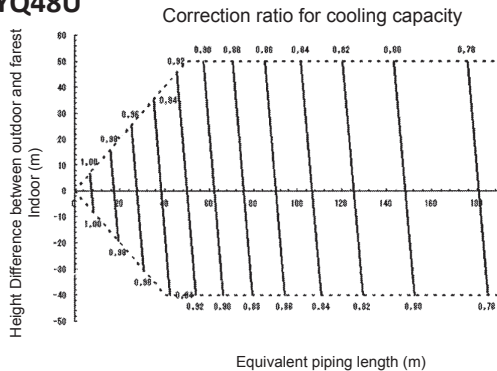

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
48 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
48 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

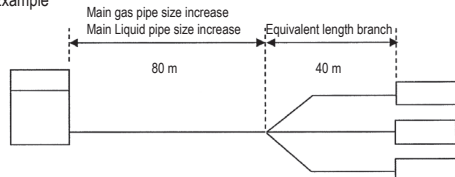



In the above case (Cooling) Overall equivalent length = $80 \text{ m} \times 1.0 + 40 \text{ m} = 120 \text{ m}$
(Heating) Overall equivalent length = $80 \text{ m} \times 0.5 + 40 \text{ m} = 80 \text{ m}$
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.97

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ50U
RXYQ50U
RXYQ50U

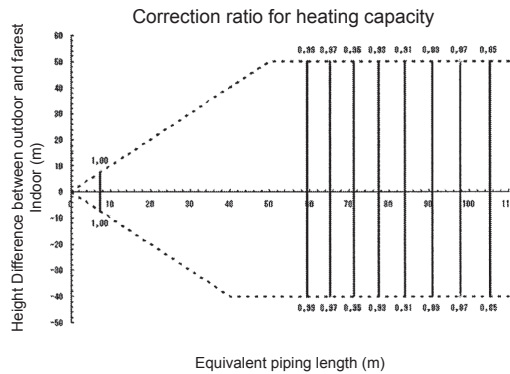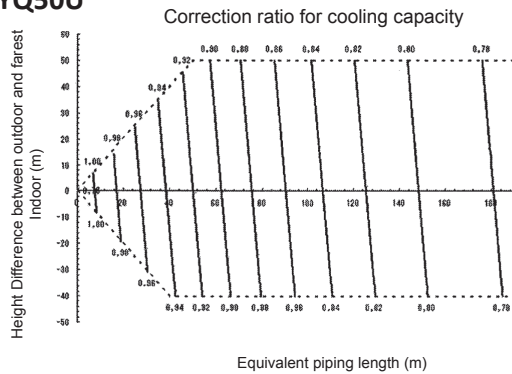

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased. For new diameters, see below.

Model	Gas	Liquid
50 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
50 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

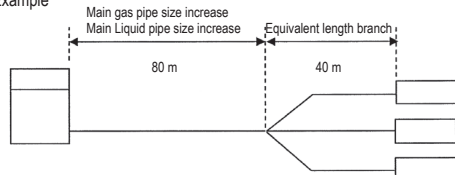

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.92



3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ52U
RXYQ52U
RXYQ52U

5

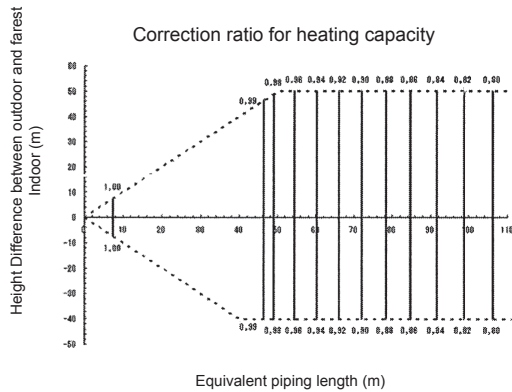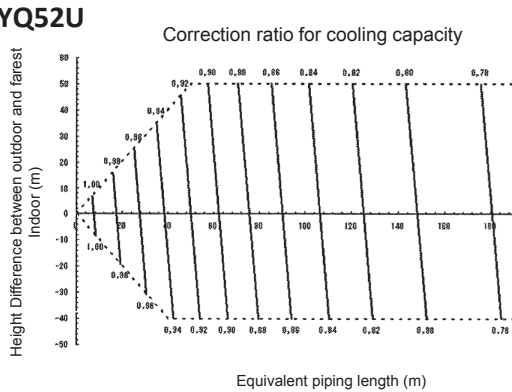

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
52 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).

*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
52 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

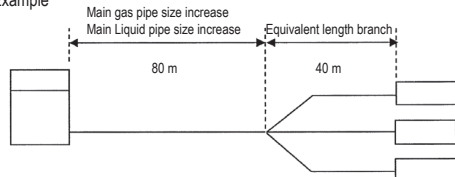



In the above case (Cooling) Overall equivalent length = $80 \text{ m} \times 1.0 + 40 \text{ m} = 120 \text{ m}$
(Heating) Overall equivalent length = $80 \text{ m} \times 0.5 + 40 \text{ m} = 80 \text{ m}$
The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.88

3D079897A

5 Capacity tables

5 - 2 Capacity Correction Factor

RYYQ54U
RXYQQ54U
RXYQ54U

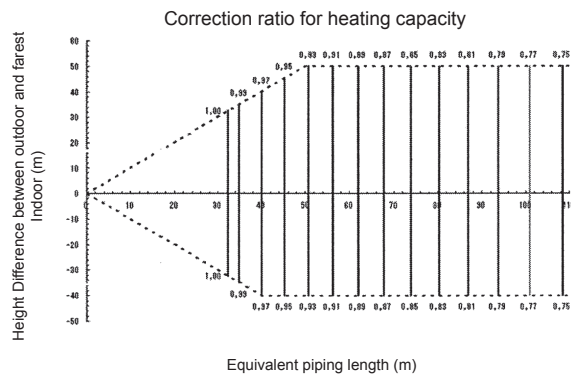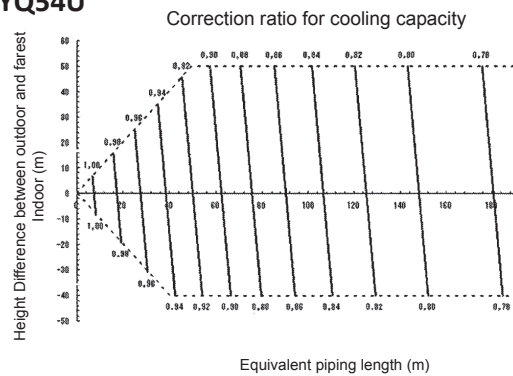

NOTES

- These figures illustrate the correction ratio for piping length in capacity for a standard indoor unit system at maximum load (with the thermostat set to maximum) under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, shown in the above figures.
- With this outdoor unit, constant evaporating pressure control when cooling and constant condensing pressure control when heating is carried out.
- Method of calculating the capacity of the outdoor units
The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is smaller.

Condition: Indoor connection ratio does not exceed 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at the 100\% connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

Condition: Indoor connection ratio exceeds 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio} \times \text{Correction ratio of piping to furthest indoor}$$

- When level difference is 50 m or more (see installation manual and 3D079540 / 3D079543) and equivalent pipe length is 90 m or more, the diameter of the main gas and liquid pipes (outdoor unit - branch sections) must be increased.
For new diameters, see below.

Model	Gas	Liquid
54 HP	41.3	22.2

- When the pipe length after the first refrigerant branch kit is more than 40 m, pipe size between first and final branch kit must be increased (only for VRV DX indoor units; details see installation manual).
*Refer to the installation manual for allowed system setups and rules for dedicated indoor connection types.

Diameter of main pipes (standard size)

Model	Gas	Liquid
54 HP	41.3	19.1


- Equivalent length used in the above figures is based upon the following equivalent length

$$\text{Equivalent piping length} = \text{Equivalent length of main pipe} \times \text{Correction factor} + \text{Equivalent length of branch pipes}$$

Choose a correction factor from the following table. When cooling capacity is calculated: gas pipe size When heating capacity is calculated: liquid pipe size

	Correction factor	
	Standard size	Size increase
Cooling (gas pipe)	1.0	
Heating (liquid pipe)	1.0	0.5

Example

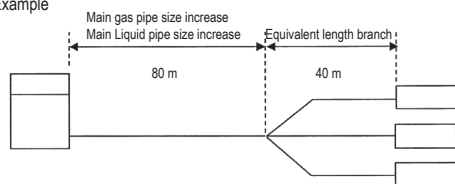

In the above case (Cooling) Overall equivalent length = 80 m x 1.0 + 40 m = 120 m
(Heating) Overall equivalent length = 80 m x 0.5 + 40 m = 80 m



The rate of change in cooling capacity when height difference = 0 is thus approximately 0.83
heating capacity when height difference = 0 is thus approximately 0.83

3D079897A

6 Dimensional drawings

6 - 1 Dimensional Drawings

6

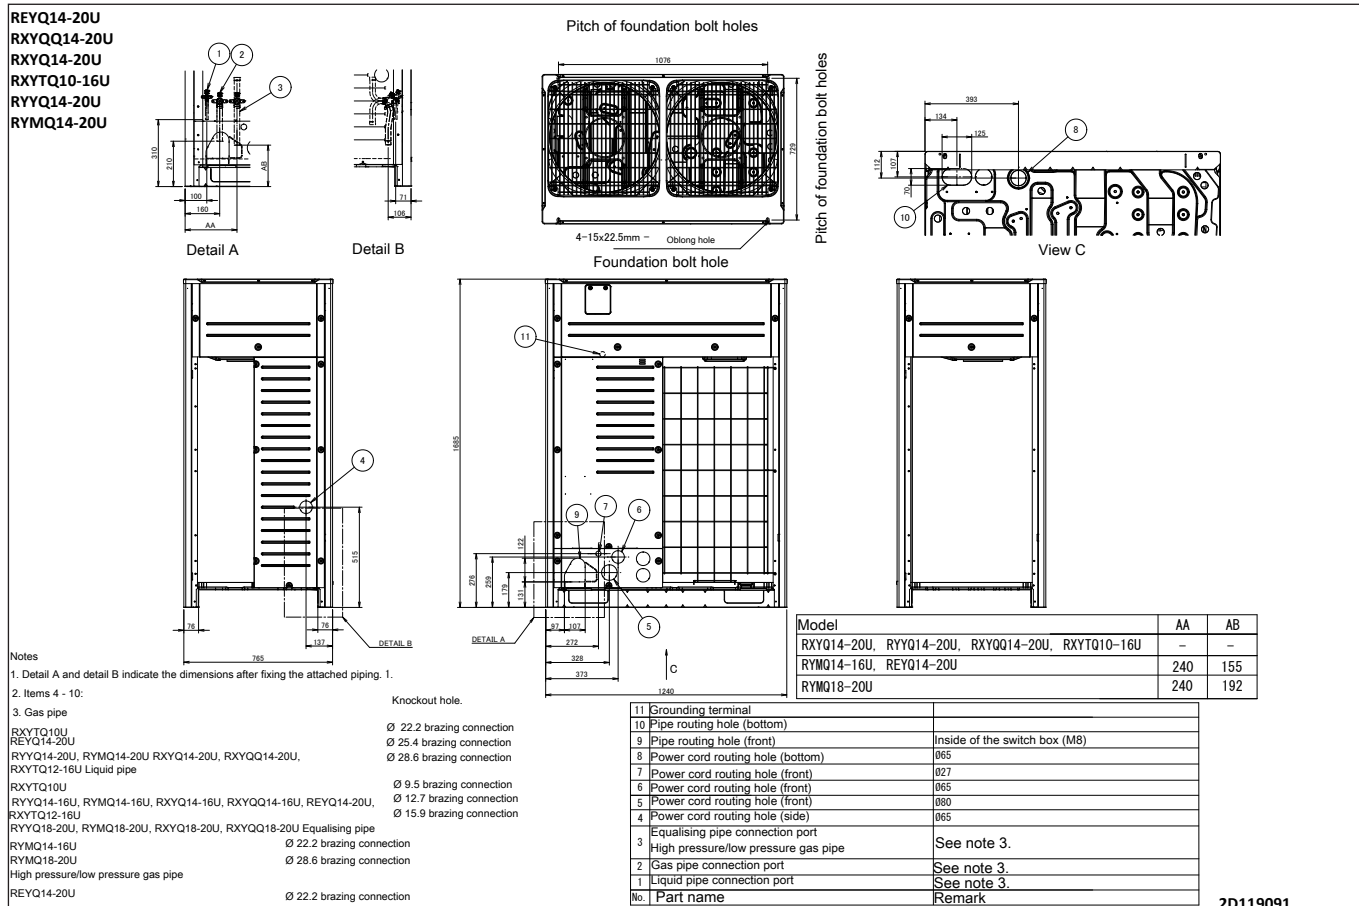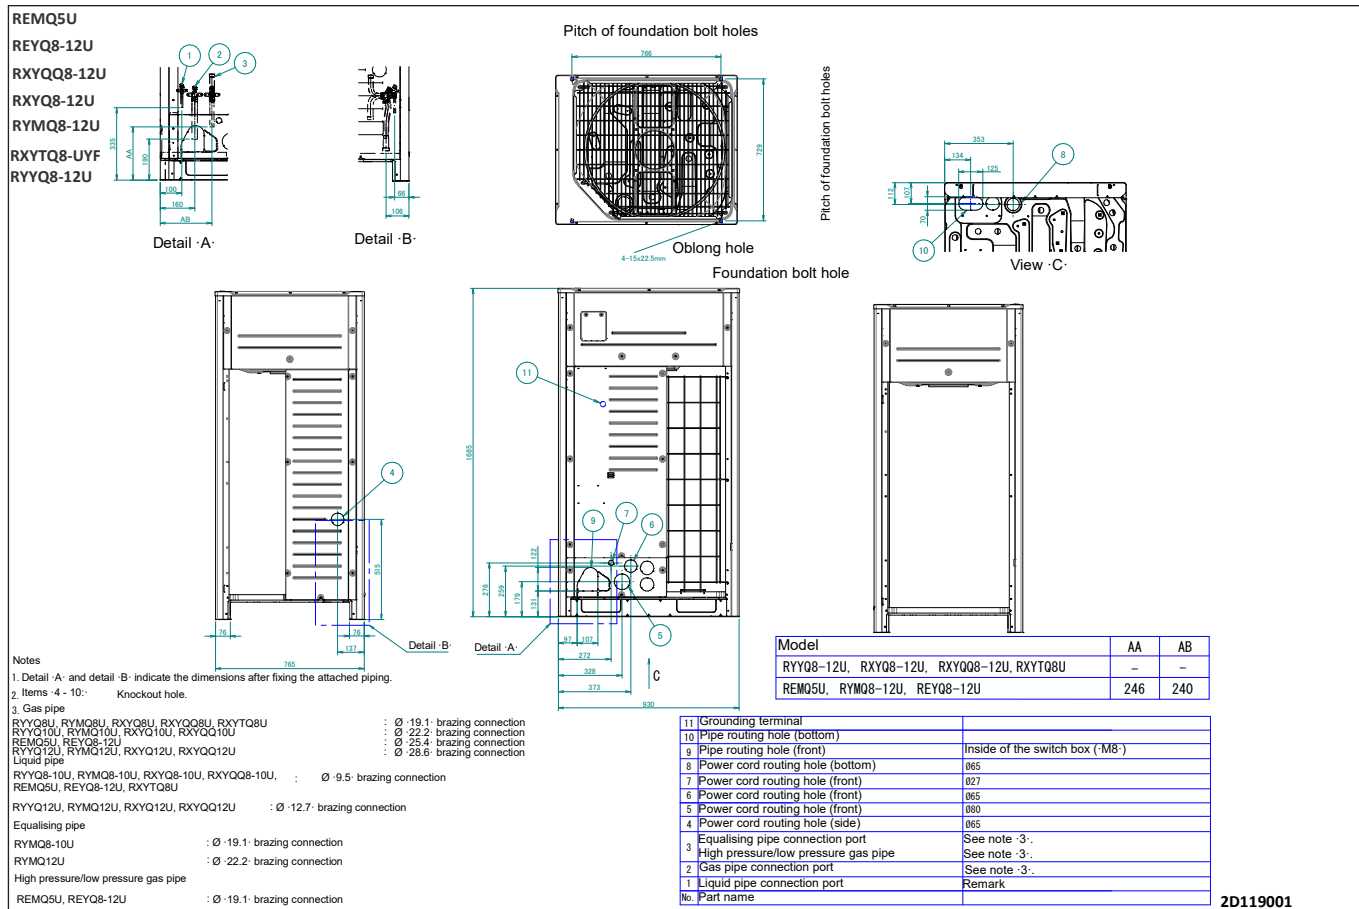

7 Centre of gravity

7 - 1 Centre of Gravity

RXYQQ8-12U


RXYQ8-12U

RXYTQ8U

RYYQ8-12U

RYMQ8-12U

Unit	AA	AB	AC
RYYQ8-12U	328	366	565
REMQ5U / REYQ8-12U			
RYMQ8-12U	354	443	565
RXYQ8-12U	339	448	565
RXYQQ8-12U			
RXYTQ8U			

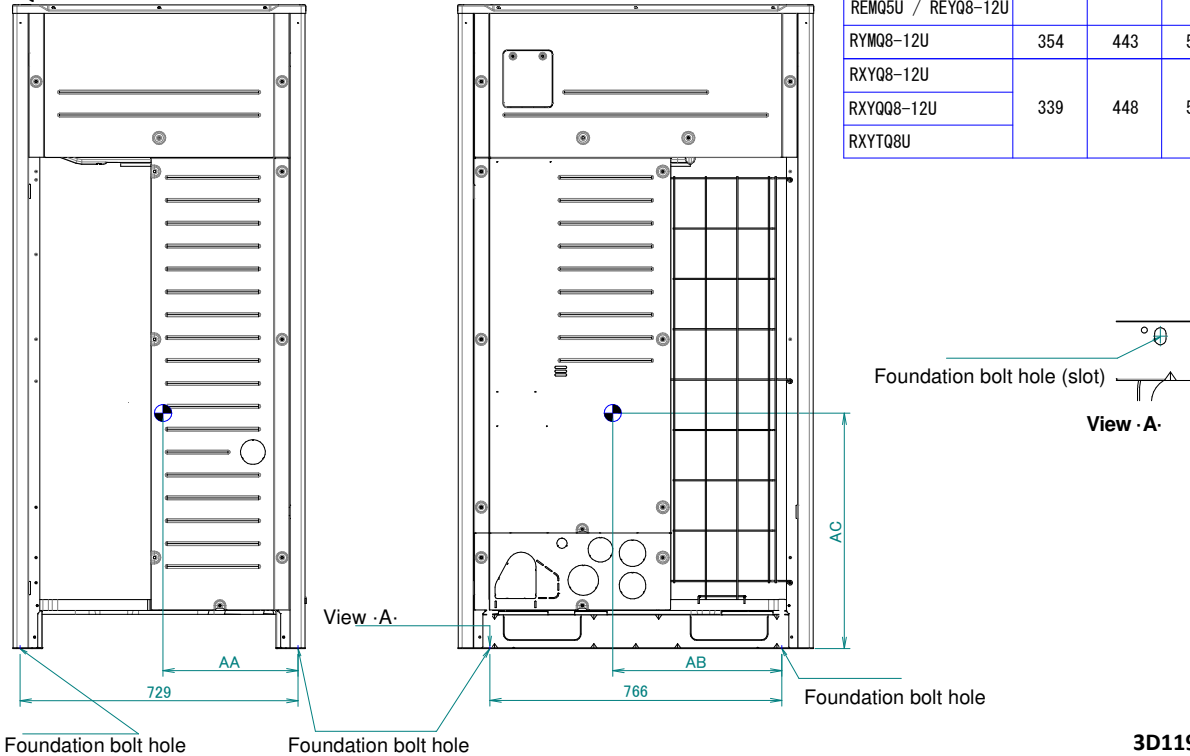

3D119703

RXYQQ14-20U


RXYQ14-20U

RXYTQ10-16U

RYYQ14-20U

RYMQ14-20U

Unit	AA	AB	AC
RYYQ14-20U	334	470	610
REYQ14-20U	334	470	610
RYMQ14-20U	360	569	610
RXYQ (Q) 14-20U	345	575	610
RXYTQ10-12U	350	610	810
RXYTQ14-16U	351	565	610

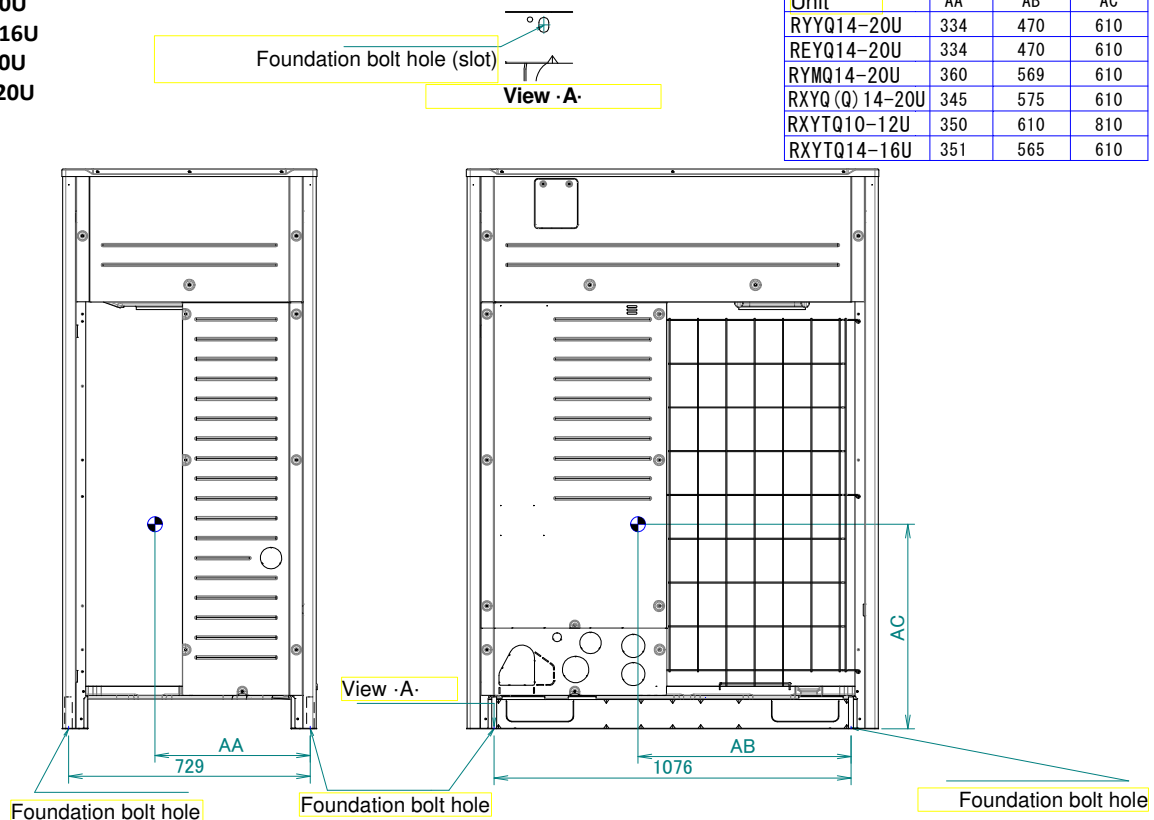



3D119704

8 Piping diagrams

8 - 1 Piping Diagrams



8

RYYQ8-12U

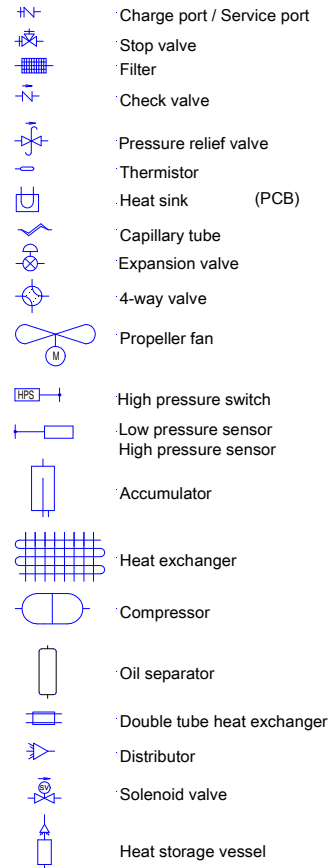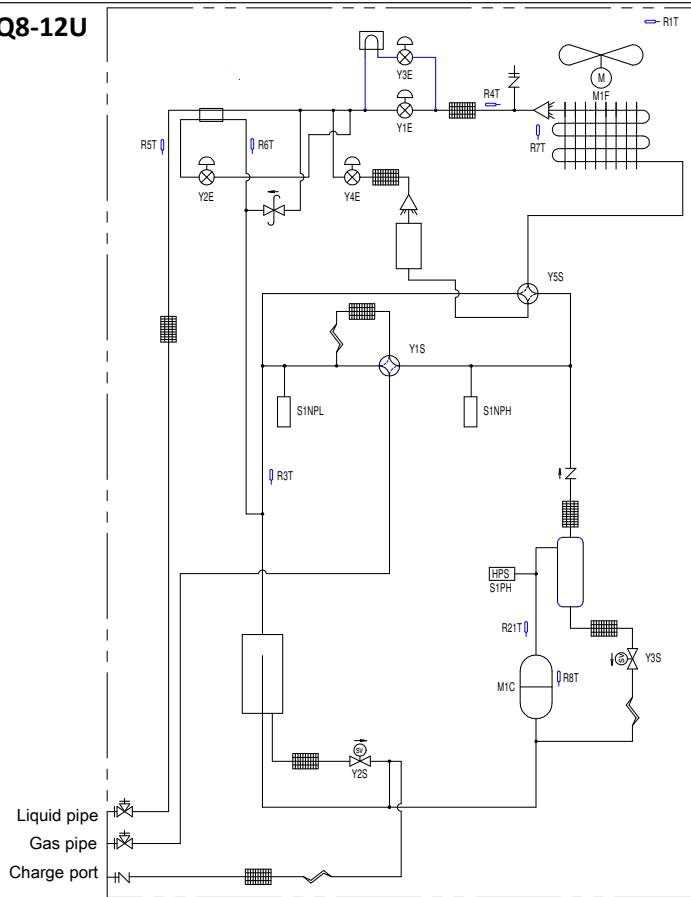

3D118183A

RYYQ14-20U

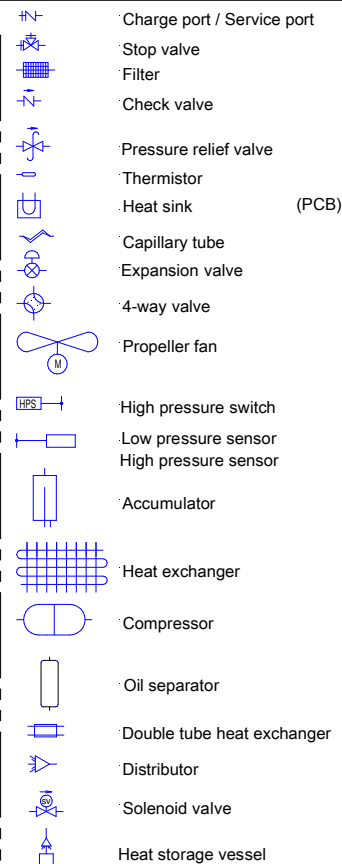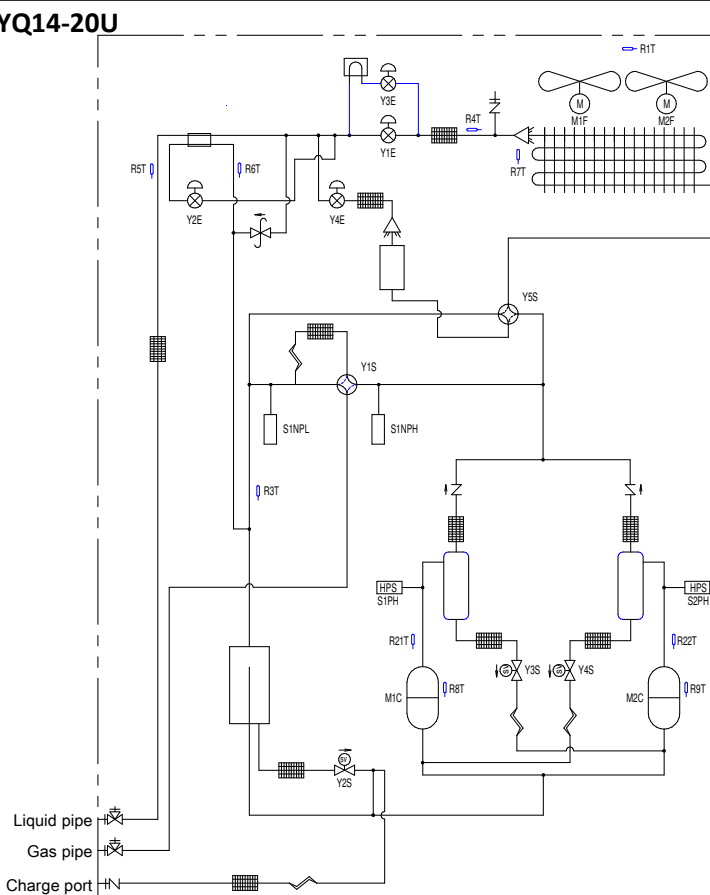


3D118184A

8 Piping diagrams

8 - 1 Piping Diagrams


RYMQ8-12U

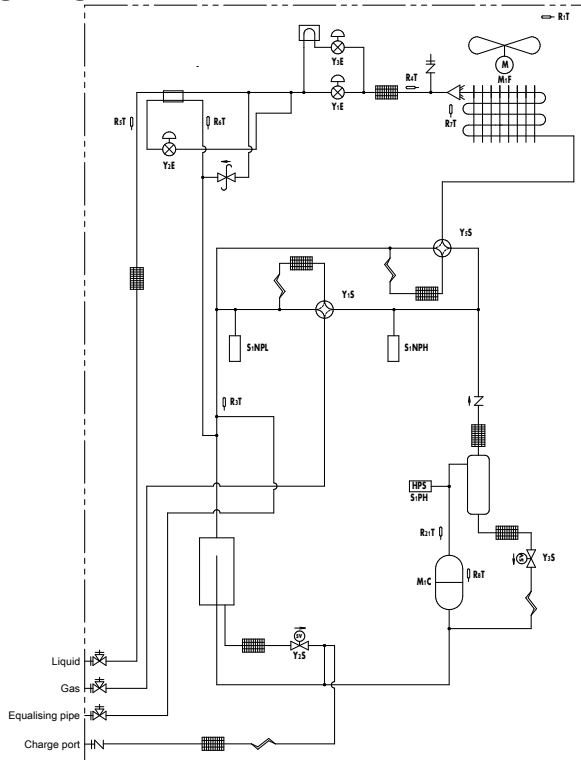

- Charge port / Service port
- Stop valve
- Filter
- Check valve
- Pressure relief valve
- Thermistor
- Heat sink (PCB)
- Capillary tube
- Expansion valve
- 4-way valve
- Propeller fan
- High pressure switch
- Low pressure sensor
- High pressure sensor
- Accumulator
- Heat exchanger
- Compressor
- Oil separator
- Double tube heat exchanger
- Distributor
- Solenoid valve

3D118185

RYMQ14-20U

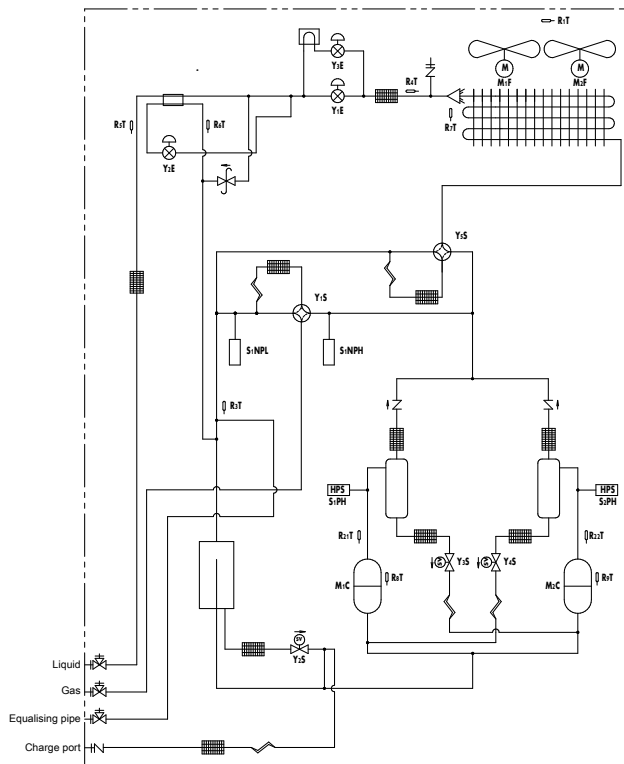

- Charge port / Service port
- Stop valve
- Filter
- Check valve
- Pressure relief valve
- Thermistor
- Heat sink (PCB)
- Capillary tube
- Expansion valve
- 4-way valve
- Propeller fan
- High pressure switch
- Low pressure sensor
- High pressure sensor
- Accumulator
- Heat exchanger
- Compressor
- Oil separator
- Double tube heat exchanger
- Distributor
- Solenoid valve

3D118186

9 Wiring diagrams


9 - 1 Wiring Diagrams - Three Phase

9


RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

Power supply 3N~ 380-415V 50Hz
3N~ 380V 60Hz

Wiring diagram

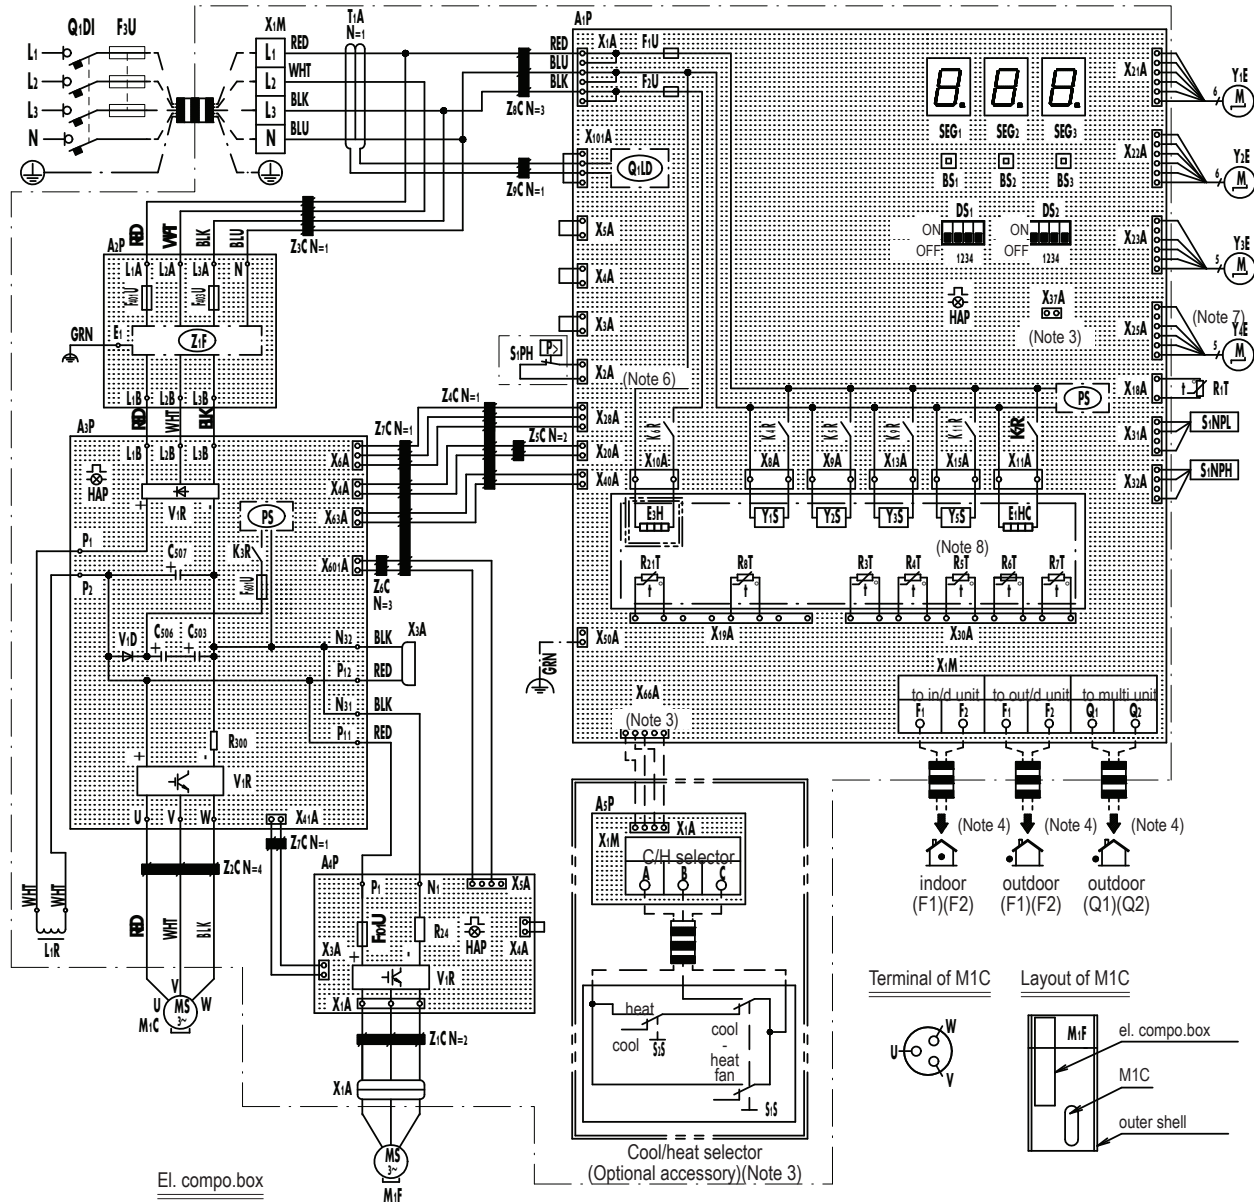

El. compo.box




(Front side)

(Rear side)

Terminal of M1C



Layout of M1C



2D117534

9 Wiring diagrams

9 - 1 Wiring Diagrams - Three Phase

RXYQ8-12U
RXYTQ8UYF
RYYQ8-12U
RYMQ8-12U

A1P	Printed Circuit Board (Main)	R3T	Thermistor (Accumulator)
A2P	Printed Circuit Board (Noise Filter)	R4T	Thermistor (Heat Exc,Liq,Pipe)
A3P	Printed Circuit Board (Inv)	R5T	Thermistor (Subcool,Liq,Pipe)
A4P	Printed Circuit Board (Fan)	R6T	Thermistor (Heat Exc,Gas Pipe)
A5P	Printed Circuit Board (ABC I/P)(Option)	R7T	Thermistor (Heat Exc,Deicer)
BS1~3 (A1P)	Push Button Switch (Mode,Set,Return)	R8T	Thermistor (M1C body)
C503,C506,C507 (A3P)	Capacitor	R21T	Thermistor (M1C discharge)
DS1,DS2 (A1P)	DIP Switch	S1NPH	Pressure Sensor (High)
E1HC	Crankcase Heater	S1NPL	Pressure Sensor (Low)
E3H	Drainpan Heater (Option)	S1PH	Pressure Switch (Disch)
F1U,F2U (A1P)	Fuse (T,3,15A,250V)	SEG1~SEG3 (A1P)	7-Segment Display
F3U	Field Fuse	T1A	Current Sensor
F101U (A4P)	Fuse	V1D (A3P)	Diode
F401U,F403U (A2P)	Fuse	V1R (A3P,A4P)	Power Module
F601U (A3P)	Fuse	X*A	Connector
HAP (A1P,A3P, A4P)	Pilotlamp (Service Monitor-Green)	X1M (A1P)	Terminal Block (Control)
K3R (A3P)	Magnetic Relay	X1M (A5P)	Terminal Block (Power Supply)(Option)
K4R (A1P)	Magnetic Relay (Y1S)	Y1E	Electronic Expansion Valve(Main)
K5R (A1P)	Magnetic Relay (Y2S)	Y2E	Electronic Expansion Valve (Injection)
K6R (A1P)	Magnetic Relay (E3H)	Y3E	Electronic Expansion Valve (Refrigerant Jacket)
K7R (A1P)	Magnetic Relay (E1HC)	Y4E	Electronic Expansion Valve (Storage Vessel)
K9R (A1P)	Magnetic Relay (Y3S)	Y1S	Solenoid Valve (Main)
K11R (A1P)	Magnetic Relay (Y5S)	Y2S	Solenoid Valve (Accumulator Oil Return)
L1R	Reactor	Y3S	Solenoid Valve (Oil1)
M1C	Motor (Compressor)	Y5S	Solenoid Valve (Sub)
M1F	Motor (Fan)	Z*C	Noise Filter (Ferrite Core)
PS (A1P,A3P)	Switching Power Supply	Z*F (A2P)	Noise Filter (With Surge Absorber)
Q1DI	Field Earth Leakage Breaker	Connector For Optional Accessories	
Q1LD (A1P)	Field Earth Current Detector	X10A	Connector (Drainpan Heater)
R24 (A4P)	Resistor (Current Sensor)	X37A	Connector (Power Adapter)
R300 (A3P)	Resistor (Current Sensor)	X66A	Connector (Remote Switching Cool/Heat Selector)
R1T	Thermistor (Air)		

NOTES


1. This wiring diagram applies only to the outdoor unit.
2. : field wiring, : terminal block, : connector, : terminal, : protective earth (screw), : functional earth, : earth wiring, : field supply, : PCB, : switch box, : option
3. When using the optional adapter, refer to the installation manual of the optional adapter.
4. For connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2, refer to the installation manual.
5. How to use BS1~3 switch. Refer to "service precaution" label on el. compo. box cover.
6. When operating, don't shortcircuit the protection devices (S1PH).
7. Only for RYYQ model.
8. Only for RYYQ/RYMQ model.
9. Colors: BLK: Black, RED: Red, BLU: Blue, WHT: White, GRN: Green.

2D117534

9 Wiring diagrams

9 - 1 Wiring Diagrams - Three Phase

RXYQ14-20U
RYYQ14-20U
RYMQ14-20U

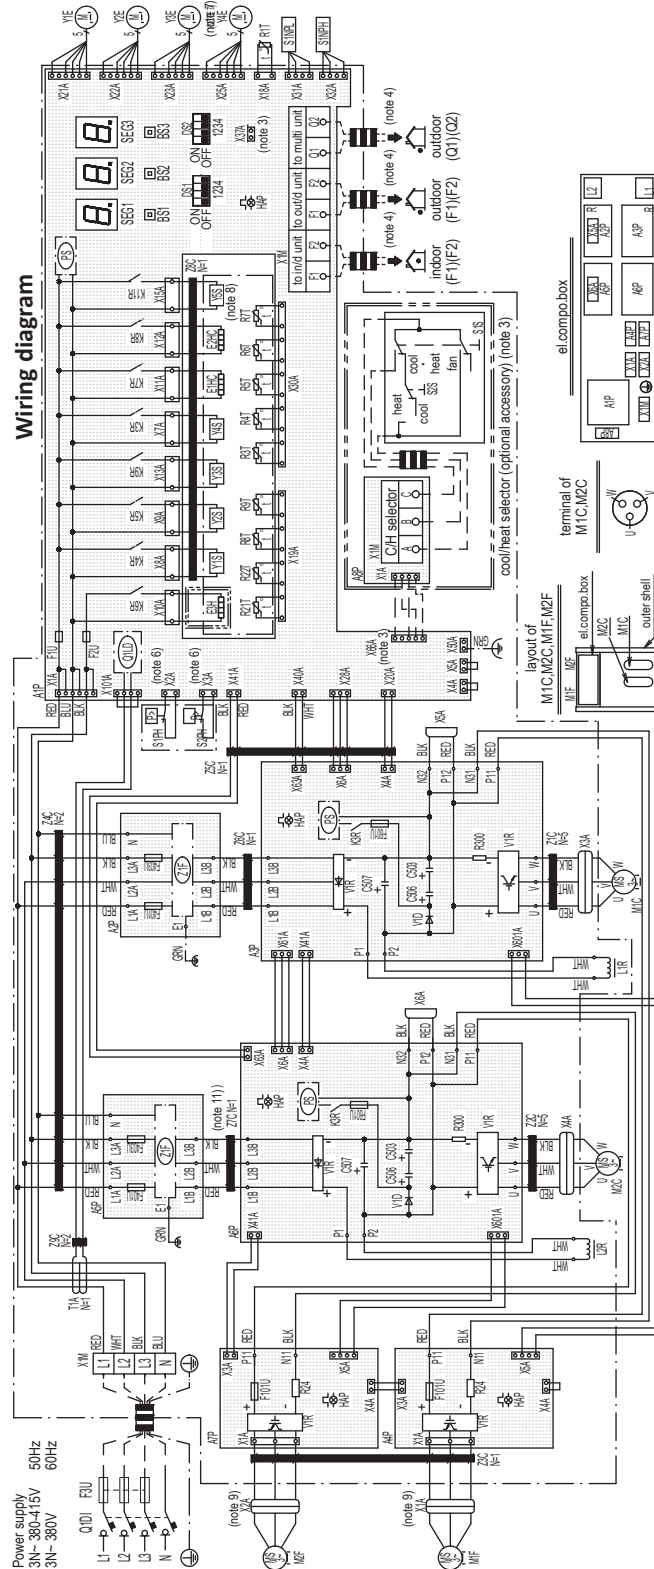

A1P	Printed circuit board (main)
A2P, A5P	Printed circuit board (noise filter)
A3P, A6P	Printed circuit board (inv)
A4P, A7P	Printed circuit board (fan)
A8P	Printed circuit board (ABC I/P)
BS1-3 (A1P)	Push button switch (mode, set, return)
C503, C506, C507 (A3P, A6P)	Capacitor
DS1, DS2 (A1P)	Dip switch S1PH,
E1HC, E2HC	Crankcase heater
E3H	Drainpan heater (option)
F1U, F2U (A1P)	Fuse (T, 3, 15A, 250V)
F3U	Field fuse
F101U (A4P, A7P)	Fuse
F401U, F403U (A2P, A5P)	Fuse
F601U (A3P, A6P)	Fuse
HAP (A1P, A3P, A4P, A6P, A7P)	Pilotlamp (service monitor-green)
K3R (A3P, A6P)	Magnetic relay
K3R (A1P)	Magnetic relay (Y4S)
K4R (A1P)	Magnetic relay (Y1S)
K5R (A1P)	Magnetic relay (Y2S)
K6R (A1P)	Magnetic relay (E3H)
K7R (A1P)	Magnetic relay (E1HC)
K8R (A1P)	Magnetic relay (E2HC)
K9R (A1P)	Magnetic relay (Y3S)
K11R (A1P)	Magnetic relay (Y5S)
L1R, L2R	Reactor
M1C, M2C	Motor (compressor)
M1F, M2F	Motor (fan)
PS (A1P, A3P, A6P)	Switching power supply
Q1DI	Field earth leakage breaker
Q1LD (A1P)	Field earth current detector
R24 (A4P, A7P)	Resistor (current sensor)
R300 (A3P, A6P)	Resistor (current sensor)
R1T	Thermistor (air)
R3T	Thermistor (accumulator)
R4T	Thermistor (heat exc, liq, pipe)
R5T	Thermistor (subcool, liq, pipe)
R6T	Thermistor (heat exc, gas pipe)
R7T	Thermistor (heat exc, deicer)
R8T, R9T	Thermistor (M1C, M2C body)
R21T, R22T	Thermistor (M1C, M2C discharge)
S1NPH	Pressure sensor (high)
S1NPL	Pressure sensor (low)
S1PH, S2PH	Pressure switch (disch)
SEG1-SEG3 (A1P)	7-segment display
T1A	Current sensor
V1D (A3P, A6P)	Diode
V1R (A3P, A4P, A6P, A7P)	Power module
X*A	Connector
X1M (A1P)	Terminal block (control)
X1M (A8P)	Terminal block (power supply)
Y1E	Electronic expansion valve (main)
Y2E	Electronic expansion valve (injection)
Y3E	Electronic expansion valve (refrigerant jacket)
Y4E	Electronic expansion valve (storage vessel (note 7))
Y1S	Solenoid valve (main)
Y2S	Solenoid valve (accumulator oil return)
Y3S	Solenoid valve (oil1)
Y4S	Solenoid valve (oil2)
Y5S	Solenoid valve (sub) (note 8)
Z*C	Noise filter (ferrite core)
Z*F (A2P, A5P)	Noise filter (with surge absorber)
Connector for optional accessories	
X10A	Connector (drainpan heater)
X37A	Connector (power adapter)
X66A	Connector (remote switching)
	Cool/heat selector

NOTES

- This wiring diagram applies only to the outdoor unit.
- Field wiring, terminal block, connector, terminal, protective earth (screw), functional earth, earth wiring, field supply, pcb, switch box, option
- When using the optional adapter, refer to the installation manual of the optional adapter.
- For connection wiring to indoor-outdoor transmission F1-F2, outdoor-outdoor transmission F1-F2, outdoor-multi transmission Q1-Q2, refer to the installation manual.
- How to use BS1-3 switch. Refer to "service precaution" label on el. Compo. Box cover.
- When operating, don't shortcircuit the protection devices (S1PH, S2PH)
- Only for RYYQ model.
- Only for RYYQ/RYMQ model.
- Connector X1A (M1F) is red, connector X2A (M2F) is white.
- Colors: BLK:black, RED:red, BLU:blue, WHT:white, GRN:green.
- Only for 14,16 class

2D117536C


10 External connection diagrams

10 - 1 External Connection Diagrams

RXYQQ8-20U
RXYQ8-20U
RXYTQ8-16UYF
RYYQ8-20U
RYMQ8-20U

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only
3. For details, refer to the wiring diagram attached to the outdoor unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. The capacity of UNIT1 must be larger than that of UNIT2 when the power source is connected in series between the units.
 The capacity of UNIT 2 must be larger than that of UNIT3 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
 Running the product in reversed phase may break the compressor and other parts.
12. Install an earth leakage circuit breaker.

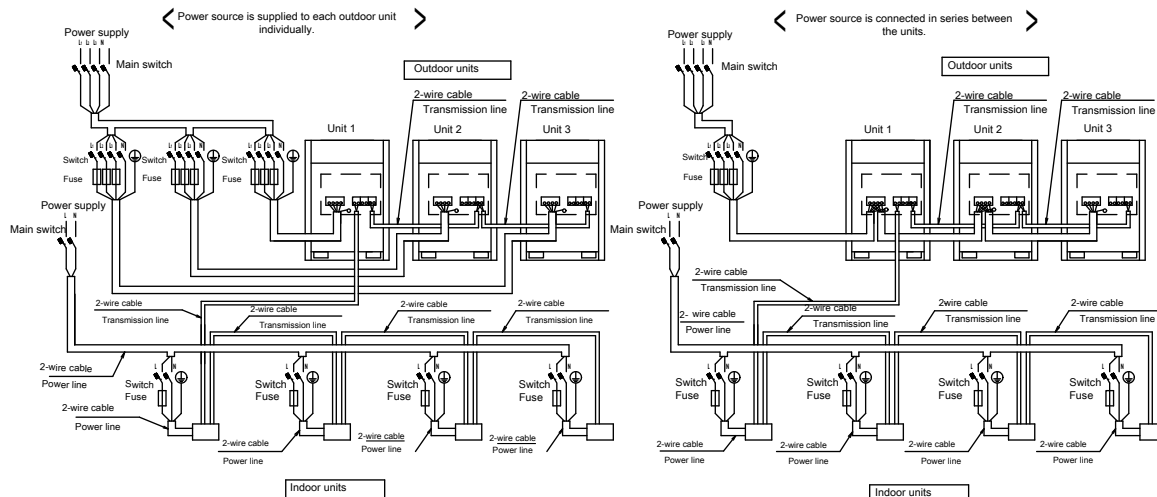


3D119200

RXYQQ8-20U
RXYQ8-20U
RXYTQ8-16U
RYYQ8-20U
RYMQ8-26U

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only
3. For details, refer to the wiring diagram attached to the outdoor unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. The capacity of UNIT1 must be larger than that of UNIT2 when the power source is connected in series between the units.
11. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
 Running the product in reversed phase may break the compressor and other parts.
12. Install an earth leakage circuit breaker.

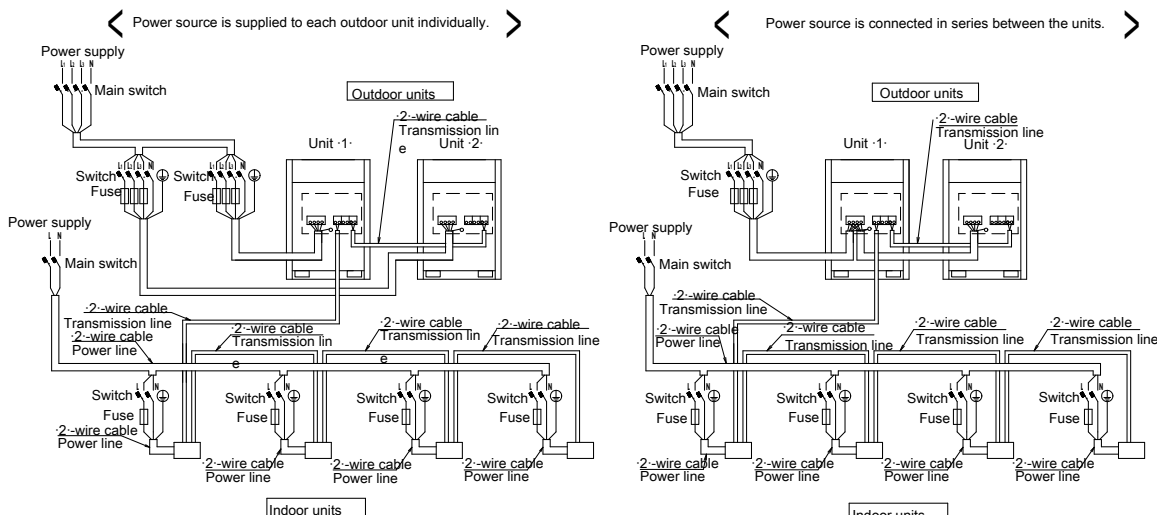

3D119316


10 External connection diagrams

10 - 1 External Connection Diagrams

RXYQQ8-20U
RXYQ8-20U
RYYQ8-20U
RYMQ8-20U
RXYTQ8-16UYF

Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
 2. Use copper conductors only
 3. For details, refer to the wiring diagram attached to the outdoor unit.
 4. Install a circuit breaker for safety.
 5. All field wiring and components must be provided by an authorised electrician.
 6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
 9. Install a main switch to control the multiple power sources that the various components of the system make use of.
10. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
- Running the product in reversed phase may break the compressor and other parts.
11. Install an earth leakage circuit breaker.

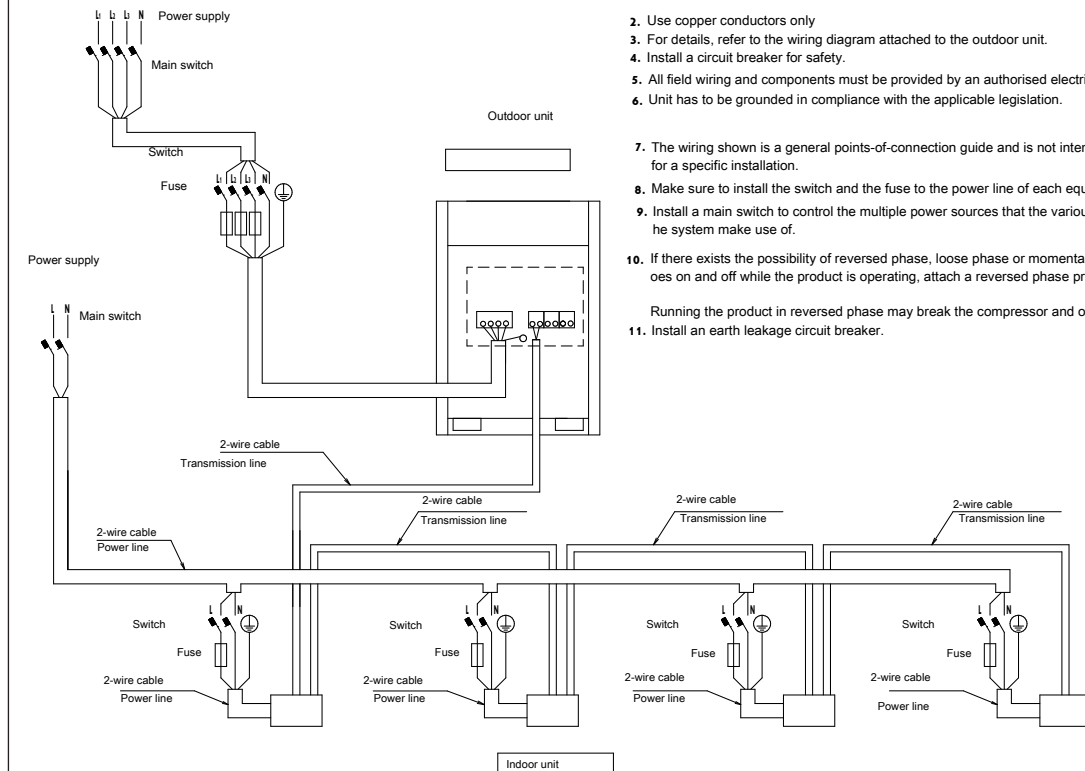


3D119317

11 Sound data

11 - 1 Sound Power Spectrum


REMQ5U
REYQ8U
RXYQQ8U
RXYQ8U
RXYTQ8UYF
RYYQ8U
RYMQ8U

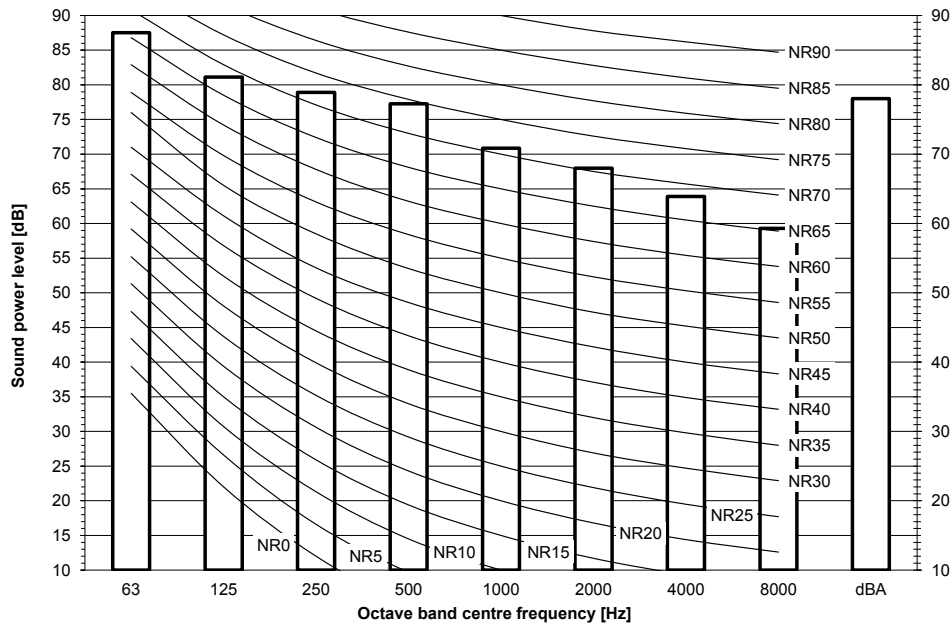

Notes
dBA = A-weighted sound power level (A scale according to IEC).
Reference acoustic intensity 0dB = $10E-6\mu W/m^2$
Measured according to ISO 3744

3D119528

REYQ10U
RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

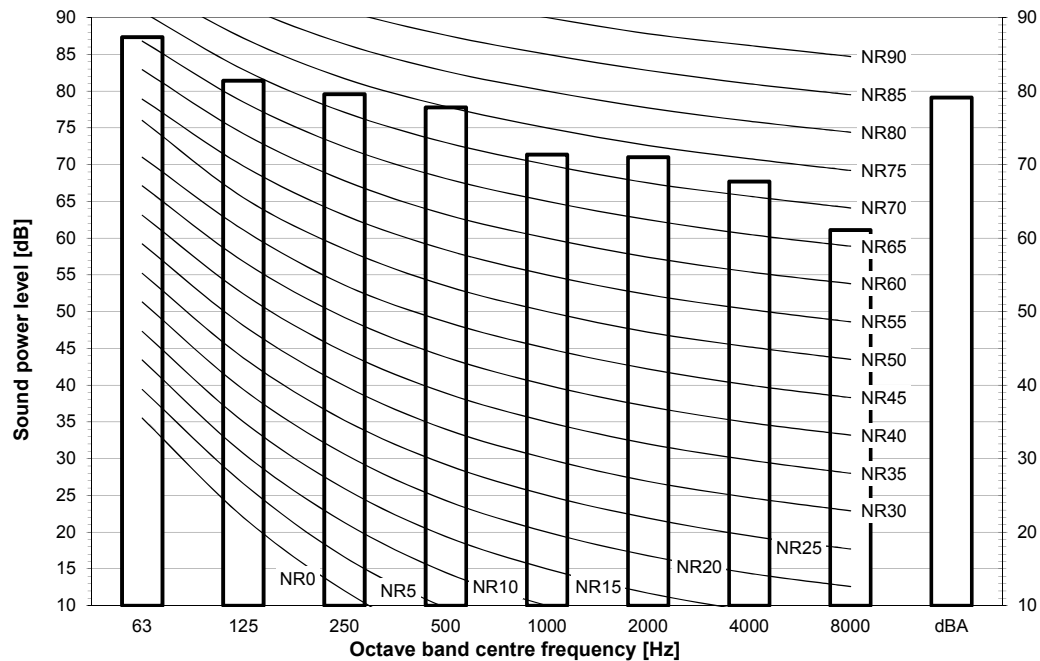


Notes
dBA = A-weighted sound power level (A scale according to IEC).
Reference acoustic intensity 0dB = $10E-6\mu W/m^2$
Measured according to ISO 3744

3D119529

11 Sound data

11 - 1 Sound Power Spectrum

REYQ12U
RXYQ12U
RXYQ12U
RYYQ12U
RYMQ12U

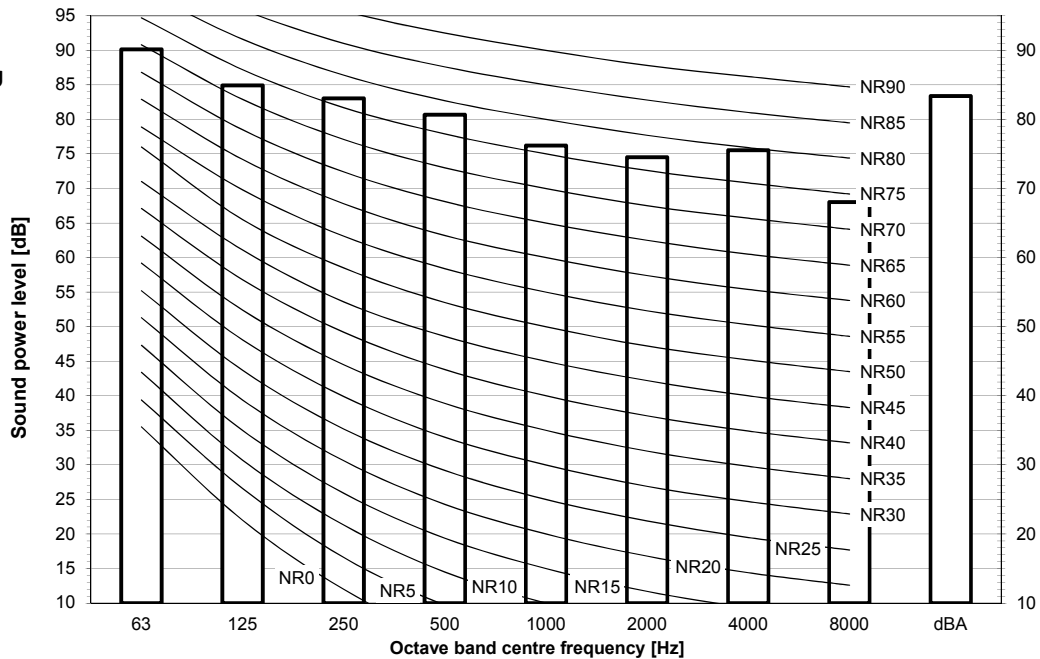

Notes


dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = 10E-6μW/m²

Measured according to ISO 3744

3D119530

REYQ14U
RXYQ14U
RXYQ14U
RYYQ14U
RYMQ14U

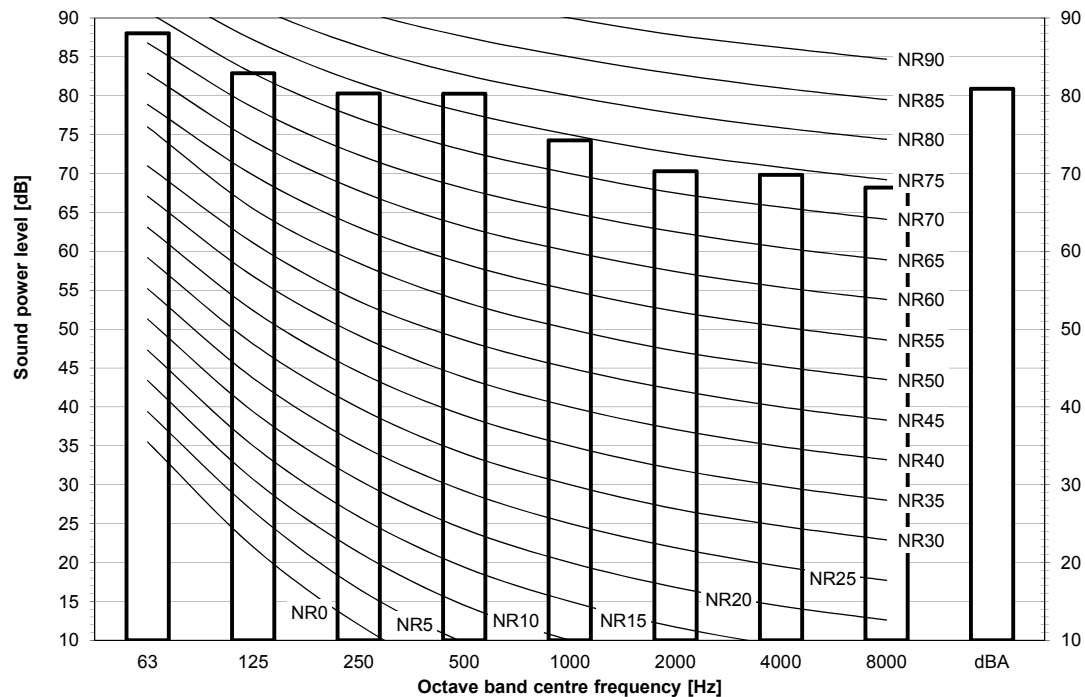

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = 10E-6μW/m²


Measured according to ISO 3744

3D119531

11 Sound data

11 - 1 Sound Power Spectrum

REYQ16U
RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

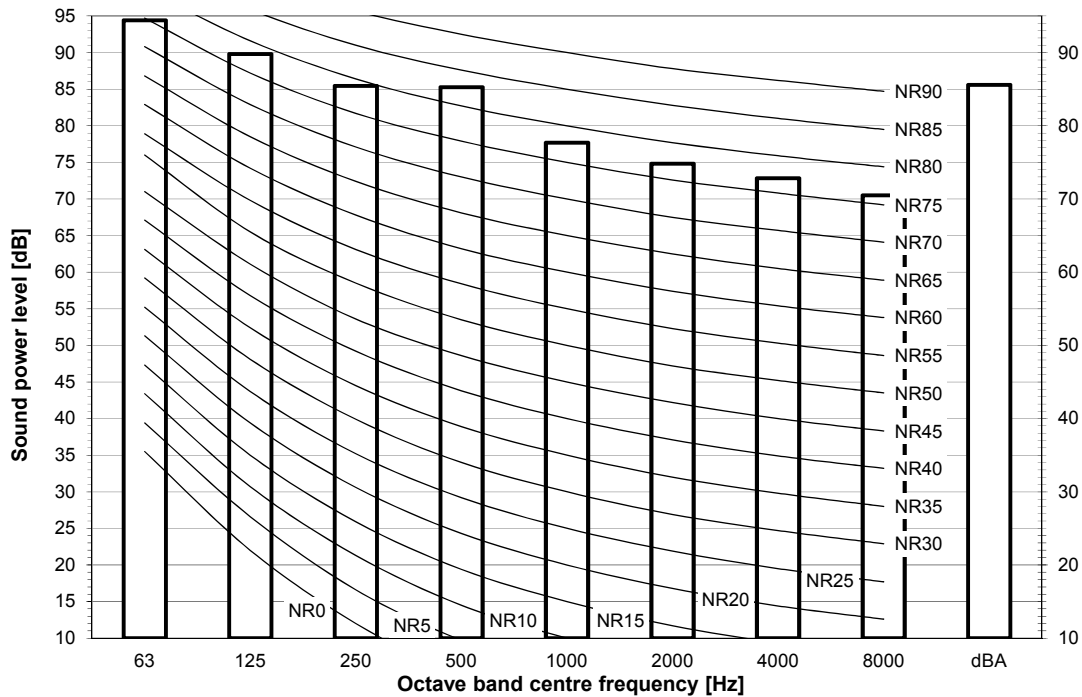

Notes


dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10^{-6} \mu\text{W}/\text{m}^2$

Measured according to ISO 3744

3D119532

REYQ18U
RXYQQ18U
RXYQ18U
RYYQ18U
RYMQ18U

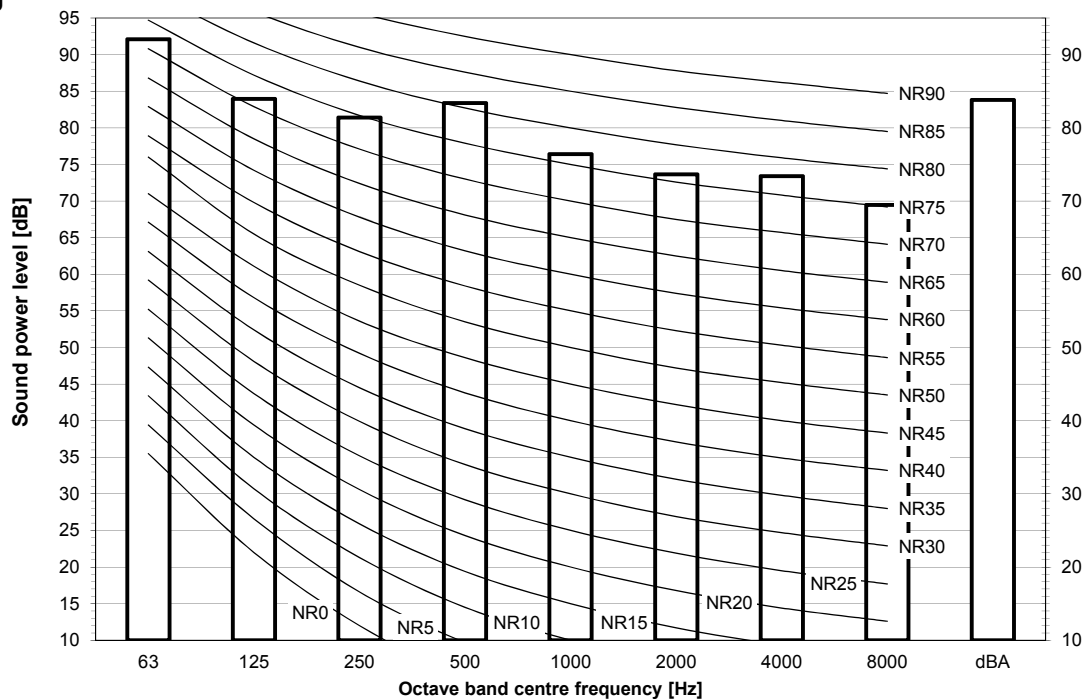

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = $10^{-6} \mu\text{W}/\text{m}^2$


Measured according to ISO 3744

3D119533

11 Sound data

11 - 1 Sound Power Spectrum

REYQ20U
RXYQQ20U
RXYQ20U
RYYQ20U
RYMQ20U

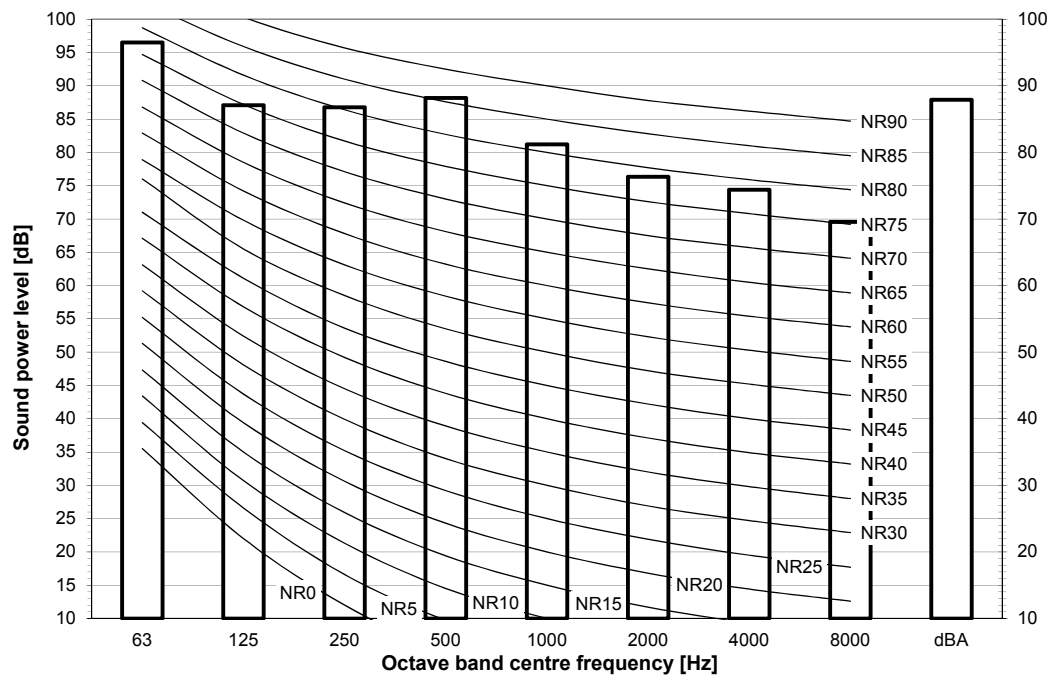

Notes

dBA = A-weighted sound power level (A scale according to IEC).

Reference acoustic intensity 0dB = 10^{-6} W/m^2


Measured according to ISO 3744

3D119534

11 Sound data


11 - 2 Sound Pressure Spectrum

REMQ5U
REYQ8U
RXYQQ8U
RXYQ8U
RXYTQ8UYF
RYYQ8U
RYMQ8U

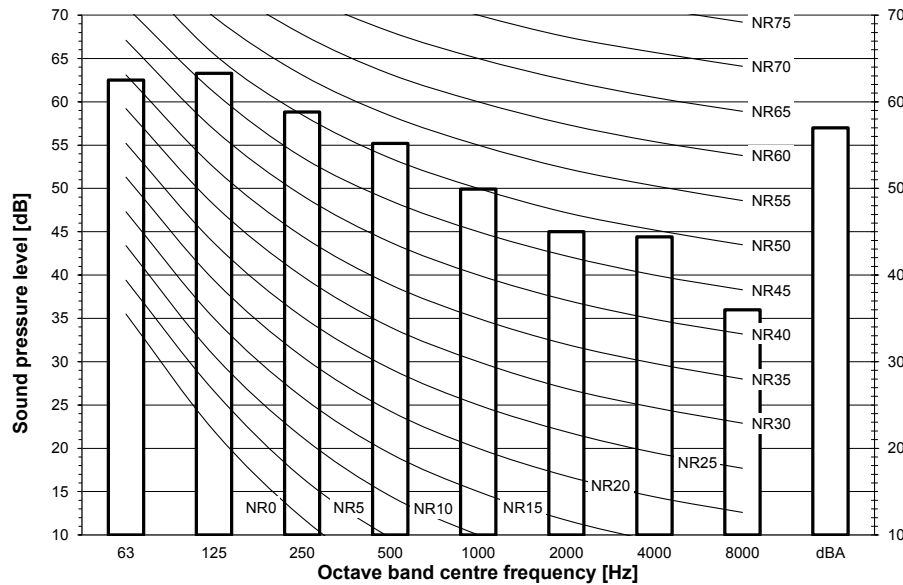


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

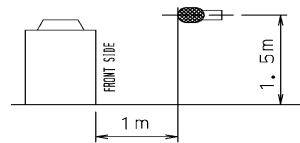


3D119521

REYQ10U
RXYQQ10U
RXYQ10U
RYYQ10U
RYMQ10U

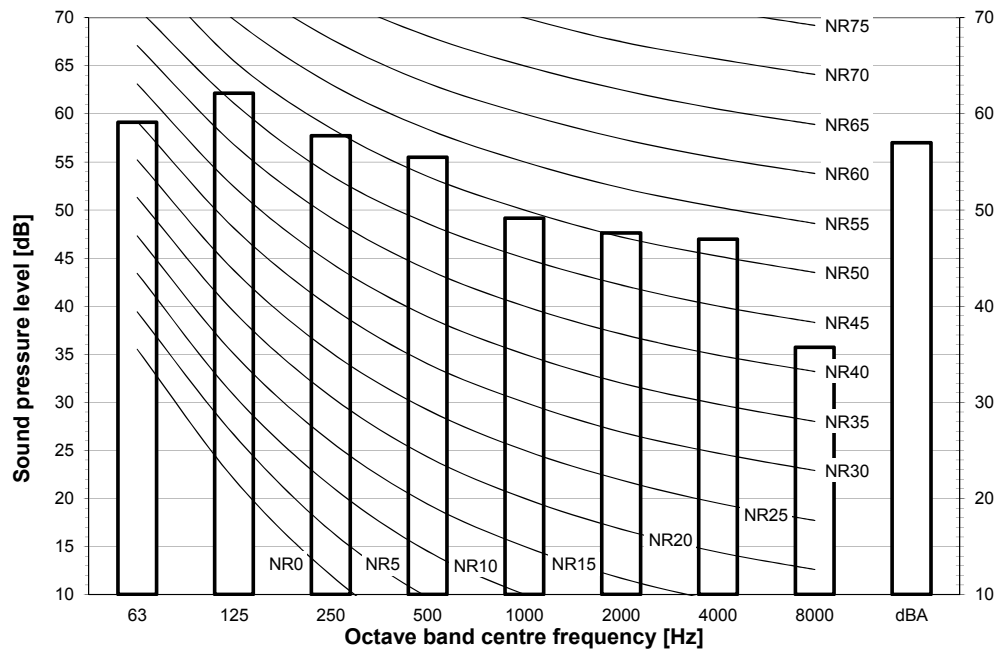

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

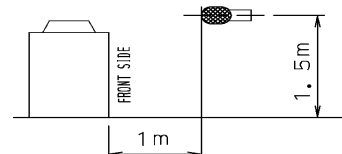


3D119522

11 Sound data

11 - 2 Sound Pressure Spectrum


11

REYQ12U
RXYQQ12U
RXYQ12U
RYYQ12U
RYMQ12U

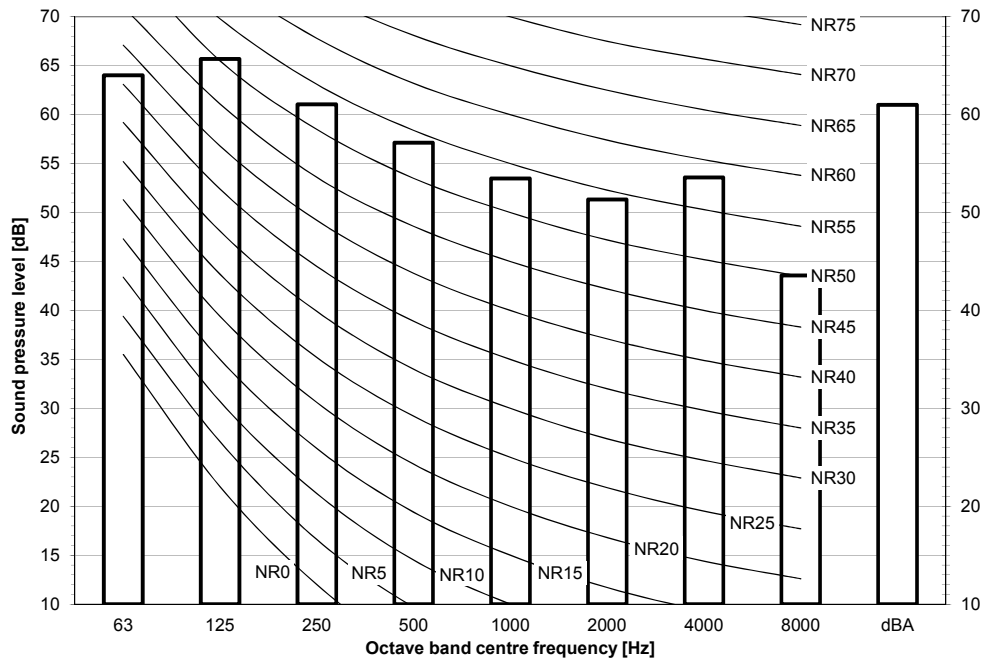


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa

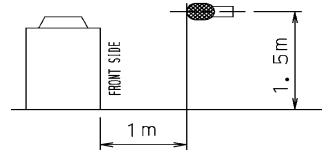


3D119523

REYQ14U
RXYQQ14U
RXYQ14U
RYYQ14U
RYMQ14U

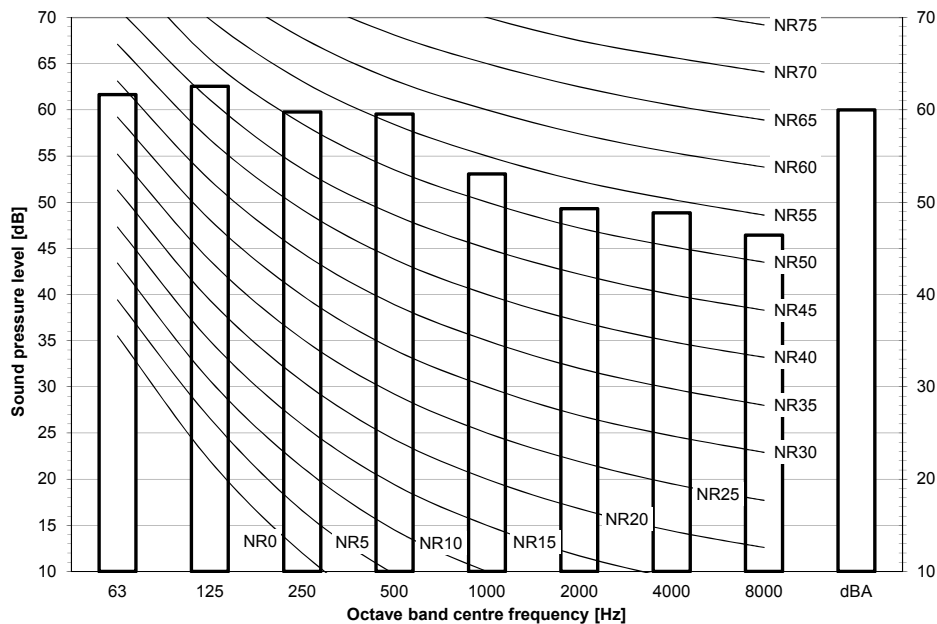

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 µPa

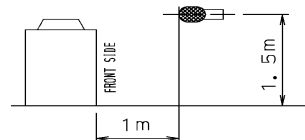


3D119524

11 Sound data


11 - 2 Sound Pressure Spectrum

REYQ16U
RXYQQ16U
RXYQ16U
RYYQ16U
RYMQ16U

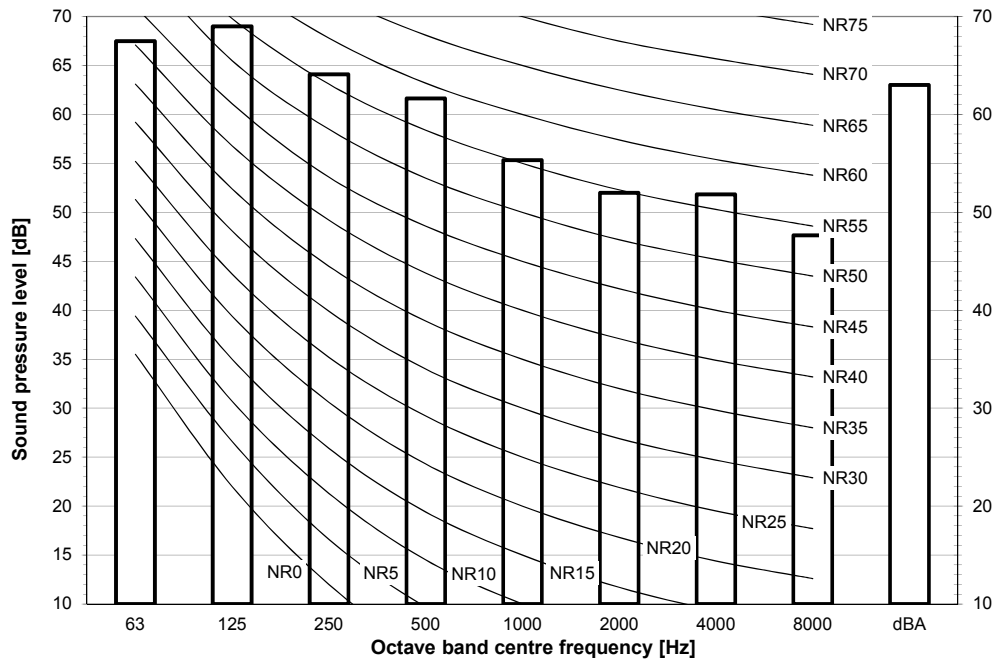


Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

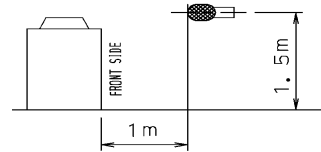


3D119525

REYQ18U
RXYQQ18U
RXYQ18U
RYYQ18U
RYMQ18U

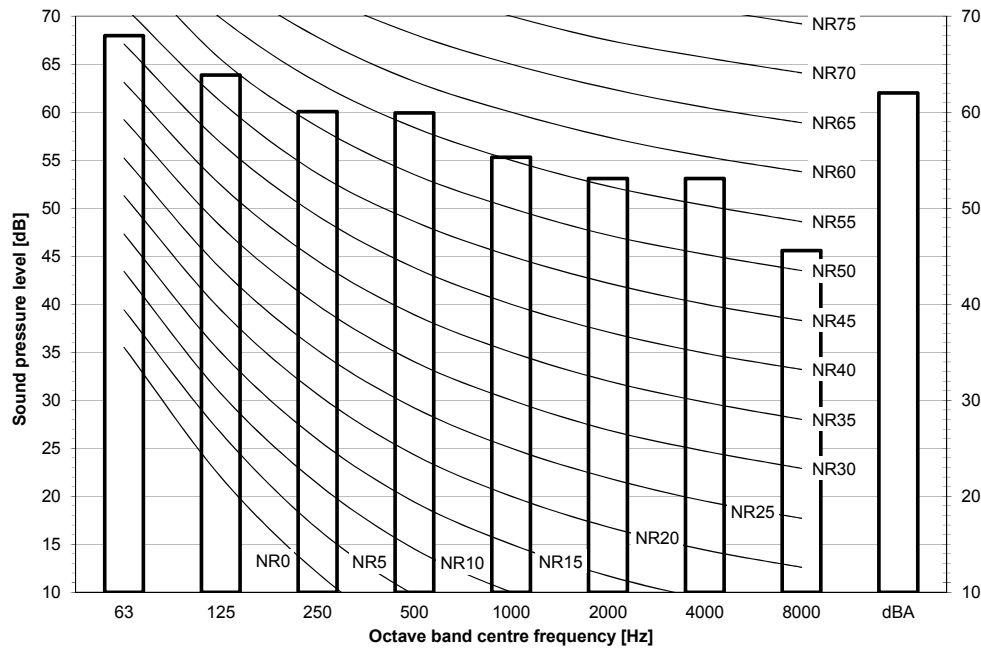

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

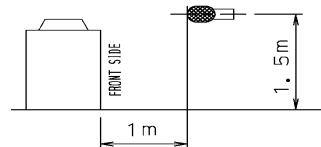


3D119526

11 Sound data


11 - 2 Sound Pressure Spectrum

REYQ20U
RXYQQ20U
RXYQ20U
RYYQ20U
RYMQ20U

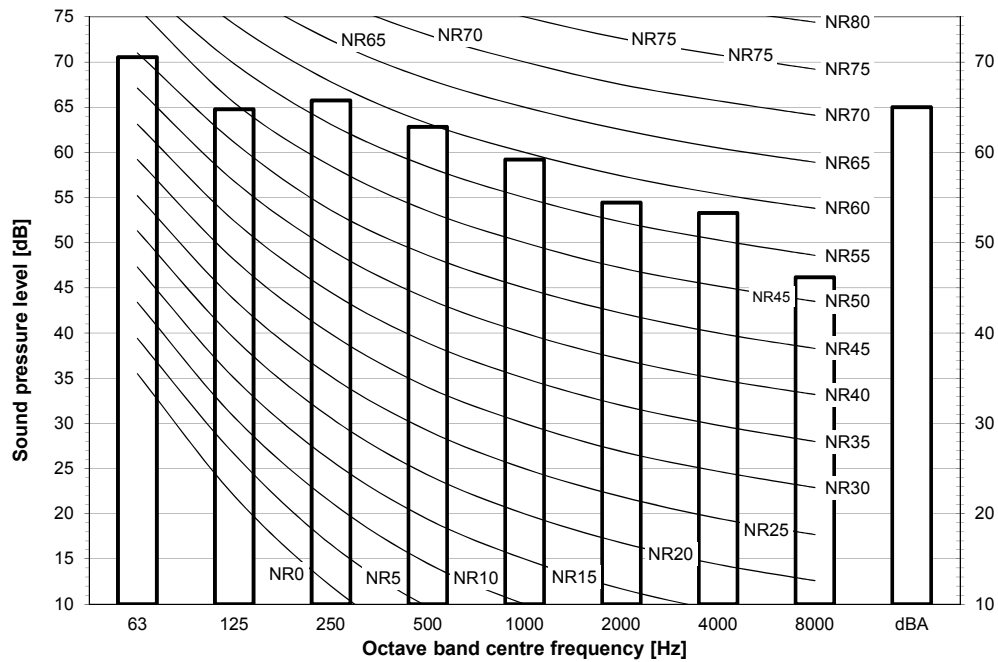

Notes

Data is valid at free field condition.
Data is valid at nominal operation condition.
dBA = A-weighted sound pressure level (A scale according to IEC).
Reference acoustic pressure 0 dB = 20 μ Pa

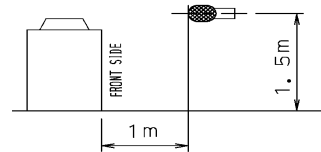

3D119527

11 Sound data

11 - 3 Sound Pressure Spectrum Quiet Mode Level 1

REMQ5U


REYQ8-12U

RXYQ8-12U

RXYTQ8UYF

RYY8-12U

RYMQ8-12U

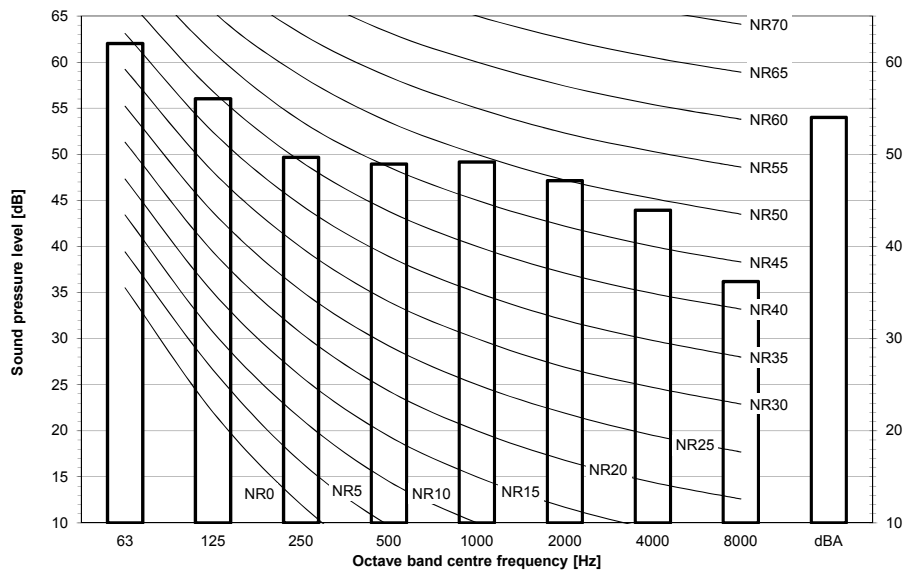

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119535

REYQ14-16U


RXYQ14-16U

RXYQ14-16U

RXYTQ14-16UYF

RYYQ14-16U

RYMQ14-16U

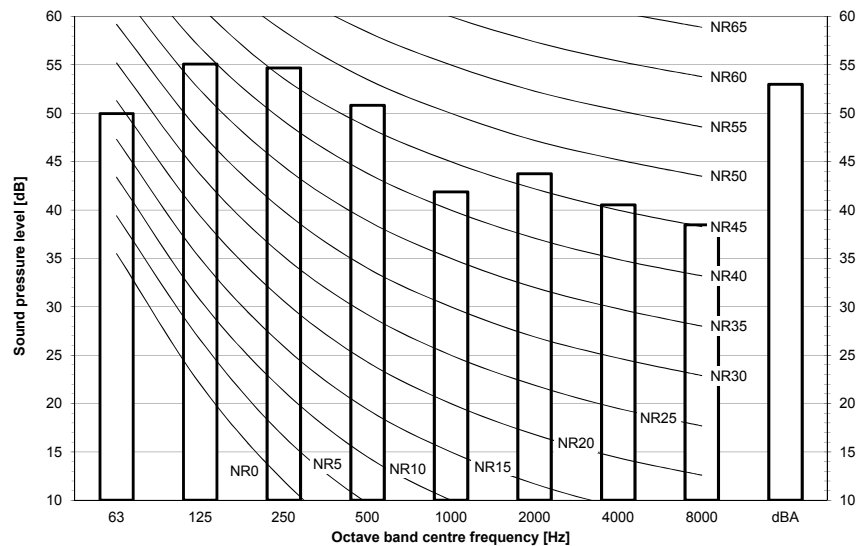

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119538

11 Sound data

11 - 3 Sound Pressure Spectrum Quiet Mode Level 1

REYQ18-20U
RXYQQ18-20U
RXYQ18-20U
RYYQ18-20U
RYMQ18-20U

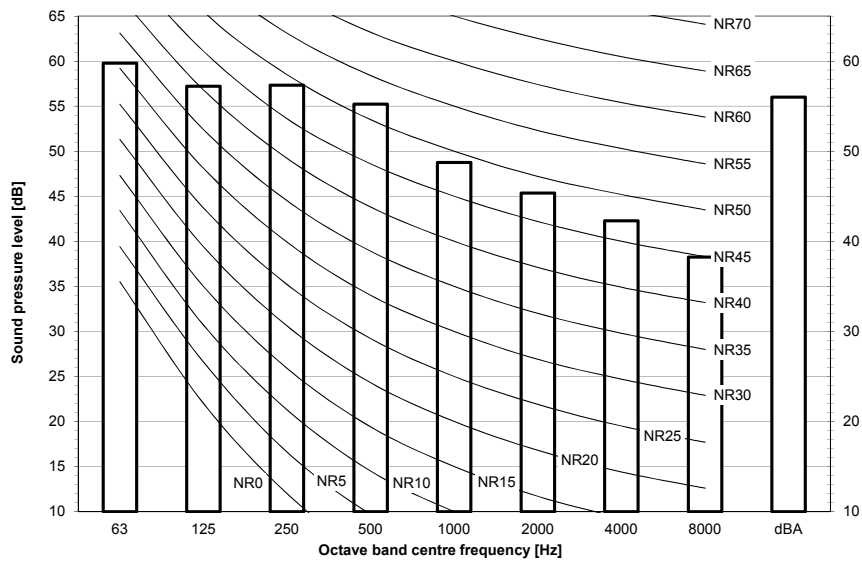

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 µPa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119541

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode Level 2

REMQ5U

REYQ8-12U


RXYQ8-12U

RXYQ8-12U

RXYTQ8UYF

RYYQ8-12U

RYMQ8-12U

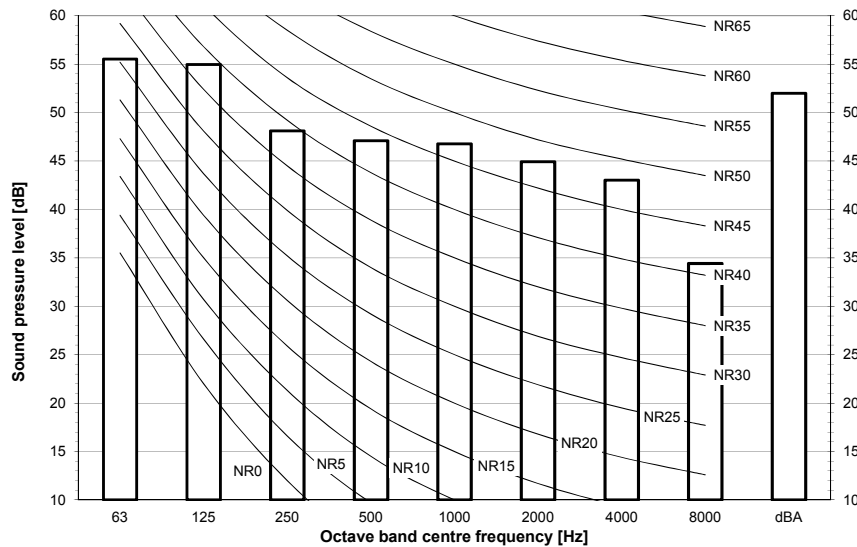

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 µPa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119536

REYQ14-16U


RXYQ14-16U

RXYQ14-16U

RXYTQ14-16UYF

RYYQ14-16U

RYMQ14-16U

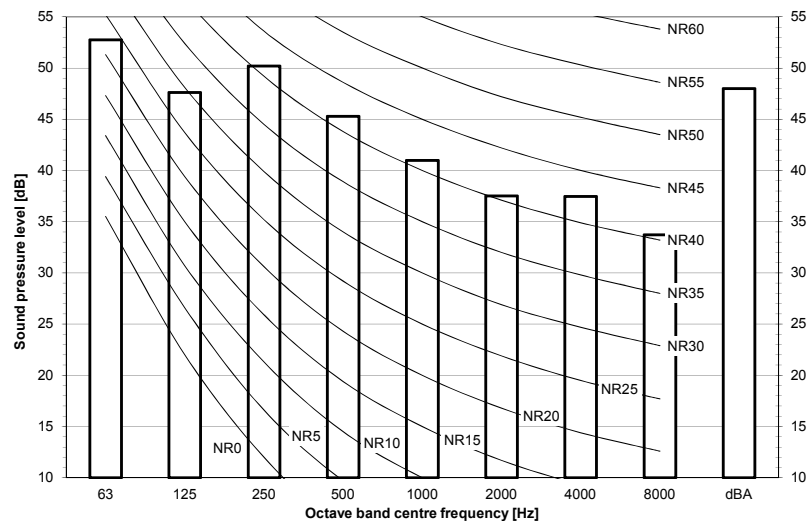

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 µPa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119539

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode Level 2

REYQ18-20U
RXYQQ18-20U
RXYQ18-20U
RYYQ18-20U
RYMQ18-20U

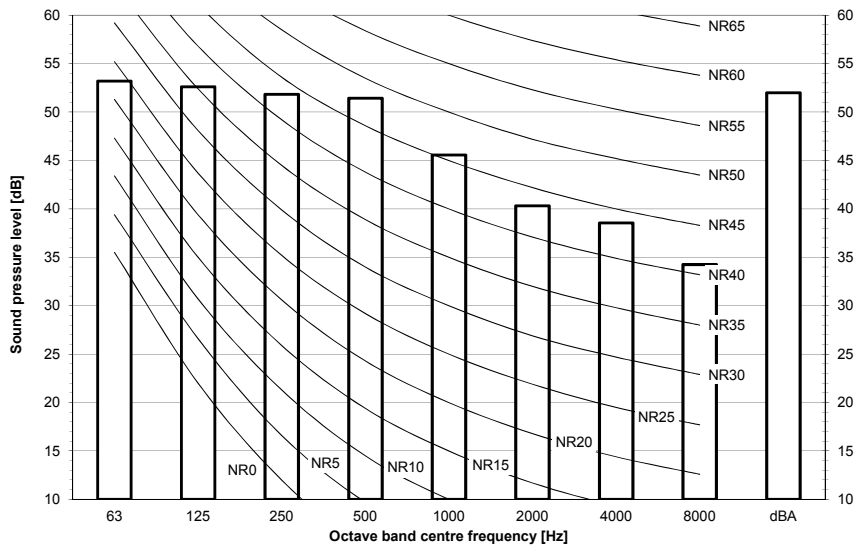

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)

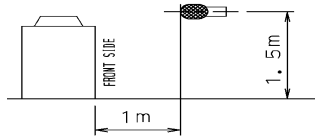

3D119542

11 Sound data

11 - 5 Sound Pressure Spectrum Quiet Mode Level 3

REMQ5U


REYQ8-12U

RXYQ8-12U

RXYTQ8UYF

RYYQ8-12U

RYMQ8-12U

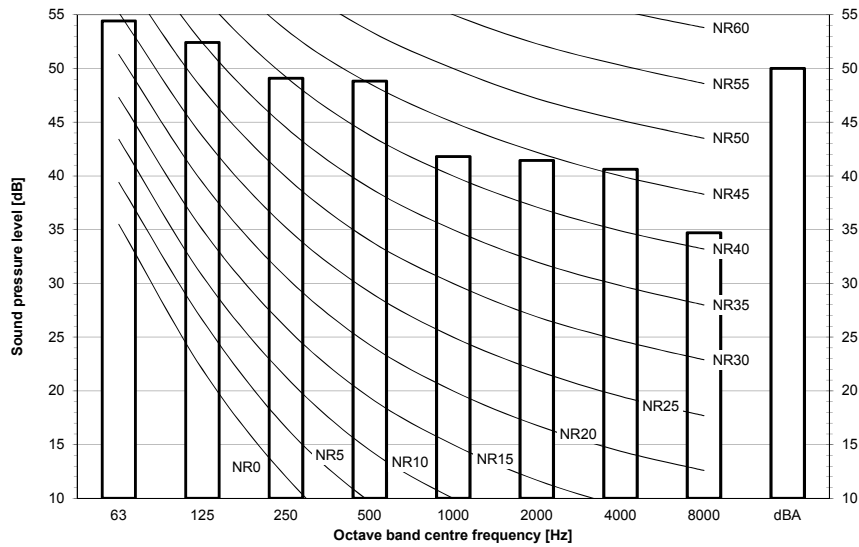

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119537

REYQ14-16U


RXYQ14-16U

RXYQ14U-16U

RXYTQ14-16UYF

RYYQ14-16U

RYMQ14-16U

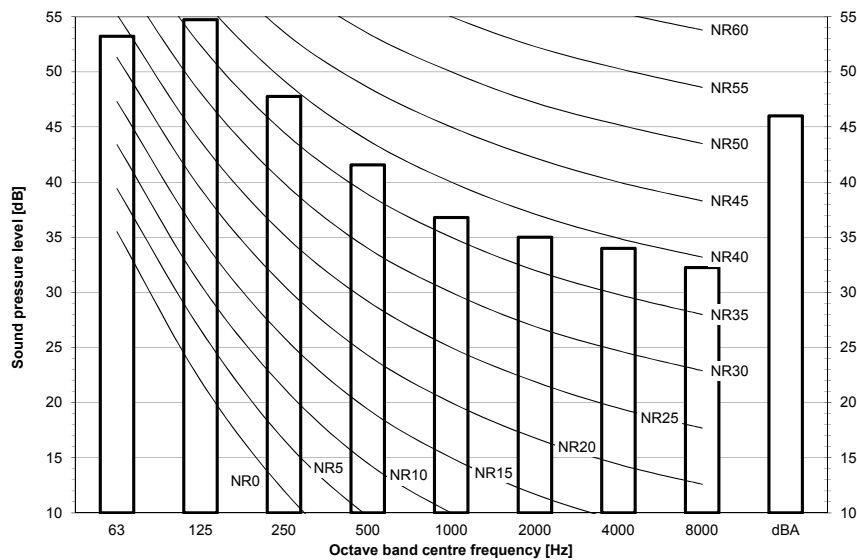

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)




3D119540

11 Sound data

11 - 5 Sound Pressure Spectrum Quiet Mode Level 3

REYQ18-20U
RXYQQ18-20U
RXYQ18-20U
RYYQ18-20U
RYMQ18-20U

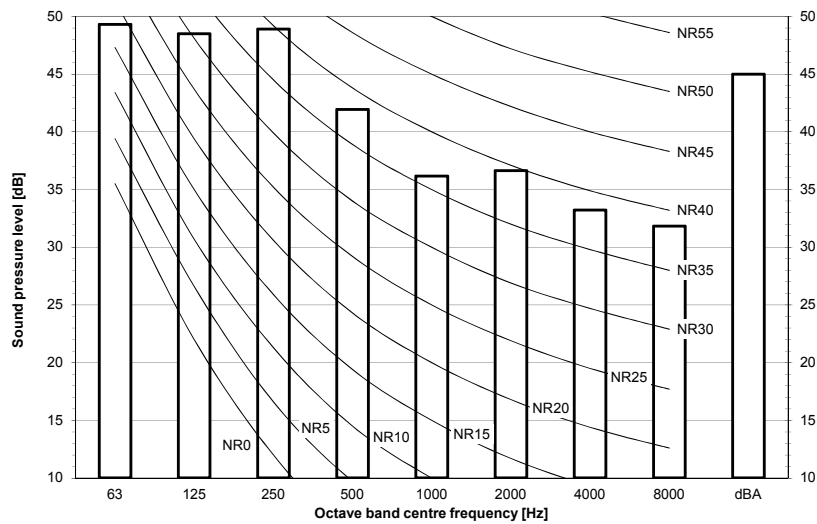

Notes

Data is valid at free field condition.

Data is valid at nominal operation condition.

dBA = A-weighted sound pressure level (A scale according to IEC).


Reference acoustic pressure 0 dB = 20 μ Pa

Data is valid under the following conditions

Cooling operation

Outdoor Ta: 35°C

Full load (maximum fan rps and maximum compressor rps for the dedicated low noise mode)



3D119543

12 Installation


12 - 1 Installation Method

REMQ5U
REYQ8-20U
RXYQ8-20U
RYYQ8-20U
RYMQ-20U

For single unit installation

For installation in rows

For centralised group layout

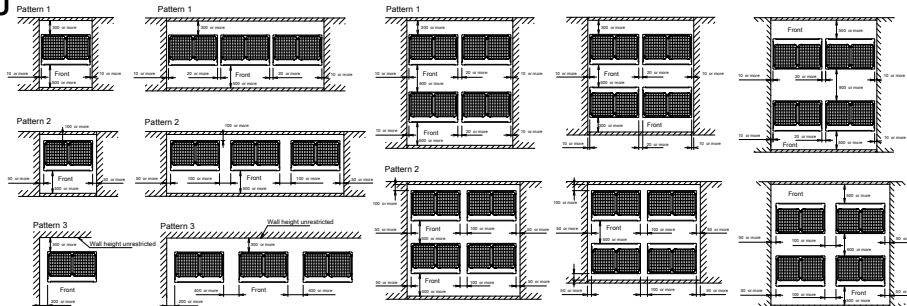

Notes

1. Height of the walls in case of patterns 1 and 2:

Front: 1500mm

Suction side: 500mm

Side: height unrestricted

The installation space shown on this drawing is based on cooling operation at 35°C (outdoor temperature).

When the design outdoor ambient temperature exceeds 35°C or the load exceeds maximum ability of much generation load of heat in all outdoor unit, make sure the suction-side space is broader than the space shown on this drawing.

2. If the walls are higher than mentioned above, then additional service space is needed:

- suction side: service space + $h1/2$


- front side: service space + $h2/2$

3. When installing the units, select the pattern that best fits the available space.

Always keep in mind to leave sufficient space for a person to pass between unit and wall and for the air to circulate freely.

If more units are to be installed than are catered for in the above patterns, your layout should take into account of the possibility of short circuits.

4. Provide sufficient space at the front to connect refrigerant piping (comfortably).



3D118467

12 Installation

12 - 2 Fixation and Foundation of Units

12

REMQ5U

REYQ8-20U



RXYQQ8-20U

RXYQ8-20U


RXYTQ8-16UYF

RYYQ8-20U

RYMQ8-20U

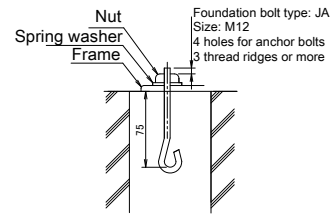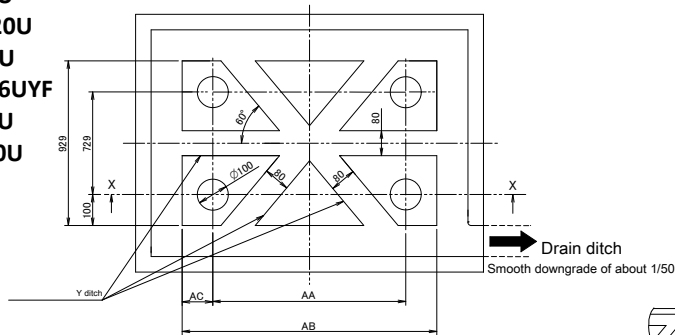

Foundation bolt fixing method

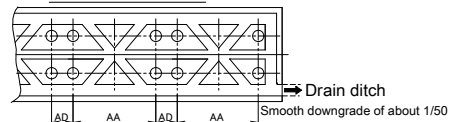

For multi-unit installation

Model	AA	AB	AC	AD
RYYQ8-12U	766	992	113	185
RYMQ8-12U				
RXYQ8-12U				
RXYQ08-12U				
REMO5T/REYQ8-12U				
RXYTQ8U				
RYYQ14-20U	1076	1076		
RYMQ14-20U				
RXYQ14-20U				
RXYQ014-20U				
REYQ14-20U				
RXYTQ10-16U				

Notes

1. Provide a drain ditch around the foundation to drain water from the installation area.
 2. The surface has to be finished with mortar. The corner edges have to be chamfered.
 3. Build the foundation on a concrete floor or, if not possible, make sure the foundation surface has a rough finish.
 4. Use a cement/sand/gravel ratio of 1/2/4 for the concrete, and a diameter of 10 mm for the reinforcement bars (approximately, 300mm intervals).
 5. When installing the equipment on a roof, make sure to check the strength of the floor and take adequate water proofing measures.
- 3D118459**

12 Installation

12 - 3 Refrigerant Pipe Selection

RXYQ-U
RYYQ-Y
RYMQ-U

VRV4
Heat pump
Piping restrictions 1/3

For the reference drawing, see
page 2/3.

		Maximum piping length			Maximum height difference			Total piping length
		Longest pipe (A+[B,G,E,J]) Actual / (Equivalent)	After first branch (B,G,E,J) Actual	After first branch (for multi-outdoor) (D) Actual / (Equivalent)	Indoor-to-outdoor ⁽³⁾ (H1) Outdoor above indoor / (indoor above outdoor)	Indoor-to-indoor (H2)	Outdoor-to-outdoor (H3)	
Standard								
VRV DX indoor units only		165/(190)m	40m ⁽¹⁾	10/(13)m	50/(40)m ⁽³⁾	30m	5m	1000m
Standard multi-combination								
All multi-outdoor-unit combinations except standard multi-outdoor-unit combinations		135/(160)m	40m ⁽¹⁾	10/(13)m	50/(40)m ⁽³⁾	30m	5m	500m
Hydrobox connection		135/(160)m	40m	10/(13)m	50/(40)m	15m	5m	300-500m ⁽⁵⁾
RA connection		100/(120)m	50m ⁽²⁾	-	50/(40)m	15m	-	250m
AHU connection	Pair	50/(55)m ⁽⁴⁾	-	-	40/(40)m	-	-	-
	Multi ⁽⁶⁾	165/(190)m	40m	10/13m	40/(40)m	15m	5m	1000m
	Mix ⁽⁷⁾	165/(190)m	40m	10/13m	40/(40)m	15m	5m	1000m

Remark

For standard multi-outdoor-unit combinations, see 3D079534.

(1) If all conditions below are met, the limitation can be extended up to 90 m

- a. The piping length between all indoor units and the nearest branch kit is ≤ 40m.
- b. It is necessary to increase the size of the gas and liquid piping if the pipe length between the first and the farthest indoor unit is >40m.
If the increased pipe size is larger than the pipe size of the main pipe, also increase the size of the main pipe.
- c. When the piping size is increased, the piping length has to be counted as double.

The total piping length has to be within limitations.

- d. The piping length difference between the nearest indoor unit from the first branch to the outdoor unit and the farthest indoor unit to the outdoor unit is ≤ 40m.

(2) If the piping length between the first branch and the BP box or VRV indoor unit is more than 20m, increase the length of the gas and liquid piping between the first branch and the BP box or VRV indoor unit.

(3) An extension to up to 90 m is possible without an additional option kit. Respect the following conditions:

-> If the outdoor units are positioned higher than the indoor units:

- a. Size up the liquid piping
- b. A dedicated setting on the outdoor unit is required.

-> If the outdoor units are positioned lower than the indoor units:

- a. 40~60m Minimum connection ratio: 80%
- 60~65m Minimum connection ratio: 90%
- 65~80m Minimum connection ratio: 100%
- 80~90m Minimum connection ratio: 110%

- b. Size up the liquid piping

A dedicated setting on the outdoor unit is required.

(4) The allowable minimum length is 5 m.

(5) In case of multi-outdoor-unit combinations.

(6) Multiple air handling units (AHU)(EKEXV + EKEQ kits).

(7) Mix of AHU units and VRV DX indoor

(8) If the equivalent piping length between is > 90m, size up the main liquid and gas piping.


3D079540E

12 Installation

12 - 3 Refrigerant Pipe Selection

RXYQ-U
RYYQ-U
RYMQ-U

VRV4
Heat pump
Piping restrictions 2/3

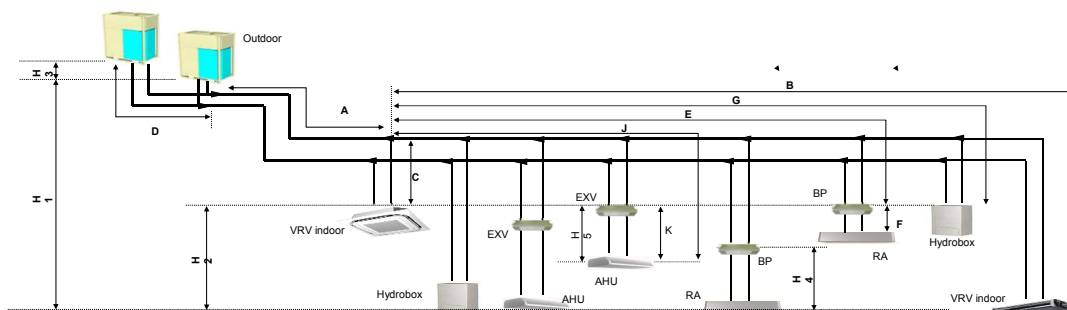

Remark

- (1) Schematic indication
Illustrations may differ from the actual appearance of the unit.
- (2) This is only to illustrate piping length limitations.
Combination of indoor unit types is not allowed.
Refer to combination table 3D079543 for details about the allowed combinations.

		Allowed piping length		Maximum height difference	
		BP to RA (F)	EXV to AHU (K)	BP to RA (H4)	EXV to AHU (H5)
RA connection		2~15m	-	5m	-
AHU connection	Pair	-	≤5m	-	5m
	Multi ⁽¹⁾	-	≤5m	-	5m
	Mix ⁽²⁾	-	≤5m	-	5m

Remark

- (1) Multiple air handling units (AHU)(EKEXV + EKEQ kits).
- (2) Mix of AHU units and VRV DX indoor

3D079540E

12 Installation

12 - 3 Refrigerant Pipe Selection

RXYQ-U
RYYQ-U
RYMQ-U

VRV4
Heat pump
Piping restrictions 3/3

System pattern Allowed connection ratio (CR) Other combinations are not allowed.	Total		Allowed capacity			
	Capacity	Indoor unit quantity (VRV, RA, AHU, Hydrobox)	VRV DX indoor unit	RA DX indoor unit	Hydrobox unit	Air handling unit (AHU)
VRV DX indoor units only	50~130%	Max.64	50~130%	-	-	-
VRV DX indoor unit + RA DX	80~130%	Max.32 ⁽¹⁾	0~130%	0~130%	-	-
RA DX indoor unit	80~130%	Max.32 ⁽¹⁾	-	80~130%	-	-
VRV DX indoor unit + LT hydrobox	50~130%	Max.32	50~130%	-	0~80%	-
VRV DX indoor unit + AHU	50~110% ⁽³⁾	Max.64 ⁽²⁾	50~110%	-	-	0~110%
AHU only Pair + multi (4)	90~110% ⁽³⁾	Max.64 ⁽²⁾	-	-	-	90~110%

Remark

- (1) There is no restriction on the number of connectable BP boxes.
- (2) For connection with AHU
EKEXV kits are also considered indoor units.
- (3) Restrictions regarding the air handling unit capacity
- (4) Pair AHU = system with 1 air handling unit connected to one outdoor unit
Multi AHU = system with multiple air handling units connected to one outdoor unit

About ventilation applications

- I. FXMQ_MF units are considered air handling units, following air handling unit limitations.
Maximum connection ratio when combined with VRV DX indoor units: <30%.
Maximum connection ratio when only air handling units are connected: <100%.
For information on the operation range, refer to the documentation of the FXMQ_MF unit.
- II. Biddle air curtains are considered air handling units, following air handling unit limitations:
For information on the operation range, refer to the documentation of the Biddle unit.
- III. [EKEXV + EKEQ] units combined with an air handling unit are considered air handling units, following air handling unit limitations.
For information on the operation range, refer to the documentation of the EKEXV-EKEQ unit.
- IV. VKM units are considered to be regular VRV DX indoor units.
For information on the operation range, refer to the documentation of the VKM unit.
- V. Because there is no refrigerant connection with the outdoor unit (only communication F1/F2), VAM units do not have connection limitations.
However, since there is communication via F1/F2, count them as regular indoor unit when calculating the maximum allowed number of connectable indoor units.


3D079540E

13 Operation range

13 - 1 Operation Range

RXYQQ-U
RXYQ-U
RYYQ-U
RYMQ-U

13

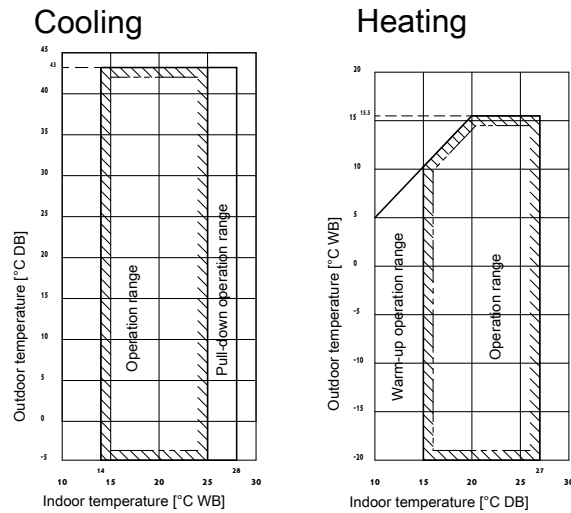

Notes

1. These figures assume the following operation conditions

Indoor and outdoor units

Equivalent piping length: 5m

Level difference: 0m

2. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).

3. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.

4. Operation range is valid in case direct expansion indoor units are used.

3D118465

14 Appropriate Indoors

14 - 1 Appropriate Indoors

RXYQ-U
RYYQ-U
RYMQ-U

Recommended indoor units for ·RXYQ*U* / RYYQ*U* / RYMQ*U*· outdoor units

HP	8	10	12	14	16	18	20
	4xFXM50	4xFXM63	6xFXM50	1xFXM50 5xFXM63	4xFXM63 2xFXM80	3xFXM50 5xFXM63	2xFXM50 6xFXM63

For multi outdoor units >16HP, the recommended amount of indoor units is the sum of the indoor units defined for a single outdoor unit.

For details about the allowed combinations, see the engineering databook.

Appropriate indoor units for ·RXYQ*U* / RYYQ*U* / RYMQ*U*· outdoor units

Covered by ·ENER LOT21·

FXFQ20-25-32-40-50-63-80-100-125
FXZQ15-20-25-32-40-50
FXCQ20-25-32-40-50-63-80-125
FXKQ25-32-40-63
FXDQ15-20-25-32-40-50-63
FXSQ15-20-25-32-40-50-63-80-100-125-140
FXMQ50-63-80-100-125-200-250
FXAQ15-20-25-32-40-50-63
FXHQ32-63-100
FXUQ71-100
FXNQ20-25-32-40-50-63
FXLQ20-25-32-40-50-63


Covered by ·ENER LOT10·

FTXJ25-35-50
FTXA20-25-35-42-50
FLXS25-35-50-60
FVXM25F-35F-50F
FVXG25-35-50
FTXM20R-25R-35R-42R-50R-60R-71R
CVXM20A

Outside the scope of ·ENER LOT21·

EKEXV50-63-80-100-125-140-200-250-400-500 + EKEQM / EKEQF
HXY080-125
VKM50-80-100
CYVS100-150-200-250
CYVM100-150-200-250
CYVL100-150-200-250

3D118461D



EEDEN22A

03/2022



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.