

Rooftop with 3 dampers Air Conditioning Technical Data UATYA-BFC3Y1



UATYA25BFC3Y1
UATYA30BFC3Y1
UATYA40BFC3Y1
UATYA50BFC3Y1
UATYA60BFC3Y1
UATYA70BFC3Y1
UATYA80BFC3Y1
UATYA90BFC3Y1
UATYA100BFC3Y1
UATYA110BFC3Y1
UATYA120BFC3Y1
UATYA140BFC3Y1
UATYA150BFC3Y1
UATYA160BFC3Y1
UATYA180BFC3Y1
UATYA190BFC3Y1

TABLE OF CONTENTS

UATYA-BFC3Y1

1	Features	4
	UATYA-BFC3Y1	4
2	Specifications	5
3	Features and advantages	12
4	Options	14
5	Capacity tables	15
	Cooling/Heating Capacity Tables	15
6	Dimensional drawings	31
7	Piping diagrams	36
8	Wiring diagrams	38
	Wiring Diagrams - Single Phase	38
9	Sound data	39
	Sound Level Data	39
10	Fan characteristics	40
11	Operation range	42

1 Features

1 - 1 UATYA-BFC3Y1

Integrated fresh air solution with extraction damper and thermodynamic heat recovery

1

- › Integrated extraction damper and fan ensures an optimal pressure balance inside the building
- › Thermo dynamic heat recovery, recovers waste heat through the outdoor heat exchanger
- › Free cooling with up to 100% fresh air intake, saving on energy consumption and improving indoor air quality
- › Reduced CO2 equivalent thanks to the use of lower GWP R-32 refrigerant
- › Highly efficient ERP compliant models, meeting the latest eco-design requirements
- › Easy to install 'plug and play' concept; no additional piping is required since this is a packaged unit
- › Available as Made-To-Stock units and Made-To-Order units with extensive option package
- › Demand controlled fresh air management thanks to the CO2 sensor connection available as accessory
- › 25mm double skinned panels ensure long-lasting life and provide good thermal and sound insulation
- › Latest pCO2 controller allows direct integration with Daikin BMS, or third party BMS via BACnet or Modbus
- › Clogged filter alarm indicates when filter requires cleaning, improving air quality and efficiency
- › Flexible supply and return air connection
- › Wide operation range in cooling (-15 ~ 48°C) and heating (-15 ~ 20°C)



Inverter

2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1
Cooling capacity	Nom.	kW		25.8 (1)	33.4 (1)	38.7 (1)	45.7 (1)
	With 30% fresh air	kW		27.8 (1)	36.1 (1)	42.5 (1)	49.6 (1)
Heating capacity	Nom.	kW		25.3 (2)	31.1 (2)	36.3 (2)	46.2 (2)
	With 30% fresh air	kW		26.0 (2)	32.4 (2)	38.3 (2)	47.7 (2)
Power input	Cooling Nom.	kW		9.1 (1)	10.8 (1)	12.7 (1)	15.4 (1)
	Heating Nom.	kW		7.8 (2)	9.4 (2)	11.1 (2)	14.2 (2)
EER				2.83 (1) / 2.96 (3)	3.09 (1) / 3.20 (3)	3.06 (1) / 3.27 (3)	2.96 (1) / 3.12 (3)
COP				3.22 (2) / 3.38 (3)	3.31 (2) / 3.48 (3)	3.26 (2) / 3.51 (3)	3.24 (2) / 3.46 (3)
Space cooling	Capacity Pdesign	kW		25.8	33.4	38.7	45.7
	SEER			4.62 (4)	4.89 (4)	5.39 (4)	5.26 (4)
	ηs,c	%		181.6	192.6	212.5	207.0
	Annual energy consumption	kWh/a		3,378	4,101	4,310	5,212
Space heating (Average climate)	Capacity Pdesign	kW		25.3	31.1	36.3	46.2
	SCOP/A			3.35 (4)	3.38 (4)	3.67 (4)	3.65 (4)
	ηs,h	%		131.0	132.2	143.8	143.0
	Pdh Heating capacity at -10°	kW		15.2	20.1	21.9	28.0
	Annual energy consumption	kWh/a		7,210	9,558	9,427	12,223
	Required back up heating cap at design conditions	kW		0.00			
Space cooling	A Condi- tion (35°C	Pdc	kW	25.8	33.4	38.7	45.7
	- 27/19)	EERd		2.83	3.09	3.06	2.96
		Power input	kW	9.1	10.8	12.7	15.4
	B Condi- tion (30°C	Pdc	kW	19.1	24.5	28.5	33.6
	- 27/19)	EERd		4.06	4.38	4.52	4.42
		Power input	kW	4.7	5.6	6.3	7.6
	C Condi- tion (25°C	Pdc	kW	12.6	15.7	18.3	21.6
	- 27/19)	EERd		5.73	6.04	6.78	6.75
		Power input	kW	2.2	2.6	2.7	3.2
	D Condi- tion (20°C	Pdc	kW	12.9	14.0	14.5	20.4
	- 27/19)	EERd		6.79	7.37	8.53	8.16
		Power input	kW	1.9		1.7	2.5
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10			
		Pdh (declared heating cap)	kW	15.2	20.1	21.9	28.0
		COPd (declared COP)		1.95	2.01	1.99	2.01
		Power input	kW	7.8	10.0	11.0	13.9
	TBivalent	Tbiv (bivalent temperature)	°C	-8			
		Pdh (declared heating cap)	kW	15.9	21.3	22.8	29.4
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.01	2.11	2.07	2.10
		Power input	kW	7.9	10.1	11.0	14.0
	A Con- dition (-7°C)	Pdh (declared heating cap)	kW	15.3	20.4	21.8	28.1
		COPd (declared COP)		2.14	2.24	2.20	2.21
		Power input	kW	7.1	9.1	9.9	12.7
	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	9.4	12.5	13.4	17.2
		COPd (declared COP)		3.62	3.57	3.94	3.91
		Power input	kW	2.6	3.5	3.4	4.4
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	9.3	10.5	9.9	14.2
		COPd (declared COP)		4.23	4.20	4.50	4.58
		Power input	kW	2.2	2.5	2.2	3.1
	D Con- dition (12°C)	Pdh (declared heating cap)	kW	10.6	11.9	11.2	16.1
		COPd (declared COP)		5.05	4.96	5.60	5.55
		Power input	kW	2.1	2.4	2.0	2.9
Evaporator	Supply side	Fan	Quantity	1			
			Air flow rate	m³/h	4,500	5,800	7,500
			Nominal ESP	Pa	300 (5)		
			High ESP	Pa	425 (5)	727 (5)	510 (5)
	Return side	Filter	Thickness	mm	98		
			Quantity		1		
			Air flow rate	m³/min	4,500	5,800	7,500
			Nominal ESP	Pa	300 (5)		
	Fresh air	Ratio	Standard	%	30		
			In free cooling	%	100		

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1
Condenser	Air flow rate	Cooling	m³/h	15,725	16,038	16,374	16,341
	Fan	Motor	Quantity	1			
	Compressor		Quantity	1			
	Refrigerant	GWP		675			
		Charge	TCO2Eq	4,725	6,750	8,100	10,125
		Charge	kg	7.0	10.0	12.0	15.0
		Circuits	Quantity	1			
	Refrigerant oil	Charged volume	l	1,5	2,8		
Dimensions	Unit	Height	mm	1,924		2,374	
		Width	mm	2,250			
		Depth	mm	3,514			
Weight	Unit		kg	1,166	1,196	1,310	1,329
Sound pressure level	Cooling		dBA	63.9 (6)	66.0 (6)	68.0 (6)	67.3 (6)
Sound power level	Cooling		dBA	82.2 (7)	84.3 (7)	86.8 (7)	86.1 (7)
Operation range	Cooling	Min.	°CDB	-10			
		Max.	°CDB	48			
	Heating	Min.	°CWB	-15			
		Max.	°CWB	26			
Cooling	Cdc (Degradation cooling)			0.25			
Heating	Cdh (Degradation heating)			0.25			

Technical specifications				UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1
Cooling capacity	Nom.		kW	58.8 (1)	65.3 (1)	74.8 (1)	89.8 (1)
	With 30% fresh air		kW	63.7 (1)	70.5 (1)	81.3 (1)	96.8 (1)
Heating capacity	Nom.		kW	55.1 (2)	64.9 (2)	68.5 (2)	84.2 (2)
	With 30% fresh air		kW	57.1 (2)	68.6 (2)	71.6 (2)	87.2 (2)
Power input	Cooling	Nom.	kW	18.8 (1)	22.4 (1)	24.2 (1)	29.4 (1)
	Heating	Nom.	kW	16.9 (2)	20.2 (2)	20.3 (2)	26.1 (2)
EER				3.12 (1) / 3.23 (3)	2.92 (1) / 3.00 (3)	3.09 (1) / 3.21 (3)	3.06 (1) / 3.22 (3)
COP				3.25 (2) / 3.40 (3)	3.21 (2) / 3.39 (3)	3.37 (2) / 3.56 (3)	3.22 (2) / 3.45 (3)
Space cooling	Capacity	Pdesign	kW	58.8	65.3	74.8	89.8
	SEER			5.50 (4)	4.53 (4)	5.56 (4)	5.47 (4)
	ηs,c		%	217.1	178.1	219.4	215.8
	Annual energy consumption			6,411	8,652	8,124	9,852
Space heating (Average climate)	Capacity	Pdesign	kW	55.1	64.9	68.5	84.2
	SCOP/A			3.47 (4)	3.41 (4)	3.70 (4)	3.65 (4)
	ηs,h		%	135.6	133.5	145.2	143.0
	PdH Heating capacity at -10°			33.2	38.3	40.1	51.5
	Annual energy consumption			15,091	17,811	17,498	22,119
	Required back up heating cap at design conditions			0.00			
Space cooling	A Condi-	Pdc	kW	58.8	65.3	74.8	89.8
	tion (35°C	EERd		3.12	2.92	3.09	3.06
	- 27/19)	Power input	kW	18.8	22.4	24.2	29.4
	B Condi-	Pdc	kW	43.2	48.1	55.4	66.1
	tion (30°C	EERd		4.70	3.87	3.96	4.35
	- 27/19)	Power input	kW	9.2	12.4	14.0	15.2
	C Condi-	Pdc	kW	27.7	30.6	35.6	42.5
	tion (25°C	EERd		6.76	5.67	6.72	6.64
	- 27/19)	Power input	kW	4.1	5.4	5.3	6.4
	D Condi-	Pdc	kW	22.1	23.9	25.8	35.3
	tion (20°C	EERd		8.84	7.24	10.32	8.83
	- 27/19)	Power input	kW	2.5	3.3	2.5	4.0
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10			
		PdH (declared heating cap)	kW	33.2	38.3	40.1	51.5
		COPd (declared COP)		1.96	1.93		1.96
		Power input	kW	16.9	19.9	20.8	26.3
	TBivalent	Tbiv (bivalent temperature)	°C	-8			
		PdH (declared heating cap)	kW	34.5	40.1	42.7	53.2

2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications				UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1
Space heating (Average climate)	TBivalent	COPd (declared COP)		2.04	2.02	2.04	2.03
		Power input		16.9	19.9	20.9	26.2
	A Con- dition (-7°C)	Pd _h (declared heating cap)		33.0	42.3	44.5	55.3
		COPd (declared COP)		2.17	2.12	2.13	2.10
	B Condi- tion (2°C)	Power input		15.2	20.0	20.9	26.3
		Pd _h (declared heating cap)		20.3	23.5	25.0	19.6
		COPd (declared COP)		3.69	3.67	3.91	3.77
		Power input		5.5	6.4		5.2
	C Condi- tion (7°C)	Pd _h (declared heating cap)		14.9	16.0	15.3	22.4
		COPd (declared COP)		4.26	4.10	4.64	4.87
	D Con- dition (12°C)	Power input		3.5	3.9	3.3	4.6
		Pd _h (declared heating cap)		16.9	18.4	17.7	25.4
Evaporator	Supply side	Fan	Quantity	1		2	
			Air flow rate	11,000	13,000	14,500	16,500
		Filter	Nominal ESP		300 (5)		
			High ESP	629 (5)	410 (5)	526 (5)	493 (5)
	Return side	Fan	Thickness		98		
			Quantity	1		2	
		Filter	Air flow rate	11,000	13,000	14,500	16,500
			Nominal ESP		300 (5)		
	Fresh air	Ratio	High ESP	426 (5)	474 (5)	596 (5)	543 (5)
			Standard		30		
			In free cooling		100		
Condenser	Air flow rate	Cooling	m ³ /h	31,183	32,203	35,774	37,285
	Fan	Motor	Quantity	2			
	Compres- sor	Quantity		1	2		
	Refriger- ant	GWP	TCO ₂ Eq	675			
		Charge	kg	12,150	15,525	16,200	
				18.0	23.0	24.0	
	Refriger- ant oil	Circuits	Quantity	1			
Dimensions	Unit	Height	mm	1,924	2,374		
Weight	Unit	Cooling	kg	1,996	2,094	2,336	2,382
Sound pressure level	Cooling	Min.	°CDB	69.0 (6)	68.1 (6)	72.6 (6)	68.7 (6)
Sound power level	Cooling	Max.	°CDB	88.5 (7)	87.5 (7)	92.5 (7)	88.6 (7)
Operation range	Cooling	Min.	°CWB	-10			
				48			
Power consump- tion in other than active mode	Thermo- stat-off mode	Cooling	PTO	kW	1	-	
				kW	1	-	
Cooling	Cdc (Degradation cooling)				0.25		
Heating	Cdh (Degradation heating)				0.25		

Technical specifications				UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1
Cooling capacity	Nom.		kW	95.8 (1)	108.9 (1)	115.0 (1)	133.4 (1)
	With 30% fresh air		kW	104.3 (1)	118.0 (1)	124.5 (1)	145.6 (1)
Heating capacity	Nom.		kW	92.8 (2)	101.5 (2)	108.0 (2)	123.1 (2)
	With 30% fresh air		kW	97.9 (2)	107.0 (2)	112.3 (2)	132.0 (2)
Power input	Cooling	Nom.	kW	32.3 (1)	36.4 (1)	39.5 (1)	42.5 (1)
	Heating	Nom.	kW	29.0 (2)	30.3 (2)	33.2 (2)	35.8 (2)
EER				2.97 (1) / 3.14 (3)	2.99 (1) / 3.11 (3)	2.91 (1) / 3.01 (3)	3.14 (1) / 3.26 (3)
COP				3.20 (2) / 3.42 (3)	3.35 (2) / 3.57 (3)	3.25 (2) / 3.40 (3)	3.44 (2) / 3.62 (3)
Space cooling	Capacity	Pdesign	kW	95.8	108.9	115.0	133.4
	SEER			5.17 (4)	5.29 (4)	5.15 (4)	4.38 (4)
	ηs,c		%	203.7	208.6	203.0	172.1
	Annual energy consumption		kWh/a	11,122	12,348	13,397	18,280
Space heating (Average climate)	Capacity	Pdesign	kW	92.8	101.5	108.0	123.1
	SCOP/A			3.62 (4)	3.56 (4)	3.53 (4)	3.39 (4)
	ηs,h		%	141.6	139.3	138.3	132.5
	Pd _h Heating capacity at -10°		kW	54.7	59.8	64.3	71.6
	Annual energy consumption		kWh/a	24,538	27,186	29,413	39,459
	Required back up heating cap at design conditions		kW	0.00			

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications					UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1	
Space cooling	A Condi- tion (35°C - 27/19)	Pdc	kW		95.8	108.9	115.0	133.4	
		EERd			2.97	2.99	2.91	3.14	
	B Condi- tion (30°C - 27/19)	Power input	kW		32.3	36.4	39.5	42.5	
		Pdc	kW		69.9	80.1	84.6	98.3	
	C Condi- tion (25°C - 27/19)	EERd			3.97	4.09	3.90	4.15	
		Power input	kW		17.6	19.6	21.7	23.7	
	D Condi- tion (20°C - 27/19)	Pdc	kW		45.3	51.4	54.3	63.2	
		EERd			6.29	6.27	6.17	5.02	
		Power input	kW		7.2	8.2	8.8	12.6	
Space heating (Average climate)	TOL	Pdc	kW		35.5	37.0	37.3	45.4	
		EERd			8.66	9.25	9.10	5.47	
		Power input	kW		4.1	4.0	4.1	8.3	
		Tol (temperature operating limit)	°C		-10				
	TBivalent	Pdh (declared heating cap)	kW		54.7	59.8	64.3	71.6	
		COPd (declared COP)			1.56	2.01	1.98	1.91	
		Power input	kW		35.0	29.8	32.5	37.4	
		Tbiv (bivalent temperature)	°C		-8				
		Pdh (declared heating cap)	kW		58.5	63.8	68.5	80.8	
Space heating (Average climate)	TBivalent	COPd (declared COP)			1.71	2.10	2.08	2.15	
		Power input	kW		34.3	30.4	33.0	37.6	
	A Condi- tion (-7°C)	Pdh (declared heating cap)	kW		60.1	66.0	70.2	80.0	
		COPd (declared COP)			1.78	2.18	2.13	2.12	
	B Condi- tion (2°C)	Power input	kW		33.8	30.3	32.9	37.7	
		Pdh (declared heating cap)	kW		34.3	37.3	40.1	51.5	
		COPd (declared COP)			3.94	3.52		3.68	
		Power input	kW		8.7	10.6	11.4	14.0	
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW		22.5	22.6	22.7	34.4	
		COPd (declared COP)			4.79	4.81	4.73	4.15	
		Power input	kW		4.7		4.8	8.3	
		Pdh (declared heating cap)	kW		25.5	25.6	25.8	38.3	
	D Condi- tion (12°C)	COPd (declared COP)			5.67	5.69	5.73	4.67	
		Power input	kW		4.5			8.2	
	Evaporator	Supply side	Fan	Quantity		2			3
				Air flow rate	m³/h	18,000	19,800	21,600	25,000
Filter			Nominal ESP	Pa	300 (5)				
			High ESP	Pa	463 (5)	427 (5)	394 (5)	441 (5)	
Return side		Fan	Thickness	mm	98				
			Quantity		2				
			Air flow rate	m³/min	18,000	19,800	21,600	25,000	
			Nominal ESP	Pa	300 (5)				
Fresh air		Ratio	High ESP	Pa	519 (5)	483 (5)	438 (5)	324 (5)	
			Standard	%	30				
Condenser	Air flow rate	Cooling	In free cooling	%	100				
			m³/h	36,195	38,143	36,865	70,704		
	Fan	Motor	Quantity		2			4	
			Quantity		2			4	
	Refriger- ant	GWP			675				
			Charge	TCO2Eq	18,900	20,250	24,300	25,650	
		Charge	kg	28.0	30.0	36.0	38.0		
			Circuits	Quantity		1			2
	Refriger- ant oil	Charged volume	l	6,3	7,5			13,5	
	Dimensions	Unit	Height	mm	2,374				
Width			mm	2,250					
Depth			mm	6,317			7,117		
Weight	Unit		kg	2,452	2,548	2,558	3,024		
Sound pressure level	Cooling		dBA	69.9 (6)	70.6 (6)	74.2 (6)	68.3 (6)		
Sound power level	Cooling		dBA	89.8 (7)	90.5 (7)	94.1 (7)	88.6 (7)		
Operation range	Cooling	Min.	°CDB	-10					
		Max.	°CDB	48					
	Heating	Min.	°CWB	-15					
		Max.	°CWB	26					
Power consump- tion in other than active mode	Thermo- stat-off mode	Cooling	PTO	kW	-	1			
		Heating	PTO	kW	-	1			
Cooling	Cdc (Degradation cooling)				0.25				
Heating	Cdh (Degradation heating)				0.25				

2 Specifications

1 - 1 UATYA-BFC3Y1

Technical specifications					UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1	
Cooling capacity	Nom.		kW		144.7 (1)	154.6 (1)	171.9 (1)	187.0 (1)	
	With 30% fresh air		kW		156.8 (1)	168.3 (1)	186.5 (1)	204.4 (1)	
Heating capacity	Nom.		kW		136.4 (2)	147.1 (2)	157.1 (2)	176.9 (2)	
	With 30% fresh air		kW		147.5 (2)	160.0 (2)	173.5 (2)	191.6 (2)	
Power input	Cooling	Nom.	kW		47.9 (1)	50.7 (1)	56.1 (1)	62.9 (1)	
	Heating	Nom.	kW		40.9 (2)	45.1 (2)	47.2 (2)	54.2 (2)	
EER					3.02 (1) / 3.14 (3)	3.05 (1) / 3.18 (3)	3.07 (1) / 3.21 (3)	2.97 (1) / 3.14 (3)	
COP					3.33 (2) / 3.57 (3)	3.26 (2) / 3.49 (3)	3.33 (2) / 3.63 (3)	3.27 (2) / 3.50 (3)	
Space cooling	Capacity	Pdesign	kW		144.7	154.6	171.9	187.0	
	SEER				4.26 (4)	4.27 (4)	4.15 (4)	4.08 (4)	
	ηs,c		%		167.2	167.6	162.8	160.2	
	Annual energy consumption		kWh/a		20,374	21,779	24,876	27,540	
Space heating (Average climate)	Capacity	Pdesign	kW		136.4	147.1	157.1	176.9	
	SCOP/A				3.36 (4)	3.34 (4)	3.31 (4)	3.34 (4)	
	ηs,h		%		131.4	130.8	129.5	130.6	
	Pdh Heating capacity at -10°		kW		80.3	85.9	95.5	105.9	
	Annual energy consumption		kWh/a		44,258	47,649	51,965	56,838	
	Required back up heating cap at design conditions		kW		0.00				
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW		144.7 3.02	154.6 3.05	171.9 3.07	187.0 2.97	
	Power input		kW		47.9	50.7	56.1	62.9	
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW		106.5 4.05	114.1 3.98	126.7 4.05	138.0 3.84	
	Power input		kW		26.3	28.7	31.3	35.9	
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW		68.5 4.86	73.3 4.92	81.4 4.82	88.7	
	Power input		kW		14.1	14.9	16.9	18.4	
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW		49.7 5.29	50.2 5.34	58.3 5.03	58.5 5.00	
	Power input		kW		9.4		11.6	11.7	
	Space heating (Average climate)	TOL	Tol (temperature operating limit)		°C	-10			
		Pdh (declared heating cap)		kW		80.3	85.9	95.5	105.9
		COPd (declared COP)				1.91	1.88	1.97	1.98
		Power input		kW		42.0	45.8	48.4	53.4
TBivalent		Tbiv (bivalent temperature)		°C	-6				
Pdh (declared heating cap)		kW		89.9	96.3	104.0	114.7		
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.12	2.08	2.14	2.13	
	Power input		kW		42.5	46.4	48.7	53.9	
	A Con- dition (-7°C)	Pdh (declared heating cap)		kW	86.4	93.6	103.4	113.7	
		COPd (declared COP)			2.03		2.11		
		Power input		kW	42.5	46.2	49.1	53.8	
	B Condi- tion (2°C)	Pdh (declared heating cap)		kW	57.3	61.3	66.3	80.0	
		COPd (declared COP)			3.67		3.60		
		Power input		kW	15.6	16.7	18.4	21.8	
	C Condi- tion (7°C)	Pdh (declared heating cap)		kW	38.3	38.5	45.0	45.3	
		COPd (declared COP)			4.12	4.10	4.02	4.01	
		Power input		kW	9.3	9.4	11.2	11.3	
	D Con- dition (12°C)	Pdh (declared heating cap)		kW	42.3		48.9		
		COPd (declared COP)			4.60	4.55	4.45	4.43	
		Power input		kW	9.2	9.3	11.0	11.1	
	Evaporator	Supply side	Fan	Quantity		3			
Air flow rate				m³/h	26,500	28,000	30,500	31,500	
Nominal ESP				Pa	300 (5)				
High ESP				Pa	416 (5)	388 (5)	340 (5)	310 (5)	
Return side		Filter	Thickness		98				
			Quantity		2				
			Air flow rate	m³/min	26,500	28,000	30,500	31,500	
			Nominal ESP	Pa	300 (5)				
Fresh air		Ratio	Standard		30				
			In free cooling		100				

2 Specifications

1 - 1 UATYA-BFC3Y1

2

Technical specifications				UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1
Condenser	Air flow rate	Cooling	m³/h	72,395	67,733	70,200	72,005
	Fan	Motor	Quantity	4			
	Compressor	Quantity		4			
	Refrigerant	GWP		675			
		Charge	TCO2Eq	25,650	31,050	33,750	
		Charge	kg	38.0	46.0	50.0	
		Circuits	Quantity	2			
Refrigerant oil	Charged volume	l	13,5				15,9
Dimensions	Unit	Height	mm	2,374			
		Width	mm	2,250			
		Depth	mm	7,117			
Weight	Unit	kg	3,035	3,074	3,192	3,271	
Sound pressure level	Cooling	dB(A)	68.3 (6)	68.7 (6)	69.1 (6)	70.0 (6)	
Sound power level	Cooling	dB(A)	88.6 (7)	89.0 (7)	89.3 (7)	90.2 (7)	
Operation range	Cooling	Min.	°CDB	-10			
		Max.	°CDB	48			
	Heating	Min.	°CWB	-15			
		Max.	°CWB	26			
Power consumption in other than active mode	Thermostat-off mode	Cooling PTO	kW	1			2
		Heating PTO	kW	1			
Cooling	Cdc (Degradation cooling)			0.25			
Heating	Cdh (Degradation heating)			0.25			

Electrical specifications				UATYA25BFC3Y1	UATYA30BFC3Y1	UATYA40BFC3Y1	UATYA50BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency	Hz		50			
	Voltage	V		400			
Current	Nominal running current (RLA)	Cooling	A	15.4	24.7	27.6	35.8
	Recommended fuses	A		25	40	50	
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA60BFC3Y1	UATYA70BFC3Y1	UATYA80BFC3Y1	UATYA90BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency	Hz		50			
	Voltage	V		400			
Current	Nominal running current (RLA)	Cooling	A	38.7	47.4	55.3	73.4
	Recommended fuses	A		50	63	80	100
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA100BFC3Y1	UATYA110BFC3Y1	UATYA120BFC3Y1	UATYA140BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency	Hz		50			
	Voltage	V		400			
Current	Nominal running current (RLA)	Cooling	A	73.4	76.8	107.0	
	Recommended fuses	A		100			160
Wiring connections	For power supply	Quantity		4G			

Electrical specifications				UATYA150BFC3Y1	UATYA160BFC3Y1	UATYA180BFC3Y1	UATYA190BFC3Y1
Power supply	Name			400/3/50±5%			
	Phase			3~			
	Frequency Hz			50			
	Voltage V			400			
Current	Nominal running current (RLA)	Cooling	A	118.2	126.8	140.0	146.0
	Recommended fuses		A	160		200	
Wiring connections	For power supply	Quantity		4G			

(1)Conditions for calculation: Ambient air 27°C DB, 19°C WB; External air 35°C DB, 24°C WB. 100% recirculating air; calculated according to EN 14511/2018 |

(2)Conditions for calculation: Ambient air 20°C DB, 15°C WB; External air 7°C DB, 6°C WB. 100% recirculating air; calculated according to EN 14511/2018 |

2 Specifications

1 - 1 UATYA-BFC3Y1

(3)With 30% fresh air |

(4)Calculated according to EN 14825/2019 |

(5)Value refers to unit at nominal airflow, delivered with no accessories and with only G4 filters. |

(6)Average sound pressure level, at 1 meter from the unit, in free field on a reflective surface. Not binding value derived from the sound power level |

(7)Sound power level in free field calculated according to standard ISO 3744. Values refer only to the base unit version


3 Features and advantages

3 - 1 Features and Advantages

3

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1


Made-To-Stock units (MTS)

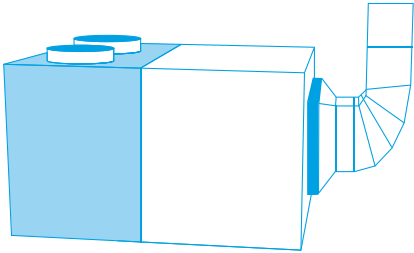

48 predefined units readily available from stock

- › Fast delivery
- › 3 versions: Base, 2 dampers and 3 dampers
 - › Thermodynamic heat recovery available on full FC3 range
- › Extended capacity up to 190 kW!
- › Comes with a wide range of standard integrated features

Made-To-Order units (MTO)

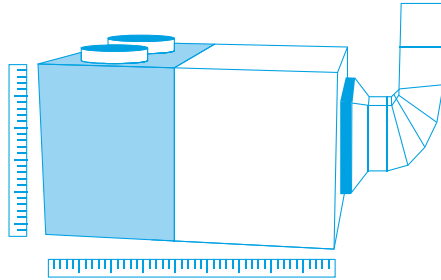

Fully customizable units for maximum flexibility

- › Almost infinite configuration possibilities thanks to wide choice of options
- › 4 versions: Base, 2 dampers, 3 dampers and 4 dampers
 - › Thermodynamic heat recovery available on full FC3 range
 - › Premium efficiency plate heat exchanger available on RS4 range
- › Extended capacity up to 190 kW!
- › Comes with a wide range of standard integrated features
- › Easy selection via selection software: rooftop.daikin.eu

ECPEN21-117

3 Features and advantages


3 - 1 Features and Advantages

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1

Standard integrated features on all Made-To-Stock and Made-To-Order units

1 R-32 refrigerant

- › Top sustainability thanks to the use of low GWP (675) refrigerant
- › Single component refrigerant, easy to re-use and recycle



2 Inverter driven compressors

- › Great year-round seasonal efficiency
- › Available up to 120 kW models

3 Increased capacity range up to 190 kW!

- › More flexibility to tackle larger projects with a small footprint



4 25 mm double skinned panels

- › Ensuring long-lasting life and providing good thermal and sound insulation

5 Full color touch display

- › Intuitive to use
- › Better visualisation of unit parameters



6 Integrated connectivity

- › Direct integration into Daikin intelligent Touch Manager BMS (via BACNET protocol)
- › Easy integration in 3rd party BMS systems via Ethernet port (BACnet TCP/IP & Modbus TCP/IP) or 3-cable port (Modbus over RS485)



7 Selection software

- › Easy selection of the correction unit and options based on location conditions
- › Direct availability of technical drawings

More standard integrated features

- › ISO Coarse 75% filter (G4) (standard for MTS only)
- › Standard clogged filter alarm
- › Flexible air delivery
- › Hydrophilic aluminum fins on indoor and outdoor unit side
- › Mesh coil guard on outdoor heat exchanger
- › Factory mounted drain pan with heater
- › Single operation voltage-free contact
- › Power supply connection safety through max/min voltage relay and reversed phase connection

ECPEN21-117

Options

Options

4

UATYA-BBAY1 UATYA-BFC2Y1 UATYA-BFC3Y1

		BASE series (UATYA-BBAY1)					FC2 series (UATYA-BFC2Y1)					FC3 series (UATYA-BFC3Y1)							
		25-30	40-50	60-70	80-120	140-190	25-30	40-50	60-70	80-90	100-120	140-190	25-30	40-50	60-70	80-100	110-120	140-180	190
Air treatment	Filter ISO Coarse 75% (G4)	2x UATYAC75A + 2x UATYAC75B (Standard for MTS)	3x UATYAC75A + 3x UATYAC75B (Standard for MTS)	6x UATYAC75B (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)	2x UATYAC75A + 2x UATYAC75B (Standard for MTS)	3x UATYAC75A + 3x UATYAC75B (Standard for MTS)	6x UATYAC75B (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)	2x UATYAC75A + 2x UATYAC75B (Standard for MTS)	3x UATYAC75A + 3x UATYAC75B (Standard for MTS)	6x UATYAC75B (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)	12x UATYAC75C (Standard for MTS)
	Filter ISO ePM10 50% (M5/F5)	2x UATY-AEPM1050A + 2x UATY-AEPM1050B	3x UATY-AEPM1050A + 3x UATY-AEPM1050B	3x UATY-AEPM1050B	12x UATY-AEPM1050C	12x UATY-AEPM1050C	2x UATY-AEPM1050A + 2x UATY-AEPM1050B	3x UATY-AEPM1050A + 3x UATY-AEPM1050B	3x UATY-AEPM1050B	12x UATY-AEPM1050C	12x UATY-AEPM1050C	12x UATY-AEPM1050C	2x UATY-AEPM1050A + 2x UATY-AEPM1050B	3x UATY-AEPM1050A + 3x UATY-AEPM1050B	3x UATY-AEPM1050B	12x UATY-AEPM1050C	12x UATY-AEPM1050C	12x UATY-AEPM1050C	12x UATY-AEPM1050C
	Filter ISO ePM10 70% (M6)	2x UATY-AEPM1070A + 2x UATY-AEPM1070B	3x UATY-AEPM1070A + 3x UATY-AEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C	12x UATY-AEPM1070C	2x UATY-AEPM1070A + 2x UATY-AEPM1070B	3x UATY-AEPM1070A + 3x UATY-AEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C	12x UATY-AEPM1070C	12x UATY-AEPM1070C	2x UATY-AEPM1070A + 2x UATY-AEPM1070B	3x UATY-AEPM1070A + 3x UATY-AEPM1070B	6x UATY-AEPM1070B	12x UATY-AEPM1070C	12x UATY-AEPM1070C	12x UATY-AEPM1070C	12x UATY-AEPM1070C
	Rigid bag filter ISO ePM1 50% (F7)	2x UATY-AEPM150A + 2x UATY-AEPM150B	3x UATY-AEPM150A + 3x UATY-AEPM150B	6x UATY-AEPM150B	12x UATY-AEPM150C	12x UATY-AEPM150C	2x UATY-AEPM150A + 2x UATY-AEPM150B	3x UATY-AEPM150A + 3x UATY-AEPM150B	6x UATY-AEPM150B	12x UATY-AEPM150C	12x UATY-AEPM150C	12x UATY-AEPM150C	2x UATY-AEPM150A + 2x UATY-AEPM150B	3x UATY-AEPM150A + 3x UATY-AEPM150B	6x UATY-AEPM150B	12x UATY-AEPM150C	12x UATY-AEPM150C	12x UATY-AEPM150C	12x UATY-AEPM150C
	Rigid bag filter ISO ePM1 85% (F9)	2x UATY-AEPM185A + 2x UATY-AEPM185B	3x UATY-AEPM185A + 3x UATY-AEPM185B	6x UATY-AEPM185B	12x UATY-AEPM185C	12x UATY-AEPM185C	2x UATY-AEPM185A + 2x UATY-AEPM185B	3x UATY-AEPM185A + 3x UATY-AEPM185B	6x UATY-AEPM185B	12x UATY-AEPM185C	12x UATY-AEPM185C	12x UATY-AEPM185C	2x UATY-AEPM185A + 2x UATY-AEPM185B	3x UATY-AEPM185A + 3x UATY-AEPM185B	6x UATY-AEPM185B	12x UATY-AEPM185C	12x UATY-AEPM185C	12x UATY-AEPM185C	12x UATY-AEPM185C
Control	UATYAC02P - Duct air quality CO ₂ probe	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYACAP - Constant air pressure control airflow transducer	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYAWRC - Remote touch screen wired remote controller	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYARBP - Room temperature return probe (incl. housing)	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
	UATYASA - Fire and smoke alarm	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•	•
Other	Rainproof hood with anti-intrusion grille	not possible	not possible	not possible	not possible	not possible	UATYARPH3	UATYARPH4	UATYARPH5	UATYARPH6	UATYARPH6	UATYARPH6	UATYARPH1	UATYARPH2	UATYARPH8	UATYARPH7	UATYARPH7	UATYARPH7	UATYARPH7
	Rubber antivibration mounts	2x UATYAAVM1	2x UATYAAVM1	2x UATYAAVM1 + 1x UATYAAVM2	4x UATYAAVM1	2x UATYAAVM1 + 2x UATYAAVM2	2x UATYAAVM1	2x UATYAAVM1	4x UATYAAVM1 + 1x UATYAAVM2	4x UATYAAVM1	3x UATYAAVM1 + 1x UATYAAVM2	2x UATYAAVM1 + 2x UATYAAVM2	1x UATYAAVM1 + 1x UATYAAVM2	1x UATYAAVM1 + 2x UATYAAVM2	3x UATYAAVM1 + 1x UATYAAVM2	2x UATYAAVM1 + 2x UATYAAVM2	4x UATYAAVM1 + 1x UATYAAVM2	3x UATYAAVM1 + 2x UATYAAVM2	3x UATYAAVM1 + 2x UATYAAVM2
	Rubber antivibration mounts when gas heater is used	1x UATYAAVM1 + 1x UATYAAVM2	1x UATYAAVM1 + 1x UATYAAVM2	1x UATYAAVM1 + 1x UATYAAVM2	5x UATYAAVM1	5x UATYAAVM1	2x UATYAAVM1	1x UATYAAVM1 + 1x UATYAAVM2	4x UATYAAVM1	5x UATYAAVM1	5x UATYAAVM1	5x UATYAAVM1	1x UATYAAVM1 + 1x UATYAAVM2	2x UATYAAVM1 + 1x UATYAAVM2	4x UATYAAVM1	5x UATYAAVM1	4x UATYAAVM1 + 1x UATYAAVM2	3x UATYAAVM1 + 2x UATYAAVM2	3x UATYAAVM1 + 2x UATYAAVM2

ECPEN21-117A

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA25BBAY1

UATYA25BFC2Y1

UATYA25BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in_sup_coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in_sup_coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in_sup_coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in_ext_coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in_ext_coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA25BBAY1

UATYA25BFC2Y1

UATYA25BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																	
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil														
	T DB [°C]	T WB [°C]	20			25			30			35			40		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
4500	24	17	26,3	18,7	7,3	25,8	18,5	7,8	25,1	18,4	8,4	24,3	17,9	9,0	23,5	17,6	9,6
	25	18	27,1	18,6	7,3	26,5	18,4	7,8	25,9	18,3	8,4	25,0	17,8	9,0	24,2	17,5	9,7
	26	18	27,2	20,2	7,3	26,5	19,9	7,8	25,8	19,6	8,4	25,1	18,8	9,1	24,4	18,6	9,7
	27	19	28,1	20,0	7,4	27,3	19,6	7,9	26,6	19,5	8,5	25,8	19,3	9,1	25,0	19,0	9,8
	28	20	28,9	19,7	7,5	28,2	19,6	8,0	27,4	19,1	8,6	26,6	19,1	9,2	25,8	18,8	9,9
	30	22	30,6	19,2	7,6	29,9	18,9	8,1	29,2	18,9	8,8	28,3	18,4	9,4	27,4	18,3	10,0
	32	24	32,3	18,7	7,7	31,6	18,4	8,2	30,9	18,4	8,9	29,0	17,9	9,5	29,0	18,3	10,0

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
4500	-15	-16	14,0	6,4	13,9	6,5	14,3	6,8	13,9	7,0	14,2	7,2	14,4	7,4	14,3	7,6	14,0	7,8
	-10	-11	16,1	6,6	16,5	6,9	16,2	7,1	16,6	7,4	16,7	7,6	16,7	7,8	17,1	8,1	16,9	8,3
	-7	-8	17,9	6,8	18,0	7,0	17,8	7,2	18,0	7,4	18,1	7,7	18,0	7,9	17,7	8,1	18,2	8,4
	-3	-4	20,0	6,7	19,9	7,0	19,9	7,2	20,1	7,4	19,9	7,6	20,1	7,8	20,3	8,1	20,1	8,3
	0	-1	21,7	6,7	21,7	6,9	21,4	7,1	21,8	7,3	21,5	7,5	21,5	7,7	21,3	8,0	21,7	8,2
	2	1	22,6	6,7	22,7	6,8	22,7	7,1	22,7	7,3	22,6	7,5	22,5	7,7	22,4	7,9	22,5	8,2
	7	6	25,8	6,8	25,7	7,0	25,5	7,2	25,4	7,4	25,4	7,6	25,3	7,9	25,3	8,1	25,1	8,3
	12	11	28,7	7,1	28,7	7,3	28,4	7,5	28,1	7,7	28,2	8,0	28,1	8,2	28,2	8,5	27,9	8,7
	17	16	32,3	7,4	32,3	7,6	32,0	7,8	31,7	8,0	31,8	8,2	31,7	8,4	31,6	8,7	31,4	9,0
	22	21	35,9	7,7	35,9	7,9	35,6	8,1	35,3	8,3	35,4	8,5	35,3	8,7	35,2	9,0	35,0	9,3
	27	26	39,5	8,0	39,5	8,2	39,2	8,4	38,9	8,6	39,0	8,8	38,9	9,0	38,8	9,3	38,6	9,6

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
4500	-15	-16	12,7	6,4	12,6	6,5	13,0	6,8	12,7	7,0	12,9	7,2	13,1	7,4	13,0	7,6	12,8	7,8
	-10	-11	14,6	6,6	15,0	6,9	14,7	7,1	15,1	7,4	15,2	7,6	15,2	7,8	15,5	8,1	15,4	8,3
	-7	-8	16,3	6,8	16,4	7,0	16,2	7,2	16,3	7,4	16,5	7,7	16,4	7,9	16,1	8,1	16,5	8,4
	-3	-4	18,2	6,7	18,1	7,0	18,1	7,2	18,3	7,4	18,1	7,6	18,3	7,8	18,4	8,1	18,3	8,3
	0	-1	19,8	6,7	19,8	6,9	19,5	7,1	19,8	7,3	19,6	7,5	19,6	7,7	19,4	8,0	19,7	8,2
	2	1	20,6	6,7	20,6	6,8	20,6	7,1	20,6	7,3	20,5	7,5	20,5	7,7	20,4	7,9	20,4	8,2
	7	6	25,8	6,8	25,7	7,0	25,5	7,2	25,4	7,4	25,4	7,6	25,3	7,9	25,3	8,1	25,1	8,3
	12	11	28,7	7,1	28,7	7,3	28,4	7,5	28,1	7,7	28,2	8,0	28,1	8,2	28,2	8,5	27,9	8,7
	17	16	32,3	7,4	32,3	7,6	32,0	7,8	31,7	8,0	31,8	8,2	31,7	8,4	31,6	8,7	31,4	9,0
	22	21	35,9	7,7	35,9	7,9	35,6	8,1	35,3	8,3	35,4	8,5	35,3	8,7	35,2	9,0	35,0	9,3
	27	26	39,5	8,0	39,5	8,2	39,2	8,4	38,9	8,6	39,0	8,8	38,9	9,0	38,8	9,3	38,6	9,6

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA30BBAY1

UATYA30BFC2Y1

UATYA30BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in_sup_coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in_sup_coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in_sup_coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in_ext_coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in_ext_coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, x = 30%, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA30BBAY1

UATYA30BFC2Y1

UATYA30BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB [°C]	T WB [°C]		20			30			35			40			45		
				T C	SHC	PI	T C	SHC	PI	T C	SHC	PI	T C	SHC	PI	T C	SHC	PI
5800	24	17		33,9	23,7	8,4	33,2	23,5	9,1	32,3	23,1	9,8	31,4	22,9	10,6	30,4	21,8	11,6
	30	18		35,0	23,4	8,5	34,3	23,2	9,1	33,4	22,8	9,9	32,4	22,6	10,7	31,3	22,2	11,6
	26	18		35,1	25,7	8,5	34,3	24,7	9,2	33,4	25,1	9,9	32,3	24,5	10,7	31,5	23,9	11,7
	27	19		36,2	25,1	8,6	35,5	25,1	9,2	34,4	24,6	10,0	33,5	24,6	10,8	32,3	24,0	11,7
	28	20		37,3	25,0	8,7	36,5	24,4	9,3	35,5	24,4	10,1	34,5	24,0	10,9	33,4	23,6	11,8
	30	22		39,8	24,2	8,8	38,9	23,8	9,4	37,8	23,8	10,2	36,8	23,6	11,1	35,4	23,0	12,0

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
5800	-15	-16	17,2	7,6	17,4	7,9	17,2	8,1	17,5	8,4	17,4	8,7	17,9	9,0	18,0	9,3	18,0	9,7
	-10	-11	20,2	8,0	19,7	8,2	19,8	8,5	20,4	8,8	20,4	9,2	20,9	9,5	21,1	9,9	21,0	10,3
	-7	-8	22,0	8,0	22,2	8,3	22,3	8,6	22,2	8,9	22,2	9,3	22,0	9,6	22,6	10,0	21,9	10,3
	-3	-4	24,3	8,0	24,4	8,2	24,6	8,6	24,6	8,8	24,7	9,2	24,6	9,6	24,8	9,9	24,7	10,3
	0	-1	26,5	7,8	26,4	8,1	26,5	8,4	26,2	8,8	26,7	9,0	26,6	9,4	26,6	9,8	26,5	10,1
	2	1	28,2	7,7	27,8	8,0	27,8	8,3	27,8	8,6	27,8	8,9	27,9	9,2	28,0	9,6	27,8	10,0
	7	6	31,4	7,8	31,2	8,1	31,2	8,4	31,2	8,7	31,2	9,0	31,2	9,4	31,0	9,7	31,2	10,2
	12	11	34,7	8,0	34,6	8,4	34,5	8,7	34,4	9,0	34,3	9,4	34,2	9,7	34,2	10,1	34,2	10,5

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																			
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil																
	T DB	TWB	10		12		14		16		18		20		22		24		
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	
5800	-15	-16	15,7	7,6	15,9	7,9	15,7	8,1	15,9	8,4	15,8	8,7	16,2	9,0	16,3	9,3	16,4	9,7	
	-10	-11	18,4	8,0	17,9	8,2	18,0	8,5	18,6	8,8	18,6	9,2	19,0	9,5	19,2	9,9	19,1	10,3	
	-7	-8	20,0	8,0	20,2	8,3	20,3	8,6	20,2	8,9	20,2	9,3	20,0	9,6	20,6	10,0	20,0	10,3	
	-3	-4	22,1	8,0	22,2	8,2	22,4	8,6	22,4	8,8	22,4	9,2	22,4	9,6	22,5	9,9	22,4	10,3	
	0	-1	24,1	7,8	24,0	8,1	24,1	8,4	23,8	8,8	24,3	9,0	24,2	9,4	24,2	9,8	24,1	10,1	
	2	1	25,7	7,7	25,2	8,0	25,2	8,3	25,3	8,6	25,3	8,9	25,3	9,2	25,5	9,6	25,3	10,0	
	7	6	31,4	7,8	31,2	8,1	31,2	8,4	31,2	8,7	31,2	9,0	31,2	9,4	31,0	9,7	31,2	10,2	
	12	11	34,7	8,0	34,6	8,4	34,5	8,7	34,4	9,0	34,3	9,4	34,2	9,7	34,2	10,1	34,2	10,5	

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA40BBAY1

UATYA40BFC2Y1

UATYA40BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = \mathbf{29.4^{\circ}\text{C}}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, x = 30%, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = \mathbf{33.96^{\circ}\text{C}}$$

UATYA40BBAY1

UATYA40BFC2Y1

UATYA40BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
7500	24	17		39,2	27,6	10,1	38,4	27,1	10,8	37,4	26,8	11,6	36,5	26,5	12,4	35,2	26,0	13,4
	40	18		40,5	27,1	10,2	39,7	26,9	10,9	38,7	26,6	11,7	37,6	26,1	12,6	36,4	25,9	13,5
	26	18		40,4	29,3	10,2	39,6	29,3	10,9	39,0	28,8	11,7	37,6	28,0	12,6	36,4	27,2	13,6
	27	19		41,7	29,1	10,3	40,9	28,9	11,0	39,8	28,6	11,8	38,8	28,4	12,7	37,4	27,8	13,7
	28	20		43,1	28,7	10,3	42,2	28,4	11,1	41,2	28,2	11,9	40,1	27,9	12,8	38,8	27,7	13,8
	30	22		45,8	28,1	10,6	44,8	27,6	11,3	44,0	27,6	12,1	42,5	26,8	13,0	41,1	26,8	14,0

PEAK Heating Capacity and Power Input Table (EN 14511)																	
Air Flow [m ³ /h]	Air conditions on External Coil			Air Condition on Supply Coil													
	T DB	TWB		10		12		14		16		18		20		22	
	[°C]	[°C]		PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
7500	-15	-16		19,8	8,7	20,0	9,1	19,8	9,3	20,3	9,7	20,1	9,9	20,7	10,4	20,5	10,7
	-10	-11		23,2	9,2	23,2	9,5	23,3	9,9	23,8	10,2	24,0	10,7	24,0	11,0	24,2	11,4
	-7	-8		25,5	9,3	25,1	9,6	25,2	10,0	25,7	10,3	25,4	10,7	25,8	11,1	25,8	11,5
	-3	-4		28,9	9,4	28,7	9,7	28,8	10,0	28,9	10,3	28,9	10,7	28,5	11,2	28,5	11,6
	0	-1		31,0	9,3	30,6	9,7	31,3	9,9	31,3	10,2	31,2	10,7	31,1	11,0	31,1	11,4
	2	1		32,8	9,2	32,6	9,5	32,6	9,9	32,5	10,2	32,4	10,5	32,5	11,0	32,4	11,3
	7	6		36,9	9,4	36,7	9,7	36,7	10,0	36,5	10,4	36,5	10,8	36,3	11,1	36,2	11,6
	12	11		40,5	9,8	40,3	10,1	40,2	10,5	40,0	10,8	39,8	11,2	39,7	11,6	39,5	12,0

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																	
Air Flow [m ³ /h]	Air conditions on External Coil			Air Condition on Supply Coil													
	T DB	TWB		10		12		14		16		18		20		22	
	[°C]	[°C]		PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
7500	-15	-16		18,0	8,7	18,2	9,1	18,0	9,3	18,4	9,7	18,2	9,9	18,8	10,4	18,7	10,7
	-10	-11		21,1	9,2	21,1	9,5	21,2	9,9	21,7	10,2	21,8	10,7	21,9	11,0	22,0	11,4
	-7	-8		23,2	9,3	22,8	9,6	22,9	10,0	23,3	10,3	23,1	10,7	23,5	11,1	23,5	11,5
	-3	-4		26,3	9,4	26,1	9,7	26,2	10,0	26,3	10,3	26,2	10,7	25,9	11,2	26,0	11,6
	0	-1		28,2	9,3	27,8	9,7	28,5	9,9	28,5	10,2	28,3	10,7	28,3	11,0	28,3	11,4
	2	1		29,8	9,2	29,7	9,5	29,6	9,9	29,5	10,2	29,5	10,5	29,6	11,0	29,4	11,3
	7	6		36,9	9,4	36,7	9,7	36,7	10,0	36,5	10,4	36,5	10,8	36,3	11,1	36,2	11,6
	12	11		40,5	9,8	40,3	10,1	40,2	10,5	40,0	10,8	39,8	11,2	39,7	11,6	39,5	12,0

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA50BBAY1
UATYA50BFC2Y1
UATYA50BFC3Y1

5

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA50BBAY1
UATYA50BFC2Y1
UATYA50BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow	Air Condition on Supply Coil			Air conditions on External Coil														
	TDB	TWB		20			26			32			35			40		
	[°C]	[°C]		TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
9000	24	17		46,3	31,9	12,2	45,2	31,5	13,1	44,2	31,2	14,1	43,0	30,6	15,2	42,1	30,9	16,4
	40	18		47,7	31,3	12,4	46,7	30,7	13,2	45,8	30,7	14,2	44,3	29,8	15,3	43,8	31,0	16,5
	26	18		47,8	34,6	12,4	46,6	33,6	13,2	45,6	33,6	14,2	44,4	33,0	15,3	43,3	33,0	16,5
	27	19		49,1	33,4	12,5	48,1	33,4	13,4	47,0	32,8	14,3	45,7	32,5	15,4	44,4	32,5	16,7
	28	20		50,5	32,6	12,6	49,6	32,6	13,5	48,4	32,0	14,5	47,1	32,0	15,6	45,8	32,0	16,8
	30	22		53,6	32,5	12,8	52,5	32,5	13,7	51,3	31,9	14,7	49,9	31,2	15,8	48,1	30,3	17,1

PEAK Heating Capacity and Power Input Table (EN 14511)																	
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil														
	T DB	TWB	10		12		14		16		18		20		22		24
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC
9000	-15	-16	24,9	10,5	25,3	11,0	25,4	11,4	25,5	11,7	25,6	12,1	25,8	12,6	25,8	13,0	26,2
	-10	-11	30,0	11,5	29,8	11,9	29,9	12,3	30,2	12,8	30,4	13,3	30,8	13,9	31,1	14,5	31,6
	-7	-8	32,6	11,5	32,6	12,1	32,8	12,5	32,6	13,1	32,9	13,6	33,2	14,1	33,0	14,6	33,8
	-3	-4	36,6	11,7	36,4	12,1	36,3	12,6	36,8	13,2	36,3	13,6	36,6	14,1	37,1	14,6	37,3
	0	-1	39,5	11,7	39,5	12,1	39,5	12,6	39,5	13,1	39,6	13,6	39,7	14,0	39,7	14,6	39,8
	2	1	41,3	11,6	41,3	12,1	41,3	12,5	41,4	13,0	41,3	13,5	41,4	14,0	41,5	14,5	41,5
	7	6	46,4	11,7	46,3	12,2	46,3	12,7	46,3	13,2	46,2	13,7	46,2	14,2	45,7	14,7	45,9
	12	11	50,4	12,2	50,4	12,7	50,1	13,2	50,0	13,7	50,0	14,2	49,9	14,8	49,8	15,3	49,5

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																	
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil														
	T DB	TWB	10		12		14		16		18		20		22		24
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC
9000	-15	-16	22,7	10,5	23,0	11,0	23,1	11,4	23,2	11,7	23,3	12,1	23,5	12,6	23,5	13,0	23,8
	-10	-11	27,3	11,5	27,1	11,9	27,2	12,3	27,4	12,8	27,6	13,3	28,0	13,9	28,3	14,5	28,7
	-7	-8	29,6	11,5	29,7	12,1	29,9	12,5	29,6	13,1	30,0	13,6	30,1	14,1	30,0	14,6	30,7
	-3	-4	33,3	11,7	33,1	12,1	33,0	12,6	33,4	13,2	33,0	13,6	33,2	14,1	33,7	14,6	33,9
	0	-1	35,9	11,7	35,9	12,1	35,9	12,6	36,0	13,1	36,0	13,6	36,1	14,0	36,1	14,6	36,2
	2	1	37,5	11,6	37,6	12,1	37,6	12,5	37,6	13,0	37,6	13,5	37,6	14,0	37,7	14,5	37,7
	7	6	46,4	11,7	46,3	12,2	46,3	12,7	46,3	13,2	46,2	13,7	46,2	14,2	45,7	14,7	45,9
	12	11	50,4	12,2	50,4	12,7	50,1	13,2	50,0	13,7	50,0	14,2	49,9	14,8	49,8	15,3	49,5

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA60BBAY1
UATYA60BFC2Y1
UATYA60BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA60BBAY1
UATYA60BFC2Y1
UATYA60BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																	
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil														
	T DB [°C]	T WB [°C]	20			26			30			35			40		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
11000	24	17	59.9	40.9	14.8	58.7	40.1	15.9	56.9	39.4	17.1	55.2	39.0	18.5	53.6	38.6	20.1
	40	18	62.0	41.0	15.0	60.4	39.9	16.0	58.7	39.1	17.3	56.9	38.8	18.7	54.9	37.6	20.2
	26	18	61.8	43.8	14.9	60.3	43.0	16.0	58.8	42.7	17.2	56.8	41.9	18.7	55.0	41.2	20.2
	27	19	63.8	43.2	15.1	62.4	42.4	16.2	60.6	42.1	17.4	58.8	41.3	18.8	56.8	40.9	20.4
	28	20	66.0	43.0	15.2	64.5	42.2	16.3	62.7	41.4	17.5	60.8	41.1	19.0	58.5	40.3	20.5
	30	22	70.3	42.5	15.5	68.6	42.1	16.7	66.5	41.3	17.9	64.4	40.6	19.3	62.3	39.8	20.9

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
11000	-15	-16	30,3	13,7	29,6	13,9	30,2	14,5	30,4	15,0	30,6	15,5	31,0	16,0	31,1	16,6	31,6	17,1
	-10	-11	35,3	14,2	35,8	14,8	34,7	15,2	35,5	15,8	36,3	16,4	36,5	17,0	36,6	17,4	37,1	18,1
	-7	-8	38,5	14,4	38,7	14,9	38,2	15,4	38,8	15,9	39,2	16,5	38,3	17,0	38,6	17,5	38,9	18,1
	-3	-4	43,2	14,4	43,4	14,9	43,5	15,4	43,6	15,8	43,1	16,4	43,8	16,9	43,7	17,5	43,6	18,0
	0	-1	47,4	14,2	47,0	14,6	46,6	15,1	47,1	15,6	46,1	16,2	46,9	16,7	46,6	17,2	46,8	17,8
	2	1	49,4	14,1	49,3	14,5	49,5	14,9	48,6	15,5	48,9	16,0	48,9	16,5	48,8	17,1	49,0	17,6
	7	6	56,1	14,4	55,6	14,8	55,6	15,3	55,3	15,8	55,2	16,4	55,0	16,9	54,8	17,5	54,7	18,0
	12	11	61,8	14,9	61,5	15,4	61,3	16,0	61,1	16,5	60,5	17,0	60,3	17,6	60,1	18,2	60,0	18,8

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
11000	-15	-16	27,5	13,7	26,9	13,9	27,5	14,5	27,6	15,0	27,8	15,5	28,2	16,0	28,3	16,6	28,7	17,1
	-10	-11	32,1	14,2	32,5	14,8	31,5	15,2	32,3	15,8	33,0	16,4	33,2	17,0	33,3	17,4	33,7	18,1
	-7	-8	35,0	14,4	35,2	14,9	34,7	15,4	35,3	15,9	35,6	16,5	34,8	17,0	35,1	17,5	35,4	18,1
	-3	-4	39,3	14,4	39,5	14,9	39,6	15,4	39,6	15,8	39,2	16,4	39,8	16,9	39,8	17,5	39,6	18,0
	0	-1	43,1	14,2	42,8	14,6	42,4	15,1	42,8	15,6	41,9	16,2	42,6	16,7	42,3	17,2	42,6	17,8
	2	1	45,0	14,1	44,9	14,5	45,0	14,9	44,2	15,5	44,4	16,0	44,4	16,5	44,4	17,1	44,6	17,6
	7	6	56,1	14,4	55,6	14,8	55,6	15,3	55,3	15,8	55,2	16,4	55,0	16,9	54,8	17,5	54,7	18,0
	12	11	61,8	14,9	61,5	15,4	61,3	16,0	61,1	16,5	60,5	17,0	60,3	17,6	60,1	18,2	60,0	18,8

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA70BBAY1 UATYA70BFC2Y1 UATYA70BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA70BBAY1 UATYA70BFC2Y1 UATYA70BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB [°C]	T WB [°C]		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
13000	24	17		66,6	45,1	17,6	65,2	44,2	18,9	63,4	43,8	20,3	61,3	43,4	22,0	59,2	42,0	23,8
	40	18		68,7	45,3	17,8	67,3	44,4	19,0	65,2	43,1	20,5	63,2	42,6	22,2	61,1	41,7	24,0
	26	18		68,6	48,1	17,8	67,2	47,7	19,0	65,4	47,2	20,5	63,3	46,8	22,2	61,1	46,3	24,0
	27	19		70,9	47,8	18,0	69,3	47,4	19,2	67,7	46,9	20,7	65,4	46,0	22,4	63,0	45,6	24,2
	28	20		73,1	47,5	18,2	71,5	46,6	19,4	69,7	45,7	20,9	67,6	45,3	22,6	64,9	44,4	24,4
	30	22		77,9	46,9	18,5	76,0	46,0	19,8	73,7	45,6	21,3	71,5	44,2	22,9	69,2	44,2	24,8

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
13000	-15	-16	36,3	16,2	36,3	16,7	36,0	17,1	36,4	17,8	36,1	18,4	35,7	18,9	36,4	19,3	36,5	19,9
	-10	-11	42,3	16,8	43,4	17,4	43,5	18,0	42,6	18,6	41,5	19,1	42,2	19,8	43,6	20,6	42,1	21,2
	-7	-8	47,2	17,0	45,1	17,5	46,4	18,1	45,0	18,7	46,0	19,4	46,8	20,1	45,1	20,6	46,5	21,4
	-3	-4	50,0	17,1	51,9	17,6	50,4	18,3	50,4	18,8	50,4	19,5	50,4	20,2	52,3	20,9	50,5	21,6
	0	-1	55,2	16,9	55,2	17,4	54,9	18,0	54,2	18,7	54,7	19,3	55,1	19,9	54,5	20,6	54,9	21,2
	2	1	58,4	16,8	58,8	17,3	58,3	17,9	58,3	18,5	59,1	19,2	58,1	19,8	58,3	20,5	57,9	21,1
	7	6	65,8	17,0	65,7	17,6	65,5	18,2	65,3	18,9	65,1	19,5	64,6	20,1	65,0	20,9	64,3	21,5
	12	11	72,4	17,7	72,1	18,3	72,1	19,0	71,8	19,7	71,5	20,3	71,2	21,0	71,0	21,7	70,8	22,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
13000	-15	-16	33,0	16,2	33,0	16,7	32,7	17,1	33,1	17,8	32,8	18,4	32,5	18,9	33,1	19,3	33,2	19,9
	-10	-11	38,4	16,8	39,4	17,4	39,5	18,0	38,7	18,6	37,8	19,1	38,3	19,8	39,7	20,6	38,3	21,2
	-7	-8	43,0	17,0	41,0	17,5	42,2	18,1	41,0	18,7	41,9	19,4	42,6	20,1	41,0	20,6	42,2	21,4
	-3	-4	45,5	17,1	47,2	17,6	45,8	18,3	45,8	18,8	45,8	19,5	45,8	20,2	47,5	20,9	45,9	21,6
	0	-1	50,2	16,9	50,2	17,4	49,9	18,0	49,2	18,7	49,7	19,3	50,1	19,9	49,6	20,6	49,9	21,2
	2	1	53,1	16,8	53,4	17,3	53,0	17,9	53,0	18,5	53,8	19,2	52,8	19,8	53,0	20,5	52,6	21,1
	7	6	65,8	17,0	65,7	17,6	65,5	18,2	65,3	18,9	65,1	19,5	64,6	20,1	65,0	20,9	64,3	21,5
	12	11	72,4	17,7	72,1	18,3	72,1	19,0	71,8	19,7	71,5	20,3	71,2	21,0	71,0	21,7	70,8	22,4

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA80BBAY1

UATYA80BFC2Y1

UATYA80BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA80BBAY1

UATYA80BFC2Y1

UATYA80BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB [°C]	T WB [°C]		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
14500	24	17		76,0	55,3	19,3	74,4	54,8	20,6	72,7	54,3	22,1	70,3	53,3	23,8	67,8	52,8	25,7
	40	18		78,5	54,5	19,5	77,7	55,5	21,0	74,9	53,5	22,3	72,7	53,0	24,0	70,1	52,0	26,0
	26	18		78,3	59,7	19,5	76,6	58,7	20,8	74,6	58,2	22,3	73,0	57,2	24,0	70,4	56,2	26,0
	27	19		81,0	59,4	19,7	79,4	59,4	21,0	77,2	57,9	22,5	74,6	56,9	24,2	72,1	56,4	26,2
	28	20		83,5	58,6	19,9	81,7	57,6	21,2	79,7	57,6	22,7	77,6	57,6	24,5	74,6	56,1	26,4
	30	22		89,1	56,9	20,4	86,9	56,4	21,7	84,9	56,4	23,1	82,2	55,4	24,9	79,4	54,9	26,9

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	TDB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
14500	-15	-16	38,2	17,4	36,8	17,7	37,4	18,3	38,4	19,1	38,3	19,7	38,4	20,3	38,7	21,2	38,0	21,7
	-10	-11	43,8	17,8	43,7	18,3	44,3	18,9	45,0	19,5	43,5	20,2	44,1	20,8	44,1	21,5	44,2	22,3
	-7	-8	48,0	17,8	47,7	18,4	48,3	19,0	47,6	19,6	48,1	20,2	47,4	20,8	47,8	21,6	47,7	22,3
	-3	-4	54,1	17,9	55,4	18,3	53,1	19,0	53,6	19,6	53,9	20,2	54,1	20,9	53,6	21,6	53,4	22,3
	0	-1	59,4	17,6	59,4	18,1	58,9	18,7	58,6	19,3	58,2	19,9	58,7	20,4	58,8	21,1	58,7	21,8
	2	1	61,2	17,4	61,1	18,0	60,9	18,5	60,7	19,1	60,3	19,7	60,6	20,4	61,5	20,9	61,4	21,6
	7	6	70,0	17,3	69,0	17,9	69,4	18,5	69,2	19,1	68,9	19,7	68,5	20,3	68,6	21,1	67,8	21,7
	12	11	75,9	17,7	75,6	18,3	75,2	18,9	75,0	19,5	74,7	20,2	74,4	20,8	74,2	21,5	73,8	22,2

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	TDB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
14500	-15	-16	34,8	17,4	33,5	17,7	34,0	18,3	34,9	19,1	34,9	19,7	34,9	20,3	35,2	21,2	34,5	21,7
	-10	-11	39,8	17,8	39,7	18,3	40,2	18,9	40,9	19,5	39,6	20,2	40,1	20,8	40,1	21,5	40,2	22,3
	-7	-8	43,6	17,8	43,4	18,4	43,9	19,0	43,2	19,6	43,7	20,2	43,1	20,8	43,4	21,6	43,4	22,3
	-3	-4	49,1	17,9	50,4	18,3	48,3	19,0	48,7	19,6	49,0	20,2	49,2	20,9	48,7	21,6	48,6	22,3
	0	-1	54,0	17,6	54,0	18,1	53,5	18,7	53,3	19,3	52,9	19,9	53,3	20,4	53,5	21,1	53,4	21,8
	2	1	55,7	17,4	55,6	18,0	55,4	18,5	55,2	19,1	54,8	19,7	55,1	20,4	55,9	20,9	55,8	21,6
	7	6	70,0	17,3	69,0	17,9	69,4	18,5	69,2	19,1	68,9	19,7	68,5	20,3	68,6	21,1	67,8	21,7
	12	11	75,9	17,7	75,6	18,3	75,2	18,9	75,0	19,5	74,7	20,2	74,4	20,8	74,2	21,5	73,8	22,2

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA90BBAY1

UATYA90BFC2Y1

UATYA90BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in_sup_coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in_sup_coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in_sup_coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in_ext_coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in_ext_coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA90BBAY1

UATYA90BFC2Y1

UATYA90BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)														
Air Flow [m ³ /h]	Air Condition on Supply Coil		Air conditions on External Coil											
	T DB [°C]	TWB [°C]	20			40			30			35		
			TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
16500	24	17	90,9	61,8	23,2	89,1	60,7	24,9	87,0	59,5	26,7	84,2	59,0	28,9
	40	18	93,8	62,0	23,4	91,8	60,9	25,1	89,8	59,7	27,0	86,8	58,6	29,1
	26	18	93,7	66,2	23,4	91,9	65,1	25,1	89,7	65,1	26,9	87,1	63,9	29,1
	27	19	96,9	65,3	23,6	94,8	64,2	25,3	92,5	64,2	27,2	89,8	63,0	29,4
	28	20	100,1	65,5	23,8	98,3	64,9	25,6	95,5	63,2	27,4	92,7	62,6	29,6
	30	22	106,3	64,2	24,2	104,0	63,1	25,9	101,4	61,9	27,9	98,1	61,3	30,1

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
16500	-15	-16	46,1	20,6	46,2	21,3	46,4	22,0	47,0	22,7	47,0	23,8	47,5	24,7	47,7	25,6	47,5	26,6
	-10	-11	55,5	21,8	55,7	22,6	55,8	23,5	56,4	24,5	56,0	25,3	56,7	26,3	56,7	27,3	56,9	28,3
	-7	-8	59,3	21,9	59,9	22,8	60,0	23,7	61,2	24,6	59,9	25,4	59,3	26,2	60,7	27,3	60,7	28,3
	-3	-4	67,0	22,2	67,0	23,1	66,9	23,9	66,0	24,7	68,0	25,6	68,4	26,6	68,2	27,5	67,6	28,5
	0	-1	72,9	21,9	71,4	22,7	69,8	23,6	72,4	24,4	72,4	25,2	70,8	26,2	70,6	27,1	72,5	28,1
	2	1	75,7	21,7	75,6	22,5	75,9	23,4	76,2	24,2	75,8	25,2	76,0	25,9	75,7	26,8	75,6	27,7
	7	6	85,6	22,0	85,3	22,6	84,1	23,4	83,8	24,2	83,6	25,1	84,2	26,1	83,7	27,0	83,0	27,9
	12	11	91,4	22,4	91,5	23,0	92,0	24,2	90,2	25,1	90,7	26,0	90,8	26,9	90,7	27,8	90,1	29,0

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
16500	-15	-16	41,9	20,6	42,0	21,3	42,2	22,0	42,7	22,7	42,8	23,8	43,2	24,7	43,4	25,6	43,2	26,6
	-10	-11	50,5	21,8	50,6	22,6	50,8	23,5	51,2	24,5	50,9	25,3	51,5	26,3	51,6	27,3	51,8	28,3
	-7	-8	53,9	21,9	54,4	22,8	54,6	23,7	55,7	24,6	54,5	25,4	53,9	26,2	55,2	27,3	55,2	28,3
	-3	-4	60,9	22,2	60,9	23,1	60,8	23,9	60,0	24,7	61,8	25,6	62,2	26,6	62,0	27,5	61,4	28,5
	0	-1	66,3	21,9	64,9	22,7	63,5	23,6	65,8	24,4	65,8	25,2	64,4	26,2	64,1	27,1	65,9	28,1
	2	1	68,8	21,7	68,7	22,5	69,0	23,4	69,3	24,2	68,9	25,2	69,1	25,9	68,8	26,8	68,8	27,7
	7	6	85,6	22,0	85,3	22,6	84,1	23,4	83,8	24,2	83,6	25,1	84,2	26,1	83,7	27,0	83,0	27,9
	12	11	91,4	22,4	91,5	23,0	92,0	24,2	90,2	25,1	90,7	26,0	90,8	26,9	90,7	27,8	90,1	29,0

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA100BBAY1

UATYA100BFC2Y1

UATYA100BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA100BBAY1

UATYA100BFC2Y1

UATYA100BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	TDB [°C]	TWE [°C]		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
18000	24	17		96.6	65.3	26.0	94.7	64.7	27.7	93.0	64.1	29.5	90.6	63.5	31.7	87.1	61.6	34.3
	40	18		99.8	64.9	26.2	97.7	64.3	27.9	95.5	63.1	29.9	92.5	61.8	32.0	89.8	61.2	34.4
	26	18		99.9	70.1	26.2	98.0	69.5	27.8	96.3	70.1	29.8	93.5	68.2	32.2	90.3	68.2	34.6
	27	19		102.9	69.1	26.5	100.9	67.8	28.2	98.6	67.8	30.1	96.0	67.2	32.3	92.7	66.0	34.8
	28	20		106.2	69.3	26.7	104.1	68.1	28.4	101.6	66.8	30.4	98.9	66.2	32.6	95.4	64.3	35.1
	30	22		113.2	66.6	27.2	110.7	66.6	28.9	108.0	65.4	30.9	105.0	64.1	33.2	101.1	63.5	35.8

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
18000	-15	-16	49,1	29,6	49,0	30,6	49,0	31,7	49,4	32,9	49,4	33,9	49,6	35,2	50,1	36,5	50,1	37,8
	-10	-11	58,4	29,4	59,3	30,4	58,7	31,6	59,7	32,6	59,4	33,7	60,2	35,0	60,3	36,3	60,3	37,6
	-7	-8	65,8	28,4	65,7	29,5	64,6	30,6	65,8	31,7	65,8	32,7	66,1	34,0	65,1	35,0	66,6	36,5
	-3	-4	73,4	27,0	73,1	27,9	73,6	28,9	73,8	29,9	73,6	30,9	72,8	31,9	74,0	33,1	74,5	34,2
	0	-1	81,2	25,4	80,9	26,4	80,8	27,2	80,6	28,2	80,7	29,1	80,7	30,1	80,7	31,1	80,6	32,4
	2	1	85,5	24,4	85,3	25,3	85,3	26,1	84,9	27,1	84,8	28,0	84,8	28,9	84,8	29,8	84,8	30,9
	7	6	95,7	24,7	95,4	25,6	95,1	26,4	94,8	27,4	94,6	28,3	92,8	28,9	94,0	30,2	91,9	30,9
	12	11	102,4	25,4	102,4	26,4	102,0	27,2	101,7	28,2	101,2	29,1	101,0	30,1	100,7	31,1	100,4	32,1

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
18000	-15	-16	44,6	29,6	44,5	30,6	44,5	31,7	44,9	32,9	44,9	33,9	45,1	35,2	45,5	36,5	45,6	37,8
	-10	-11	53,1	29,4	53,9	30,4	53,3	31,6	54,2	32,6	54,0	33,7	54,7	35,0	54,8	36,3	54,8	37,6
	-7	-8	59,8	28,4	59,7	29,5	58,8	30,6	59,8	31,7	59,8	32,7	60,1	34,0	59,2	35,0	60,6	36,5
	-3	-4	66,7	27,0	66,5	27,9	66,9	28,9	67,1	29,9	66,9	30,9	66,2	31,9	67,3	33,1	67,7	34,2
	0	-1	73,8	25,4	73,5	26,4	73,5	27,2	73,3	28,2	73,3	29,1	73,3	30,1	73,4	31,1	73,3	32,4
	2	1	77,7	24,4	77,6	25,3	77,6	26,1	77,2	27,1	77,1	28,0	77,1	28,9	77,1	29,8	77,1	30,9
	7	6	95,7	24,7	95,4	25,6	95,1	26,4	94,8	27,4	94,6	28,3	92,8	28,9	94,0	30,2	91,9	30,9
	12	11	102,4	25,4	102,4	26,4	102,0	27,2	101,7	28,2	101,2	29,1	101,0	30,1	100,7	31,1	100,4	32,1

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA110BBAY1

UATYA110BFC2Y1

UATYA110BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in_sup_coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in_sup_coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in_sup_coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in_ext_coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in_ext_coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in_ext_coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA110BBAY1

UATYA110BFC2Y1

UATYA110BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow (m³/h)	Air Condition on Supply Coil			Air conditions on External Coil														
	TDB [°C]	TDB [°C]	TDB [°C]	20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
19800	24	17	110,6	76,7	29,4	108,6	76,7	31,2	105,8	75,3	33,2	102,6	74,7	35,7	99,7	74,7	38,6	
	40	18	114,2	76,9	29,8	111,6	74,9	31,6	109,1	74,9	33,6	106,0	74,2	36,1	102,2	72,9	38,9	
	26	18	113,9	82,6	29,7	112,6	84,0	31,7	109,7	83,3	33,9	105,6	80,6	36,1	102,8	81,3	39,0	
	27	19	117,6	82,2	30,1	115,2	81,5	31,8	112,1	80,9	34,0	108,9	80,2	36,4	105,3	78,8	39,3	
	28	20	121,3	81,1	30,4	118,9	80,5	32,2	115,7	79,8	34,4	112,4	79,1	36,8	108,2	77,7	39,8	
	30	22	129,6	80,3	31,0	126,7	78,9	32,9	123,2	77,6	35,1	119,5	76,2	37,6	115,1	76,2	40,6	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
19800	-15	-16	55,1	24,1	56,0	25,0	56,0	25,3	56,4	26,7	55,8	27,3	56,9	28,4	57,3	29,5	57,3	30,5
	-10	-11	65,2	25,2	65,2	26,0	65,4	26,9	65,2	27,9	64,9	28,8	65,2	29,8	65,2	30,7	66,8	32,0
	-7	-8	72,2	25,7	72,8	26,5	71,8	27,4	71,3	28,3	73,1	29,4	73,4	30,4	72,5	31,4	74,0	32,6
	-3	-4	77,9	25,9	81,7	26,8	81,4	27,7	80,8	28,5	81,2	29,6	81,1	30,6	81,3	31,7	81,3	32,7
	0	-1	87,6	25,7	87,5	26,6	87,4	27,6	87,3	28,3	85,1	29,3	87,1	30,3	87,0	31,4	84,7	32,5
	2	1	89,0	26,1	91,7	26,4	91,6	27,3	91,3	28,2	91,3	29,2	91,1	30,1	91,0	31,2	90,9	32,2
	7	6	103,1	25,6	102,7	26,5	102,4	27,4	102,1	28,3	101,8	29,2	101,5	30,3	101,3	31,4	101,1	32,5
	12	11	111,1	26,4	110,0	27,3	109,6	28,2	109,4	29,1	109,5	30,1	108,5	31,2	108,3	32,3	107,8	33,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
19800	-15	-16	50,1	24,1	50,9	25,0	50,9	25,3	51,3	26,7	50,7	27,3	51,7	28,4	52,1	29,5	52,1	30,5
	-10	-11	59,3	25,2	59,3	26,0	59,5	26,9	59,2	27,9	59,0	28,8	59,2	29,8	59,3	30,7	60,7	32,0
	-7	-8	65,6	25,7	66,1	26,5	65,3	27,4	64,8	28,3	66,5	29,4	66,7	30,4	65,9	31,4	67,3	32,6
	-3	-4	70,8	25,9	74,3	26,8	74,0	27,7	73,4	28,5	73,8	29,6	73,7	30,6	73,9	31,7	73,9	32,7
	0	-1	79,6	25,7	79,5	26,6	79,4	27,6	79,3	28,3	77,4	29,3	79,2	30,3	79,1	31,4	77,0	32,5
	2	1	80,9	26,1	83,3	26,4	83,3	27,3	83,0	28,2	83,0	29,2	82,8	30,1	82,7	31,2	82,7	32,2
	7	6	103,1	25,6	102,7	26,5	102,4	27,4	102,1	28,3	101,8	29,2	101,5	30,3	101,3	31,4	101,1	32,5
	12	11	111,1	26,4	110,0	27,3	109,6	28,2	109,4	29,1	109,5	30,1	108,5	31,2	108,3	32,3	107,8	33,4

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA120BBAY1

UATYA120BFC2Y1

UATYA120BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA120BBAY1

UATYA120BFC2Y1

UATYA120BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB [°C]	T WB [°C]		20			40			30			35			40		
				T C	S H C	P I	T C	S H C	P I	T C	S H C	P I	T C	S H C	P I	T C	S H C	P I
21600	24	17		117,0	82,3	32,1	114,3	81,5	34,0	111,1	80,8	36,3	108,2	80,1	38,6	104,5	78,6	41,5
	40	18		120,6	81,8	32,5	117,8	81,1	34,4	114,7	79,6	36,7	111,5	78,8	39,1	107,9	77,4	42,0
	26	18		120,9	90,3	32,6	117,3	88,1	34,4	117,6	90,3	37,0	111,3	85,8	39,1	107,9	85,8	42,1
	27	19		124,1	88,4	32,9	121,4	86,9	34,8	118,6	86,9	37,1	114,7	85,4	39,5	111,1	84,6	42,5
	28	20		128,0	87,2	33,3	125,3	85,7	35,2	122,0	84,9	37,5	118,5	84,1	40,0	114,4	83,4	43,0
	30	22		136,5	85,5	34,1	133,2	83,9	36,1	129,9	83,2	38,3	126,1	82,4	40,8	121,5	80,9	43,6

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
21600	-15	-16	59,2	25,9	58,6	27,1	59,1	28,0	60,2	29,1	60,4	29,8	60,7	31,1	60,9	32,0	61,4	33,2
	-10	-11	69,3	27,5	69,4	28,4	70,4	29,4	69,5	30,4	69,7	31,5	70,1	32,5	70,1	33,4	69,9	34,5
	-7	-8	76,6	28,1	76,8	29,0	77,5	29,9	75,6	30,9	77,5	31,9	75,8	33,0	76,1	34,1	77,2	35,3
	-3	-4	84,7	28,5	84,3	29,4	86,4	30,3	86,5	31,2	86,4	32,3	86,6	33,5	87,0	34,6	87,2	35,8
	0	-1	93,4	28,3	93,3	29,2	92,9	30,1	92,9	31,1	92,9	32,1	91,7	33,3	92,9	34,5	92,5	35,4
	2	1	97,1	28,2	97,6	29,1	97,4	30,0	97,2	31,0	97,1	32,0	97,1	33,1	96,6	34,2	97,0	35,4
	7	6	109,1	28,2	96,6	28,9	108,5	30,0	108,6	31,1	108,3	32,1	108,0	33,2	107,8	34,3	107,5	35,5
	12	11	118,1	29,2	117,6	30,1	117,2	31,1	116,7	32,1	116,2	33,2	115,9	34,3	114,9	35,4	114,9	36,5

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	TDB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
21600	-15	-16	53,8	25,9	53,3	27,1	53,7	28,0	54,7	29,1	54,9	29,8	55,2	31,1	55,3	32,0	55,8	33,2
	-10	-11	63,0	27,5	63,1	28,4	64,0	29,4	63,2	30,4	63,4	31,5	63,7	32,5	63,7	33,4	63,6	34,5
	-7	-8	69,7	28,1	69,8	29,0	70,5	29,9	68,8	30,9	70,5	31,9	68,9	33,0	69,2	34,1	70,2	35,3
	-3	-4	77,0	28,5	76,6	29,4	78,6	30,3	78,6	31,2	78,6	32,3	78,8	33,5	79,1	34,6	79,3	35,8
	0	-1	84,9	28,3	84,8	29,2	84,5	30,1	84,4	31,1	84,5	32,1	83,4	33,3	84,4	34,5	84,1	35,4
	2	1	88,2	28,2	88,7	29,1	88,5	30,0	88,4	31,0	88,3	32,0	88,3	33,1	87,9	34,2	88,2	35,4
	7	6	109,1	28,2	96,6	28,9	108,5	30,0	108,6	31,1	108,3	32,1	108,0	33,2	107,8	34,3	107,5	35,5
	12	11	118,1	29,2	117,6	30,1	117,2	31,1	116,7	32,1	116,2	33,2	115,9	34,3	114,9	35,4	114,9	36,5

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA140BBAY1

UATYA140BFC2Y1

UATYA140BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA140BBAY1

UATYA140BFC2Y1

UATYA140BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB	T WB		20			30			35			40			45		
	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI			
25000	24	17	136,2	98,0	33,1	133,6	97,1	35,5	129,7	95,4	38,4	125,7	94,5	41,7	121,1	92,8	45,4	
	40	18	141,1	97,4	33,3	138,2	97,4	35,8	133,8	94,0	38,8	129,6	94,0	42,2	124,9	92,3	45,8	
	26	18	140,6	105,5	33,3	137,3	104,7	35,7	133,5	103,0	38,7	129,7	98,6	42,2	125,7	103,8	46,2	
	27	19	144,9	104,2	33,6	142,2	105,0	36,1	138,2	103,3	39,2	133,5	100,7	42,5	128,6	99,8	46,2	
	28	20	149,8	103,6	33,8	146,0	102,8	36,4	142,4	101,9	39,1	137,5	100,2	42,9	133,0	100,2	46,8	
	30	22	159,4	100,8	34,2	155,6	99,9	36,9	151,7	99,9	40,1	146,4	98,2	43,6	140,8	96,4	47,3	

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
25000	-15	-16	66,3	30,1	67,3	31,2	66,7	32,0	66,5	33,2	68,6	34,5	66,9	35,5	67,5	37,0	67,4	38,2
	-10	-11	79,3	31,8	80,1	32,7	80,3	33,8	79,3	35,0	78,5	36,2	78,8	37,4	79,7	38,7	79,4	40,1
	-7	-8	86,9	32,0	87,0	33,0	86,5	34,0	86,4	35,1	87,5	36,4	88,7	37,6	84,9	38,9	86,3	40,3
	-3	-4	100,2	31,8	98,8	32,9	95,0	34,1	98,0	35,1	98,1	36,1	97,2	37,4	96,8	38,7	95,1	40,1
	0	-1	104,1	31,7	103,0	32,7	106,0	33,1	105,8	34,1	105,6	35,4	102,5	37,0	105,5	37,7	102,1	39,6
	2	1	109,4	30,9	109,4	31,7	109,5	32,8	107,7	34,0	107,9	35,0	107,4	36,4	107,7	37,4	108,2	38,7
	7	6	125,4	30,3	124,6	31,3	124,0	32,4	123,4	33,5	123,3	34,8	123,1	35,8	122,6	37,0	122,1	38,4
	12	11	135,3	30,7	134,5	31,8	134,4	32,8	132,5	34,0	133,7	35,1	133,1	36,3	132,5	37,6	131,9	38,9

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																			
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil																
	T DB	TWB	10		12		14		16		18		20		22		24		
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	
25000	-15	-16	60,3	30,1	61,2	31,2	60,6	32,0	60,5	33,2	62,3	34,5	60,9	35,5	61,4	37,0	61,3	38,2	
	-10	-11	72,1	31,8	72,8	32,7	73,0	33,8	72,1	35,0	71,4	36,2	71,6	37,4	72,4	38,7	72,2	40,1	
	-7	-8	79,0	32,0	79,1	33,0	78,7	34,0	78,6	35,1	79,6	36,4	80,6	37,6	77,2	38,9	78,4	40,3	
	-3	-4	91,1	31,8	89,8	32,9	86,4	34,1	89,1	35,1	89,2	36,1	88,4	37,4	88,0	38,7	86,5	40,1	
	0	-1	94,6	31,7	93,6	32,7	96,3	33,1	96,2	34,1	96,0	35,4	93,2	37,0	95,9	37,7	92,8	39,6	
	2	1	99,5	30,9	99,4	31,7	99,5	32,8	97,9	34,0	98,1	35,0	97,6	36,4	97,9	37,4	98,4	38,7	
	7	6	125,4	30,3	124,6	31,3	124,0	32,4	123,4	33,5	123,3	34,8	123,1	35,8	122,6	37,0	122,1	38,4	
	12	11	135,3	30,7	134,5	31,8	134,4	32,8	132,5	34,0	133,7	35,1	133,1	36,3	132,5	37,6	131,9	38,9	

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA150BBAY1

UATYA150BFC2Y1

UATYA150BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow, $V_{exhaust}$* , and the *total air flow on the external coils, V_{axial}* :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA150BBAY1

UATYA150BFC2Y1

UATYA150BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	T DB [°C]	T WB [°C]		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
26500	24	17		147.6	104.5	37.4	144.3	103.6	40.2	140.3	102.7	43.4	136.1	100.9	47.1	131.5	100.0	51.1
	40	18		152.4	104.0	37.8	148.8	103.1	40.6	145.1	102.1	43.9	140.5	100.3	47.5	135.6	98.5	51.6
	26	18		152.5	113.6	37.7	149.0	111.7	40.5	145.1	111.7	43.9	140.3	108.9	47.5	137.3	108.0	51.7
	27	19		157.2	112.1	38.1	153.5	110.2	40.9	150.6	113.0	44.2	144.9	108.4	48.0	139.3	106.5	52.1
	28	20		162.1	110.6	38.4	158.2	109.7	41.3	153.7	107.8	44.6	149.1	106.9	48.3	143.6	105.9	52.4
	30	22		172.5	108.5	38.9	168.3	106.7	42.0	163.5	105.7	45.4	158.4	104.8	49.2	152.8	102.9	53.0

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
			PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
26500	-15	-16	74,8	33,5	75,0	34,6	75,8	35,9	74,7	36,8	74,9	38,1	74,3	39,4	74,4	40,7	77,1	43,0
	-10	-11	89,0	35,3	87,6	36,4	89,2	37,7	89,7	39,2	89,2	40,6	88,3	42,0	87,4	43,5	87,6	45,1
	-7	-8	97,5	36,0	96,6	37,1	96,5	38,3	93,9	39,6	97,8	41,2	95,0	42,5	96,9	44,1	96,4	45,5
	-3	-4	108,5	36,1	108,4	37,2	105,0	38,3	105,1	39,6	106,1	41,0	108,0	42,4	109,0	43,8	108,1	45,3
	0	-1	116,6	35,5	114,6	36,7	115,0	37,8	116,7	39,1	113,7	40,6	115,8	41,7	113,7	43,4	114,7	44,7
	2	1	123,6	34,8	123,5	36,0	122,8	37,1	123,1	38,3	121,0	39,7	122,1	40,9	122,0	42,4	119,0	44,1
	7	6	138,8	34,7	138,3	35,8	138,0	37,0	136,1	38,2	136,6	39,5	136,4	40,9	136,0	42,4	136,4	44,0
	12	11	150,0	35,3	150,1	36,6	149,7	37,8	147,3	39,0	147,3	40,4	145,3	41,6	146,6	43,4	146,4	44,9

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m ³ /h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
			PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
26500	-15	-16	68,0	33,5	68,2	34,6	68,9	35,9	67,9	36,8	68,1	38,1	67,6	39,4	67,6	40,7	70,1	43,0
	-10	-11	80,9	35,3	79,7	36,4	81,1	37,7	81,5	39,2	81,1	40,6	80,3	42,0	79,4	43,5	79,7	45,1
	-7	-8	88,6	36,0	87,8	37,1	87,8	38,3	85,3	39,6	88,9	41,2	86,3	42,5	88,1	44,1	87,7	45,5
	-3	-4	98,7	36,1	98,6	37,2	95,5	38,3	95,6	39,6	96,5	41,0	98,1	42,4	99,1	43,8	98,3	45,3
	0	-1	106,0	35,5	104,2	36,7	104,5	37,8	106,1	39,1	103,4	40,6	105,3	41,7	103,4	43,4	104,3	44,7
	2	1	112,4	34,8	112,3	36,0	111,6	37,1	111,9	38,3	110,0	39,7	111,0	40,9	110,9	42,4	108,2	44,1
	7	6	138,8	34,7	138,3	35,8	138,0	37,0	136,1	38,2	136,6	39,5	136,4	40,9	136,0	42,4	136,4	44,0
	12	11	150,0	35,3	150,1	36,6	149,7	37,8	147,3	39,0	147,3	40,4	145,3	41,6	146,6	43,4	146,4	44,9

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA160BBAY1

UATYA160BFC2Y1

UATYA160BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA160BBAY1

UATYA160BFC2Y1

UATYA160BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	TDB [°C]	TWE [°C]		20			40			30			35			40		
				TC	SHC	RI	TC	SHC	RI	TC	SHC	RI	TC	SHC	RI	TC	SHC	RI
28000	24	17		157,5	110,0	40,3	153,8	109,0	43,0	151,6	111,0	46,2	145,7	107,1	50,0	140,6	105,2	54,3
	40	18		162,1	109,4	40,6	159,2	108,4	43,3	155,9	108,4	46,6	150,7	106,5	50,4	144,9	103,6	54,8
	26	18		162,4	119,5	40,6	158,5	117,5	43,2	154,5	116,6	46,6	149,8	114,6	50,3	144,7	113,7	54,7
	27	19		166,0	116,0	40,8	163,9	117,0	43,6	160,4	116,0	46,9	154,6	114,0	50,7	149,2	113,1	55,2
	28	20		172,4	116,4	41,2	169,7	116,4	43,9	164,6	114,4	47,4	160,3	114,4	51,2	154,4	112,5	55,5
	30	22		184,2	115,2	41,8	180,1	113,2	44,6	174,9	110,3	48,2	169,7	109,3	52,0	163,8	108,3	56,3

PEAK Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
28000	-15	-16	81,5	36,7	79,6	37,8	81,5	39,2	82,8	40,9	81,0	42,0	81,2	43,6	80,9	45,2	80,3	46,6
	-10	-11	93,8	38,3	98,2	39,9	94,0	41,0	95,0	42,6	94,5	44,9	94,7	45,8	94,5	47,5	95,1	49,3
	-7	-8	105,7	39,1	103,1	40,2	103,5	41,6	103,6	43,1	105,1	44,8	102,9	46,2	103,1	47,9	106,1	49,8
	-3	-4	115,9	39,6	119,6	40,6	114,6	42,0	113,3	43,4	115,9	45,1	115,5	46,6	114,8	48,5	114,8	49,9
	0	-1	124,3	39,0	123,9	40,2	125,8	41,3	125,6	42,7	125,5	44,2	127,3	45,5	125,4	47,2	125,1	48,7
	2	1	134,5	38,3	133,5	39,5	133,1	40,8	132,9	42,1	132,7	43,6	132,3	45,1	131,7	46,8	132,4	48,1
	7	6	149,8	38,2	149,4	39,5	148,7	41,0	147,3	42,0	148,0	43,7	147,5	45,2	146,8	46,7	146,9	48,6
	12	11	161,7	39,1	160,8	40,4	160,1	41,7	159,5	43,1	158,7	44,6	158,4	46,1	157,3	47,8	157,4	49,3

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow [m³/h]	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB [°C]	TWB [°C]	10		12		14		16		18		20		22		24	
28000	-15	-16	74,1	36,7	72,4	37,8	74,1	39,2	75,3	40,9	73,6	42,0	73,9	43,6	73,5	45,2	73,0	46,6
	-10	-11	85,2	38,3	89,3	39,9	85,5	41,0	86,4	42,6	85,9	44,9	86,1	45,8	85,9	47,5	86,5	49,3
	-7	-8	96,1	39,1	93,8	40,2	94,1	41,6	94,2	43,1	95,6	44,8	93,6	46,2	93,8	47,9	96,5	49,8
	-3	-4	105,4	39,6	108,7	40,6	104,2	42,0	103,0	43,4	105,4	45,1	105,0	46,6	104,4	48,5	104,4	49,9
	0	-1	113,0	39,0	112,6	40,2	114,4	41,3	114,2	42,7	114,1	44,2	115,7	45,5	114,0	47,2	113,7	48,7
	2	1	122,3	38,3	121,4	39,5	121,0	40,8	120,8	42,1	120,6	43,6	120,3	45,1	119,7	46,8	120,4	48,1
	7	6	149,8	38,2	149,4	39,5	148,7	41,0	147,3	42,0	148,0	43,7	147,5	45,2	146,8	46,7	146,9	48,6
	12	11	161,7	39,1	160,8	40,4	160,1	41,7	159,5	43,1	158,7	44,6	158,4	46,1	157,3	47,8	157,4	49,3

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA180BBAY1

UATYA180BFC2Y1

UATYA180BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the air temperature on supply coil data set

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the air temperature on the outdoor coil data set

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the exhaust air flow, $V_{exhaust}$, and the total air flow on the external coils, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA180BBAY1

UATYA180BFC2Y1

UATYA180BFC3Y1

Cooling Capacity and Power Input Table [EN 14511]																		
Air Flow [m³/h]	Air Condition on Supply Coil			Air conditions on External Coil														
	TDB [°C]	TWB [°C]		20			40			30			35			40		
				TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI	TC	SHC	PI
30500	24	17		175.1	122.7	44.7	171.2	121.7	47.4	167.0	119.6	51.1	162.2	119.6	55.2	155.9	116.5	59.8
	25	18		180.7	122.1	44.9	176.8	120.0	47.8	172.2	119.0	51.6	167.1	118.0	55.6	160.9	114.9	60.4
	26	18		180.4	131.9	45.0	176.5	130.8	47.9	171.9	129.8	51.5	166.9	127.7	55.6	161.3	122.5	60.4
	27	19		186.2	130.2	45.4	182.3	130.2	48.2	177.6	128.1	52.0	173.4	129.2	56.2	165.8	126.1	60.8
	28	20		192.2	129.6	45.7	187.4	127.5	48.7	183.2	127.5	52.5	177.8	126.5	56.6	170.8	124.4	61.3
	30	22		204.7	126.3	46.1	200.0	126.3	49.6	194.4	123.1	53.4	189.9	123.1	57.3	181.2	121.0	62.4

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil			Air Condition on Supply Coil														
	T DB	TWB		10		12		14		16		18		20		22		24
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
30500	-15	-16	88,1	38,6	88,2	39,8	88,3	41,1	88,4	42,8	86,7	43,8	86,8	45,4	88,5	47,5	86,2	48,4
	-10	-11	103,1	40,5	102,9	41,8	103,9	43,4	102,1	44,8	102,4	46,6	105,1	48,4	105,2	50,2	101,3	52,0
	-7	-8	111,4	40,9	110,0	42,3	110,6	43,7	115,1	45,4	115,2	47,0	113,4	48,7	110,1	50,4	105,8	51,9
	-3	-4	122,1	41,3	129,6	42,6	122,1	44,0	122,0	45,5	123,9	47,1	123,0	48,8	122,2	50,5	121,9	52,3
	0	-1	133,5	41,1	136,4	42,2	137,7	43,5	136,4	45,0	134,9	46,6	135,5	48,4	134,2	49,9	133,9	51,7
	2	1	143,0	40,3	142,2	41,6	141,9	43,0	143,4	44,4	141,6	45,8	142,3	47,3	137,9	49,4	138,4	51,0
	7	6	162,1	39,9	162,0	41,3	160,0	42,7	160,3	44,3	159,2	45,5	157,2	47,2	159,1	48,8	156,5	50,5
	12	11	172,7	40,6	172,4	42,0	171,7	43,4	171,0	44,9	170,2	46,6	169,7	48,0	168,9	49,7	168,2	51,4

INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
30500	-15	-16	80.1	38.6	80.2	39.8	80.3	41.1	80.4	42.8	78.8	43.8	78.9	45.4	80.4	47.5	78.4	48.4
	-10	-11	93.7	40.5	93.6	41.8	94.4	43.4	92.9	44.8	93.1	46.6	95.5	48.4	95.6	50.2	92.1	52.0
	-7	-8	101.3	40.9	100.0	42.3	100.5	43.7	104.6	45.4	104.7	47.0	103.1	48.7	100.1	50.4	96.2	51.9
	-3	-4	111.0	41.3	117.8	42.6	111.0	44.0	110.9	45.5	112.6	47.1	111.8	48.8	111.1	50.5	110.8	52.3
	0	-1	121.4	41.1	124.0	42.2	125.2	43.5	124.0	45.0	122.6	46.6	123.2	48.4	122.0	49.9	121.7	51.7
	2	1	130.0	40.3	129.3	41.6	129.0	43.0	130.4	44.4	128.7	45.8	129.4	47.3	125.4	49.4	125.8	51.0
	7	6	162.1	39.9	162.0	41.3	160.0	42.7	160.3	44.3	159.2	45.5	157.2	47.2	159.1	48.8	156.5	50.5
	12	11	172.7	40.6	172.4	42.0	171.7	43.4	171.0	44.9	170.2	46.6	169.7	48.0	168.9	49.7	168.2	51.4

Data calculated in accordance with EN 14511

5 Capacity tables

5 - 1 Cooling/Heating Capacity Tables

UATYA190BBAY1

UATYA190BFC2Y1

UATYA190BFC3Y1

Use as input for the tables, the air condition on supply coil and external coil, determined according to the following formulas. If air conditions on the supply coil and external coil are not present in the table, interpolation is required.

DETERMINATION OF AIR TEMPERATURE ON SUPPLY COIL (use as input in the table)

$$T_{in, sup, coil} = T_{indoor} * \left(1 - \frac{x}{100}\right) + T_{outdoor} * \frac{x}{100}$$

Where:

$T_{in, sup, coil}$ is the temperature that has to be used as input for the table of the *air temperature on supply coil data set*

T_{indoor} is the temperature of the indoor ambient

$T_{outdoor}$ is the temperature of the outdoor ambient

For unit with dampers, x is the amount (in %) of the fresh air. As factory default this is set to 30%, therefore the above calculation is:

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$ and $T_{outdoor} = 35^{\circ}\text{C}$)

$$T_{in, sup, coil} = T_{indoor} * 0.7 + T_{outdoor} * 0.3 = 27 * 0.7 + 35 * 0.3 = 29.4^{\circ}\text{C}$$

DETERMINATION OF AIR TEMPERATURE ON THE EXTERNAL COIL (use as input in the table)

For units basic units and two dampers units, the thermodynamic heat recovery on the external coil is not present. For this reason, use:

$$T_{in, ext, coil} = T_{outdoor}$$

For three dampers units, the thermodynamic heat recovery on the external coil is present. For this reason, use:

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right)$$

Where:

$T_{in, ext, coil}$ is the temperature that has to be used as input for the table of the *air temperature on the outdoor coil data set*

T_{indoor} is the temperature of the indoor ambient.

$T_{outdoor}$ is the temperature of the outdoor ambient.

$x_{exhaust}$ is the ratio between the *exhaust air flow*, $V_{exhaust}$, and the *total air flow on the external coils*, V_{axial} :

$$x_{exhaust} = \frac{V_{exhaust}}{V_{axial}} = \frac{x * V_{intake}}{V_{axial}}$$

Where:

x is the amount (in %) of the fresh air. As factory default this is set to 30%

V_{intake} is the return air flow. As factory default, the return air flow is equal to the supply air flow.

(e.g. with $T_{indoor} = 27^{\circ}\text{C}$, $T_{outdoor} = 35^{\circ}\text{C}$, $x = 30\%$, $V_{intake} = 4950 \text{ mc/h}$, $V_{axial} = 11500 \text{ mc/h}$)

$$T_{in, ext, coil} = T_{indoor} * \frac{x_{exhaust}}{100} + T_{outdoor} * \left(1 - \frac{x_{exhaust}}{100}\right) = T_{indoor} * \frac{x * V_{intake}}{V_{axial}} + T_{outdoor} * \left(1 - \frac{x * V_{intake}}{V_{axial}}\right)$$

$$= T_{indoor} * \frac{30 * 4950}{11500} + T_{outdoor} * \left(1 - \frac{30 * 4950}{11500}\right) = 27 * 0.129 + 35 * (1 - 0.129) = 33.96^{\circ}\text{C}$$

UATYA190BBAY1

UATYA190BFC2Y1

UATYA190BFC3Y1

Cooling Capacity and Power Input Table (EN 14511)																	
Air Flow [m³/h]	Air Condition on Supply Coil		Air conditions on External Coil														
	T DB [°C]	TWB [°C]	20			40			30			35			40		
31500	24	17	190,2	134,0	50,4	186,2	131,8	53,5	181,5	130,7	57,3	176,5	129,6	61,8	169,9	127,4	67,0
	40	18	196,3	133,3	50,8	192,0	131,1	54,0	187,2	130,0	57,9	181,9	127,9	62,3	174,9	125,7	67,6
	26	18	196,5	143,6	50,8	191,5	140,4	53,7	187,6	141,4	57,7	181,4	138,2	62,3	175,5	139,3	67,8
	27	19	202,2	141,9	51,3	197,7	140,8	54,5	193,8	140,8	58,6	187,0	136,4	62,9	180,3	136,4	68,3
	28	20	209,1	141,3	51,7	204,1	139,1	55,1	198,9	136,9	59,1	192,6	135,8	63,7	184,8	132,5	69,0
	30	22	222,1	138,9	52,7	217,1	136,7	56,2	211,4	134,4	60,3	204,4	132,2	65,1	196,8	131,1	70,3

PEAK Heating Capacity and Power Input Table [EN 14511]																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
31500	-15	-16	97,9	42,9	99,5	44,3	98,0	45,7	96,6	46,9	99,8	49,1	97,2	50,2	98,6	52,2	98,1	54,1
	-10	-11	114,8	45,0	114,6	46,4	113,3	47,9	112,5	49,4	113,5	51,4	112,8	53,1	111,5	54,7	113,2	57,0
	-7	-8	126,3	45,7	123,0	47,0	125,2	48,7	127,1	50,4	124,4	51,9	125,1	53,9	123,1	55,7	125,0	57,7
	-3	-4	140,9	46,3	136,3	47,5	138,3	49,4	140,7	51,1	141,1	52,6	139,6	54,5	139,7	56,6	139,0	58,6
	0	-1	152,8	46,0	149,5	47,6	147,4	50,0	153,2	50,5	152,9	52,5	148,6	54,4	151,0	55,9	151,0	57,7
	2	1	157,6	45,7	159,1	47,3	160,1	48,6	159,1	50,1	157,3	52,1	155,8	53,8	153,3	55,6	155,4	57,5
	7	6	181,0	45,5	180,3	47,0	180,5	48,6	179,9	50,3	178,3	51,9	177,1	54,2	174,4	55,2	176,8	57,8
	12	11	193,2	46,7	193,4	48,4	191,3	49,6	192,0	51,6	189,8	53,2	190,3	55,4	190,0	57,2	189,3	59,3


INTEGRATED Heating Capacity and Power Input Table (EN 14511)																		
Air Flow	Air conditions on External Coil		Air Condition on Supply Coil															
	T DB	TWB	10		12		14		16		18		20		22		24	
[m³/h]	[°C]	[°C]	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI	PC	PI
31500	-15	-16	89,0	42,9	90,5	44,3	89,1	45,7	87,9	46,9	90,7	49,1	88,3	50,2	89,6	52,2	89,2	54,1
	-10	-11	104,4	45,0	104,2	46,4	103,0	47,9	102,3	49,4	103,2	51,4	102,5	53,1	101,4	54,7	102,9	57,0
	-7	-8	114,8	45,7	111,8	47,0	113,8	48,7	115,5	50,4	113,1	51,9	113,7	53,9	111,9	55,7	113,6	57,7
	-3	-4	128,1	46,3	123,9	47,5	125,7	49,4	127,9	51,1	128,3	52,6	126,9	54,5	127,0	56,6	126,4	58,6
	0	-1	138,9	46,0	135,9	47,6	134,0	50,0	139,3	50,5	139,0	52,5	135,1	54,4	137,3	55,9	137,3	57,7
	2	1	143,3	45,7	144,6	47,3	145,5	48,6	144,6	50,1	143,0	52,1	141,6	53,8	139,4	55,6	141,3	57,5
	7	6	181,0	45,5	180,3	47,0	180,5	48,6	179,9	50,3	178,3	51,9	177,1	54,2	174,4	55,2	176,8	57,8
	12	11	193,2	46,7	193,4	48,4	191,3	49,6	192,0	51,6	189,8	53,2	190,3	55,4	190,0	57,2	189,3	59,3

Data calculated in accordance with EN 14511

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA20-30BFC3Y1

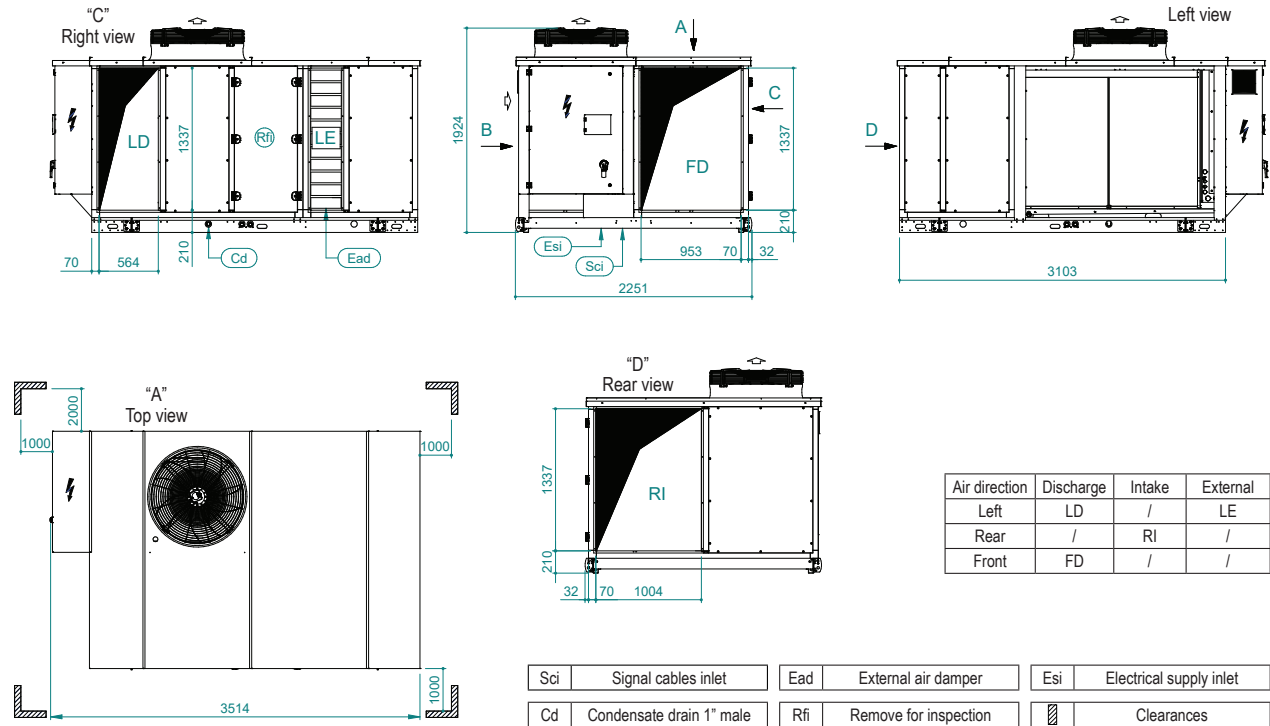

DDIM000961D

UATYA20-30BFC3Y1

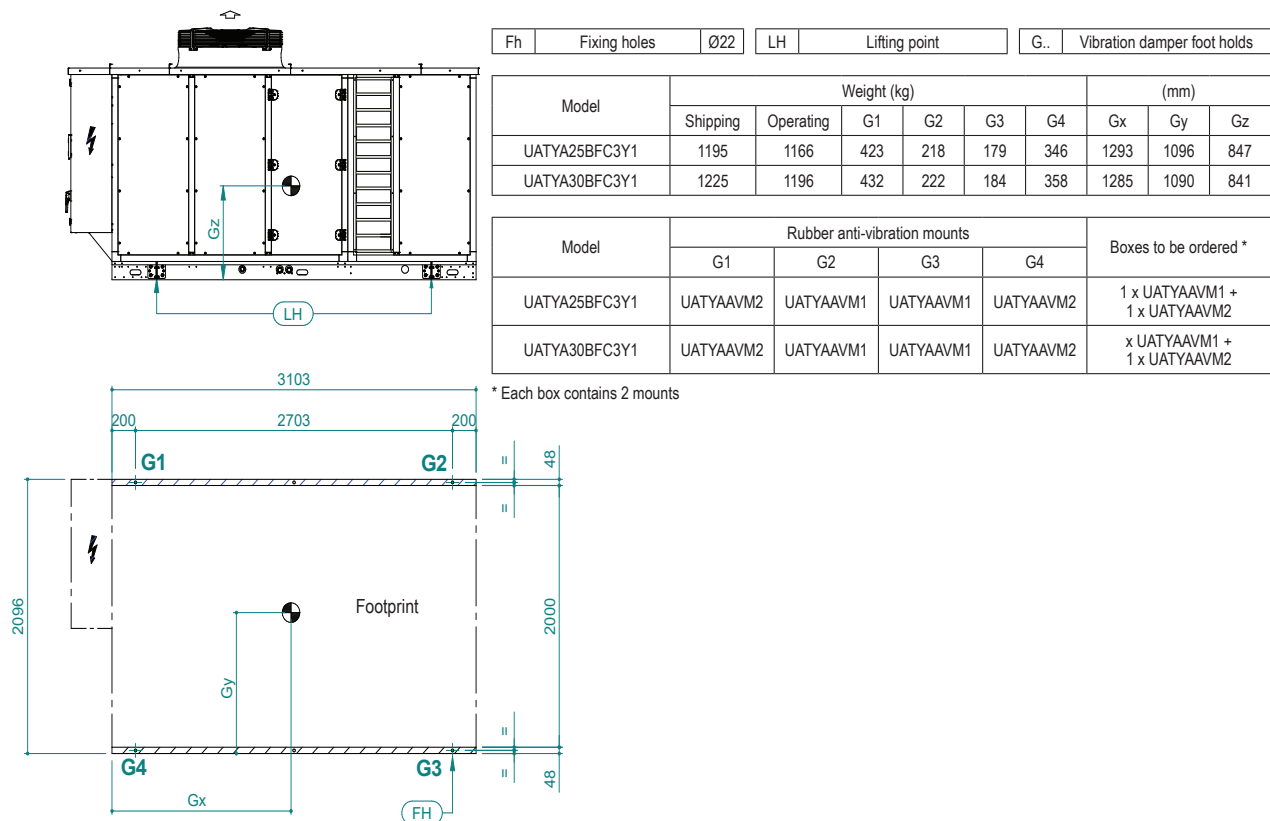


DDIM000961D

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA40-50BFC3Y1

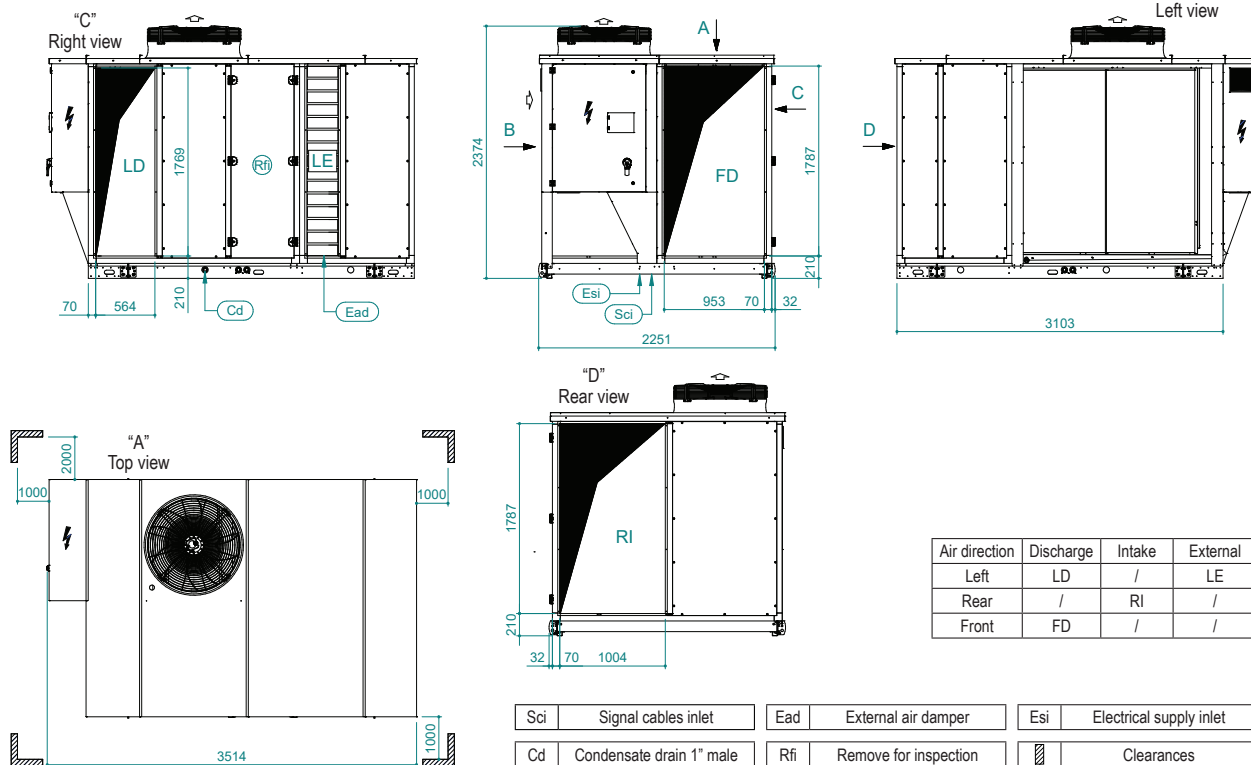

DDIM000962D

UATYA40-50BFC3Y1

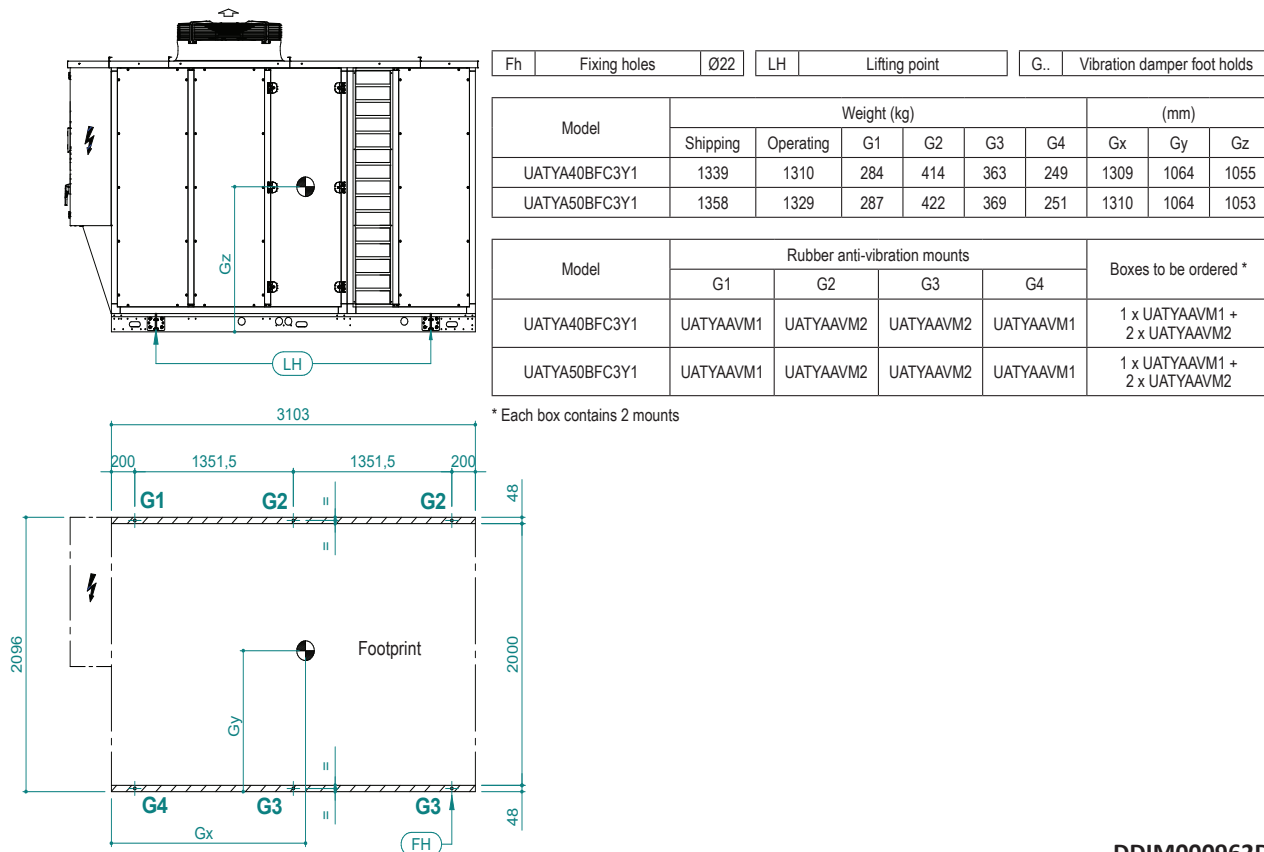


DDIM000962D

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA60-70BFC3Y1

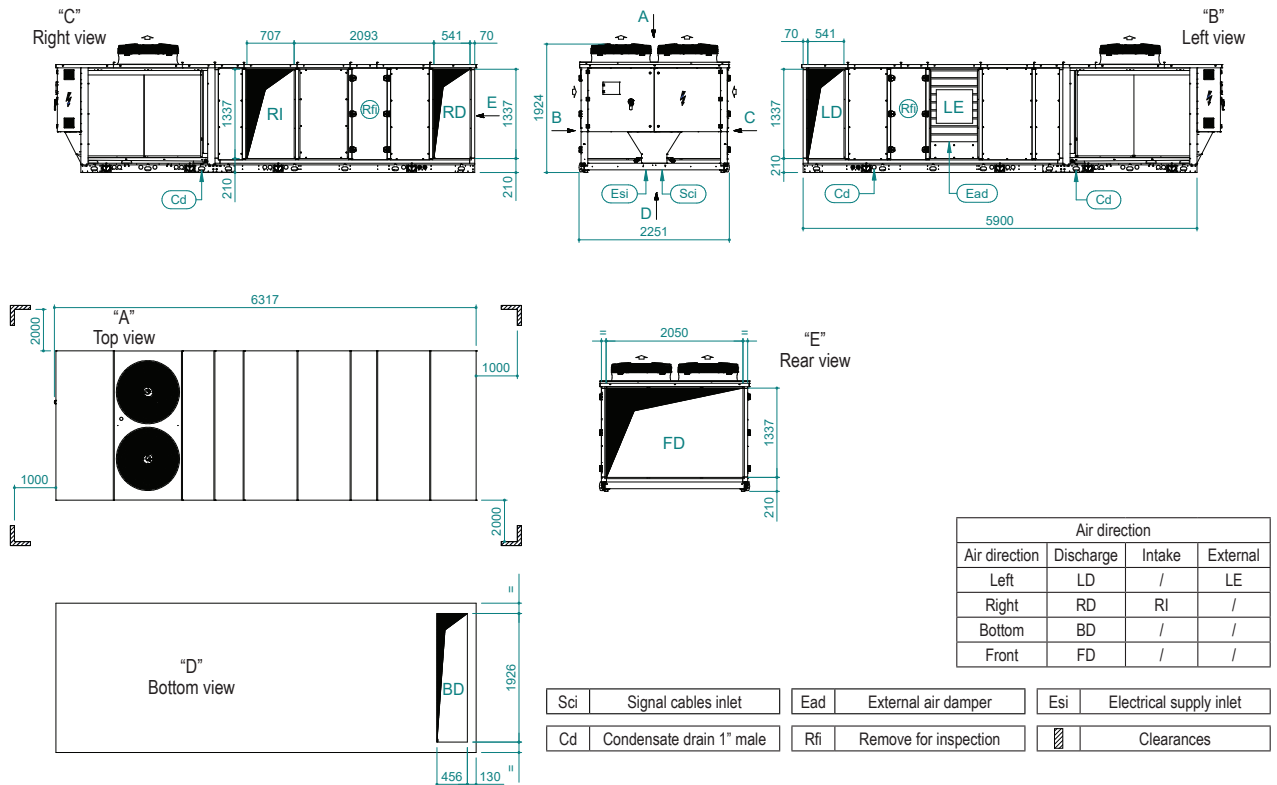

DDIM000963D_v2

UATYA60-70BFC3Y1

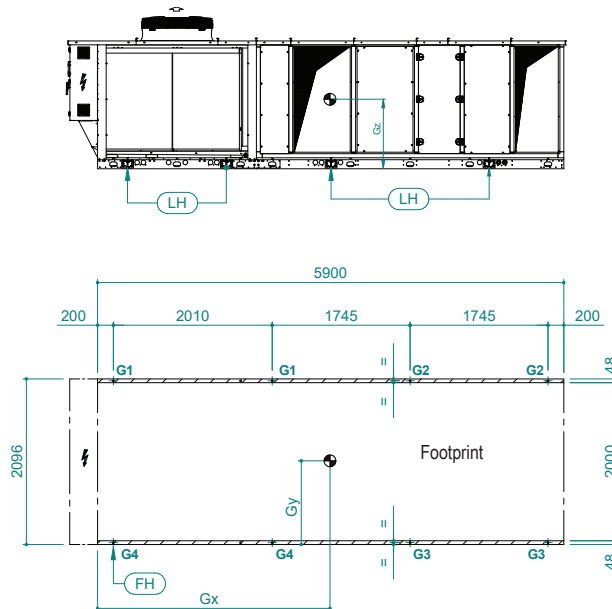

Fh	Fixing holes	Ø22	LH	Lifting point	G..	Vibration damper foot holds
Model	Weight (kg)					
	Shipping	Operating	G1	G2	G3	G4
UATYA60BFC3Y1	2035	1996	358	178	153	309
UATYA70BFC3Y1	2133	2094	399	185	147	316

Model	Rubber anti-vibration mounts				Boxes to be ordered *
	G1	G2	G3	G4	
UATYA60BFC3Y1	UATYA60BFC3Y1	UATYA60BFC3Y1	UATYA60BFC3Y1	UATYA60BFC3Y1	3 x UATYA60BFC3Y1 + 1 x UATYA60BFC3Y1
UATYA70BFC3Y1	UATYA70BFC3Y1	UATYA70BFC3Y1	UATYA70BFC3Y1	UATYA70BFC3Y1	3 x UATYA70BFC3Y1 + 1 x UATYA70BFC3Y1

* Each box contains 2 mounts


DDIM000963D_v2

6 Dimensional drawings

6 - 1 Dimensional Drawings


6

UATYA80-120BFC3Y1

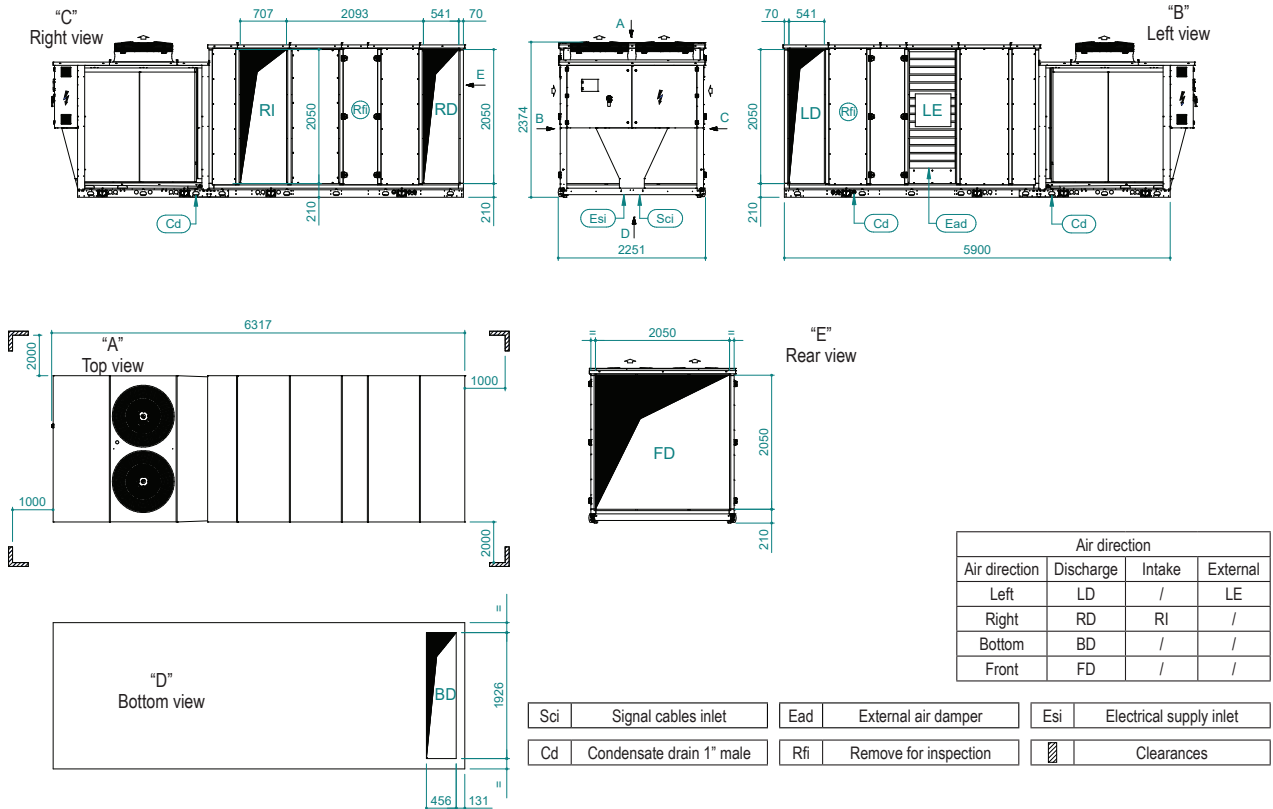

DDIM000964D_v2

UATYA80-120BFC3Y1

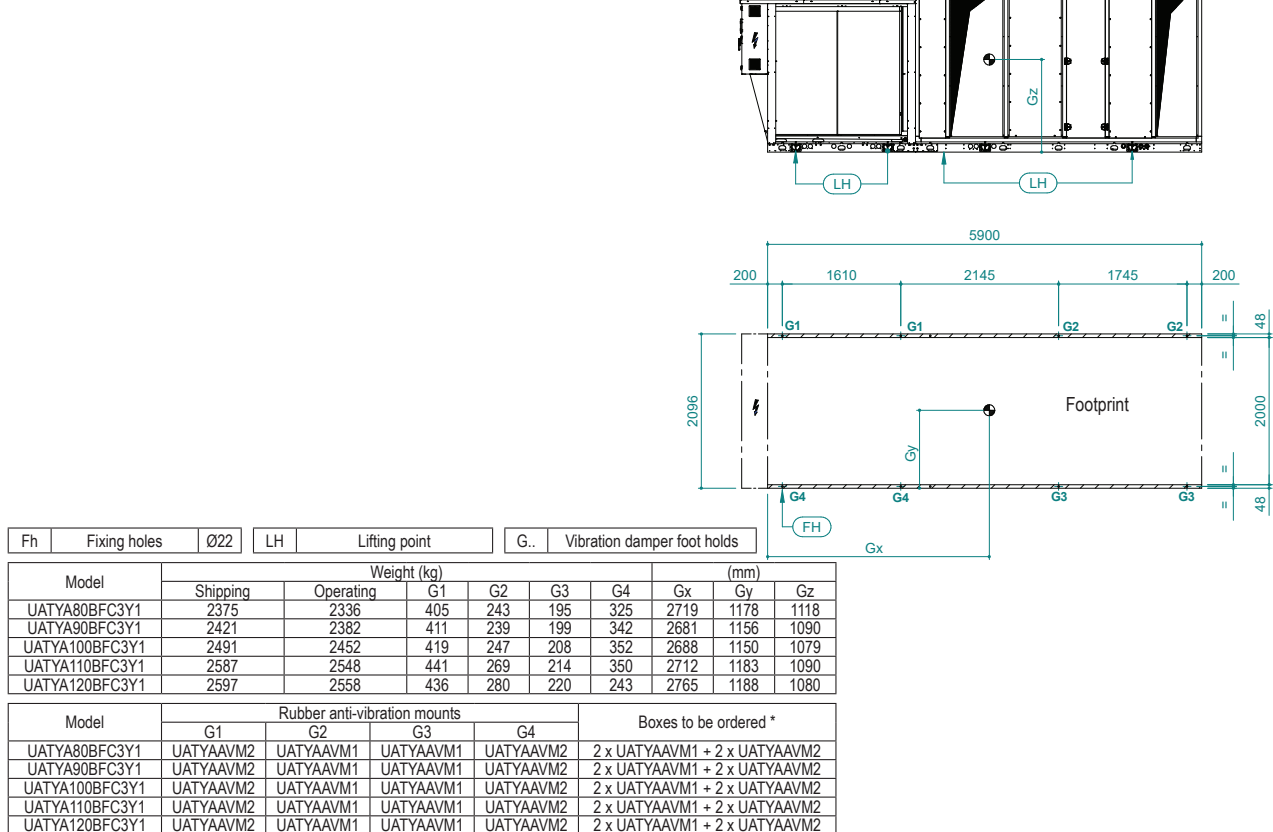


* Each box contains 2 mounts

DDIM000964D_v2

6 Dimensional drawings


6 - 1 Dimensional Drawings

UATYA140-190BFC3Y1

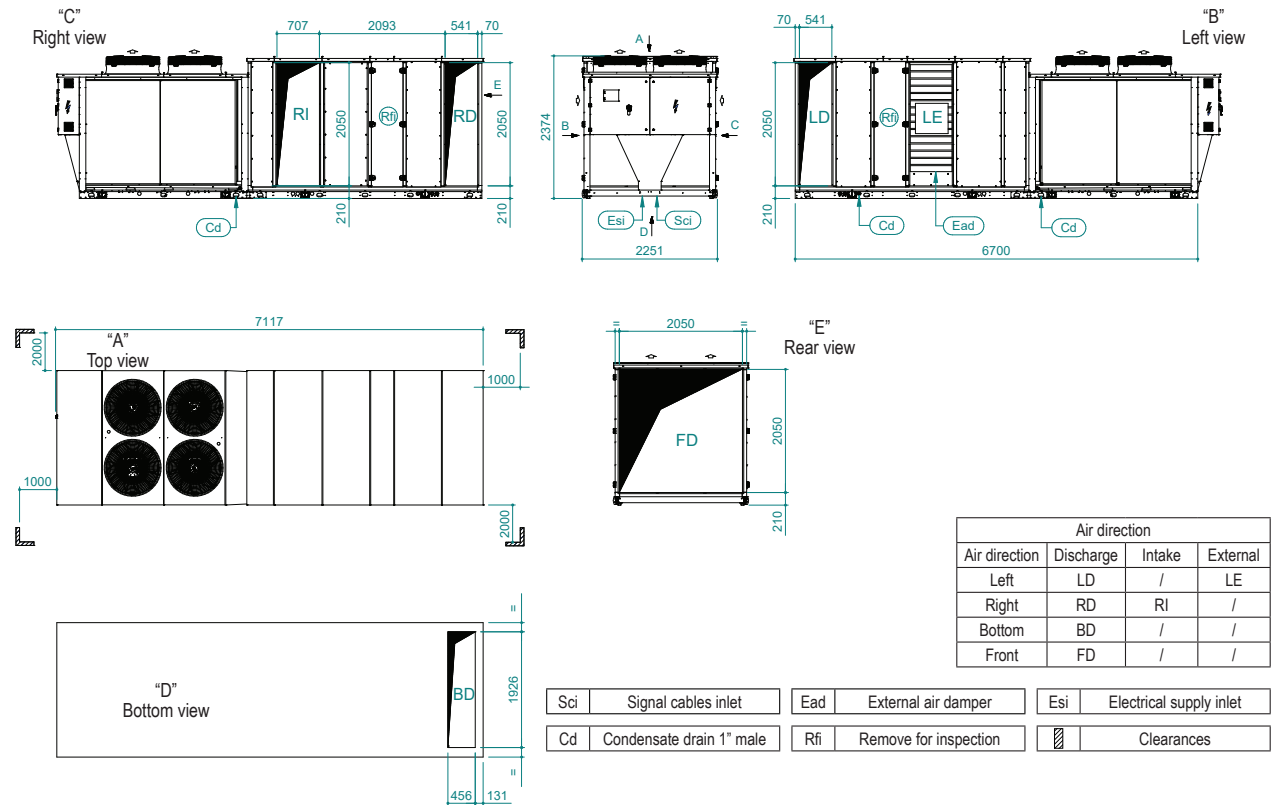

DDIM000965D_v2

UATYA140-190BFC3Y1

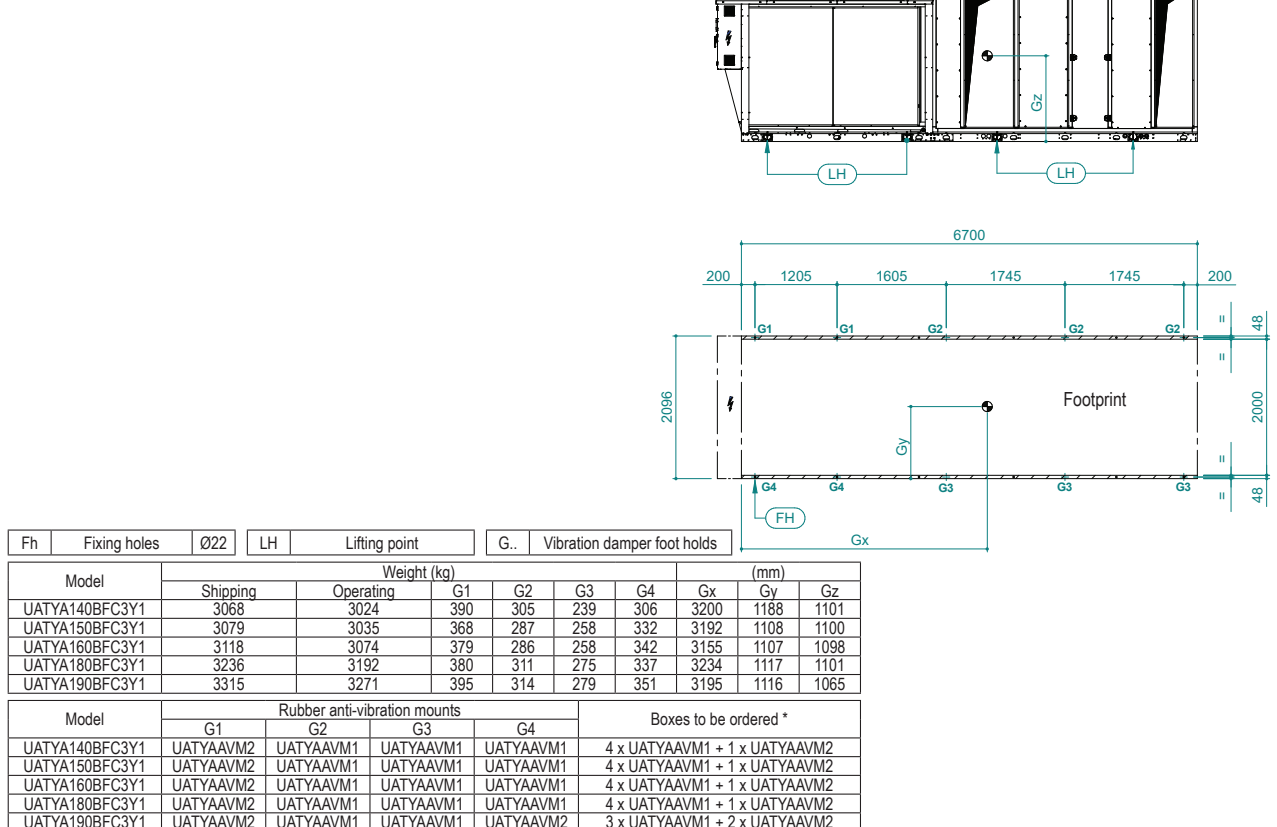

* Each box contains 2 mounts

DDIM000965D_v2

7 - 1 Piping Diagrams

7

(1) Only in unit with ØAC larger or equal to 35mm



8 Wiring diagrams

8 - 1 Wiring Diagrams - Single Phase

8

UATYA-BBAY1**UATYA-BFC2Y1****UATYA-BFC3Y1**

All wiring diagrams can be downloaded from the Daikin Europe Portal (my.daikin.eu) or your local country portal.

9 Sound data

9 - 1 Sound Level Data

UATYA-BBAY1
UATYA-BFC2Y1
UATYA-BFC3Y1

MODEL	Octave Bands [dB]																TOT dB(A)	
	63 Hz		125 Hz		250 Hz		500 Hz		1000 Hz		2000 Hz		4000 Hz		8000 Hz			
	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp	Lw	Lp		
UATYA25	87	69	84	66	79	60	75	57	72	54	68	50	64	46	55	37	82	64
UATYA30	88	69	85	66	80	61	79	61	79	60	78	60	76	58	70	52	84	66
UATYA40	85	66	82	63	83	64	77	59	81	63	80	62	79	60	65	47	87	68
UATYA50	88	69	85	66	79	61	80	61	80	62	81	62	77	59	73	54	86	67
UATYA60	91	71	88	68	83	64	81	61	82	62	81	62	83	64	75	55	89	69
UATYA70	92	72	89	69	85	66	81	61	82	63	81	62	79	60	67	48	88	68
UATYA80	97	77	94	74	88	69	84	64	85	65	82	62	89	69	77	57	93	73
UATYA90	97	77	94	74	85	65	83	63	83	63	82	62	79	59	73	53	89	69
UATYA100	97	77	94	74	85	66	83	63	84	64	82	63	83	63	75	55	90	70
UATYA110	97	77	94	74	86	66	83	63	84	64	84	64	84	64	75	55	90	71
UATYA120	97	77	94	74	88	68	85	65	87	67	86	66	90	70	79	59	94	74
UATYA140	100	80	97	77	87	67	84	64	84	63	79	59	77	56	68	48	89	68
UATYA150	100	80	97	77	88	67	84	64	83	63	79	59	77	56	68	47	89	68
UATYA160	100	80	97	77	88	67	85	64	84	63	80	60	77	57	69	49	89	69
UATYA180	100	80	97	77	88	67	85	64	84	64	81	61	78	57	71	50	89	69
UATYA190	100	80	97	77	88	67	85	65	84	64	84	64	78	58	70	50	90	70

Lw: Sound power level in free field calculated according to standard ISO 3744. Values refer only to the base unit version

Lp: Average sound pressure level, at 1 meter from the unit, in free field on a reflective surface. Not binding value derived from the sound power level

10 Fan characteristics

10 - 1 Fan Characteristics

10

UATYA25-80BBAY1

UATYA25-80BFC2Y1

UATYA25-80BFC3Y1

		UATYA25			UATYA30			UATYA40			UATYA50			UATYA60			UATYA70			UATYA80		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
DECLARED AIR FLOW	[mc/h]	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)																						
Available Pressure																						
50	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
100	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
150	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
200	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
250	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14062	11600	14500	15950
300	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	13742	11600	14500	15950
RETURN FAN (only for version UATYA***BFC3Y1)																						
Available Pressure																						
50	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
100	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
150	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
200	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
250	Pa	3600	4500	4950	4640	5800	6380	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14300	11600	14500	15950
300	Pa	3600	4500	4950	4640	5800	6211	6000	7500	8250	7200	9000	9900	8800	11000	12100	10400	13000	14221	11600	14500	15950

* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

UATYA90-120BBAY1

UATYA90-120BFC2Y1

UATYA90-120BFC3Y1

		UATYA90			UATYA100			UATYA110			UATYA120		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
DECLARED AIR FLOW	[mc/h]	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)													
Available Pressure													
50	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
100	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
150	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
200	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
250	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
300	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
RETURN FAN (only for version UATYA***BFC3Y1)													
Available Pressure													
50	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
100	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
150	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
200	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
250	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760
300	Pa	13200	16500	18150	14400	18000	19800	15840	19800	21780	17280	21600	23760

* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

10 Fan characteristics

10 - 1 Fan Characteristics

UATYA140-190BBAY1

UATYA140-190BFC2Y1

UATYA140-190BFC3Y1

10

		UATYA140			UATYA150			UATYA160			UATYA180			UATYA190		
		MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*	MIN	NOMINAL	MAX*
DECLARED AIR FLOW	[mc/h]	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075

SUPPLY FAN (for version UATYA***BBAY1 / UATYA***BFC2Y1 / UATYA***BFC3Y1)

Available Pressure																
50	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
100	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
150	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
200	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
250	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
300	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	30500	25200	31500	31500

RETURN FAN (only for version UATYA***BFC3Y1)

Available Pressure																
50	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
100	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30800	24400	30500	32940	25200	31500	33075
150	Pa	20000	25000	27500	21200	26500	29150	22400	28000	30792	24400	30500	32940	25200	31500	33075
200	Pa	20000	25000	27500	21200	26500	29150	22400	28000	29911	24400	30500	32940	25200	31500	33075
250	Pa	20000	25000	26738	21200	26500	29138	22400	28000	29138	24400	30500	32940	25200	31500	33075
300	Pa	20000	25000	25690	21200	26500	28442	22400	28000	28442	24400	30500	32940	25200	31500	33036


* The maximum airflow is related to the available pressure required. Check the table below to get the maximum airflow for the different available pressures.

11 Operation range

11 - 1 Operation Range


UATYA25BBAY1
UATYA25BFC2Y1
UATYA25BFC3Y1

11

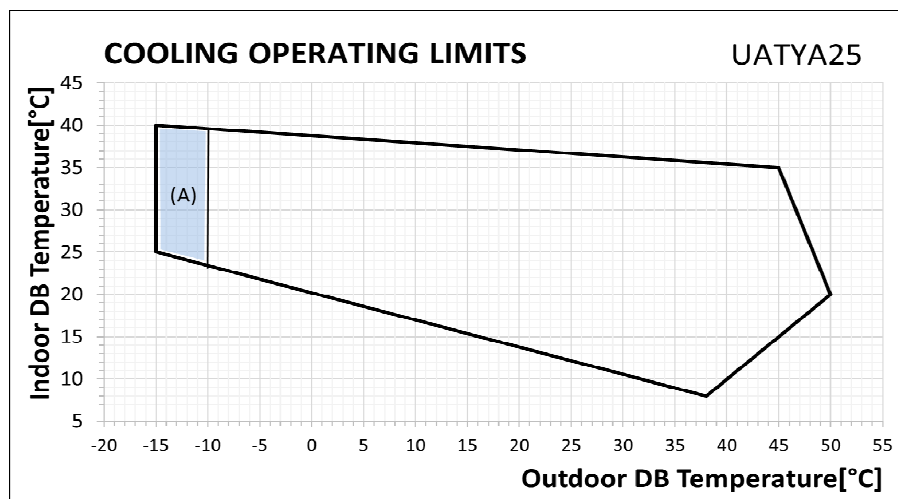

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

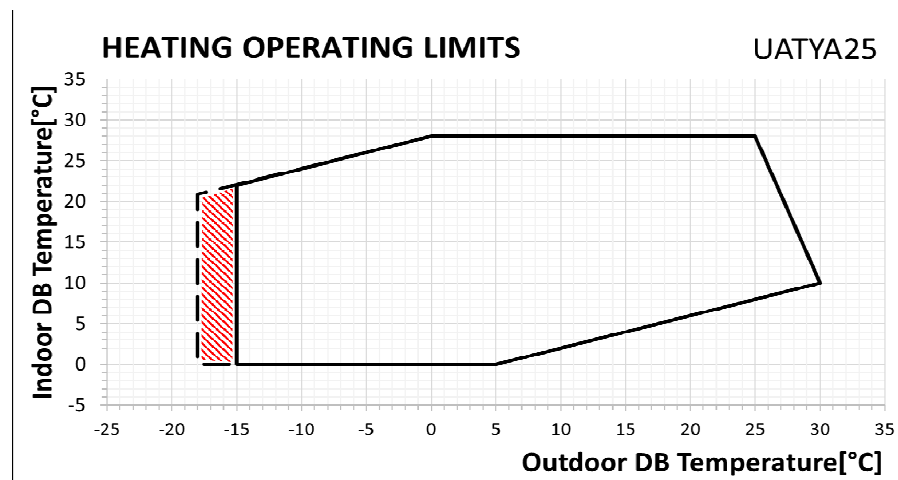

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.




Operation guaranteed (HEATING OPERATION).

11 Operation range

11 - 1 Operation Range


UATYA30-70BBAY1
UATYA90-110BBAY1
UATYA30-70BFC2Y1
UATYA90-110BFC2Y1
UATYA30-70BFC3Y1
UATYA90-110BFC3Y1

11

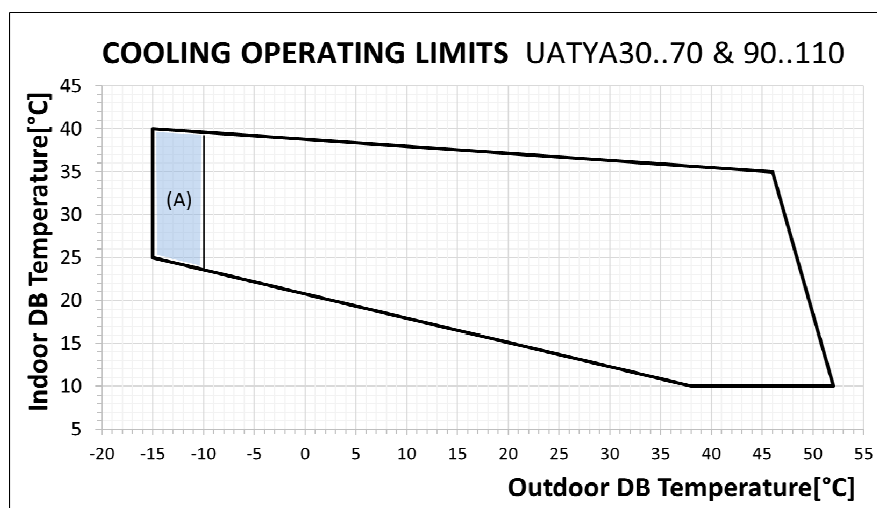

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

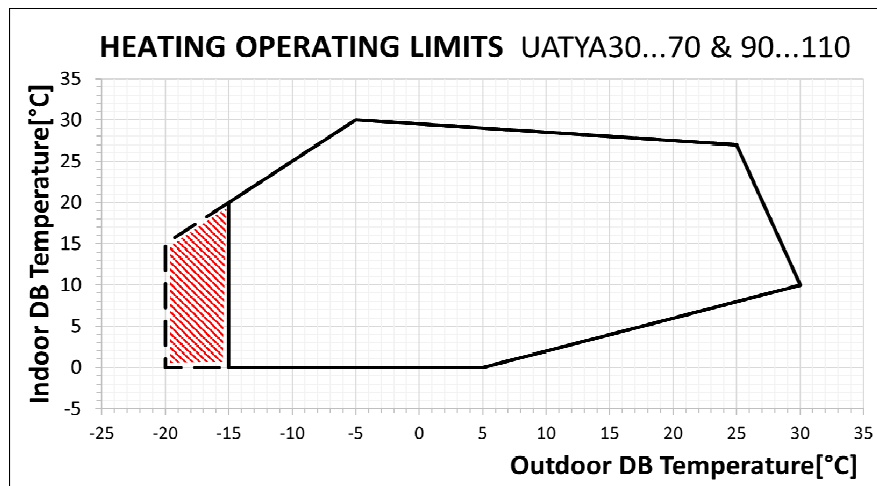

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.




Operation guaranteed (HEATING OPERATION).

11 Operation range

11 - 1 Operation Range


11

UATYA80BBAY1
UATYA120BBAY1
UATYA80BFC2Y1
UATYA120BFC2Y1
UATYA80BFC3Y1
UATYA120BFC3Y1

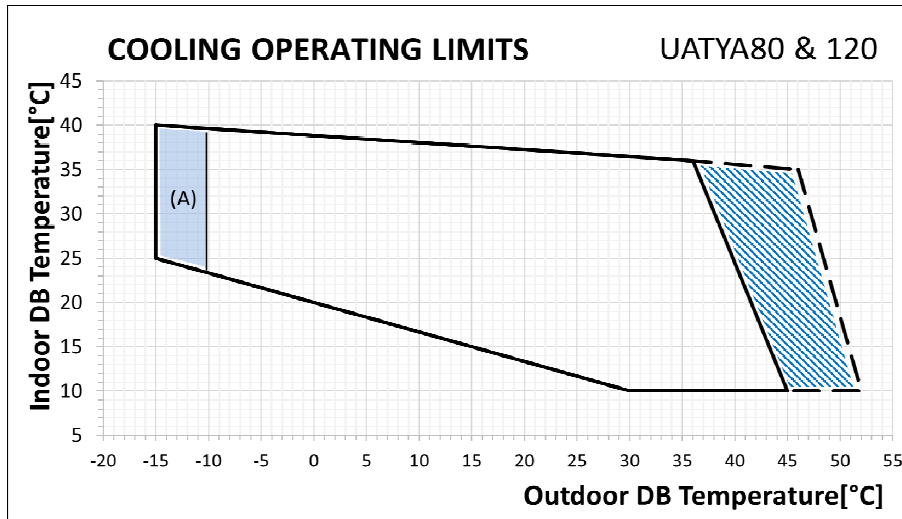

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

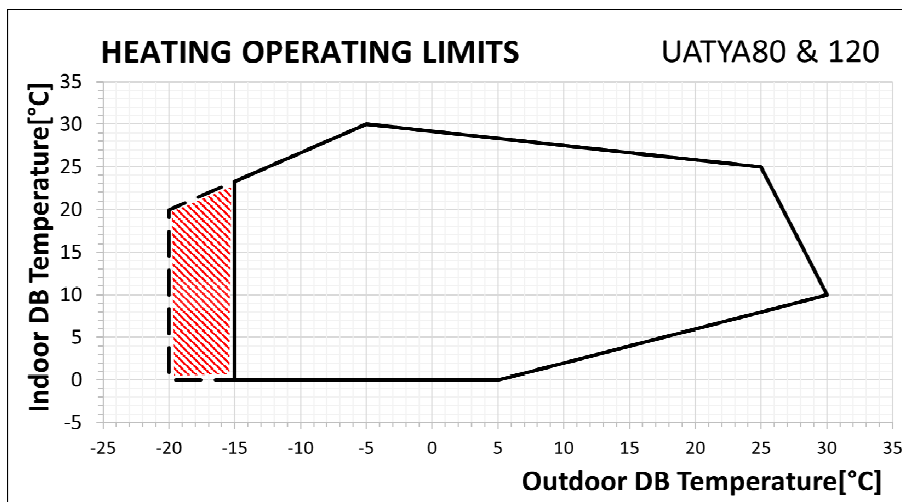

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb)

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.



Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.



Operation guaranteed (HEATING OPERATION).


11 Operation range

11 - 1 Operation Range

UATYA140-190BBAY1


UATYA140-190BFC2Y1

UATYA140-190BFC3Y1

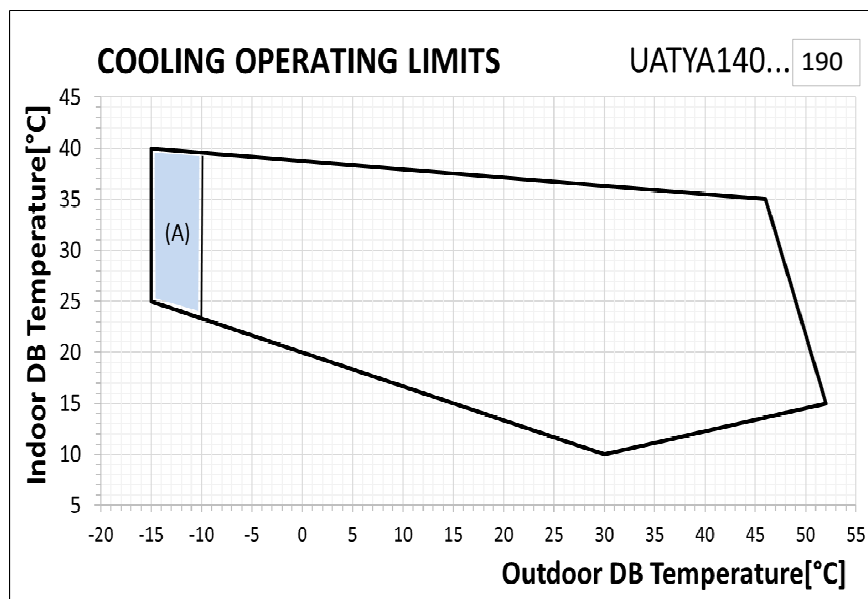

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

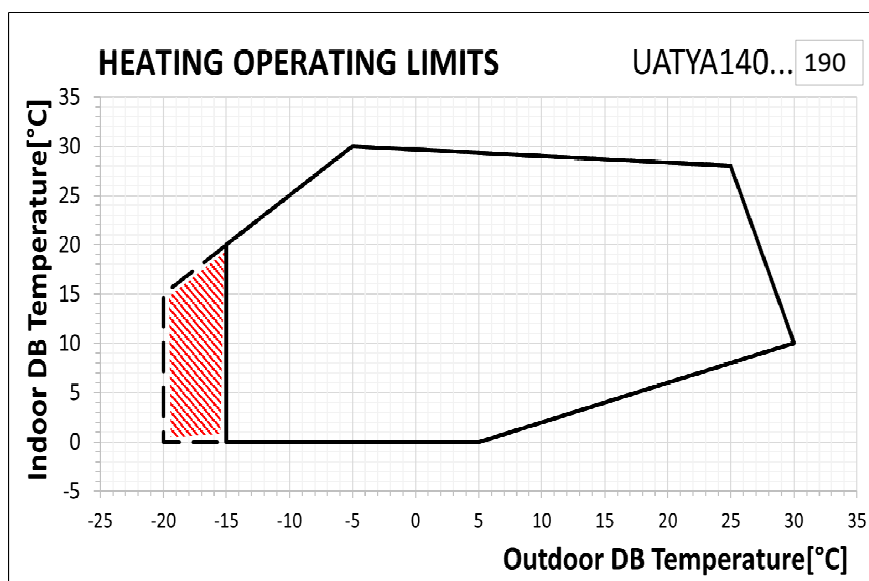

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb).

Indoor DB Temperature [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).



Performances and operation guaranteed.




Operation guaranteed (COOLING OPERATION). The cooling capacity can be reduced up to 5% compared to the maximum achievable at full speed.



Performances and operation guaranteed with EC axial fans.



Operation guaranteed (HEATING OPERATION).



EEDEN21B

08/2021



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.