



# VRV IV S-series heat pump Air Conditioning Technical Data RXYSQ-TY1



RXYSQ8TMY1B  
RXYSQ10TMY1B  
RXYSQ12TMY1B



# TABLE OF CONTENTS

## RXYSQ-TY1

1	Features	4
	RXYSQ-TY1	4
2	Specifications	5
3	Options	8
4	Combination table	9
5	Capacity tables	11
	Capacity Table Legend	11
	Capacity Correction Factor	12
6	Dimensional drawings	15
7	Centre of gravity	16
8	Piping diagrams	18
9	Wiring diagrams	19
	Wiring Diagrams - Three Phase	19
10	External connection diagrams	20
11	Sound data	21
	Sound Power Spectrum	21
	Sound Pressure Spectrum	23
12	Installation	25
	Installation Method	25
	Refrigerant Pipe Selection	29
13	Operation range	31
14	Appropriate Indoors	32

# 1 Features

## 1 - 1 RXYSQ-TY1

1

- › Space saving trunk design for flexible installation
- › Covers all thermal needs of a building via a single point of contact: accurate temperature control, ventilation, air handling units and Biddle air curtains
- › Wide range of indoor units: either connect VRV or stylish indoor units such as Daikin Emura, Perfera ...
- › Wide range of units (4 to 12HP) suitable for projects up to 200m<sup>2</sup> with space limitations
- › Incorporates VRV IV standards & technologies: Variable Refrigerant Temperature and full inverter compressors
- › Customize your VRV for best seasonal efficiency & comfort with the weather dependant Variable Refrigerant Temperature function. Increased seasonal efficiency with up to 28%. No more cold draft by supply of high outblow temperatures
- › VRV configurator software for the fastest and most accurate commissioning, configuration and customisation
- › 3 steps in night quiet mode: step 1: 47dBA, step 2: 44 dBA, step 3: 41 dBA
- › Possibility to limit peak power consumption between 30 and 80%, for example during periods with high power demand
- › Connectable to all VRV control systems
- › Keep your system in top condition via the Daikin Cloud Service: 24/7 monitoring for maximum efficiency, extended lifetime and immediate service support thanks to failure prediction



Inverter

## 2 Specifications

### 1 - 1 RXYSQ-TY1

Technical Specifications				RXYSQ8TY1	RXYSQ10TY1	RXYSQ12TY1
Recommended combination				4 x FXMQ50P7VEB	4 x FXMQ63P7VEB	6 x FXMQ50P7VEB
Recommended combination 2				4 x FXSQ50A2VEB	4 x FXSQ63A2VEB	6 x FXSQ50A2VEB
Cooling capacity	Prated,c		kW	22.4 (1)	28.0 (1)	33.5 (1)
Heating capacity	Nom.	6°CWB	kW	22.4 (2)	28.0 (2)	33.5 (2)
	Prated,h		kW	22.4 (2)	28.0 (2)	33.5 (2)
	Max.	6°CWB	kW	25.0 (2)	31.5 (2)	37.5 (2)
Power input - 50Hz	Heating	Nom.	6°CWB	kW	5.82 (2)	6.60 (2)
COP at nom.	6°CWB		kW/kW	3.85	4.24	4.09
capacity						
SCOP				4.2	4.1	4.3
SCOP recommended combination 2				4.2	4.1	4.3
SEER				6.3		6.5
SEER recommended combination 2				6.0	6.3	
ηs,c			%	247.3	247.4	256.5
ηs,c recommended combination 2				237.8	247.4	248.6
ηs,h			%	165.8	162.4	169.6
ηs,h recommended combination 2				163.4	162.2	167.0
Space cooling	A Condi- tion (35°C - 27/19)	EERd Pdc	kW	2.6	2.8	2.7
			kW	22.4	28.0	33.5
	B Condi- tion (30°C - 27/19)	EERd Pdc	kW	4.2	4.3	
			kW	16.5	20.6	24.7
	C Condi- tion (25°C - 27/19)	EERd Pdc	kW	7.7		7.9
			kW	10.6	13.3	15.9
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW	13.7	12.2	13.6
			kW	6.4	7.1	7.3
	A Condi- tion (35°C - 27/19)	EERd Pdc	kW	2.3	2.8	2.5
			kW	22.4	28.0	33.5
Space cooling recommended combination 2	B Condi- tion (30°C - 27/19)	EERd Pdc	kW	4.2	4.3	4.2
			kW	16.5	20.6	24.7
	C Condi- tion (25°C - 27/19)	EERd Pdc	kW	7.5	7.7	
			kW	10.6	13.3	15.9
	D Condi- tion (20°C - 27/19)	EERd Pdc	kW	13.4	12.3	13.5
			kW	6.4	7.3	
	TBivalent	COPd (declared COP)		2.4	2.2	
		Pdh (declared heating cap)	kW	14.9	19.6	23.5
		Tbiv (bivalent temperature)	°C	-10		
	TOL	COPd (declared COP)		2.4	2.2	
		Pdh (declared heating cap)	kW	14.9	19.6	23.5
		Tol (temperature operating limit)	°C	-10		
Space heating (Average climate)	A Con- dition (-7°C)	COPd (declared COP) Pdh (declared heating cap)	kW	2.6	2.4	
			kW	13.2	17.4	20.8
	B Condi- tion (2°C)	COPd (declared COP) Pdh (declared heating cap)	kW	4.0	4.1	4.3
			kW	8.0	10.6	12.7
	C Condi- tion (7°C)	COPd (declared COP) Pdh (declared heating cap)	kW	5.9		6.3
			kW	5.0	6.8	8.1
	D Con- dition (12°C)	COPd (declared COP) Pdh (declared heating cap)	kW	7.8	6.3	6.7
			kW	5.8	6.4	6.6
	A Con- dition (-7°C)	COPd (declared COP) Pdh (declared heating cap)	kW	2.6	2.4	2.3
			kW	13.2	17.4	20.8
	B Condi- tion (2°C)	COPd (declared COP) Pdh (declared heating cap)	kW	4.0	4.1	4.2
			kW	8.0	10.6	12.7
	C Condi- tion (7°C)	COPd (declared COP) Pdh (declared heating cap)	kW	5.8	5.9	6.2
			kW	5.2	6.8	8.1
Space heating (Average climate) recommended combination 2	D Con- dition (12°C)	COPd (declared COP) Pdh (declared heating cap)	kW	7.7	6.3	6.6
			kW	5.7	6.4	6.5
	TBivalent	COPd (declared COP)		2.3	2.2	
		Pdh (declared heating cap)	kW	14.9	19.6	23.5
		Tbiv (bivalent temperature)	°C	-10.0		
	Capacity range			HP	8	10
						12

## 2 Specifications

### 1 - 1 RXYSQ-TY1

2

Technical Specifications					RXYSQ8TY1	RXYSQ10TY1	RXYSQ12TY1
PED	Category				Category II		
	Most critical part	Name Ps*V	Bar*I		202	Accumulator 279	
Maximum number of connectable indoor units					64 (3)		
Indoor index connection	Min.				100.0	125.0	150.0
	Max.				260.0	325.0	390.0
Dimensions	Unit	Height	mm		1,430	1,615	
		Width	mm		940		
		Depth	mm		320	460	
	Packed unit	Height	mm		1,615	1,745	
		Width	mm		1,030	1,015	
		Depth	mm		420	575	
Weight	Unit	kg		144	175	180	
	Packed unit	kg		158	191	196	
Packing	Material				Carton		
Packing	Weight	kg		5.6	8.2		
Packing 2	Material				Wood		
	Weight	kg		5.5	8.8		
Packing 3	Material				Plastic		
	Weight	kg		0.3	0.4		
Casing	Colour				Daikin White		
	Material				Painted galvanized steel plate		
Heat exchanger	Type				Cross fin coil		
	Indoor side				Air		
	Outdoor side				Air		
	Air flow rate	Cooling Heating	Rated Rated	m³/h m³/h	8,400 8,400	10,920 10,920	
Fan	Quantity				2		
Fan motor	Quantity				2		
	Type				DC motor		
Compressor	Output W				200		
	Quantity				1		
	Type				Hermetically sealed scroll compressor		
Operation range	Crankcase heater W				33		
	Cooling	Min.	°CDB		-5.0		
		Max.	°CDB		52.0		
	Heating	Min.	°CWB		-20.0		
Max.		°CWB		15.5			
Sound power level	Cooling	Nom.	dBA		73.0 (4)	74.0 (4) 76.0 (4)	
	Heating	Prated,h	dBA		73.0 (4)	74.0 (4) 76.0 (4)	
Sound pressure level	Cooling	Nom.	dBA		55.0 (5) 57.0 (5)		
Refrigerant	Type				R-410A		
	GWP				2,087.5		
	Charge	TCO2Eq		11.5	14.6	16.7	
	Charge	kg		5.5	7.0	8.0	
Refrigerant oil	Type				Synthetic (ether) oil FVC68D		
Piping connections	Liquid	Type			Braze connection		
		OD	mm		10	13	
	Gas	Type			Braze connection		
		OD	mm		19.1	22.2 25.4	
Total piping length	System	Actual	m		300 (6)		
Defrost method					Reversed cycle		
Capacity control	Method				Inverter controlled		
Indication if the heater is equipped with a supplementary heater					no		
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0		
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000		
		Heating	PCK	kW	0.040	0.046	
	Off mode	Cooling	POFF	kW	0.035	0.046	
		Heating	POFF	kW	0.040	0.046	
	Standby mode	Cooling	PSB	kW	0.035	0.046	
		Heating	PSB	kW	0.040	0.046	
	Thermo-stat-off mode	Cooling	PTO	kW	0.015	0.013	
		Heating	PTO	kW	0.055	0.059	
Cooling	Cdc (Degradation cooling)				0.25		
Heating	Cdh (Degradation heating)				0.25		

## 2 Specifications

### 1 - 1 RXYSQ-TY1

Technical Specifications			RXYSQ8TY1	RXYSQ10TY1	RXYSQ12TY1
Safety devices	Item	01	High pressure switch		
		02	Fan driver overload protector		
		03	Inverter overload protector		
		04	PC board fuse		

Standard accessories: Installation manual;Quantity: 1;

Standard accessories: Operation manual;Quantity: 1;

Standard accessories: Connection pipes;Quantity: 1;

Electrical Specifications			RXYSQ8TY1	RXYSQ10TY1	RXYSQ12TY1
Power supply	Name		Y1		
	Phase		3N~		
	Frequency	Hz	50		
	Voltage	V	380-415		
Power supply intake			Both indoor and outdoor unit		
Voltage range	Min.	%	-10		
	Max.	%	10		
Current	Nominal running current (RLA)	Cooling A	9.6 (7)	10.7 (7)	13.4 (7)
	Nominal running current (RLA)	Combina- tion A	-		
Current - 50Hz	Nominal running current (RLA)	Combina- tion B	-		
	Starting current (MSC) - remark		See note 11		
	Zmax	List	No requirements		
	Minimum Ssc value	kVa	910 (8)	564 (8)	615 (8)
	Minimum circuit amps (MCA)	A	18.5 (9)	22.0 (9)	24.0 (9)
	Maximum fuse amps (MFA)	A	25 (10)		32 (10)
	Total overcurrent amps (TOCA)	A	16.5 (11)	25.0 (11)	27.0 (11)
	Full load amps (FLA)	Total A	1.4 (12)		
Power Performance	Power factor	Combina- tion B 35°C ISO - Full load	-		
		46°C ISO - Full load	-		
Wiring connections - 50Hz	For power supply	Quantity	5G		
	For connection with indoor	Quantity	2		
	Remark		F1,F2		

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m |

(3)Actual number of units depends on the indoor unit type (VRV DX indoor, RA DX indoor, etc.) and the connection ratio restriction for the system (being; 50% ≤ CR ≤130%). |

(4)Sound power level is an absolute value that a sound source generates. |

(5)Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings. |

(6)Refer to refrigerant pipe selection or installation manual |

(7)RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB |

(8)In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with Ssc ≥ minimum Ssc value |

(9)MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current. |

(10)MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker). |

(11)TOCA means the total value of each OC set. |

(12)FLA means the nominal running current of the fan |

Cooling: T1: indoor temp. 26,7°CDB, 19,4°CWB, outdoor temp. 35°CDB, AHRI 1230:2010, power input indoor units (duct type) included |

Cooling: T3: indoor temp. 29,0°CDB, 19,0°CWB, outdoor temp. 46°CDB, ISO15042:2011, power input indoor units (duct type) included |

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB, AHRI 1230:2010, power input indoor units (duct type) included |

MSC means the maximum current during start up of the compressor. This unit uses only inverter compressors. Starting current is always ≤ max. running current. |

Maximum allowable voltage range variation between phases is 2%. |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

The automatic ESEER value corresponds with normal VRV IV-S heat pump operation, including the advanced energy saving functionality (variable refrigerant temperature control). |

The standard ESEER value corresponds with normal VRV IV-S heat pump operation, not taking into account the advanced energy saving functionality. |

Sound values are measured in a semi-anechoic room. |

EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current > 16A and ≤ 75A per phase |

Ssc: Short-circuit power |

For detailed contents of standard accessories, see installation/operation manual

# 3 Options

## 3 - 1 Options

### RXYSQ-TY1

#### VRV4-S Heat pump Option list

Nr.	Item	RXYSQ4~6TMV1B	RXYSQ4~6T7V1B RXYSQ4~6T8VB(9)	RXYSQ4~6T7Y1B RXYSQ4~6T8YB(9)	RXYSQ8~12TMY1B	RXYSQ6T7Y1B9 RXYSQ6T8Y1B9	RXYSQ6TMYFK
I.	Refnet header	-	-	-	KHRQ22M64H	-	KHRQ22M64H
					KHRQ22M20T		
II.	Refnet joint	-	-	-	KHRQ22M29T9	-	KHRQ22M29T9
		-	-	-	KHRQ22M64T	-	KHRQ22M64T
1a.	Cool/heat selector (switch)	-	KRC19-26	-	-	KRC19-26	-
1b.	Cool/heat selector (fixing box)	-	KJB111A	-	-	KJB111A	-
1c.	Cool/heat selector (PCB)	-	EBRP2B	-	-	-	-
1d.	Cool/heat selector (cable)	-	-	EKCHSC	-	EKCHSC	-
2.	Drain plug kit	-	EKDK04	-	-	EKDK04	-
3.	VRV configurator				EKPCCAB*		
4.	Demand PCB				DTA104A61/62*		
5.	Branch provider - ·2· rooms		BPMKS967A2		-	-	-
6.	Branch provider - ·3· rooms		BPMKS967A3		-	-	-

#### Notes

1. All options are kits
2. To mount option ·1a·, option ·1b· is required.
3. For ·RXYSQ4~6T7V1B·  
For ·RXYSQ4~6T8VB·  
To operate the cool/heat selector function, options ·1a· and ·1c· are both required.
4. For ·RXYSQ4~6T7Y1B·  
For ·RXYSQ4~6T8YB·  
To operate the cool/heat selector function, options ·1a· and ·1d· are both required.

3D097778E

## 4 Combination table

### 4 - 1 Combination Table

#### RXYSQ-TY1

VRV4-S

Heat pump

Indoor unit combination restrictions

Indoor unit combination pattern	·VRV* DX· indoor unit	·RA DX· indoor unit	Hydrobox unit	Air handling unit (AHU) <sup>(1)</sup>
·VRV* DX· indoor unit	O	X	X	O
·RA DX· indoor unit	X	O	X	X
Hydrobox unit	X	X	X	X
Air handling unit (AHU) <sup>(1)</sup>	O	X	X	O <sub>1</sub>

O: Allowed

X: Not allowed

#### Notes

##### 1. O<sub>1</sub>

- Combination of ·AHU· only + control box ·EKEQFA· (not combined with ·VRV DX· indoor units)

→ ·X·-control is possible [·EKEQV+EKEQFA\*· boxes]. No Variable Refrigerant Temperature control possible.

→ ·Y·-control is possible [·EKEQV+EKEQFA\*· boxes]. No Variable Refrigerant Temperature control possible.

→ ·W·-control is possible [·EKEQV+EKEQFA\*· boxes]. No Variable Refrigerant Temperature control possible.

- Combination of ·AHU· only + control box ·EKEQMA· (not combined with ·VRV DX· indoor units)

→ Z-control is possible (the allowed number of [·EKEQV + EKEQMA· boxes] is determined by the connection ratio (·90-110%·) and the capacity of the outdoor unit).

##### 2. Combination of ·AHU· and ·VRV DX· indoor units

→ Z-control is possible (·EKEQMA\*· boxes are allowed, but with a limited connection ratio).

##### 3. (1) The following units are considered AHUs:

→ ·EKEQV + EKEQ(MA/FA) + AHU· coil

→ ·Biddle· air curtain

→ ·FXMQ\_MF· units

#### Information

- ·VKM· units are considered regular ·VRV DX· indoor units.

3D097983A

#### RXYSQ-TY1

VRV4-S

Heat pump

Indoor unit combination restrictions

Combination table	RXYSQ4~6TMV1B	RXYSQ4~6T7V1B	RXYSQ4~6T7Y1B	RXYSQ8~12TMY1B
·VRV* DX· indoor unit	O	O	O	O
·RA DX· indoor unit	O	O	O	O
Hydrobox unit	X	X	X	X
Air handling unit (AHU) <sup>(2)</sup>	O	O	O	O

O: Allowed

X: Not allowed

#### Notes

(2) The following units are considered AHUs:

→ ·EKEQV + EKEQ(MA/FA) + AHU· coil

→ ·Biddle· air curtain

→ ·FXMQ\_MF· units

3D097983A

# 4 Combination table

## 4 - 1 Combination Table

### RXYSQ-TY1

4

#### Unit combination restrictions: ·VRV4· outdoor units (all models) + ·15·-class indoor units

Units in scope: ·FXZQ15A· and ·FXAQ15A·.

- In case the system contains these indoor units and the total connection ratio (·CR·) ≤ ·100·%: no special restrictions. Follow the restrictions that apply to regular ·VRV DX· indoor units.
- In case the system contains these indoor units and the total connection ratio (·CR·) > ·100·%: special restrictions apply.
  - When the connection ratio (·CR1·) of the sum of all ·FXZQ15A· and/or ·FXAQ15A· units in the system ≤ ·70·%, and ALL other ·VRV DX· indoor units have an individual capacity class > ·50·: no special restrictions.
  - When the connection ratio (·CR1·) of the sum of all ·FXZQ15A· and/or ·FXAQ15A· units in the system ≤ ·70·%, and NOT ALL other ·VRV DX· indoor units have an individual capacity class > ·50·: the restrictions below apply.
    - ° 100% < CR ≤ 105% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·70·%.
    - ° 105% < CR ≤ 110% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·60·%.
    - ° 110% < CR ≤ 115% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·40·%.
    - ° 115% < CR ≤ 120% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·25·%.
    - ° 120% < CR ≤ 125% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·10·%.
    - ° 125% < CR ≤ 130% -> ·FXZQ15A· and ·FXAQ15A· cannot be used.

#### Remark

Only the ·15·-class indoor units explicitly mentioned on this page are in scope. Other indoor units follow the rules that apply to regular ·VRV DX· indoor units.

3D104665A

### RXYSQ-TY1

### RXYSQ-TY9

### RXYSQ-TV9

### RXYSQ-TV1

VRV4-S  
Heat pump  
·RA/SA DX· indoor unit  
Compatibility list

Configuration		Indoor unit type	
·RA· indoor unit	Wall-mounted	<i>Emura</i>	FTXJ20A
			FTXJ25A
			FTXJ35A
			FTXJ42A
			FTXJ50A
		<i>FTXM</i>	FTXM20N
			FTXM20R
			FTXM25N
			FTXM25R
			FTXM35N
			FTXM35R
	Floor-standing	<i>Flex</i>	FLXS25B
			FLXS35B
			FLXS50B
			FLXS60B
		<i>FVXM</i>	FVXM25F
			FVXM35F
			FVXM50F
			CVXM20A
			FVXM25A
			FVXM35A
·SA· indoor unit	Cassette	Fully Flat 2x2	FFA25A
			FFA35A
			FFA50A
			FFA60A
			FFA71A
		Roundflow 3x3	FCAG35A
			FCAG50A
			FCAG60A
			FCAG71A
			FCAG71A
	Ceiling-suspended		FHA35A
			FHA50A
			FHA60A
			FHA71A
			FHA71A
	Duct		FBA35A
			FBA50A
			FBA60A
			FBA71A
			FBA71A
	Floor-standing	FNA	FNA25A
			FNA35A
			FNA50A
			FNA60A
			FNA60A
	Duct	<i>FDXM</i>	FDXM25F
			FDXM35F
			FDXM50F
			FDXM60F
			FDXM60F

#### Remark

- The limitations on the use of ·RA/SA· indoor units with the ·VRV4-S· Heat Pump are subject to the rules set out in drawings ·3D097983· and ·3D097984·.

3D097777J


## 5 Capacity tables

### 5 - 1 Capacity Table Legend

In order to fulfill more your requirements on quick access of data in the format you require, we have developed a tool to consult capacity tables.

Below you can find the link to the capacity table database and an overview of all the tools we have to help you select the correct product:

- **Capacity table database:** lets you find back and export quickly the capacity information you are looking for based upon unit model, refrigerant temperature and connection ratio.
- You can access the capacity table viewer here:  
[https://my.daikin.eu/content/denv/en\\_US/home/applications/software-finder/capacity-table-viewer.html](https://my.daikin.eu/content/denv/en_US/home/applications/software-finder/capacity-table-viewer.html)



- An overview of **all software tools** that we offer can be found here:  
[https://my.daikin.eu/denv/en\\_US/home/applications/software-finder.html](https://my.daikin.eu/denv/en_US/home/applications/software-finder.html)



# 5 Capacity tables

## 5 - 2 Capacity Correction Factor

### RXYSQ-TY1

#### MINI VRV

#### Integrated heating capacity coefficient

The heating capacity tables do not take into account the capacity reduction in case of frost accumulation or defrost operation.  
The capacity values that take these factors into account, or in other words, the integrated heating capacity values, can be calculated as follows:


Formula

A = Integrated heating capacity  
B = Capacity characteristics value  
C = Integrated correction factor for frost accumulation (see table)

$$A = B \cdot C$$

Inlet air temperature of heat exchanger

[°CDB/°CWB]	-7/-7.6	-5/-5.6	-3/-3.7	0/-0.7	3/2.2	5/4.1	7/6
RXYSQ4TMV1B							
RXYSQ5TMV1B							
RXYSQ6TMV1B							
RXYSQ4T7V1B							
RXYSQ5T7V1B							
RXYSQ6T7V1B							
RXYSQ4T7Y1B							
RXYSQ5T7Y1B							
RXYSQ6T7Y1B							
RXYSQ6T7Y1B9							
RXYSQ4T8VB							
RXYSQ5T8VB	0,88	0,86	0,80	0,75	0,76	0,82	1,00
RXYSQ6T8VB							
RXYSQ4T8YB							
RXYSQ5T8YB							
RXYSQ6T8YB							
RXYSQ6T8Y1B9							
RXYSQ4T8VB9							
RXYSQ5T8VB9							
RXYSQ6T8VB9							
RXYSQ4T8YB9							
RXYSQ5T8YB9							
RXYSQ6T8YB9							
RXYSQ8TMY1B	0,95	0,93	0,88	0,84	0,85	0,90	1,00
RXYSQ10TMY1B	0,95	0,93	0,87	0,79	0,80	0,88	1,00
RXYSQ6TMYFK	0,95	0,93	0,87	0,79	0,80	0,88	1,00
RXYSQ12TMY1B	0,95	0,92	0,87	0,75	0,76	0,85	1,00

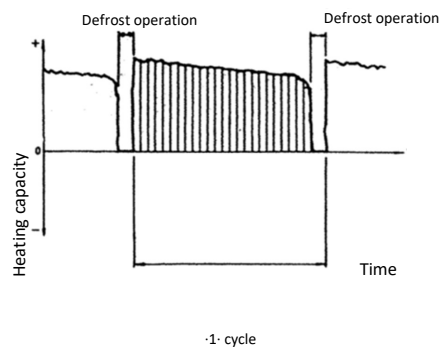

#### Notes


- (1) The figure shows the integrated heating capacity for a single cycle (from one defrost operation to the next).
- (2) When there is an accumulation of snow against the outdoor unit heat exchanger, there will always be a temporary reduction in capacity depending on the outdoor temperature (°C DB), relative humidity (RH) and the amount of frosting which occurs.

3D09659D

# 5 Capacity tables

## 5 - 2 Capacity Correction Factor

### RXYSQ8TY1

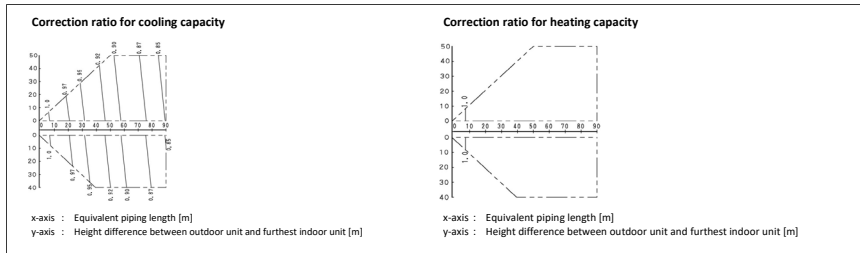

#### Notes

- These figures illustrate the capacity correction factor due to the piping length for a standard indoor unit system at maximum load (with the thermostat set to maximum), under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, as shown in the above figures.
- With this outdoor unit, the following control is used:- in case of cooling: constant evaporating pressure control- in case of heating: constant condensing pressure control

#### 3. Method of calculating the capacity of the outdoor units.

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is less.

##### Indoor connection ratio ≤ 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at 100\% connection ratio.} \times \text{Correction ratio of piping to furthest indoor unit}$$

##### Indoor connection ratio > 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio.} \times \text{Correction ratio of piping to furthest indoor unit}$$

- When the overall equivalent piping length is 90 m or more, the diameter of the main gas pipes (outdoor unit - branch sections) must be increased. For the new diameters, see below.

Model	Standard liquid side Ø	Increased liquid side Ø	Standard gas side Ø	Increased gas side Ø
RXYSQ8TY1B	9,5	12,7	19,1	22,2

#### 5. Overall equivalent length


$$\text{Overall equivalent length} = \text{Equivalent length of the main pipe} \times \text{Correction factor} + \text{Equivalent length of the branch pipes}$$

Choose the correction factor from the following table.

When calculating the cooling capacity: gas pipe size

When calculating the heating capacity: liquid pipe size

	Standard size	Size increase
Cooling (gas pipe)	1,0	0,5
Heating (liquid pipe)	1,0	0,3



##### Overall equivalent length


- Cooling mode = 80 m x 0,5 + 40 m = 80 m
- Heating mode = 80 m x 0,3 + 40 m = 64 m

##### Capacity correction ratio (height difference = 0)

- Cooling mode = 0,87
- Heating mode = 1,00

3D094660D

### RXYSQ10TY1

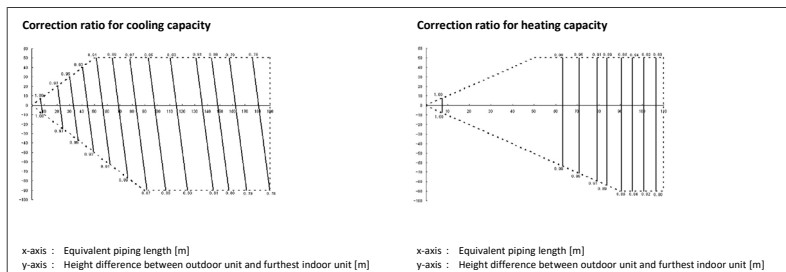

#### Notes

- These figures illustrate the capacity correction factor due to the piping length for a standard indoor unit system at maximum load (with the thermostat set to maximum), under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, as shown in the above figures.
- With this outdoor unit, the following control is used:- in case of cooling: constant evaporating pressure control- in case of heating: constant condensing pressure control

#### 3. Method of calculating the capacity of the outdoor units.

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is less.

##### Indoor connection ratio ≤ 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at 100\% connection ratio.} \times \text{Correction ratio of piping to furthest indoor unit}$$

##### Indoor connection ratio > 100%.

$$\text{Maximum capacity of outdoor units} = \text{Capacity of outdoor units from capacity table at installed connection ratio.} \times \text{Correction ratio of piping to furthest indoor unit}$$

- When the overall equivalent piping length is 90 m or more, the diameter of the main gas pipes (outdoor unit - branch sections) must be increased. For the new diameters, see below.

Model	Standard liquid side Ø	Increased liquid side Ø	Standard gas side Ø	Increased gas side Ø
RXYSQ10TY1B	9,5	12,7	22,2	25,4 *

\* If not available on-site, do not increase the piping diameter.

If not increased, do not apply a correction factor to the equivalent piping length (see note 5).

#### 5. Overall equivalent length


$$\text{Overall equivalent length} = \text{Equivalent length of the main pipe} \times \text{Correction factor} + \text{Equivalent length of the branch pipes}$$

Choose the correction factor from the following table.

When calculating the cooling capacity: gas pipe size

When calculating the heating capacity: liquid pipe size

	Standard size	Size increase
Cooling (gas pipe)	1,0	0,5
Heating (liquid pipe)	1,0	0,2



##### Overall equivalent length

- Cooling mode = 80 m x 0,5 + 40 m = 80 m
- Heating mode = 80 m x 0,2 + 40 m = 56 m

##### Capacity correction ratio (height difference = 0)

- Cooling mode = 0,87
- Heating mode = 0,99


3D094660D

# 5 Capacity tables

## 5 - 2 Capacity Correction Factor


### RXYSQ12TY1

Correction ratio for cooling capacity



x-axis : Equivalent piping length [m]  
y-axis : Height difference between outdoor unit and furthest indoor unit [m]

Correction ratio for heating capacity



x-axis : Equivalent piping length [m]  
y-axis : Height difference between outdoor unit and furthest indoor unit [m]

#### Notes

- These figures illustrate the capacity correction factor due to the piping length for a standard indoor unit system at maximum load (with the thermostat set to maximum), under standard conditions. Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, as shown in the above figures.
- With this outdoor unit, the following control is used:- in case of cooling: constant evaporating pressure control- in case of heating: constant condensing pressure control

#### 3. Method of calculating the capacity of the outdoor units.

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is less.

##### Indoor connection ratio ≤ 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at 100% connection ratio. x Correction ratio of piping to furthest indoor unit

##### Indoor connection ratio > 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at installed connection ratio. x Correction ratio of piping to furthest indoor unit

- When the overall equivalent piping length is 90 m or more, the diameter of the main gas pipes (outdoor unit - branch sections) must be increased. For the new diameters, see below.

Model	Standard liquid side Ø	Increased liquid side Ø	Standard gas side Ø	Increased gas side Ø
RXYSQ8TMY1B	12,7	15,9	25,4	28,6

#### 5. Overall equivalent length

Overall equivalent length = Equivalent length of the main pipe x Correction factor + Equivalent length of the branch pipes


Choose the correction factor from the following table.

When calculating the cooling capacity: gas pipe size

When calculating the heating capacity: liquid pipe size

	Standard size	Size increase
Cooling (gas pipe)	1,0	0,5
Heating (liquid pipe)	1,0	0,3

#### Example



#### Overall equivalent length

- Cooling mode = 80 m x 0,5 + 40 m = 80 m
- Heating mode = 80 m x 0,2 + 40 m = 64 m

#### Capacity correction ratio (height difference = 0)


- Cooling mode = 0,92
- Heating mode = 1,00

3D094660D

# 6 Dimensional drawings


## 6 - 1 Dimensional Drawings

### RXYSQ8TY1

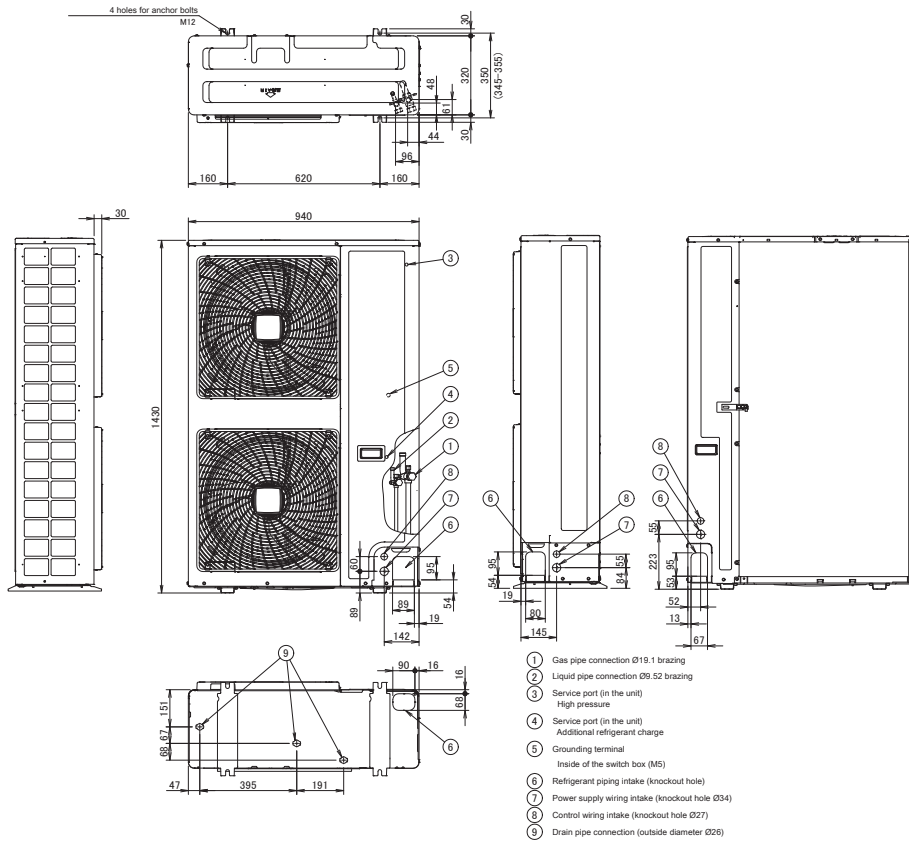

3D098108

### RXYSQ10-12TY1

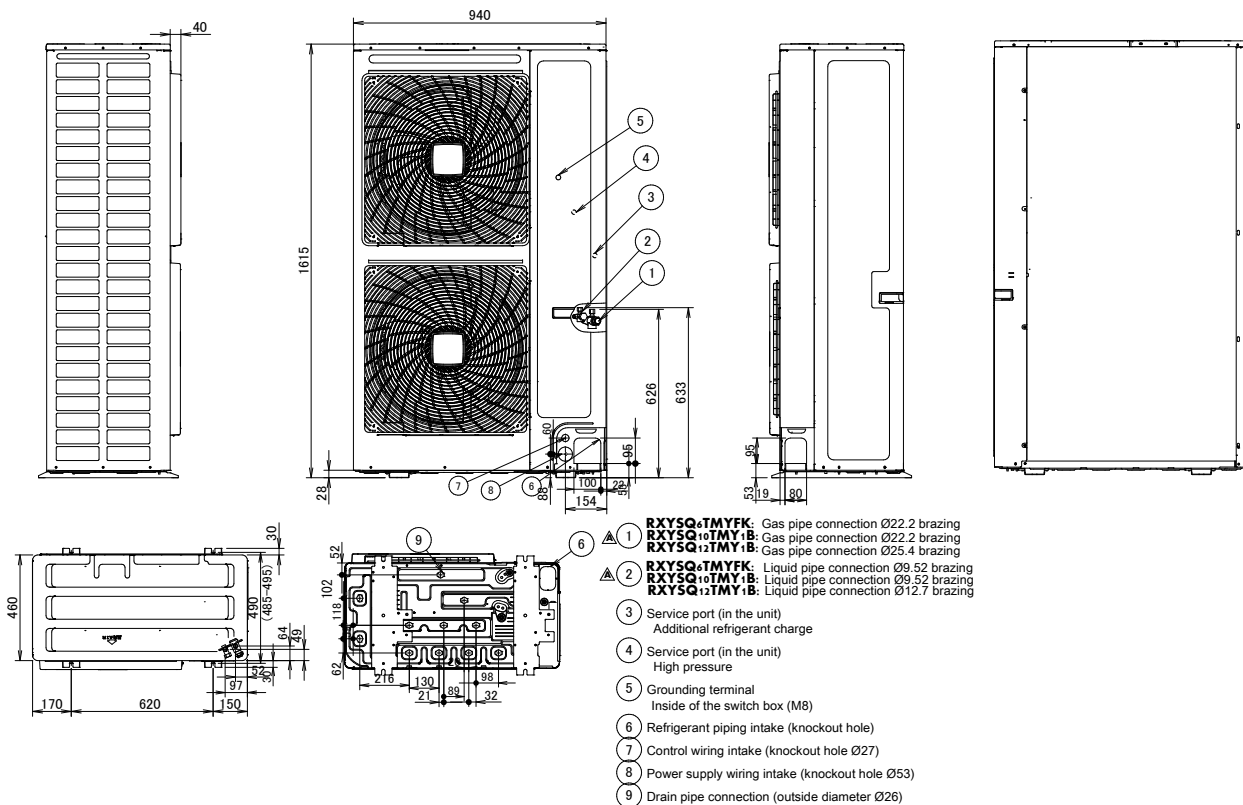


3D098109A

# 7 Centre of gravity

7 - 1 Centre of Gravity

## RXYSQ8TY1

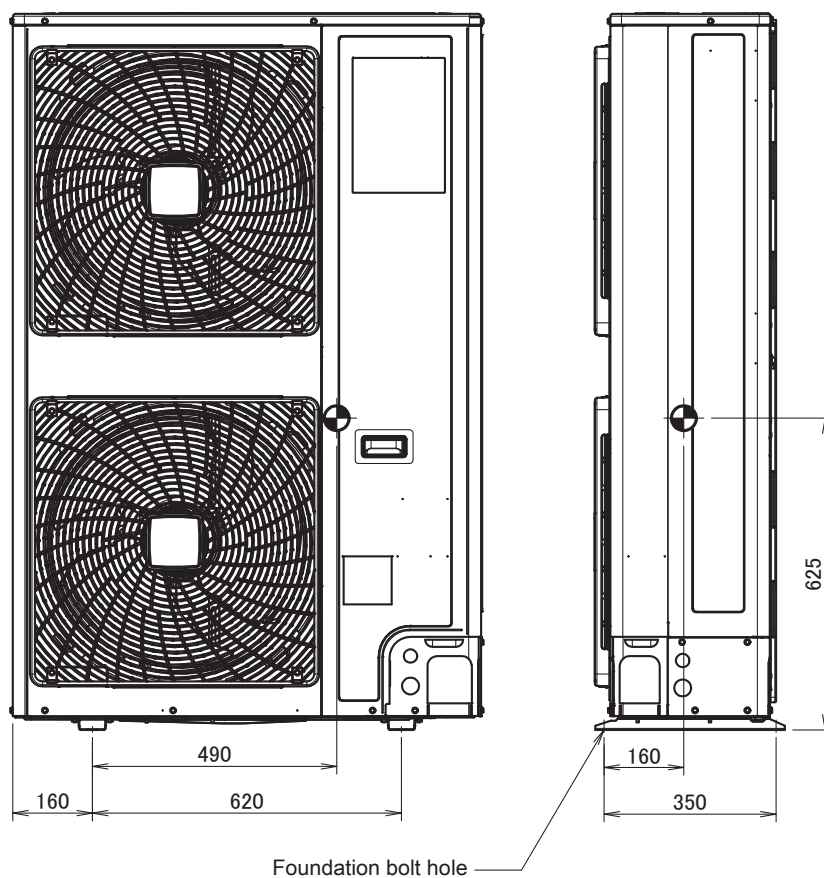


4D098084

## 7 Centre of gravity

7 - 1 Centre of Gravity

RXYSQ10-12TY1

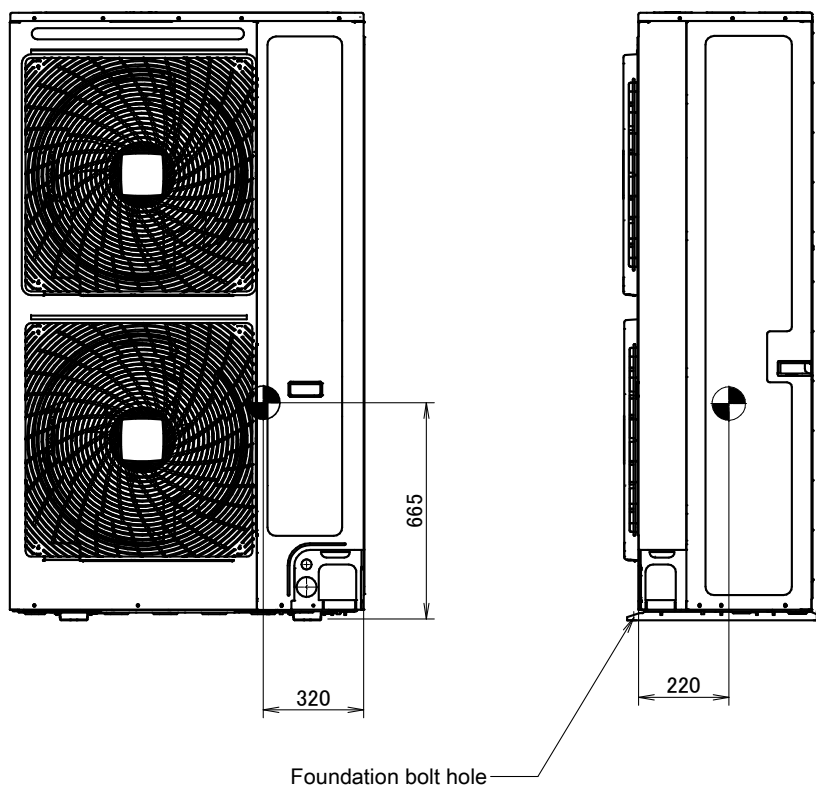


4D098085

# 8 Piping diagrams

## 8 - 1 Piping Diagrams


8

### RXYSQ8TY1

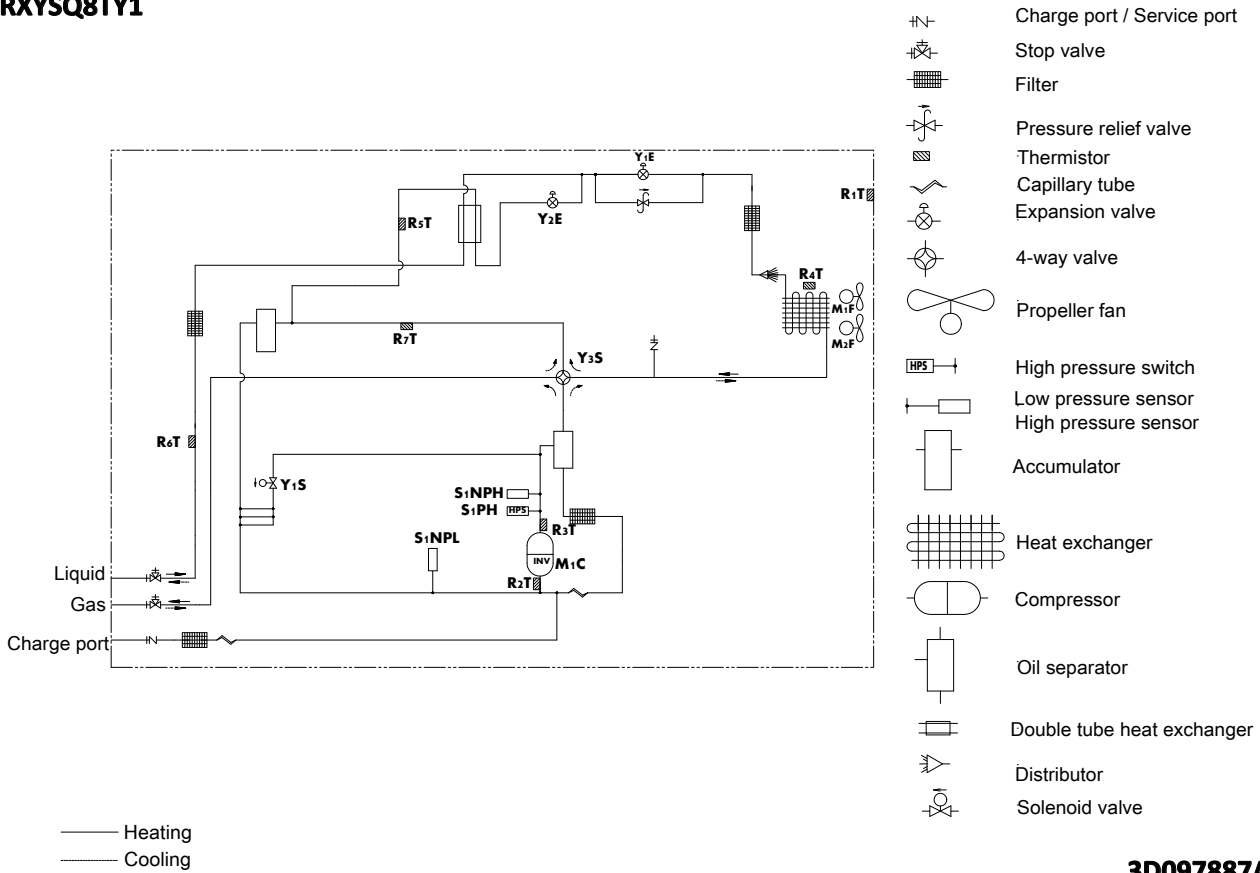

3D097887A

### RXYSQ10-12TY1

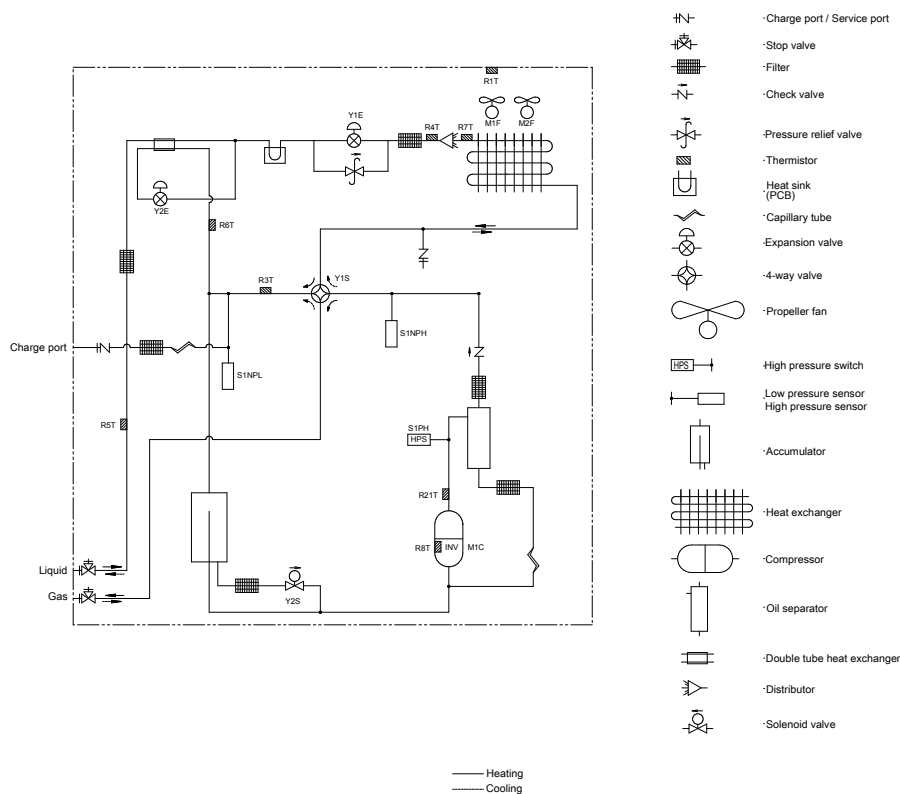


3D097888

# 9 Wiring diagrams

## 9 - 1 Wiring Diagrams - Three Phase

### RXYSQ8TY1

- A1P : Printed circuit board (Main)
- A2P : Printed circuit board (Noise filter)
- A3P : Printed circuit board (INV)
- A4P : Printed circuit board (Fan 1)
- A5P : Printed circuit board (Fan 2)
- B51-B55 : Push button switch (Mode, set, return, test, reset)
- C32, C67 : Capacitor
- DS1 : Dip switch
- E1HC : Crankcase heater
- F101U : Fuse (SA, DC650V) (A4P) (A5P)
- F1U, F2U : Fuse (T 3.15A / 250V) (A1P)
- F400U : Fuse (T 6.3A / 250V) (A2P)
- H1P-H8P : Pilot lamp (service monitor-orange) (H2P) Prepare, Test ----- Flickering  
Malfunction Detection - Light up
- K1P : Pilotlamp (service monitor - green)
- K2M : Magnetic relay (A3P)
- K3R : Magnetic contactor (M1C) (A3P)
- K3R : Magnetic relay (A2P)
- K3R : Magnetic relay (Y15)
- K5R : Magnetic relay (Y35)
- K7R : Magnetic relay (E1HC)
- L1R : Reactor
- M1C : Motor (compressor)
- M1F, M2F : Motor (fan)
- PS : Switching power supply (A1P) (A3P)
- Q1RP : Reverse phase protector
- R24 : Resistor (current sensor) (A4P) (A5P)
- R2, R3 : Resistor
- R95 : Resistor (current limiting)
- R1T : Thermistor (Air)
- R2T : Thermistor (Suction)
- R3T : Thermistor (M1C Discharge)
- R4T : Thermistor (heat exchanger deicer)
- R5T : Thermistor (heat exchanger outlet)
- R6T : Thermistor (Liquid pipe)
- R7T : Thermistor (Accumulator)
- S1NPH : Pressure sensor (High)
- S1NPL : Pressure sensor (low)
- S1PH : High pressure switch
- V1CP : Safety devices input
- V1R : IGBT Module (A4P) (A5P)
- V1R : Diode bridge IGBT Module (A3P)
- X1A, X2A : Connector (M1F)
- X3A, X4A : Connector (M2F)
- X1M : Terminal strip (Power supply)
- X1M : Terminal strip (Control) (A1P)
- Y1E : Electronic expansion valve (Main)
- Y2E : Electronic expansion valve (Subcool)
- Y1S : Solenoid valve (hot gas)
- Y3S : Solenoid valve (4 way valve)
- Z1C-8C : Noise filter (ferrite core)
- Z1F : Noise filter (with surge absorber)

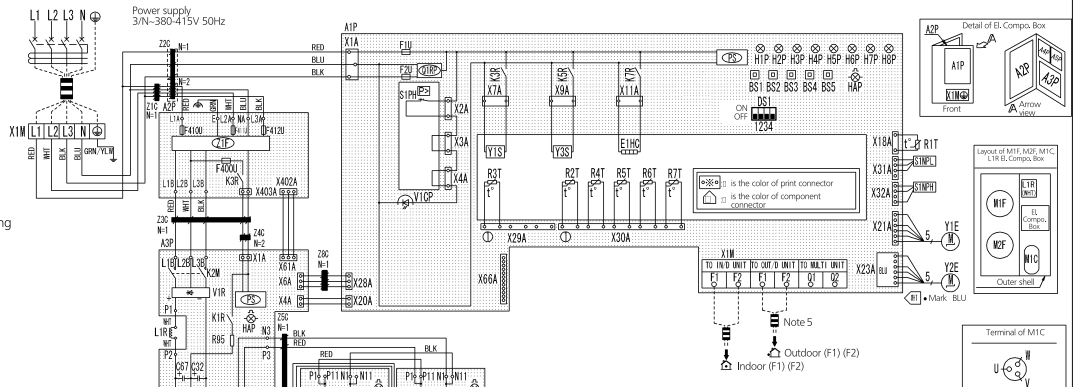


#### Notes:

1. This wiring diagram only applies to the outdoor unit.
2. Field wiring
3. Terminal, Connector, Movable connector, Fixed connector, Terminal strip, Protective earth (screw), Noiseless earth
4. Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1 - F2, outdoor-outdoor transmission F1 - F2.
5. Refer to 'installation manual' (on back front plate). How to use B51-B55 and DS1 switch.
6. When operating, do not short circuit for protection device. (S1PH)
7. Colours: BLK: Black, RED: Red, BLU: Blue, WHT: White, GRN: Green, BRN: Brown, YLW: Yellow

2D094434D

### RXYSQ10-12TY1

- A1P : Printed circuit board (Main)
- A2P : Printed circuit board (Noise filter)
- A3P : Printed circuit board (INV)
- A4P : Printed circuit board (Fan 1)
- A5P : Printed circuit board (Fan 2)
- B51-B53 : Push button switch (Mode, Set, Return)
- C47, C48 : Capacitor (A3P)
- DS1, DS2 : Dip switch (A1P)
- E1HC : Crankcase heater
- F1U, F2U : Fuse (T 3.15A / 250V) (A1P)
- F101U : Fuse (A4P) (A5P)
- F411U-F412U : Fuse (A2P)
- F601U : Fuse (A3P)
- HAP : Pilotlamp (service monitor - green)
- K1M : Magnetic contactor (A3P)
- K1R : Magnetic relay (A3P)
- K3R : Magnetic relay (A3P)
- K4R : Magnetic relay (Y2S) (A1P)
- K7R : Magnetic relay (E1HC) (A1P)
- K11R : Magnetic relay (Y1S) (A1P)
- L1R : Reactor
- M1C : Motor (compressor)
- M1F, M2F : Motor (fan)
- PS : Switching power supply (A1P) (A3P)
- Q1LD : Leakage detection circuit (A1P)
- Q1RP : Phase reversal detect circuit (A1P)
- R1T : Thermistor (Air) (A1P)
- R21T : Thermistor (M1C Discharge)
- R3T : Thermistor (Accumulator)
- R4T : Thermistor (Heat exchanger liq. Pipe)
- R5T : Thermistor (Subcool liq. Pipe)
- R6T : Thermistor (Heat exchanger gas pipe)
- R7T : Thermistor (heat exchanger deicer)
- R8T : Thermistor (M1C body)
- R1 : Resistor (current limiting) (A3P)
- R24 : Resistor (current sensor) (A4P)
- R313 : Resistor (current sensor) (A3P)
- R865, R867 : Resistor (A3P)
- S1NPH : Pressure sensor (High)
- S1NPL : Pressure sensor (low)
- S1PH : High pressure switch
- SEG1-SEG3 : 7-segment display (A1P)
- T1A : current sensor
- V1R : Power module (A3P) (A4P) (A5P)
- V2R : Power module (A3P)
- X1A, X2A : Connector (M1F)
- X3A, X4A : Connector (M2F)
- X1M : Terminal block (Power supply)
- X1M : Terminal block (Control) (A1P)
- Y1E : Electronic expansion valve (Main)
- Y2E : Electronic expansion valve (injection)
- Y1S : Solenoid valve (Main)
- Y2S : Solenoid valve (Accumulator oil return)
- Z1C-Z4C : Noise filter (ferrite core)
- Z1F : Noise filter (with surge absorber) (A2P)

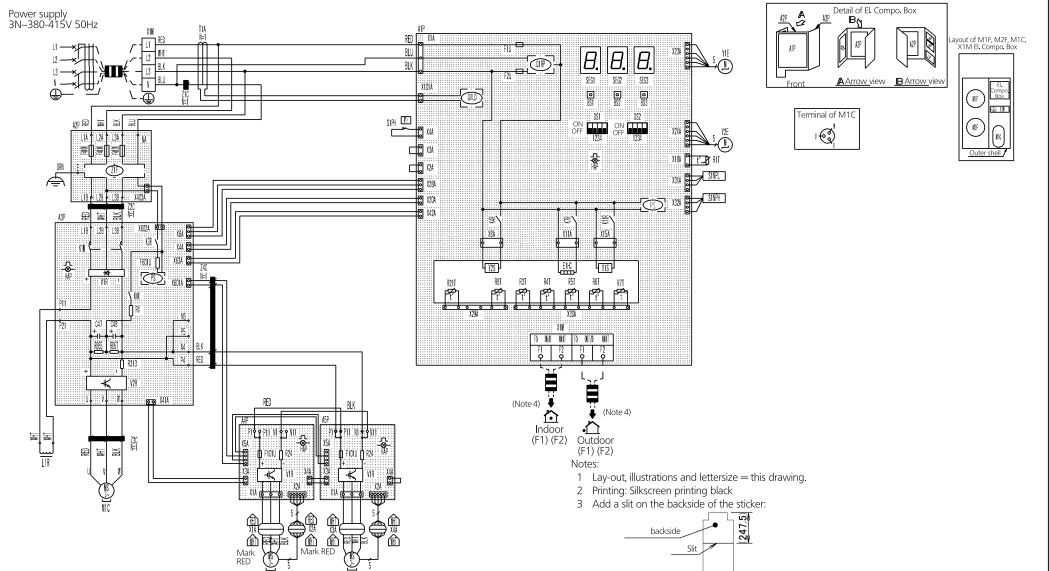

#### Notes:

1. This wiring diagram only applies to the outdoor unit.
2. Field wiring
3. Refer to the installation manual, for connection wiring to indoor-outdoor transmission F1 - F2, outdoor-outdoor transmission F1 - F2.
4. How to use B51-B53 switch, refer to the installation manual.
5. When operating, do not short circuit for protection device. (S1PH)
6. Colours: BLK: Black, RED: Red, BLU: Blue, WHT: White, GRN: Green

3D094435D


# 10 External connection diagrams

## 10 - 1 External Connection Diagrams

RXYSQ-12TY1

External connection diagram


VRV indoor unit

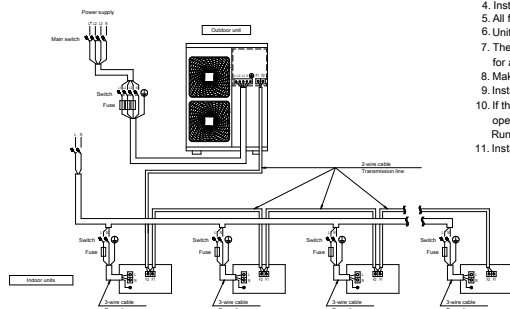


### Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only.
3. For more details, refer to the wiring diagram of the unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main switch to (if necessary) immediately interrupt all the system's power sources.
10. If there exists the possibility of reversed phase, loose phase or momentary blackout, or if the power goes on and off while the product is operating, attach a reversed phase protection circuit locally.
11. Running the product in reversed phase may break the compressor and other parts.
12. Install an earth leakage circuit breaker.

BP box + RA/SA indoor unit

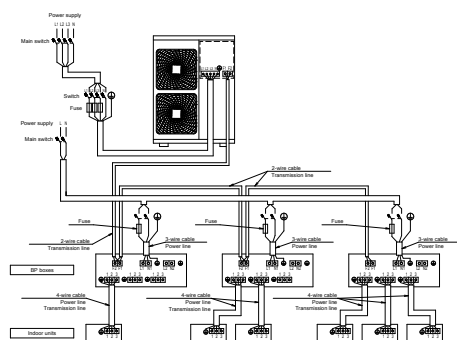

Power source is supplied to each BP box individually.

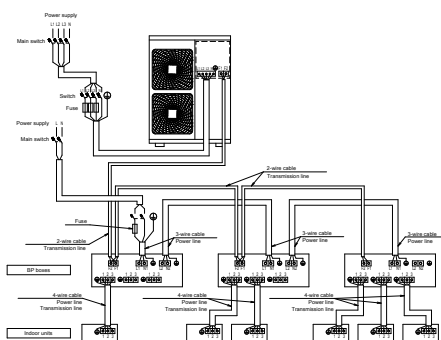


Power source is connected in series between the units.

10094669

# 11 Sound data

## 11 - 1 Sound Power Spectrum


RXYSQ8TY1

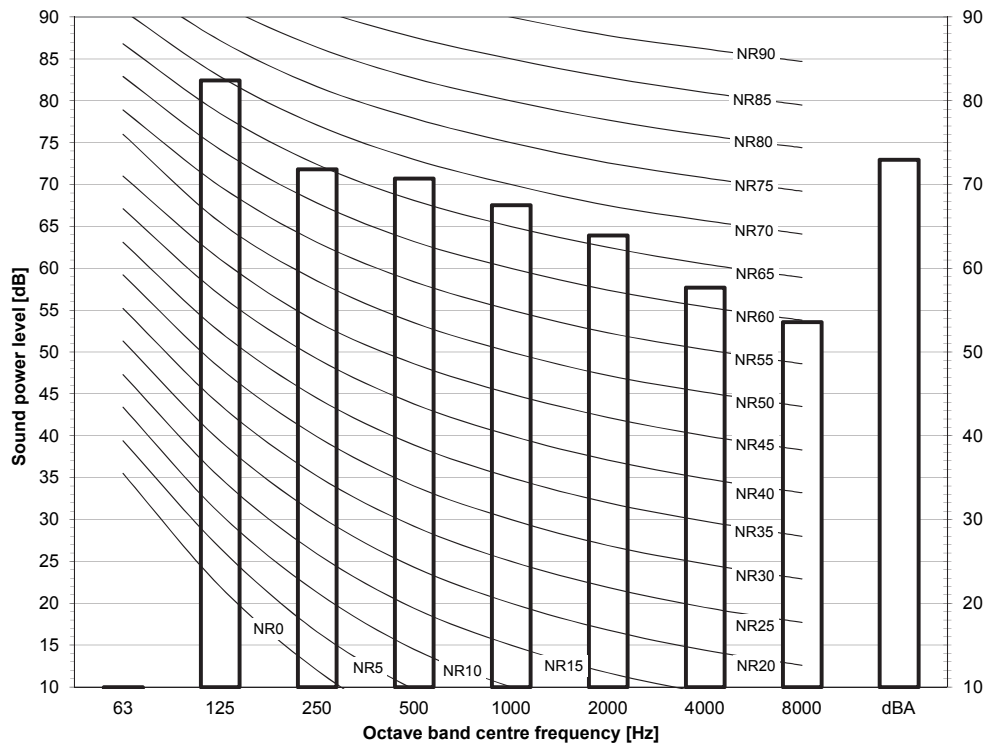

Notes  
 - dBA = A-weighted sound power level (A scale according to IEC).  
 - Reference acoustic intensity  $0\text{ dB} = 10\text{E-}6\mu\text{W/m}^2$   
 - Measured according to ISO 3744

3D098240

RXYSQ10TY1

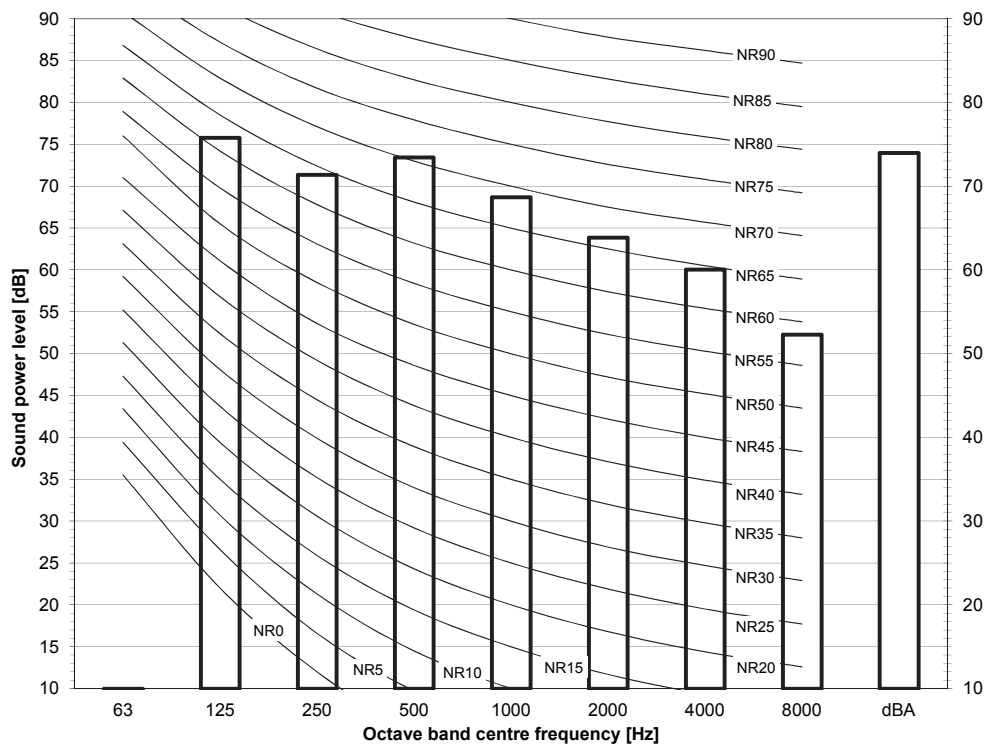

Notes  
 - dBA = A-weighted sound power level (A scale according to IEC).  
 - Reference acoustic intensity  $0\text{ dB} = 10\text{E-}6\mu\text{W/m}^2$   
 - Measured according to ISO 3744


3D098241

# 11 Sound data

## 11 - 1 Sound Power Spectrum

11

RXYSQ12TY1

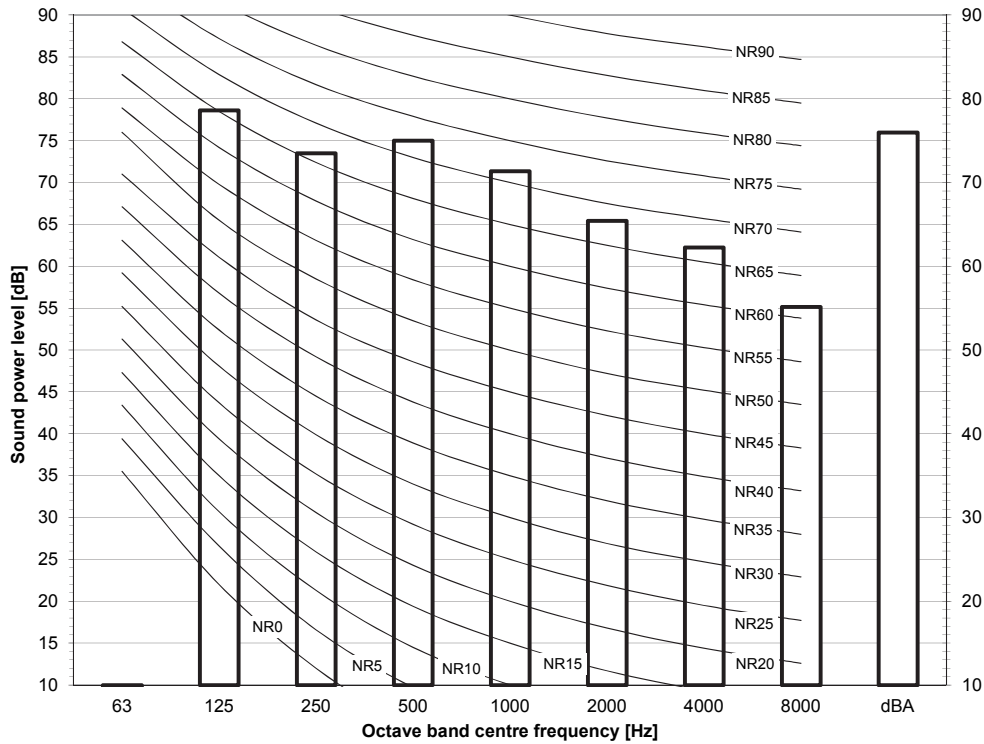

**Notes**


- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity  $0\text{ dB} = 10^{-6}\text{ W/m}^2$
- Measured according to ISO 3744

3D098242


# 11 Sound data

## 11 - 2 Sound Pressure Spectrum

RXYSQ8TY1

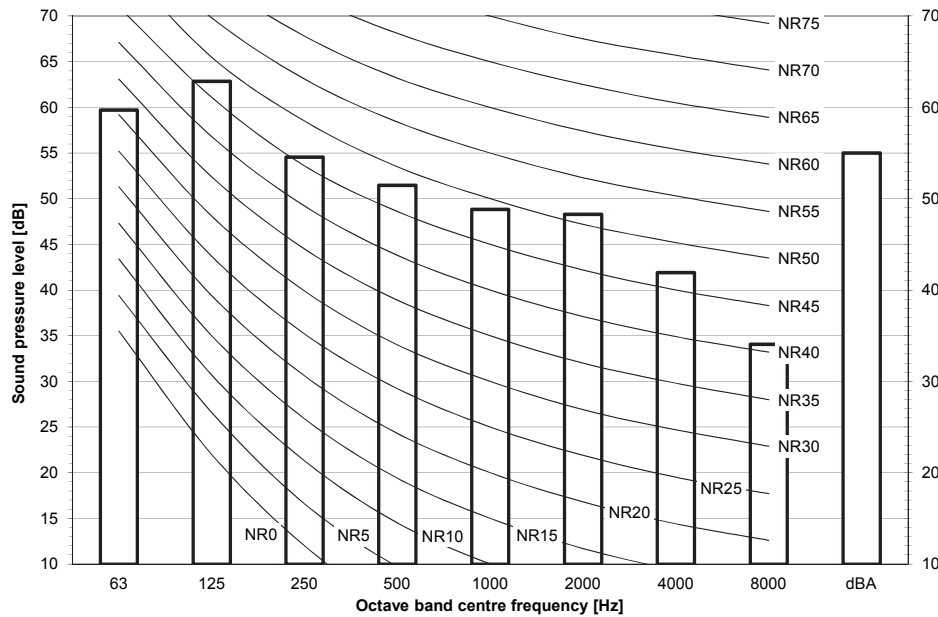


Notes  
 - Data is valid at free field condition.  
 - Data is valid at nominal operation condition.  
 - dBA = A-weighted sound pressure level (A scale according to IEC).  
 - Reference acoustic pressure 0 dB = 20  $\mu$ Pa

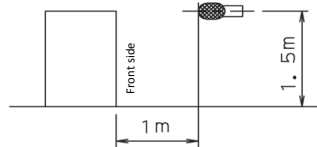


3D098245

RXYSQ10TY1

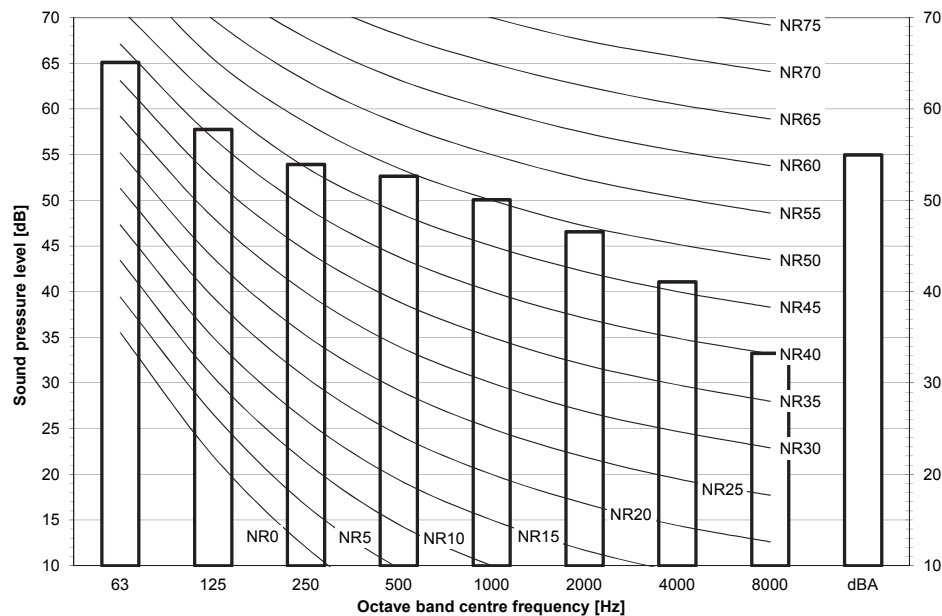

Notes  
 - Data is valid at free field condition.  
 - Data is valid at nominal operation condition.  
 - dBA = A-weighted sound pressure level (A scale according to IEC).  
 - Reference acoustic pressure 0 dB = 20  $\mu$ Pa

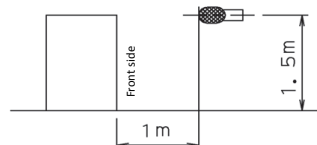


3D098246

# 11 Sound data

## 11 - 2 Sound Pressure Spectrum


11

RXYSQ12TY1

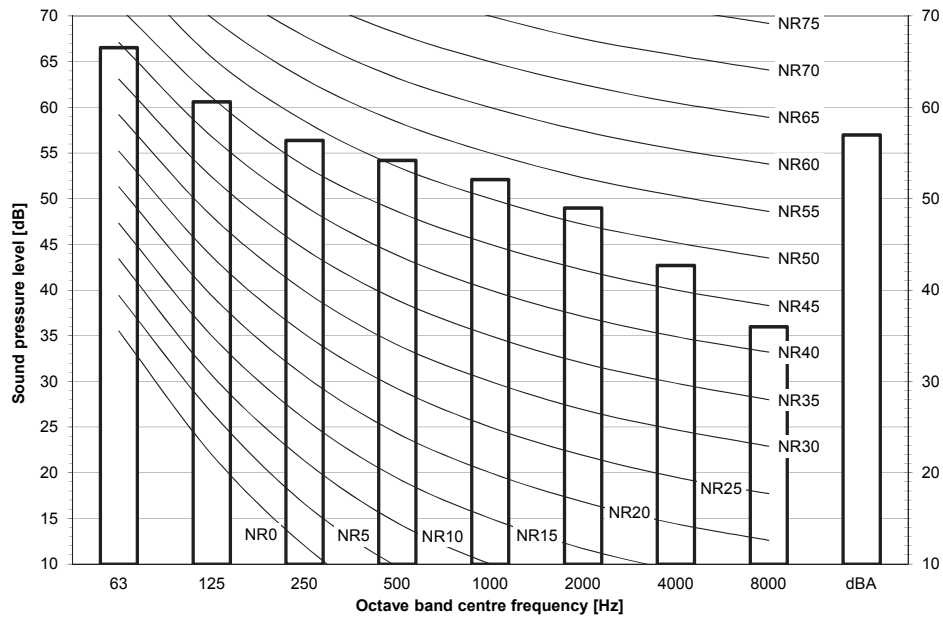

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20  $\mu$ Pa

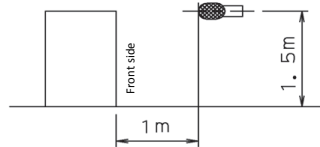

3D098247

# 12 Installation

## 12 - 1 Installation Method

### RXYSQ8TY1


Required installation space

The unit of the values is mm.


#### 1. Where there is an obstacle on the suction side:

##### (a) No obstacle above


- (1) Stand-alone installation
- Obstacle on the suction side only



- Obstacle on both sides




- (2) Series installation (2 or more) (note)
- Obstacle on both sides




##### (b) Obstacle above, too


- (1) Stand-alone installation
- Obstacle on the suction side, too



- Obstacle on the suction side and both sides




- (2) Series installation (2 or more) (note)
- Obstacle on the suction side and both sides




#### 2. Where there is an obstacle on the discharge side:

##### (a) No obstacle above

- (1) Stand-alone installation




- (2) Series installation (2 or more) (note)




##### (b) Obstacle above, too

- (1) Stand-alone installation



- (2) Series installation (2 or more) (note)




#### 3. Where there are obstacles on both suction and discharge sides:

##### Pattern 1


Where the obstacles on the discharge side is higher than the unit:  
(There is no height limit for obstructions on the intake side.)

##### (a) No obstacle above

- (1) Stand-alone installation

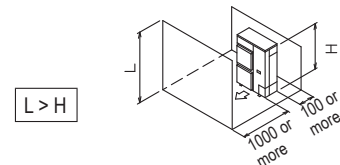

- (2) Series installation (2 or more) (note)

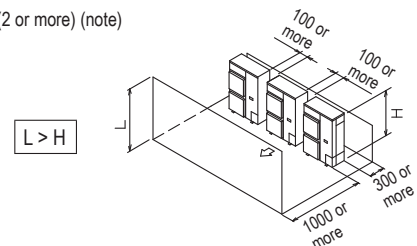

3D068442T



# 12 Installation

## 12 - 1 Installation Method

### RXYSQ10-12TY1

#### Required installation space


The unit of the values is mm.

#### 1. Where there is an obstacle on the suction side:


##### (a) No obstacle above

###### (1) Stand-alone installation

- Obstacle on the suction side only




- Obstacle on both sides



###### (2) Series installation (2 or more) (note)


- Obstacle on both sides




##### (b) Obstacle above, too

###### (1) Stand-alone installation

- Obstacle on the suction side, too




- Obstacle on the suction side and both sides



###### (2) Series installation (2 or more) (note)


- Obstacle on the suction side and both sides




#### 2. Where there is an obstacle on the discharge side:

##### (a) No obstacle above

###### (1) Stand-alone installation




###### (2) Series installation (2 or more) (note)




##### (b) Obstacle above, too

###### (1) Stand-alone installation



###### (2) Series installation (2 or more) (note)




#### 3. Where there are obstacles on both suction and discharge sides:

##### Pattern 1


Where the obstacles on the discharge side is higher than the unit:  
(There is no height limit for obstructions on the intake side.)

##### (a) No obstacle above

###### (1) Stand-alone installation

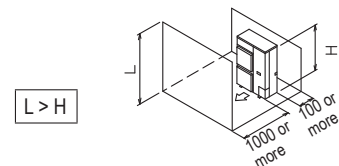

###### (2) Series installation (2 or more) (note)

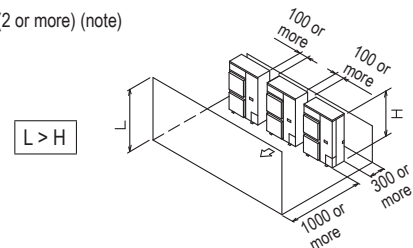

3D083122P



# 12 Installation

## 12 - 2 Refrigerant Pipe Selection

RXYSQ-TY1  
RXYSQ-TY9  
RXYSQ-TV9  
RXYSQ-TV1

VRV4-S  
Heat pump  
Piping restrictions ·1/3·

For the reference drawing, see page ·2/3·.		Maximum piping length		Maximum height difference		Total piping length
		Longest pipe	After first branch	Indoor-to-outdoor	Indoor-to-indoor	
		(A+[B,D+E,H])	(B,D+E,H)	(H1)	(H2)	
		Actual / (Equivalent)	Actual	Outdoor above indoor / (indoor above outdoor)		
Standard ·VRV DX· indoor units only	RXYSQ4~6TMV1B	70/(90)m	40m	30/(30)m	15m	300m
	RXYSQ4~6T7(V/Y)1B	120/(150)m	40m	50/(40)m	15m	300m
	RXYSQ4~6T8(V/Y)B					
	RXYSQ8TMY1B	100/(130)m	40m	50/(40)m	15m	300m
	RXYSQ10~12TMY1B	120/(150)m	40m	50/(40)m	15m	300m
·RA· connection	RXYSQ4~6TMV1B	35/(45)m	40m	30/(30)m	15m	140m
	RXYSQ4~6T7(V/Y)1B	65/(85)m	40m	30/(30)m	15m	140m
	RXYSQ4~6T8(V/Y)B					
	RXYSQ8TMY1B	70/(90)m	40m	30/(30)m	15m	140m
	RXYSQ10~12TMY1B	70/(90)m	40m	30/(30)m	15m	140m
Air handling unit (·AHU·) connection	Pair	50/(55)m <sup>(1)</sup>	-	40/(40)m	-	-
	Multi (2)	50/(55)m <sup>(1)</sup>	40m	40/(40)m	15m	300m
	Mix (3)	50/(55)m <sup>(1)</sup>	40m	40/(40)m	15m	300m


### Notes

- The allowable minimum length is ·5· m.
- Multiple air handling units (·AHU·)(·EKEXV· + ·EKEQ· kits).
- Mix of air handling units (·AHU·) and ·VRV DX· indoor units.

3D097984C

RXYSQ-TY1  
RXYSQ-TY9  
RXYSQ-TV9  
RXYSQ-TV1

VRV4-S  
Heat pump  
Piping restrictions ·2/3·

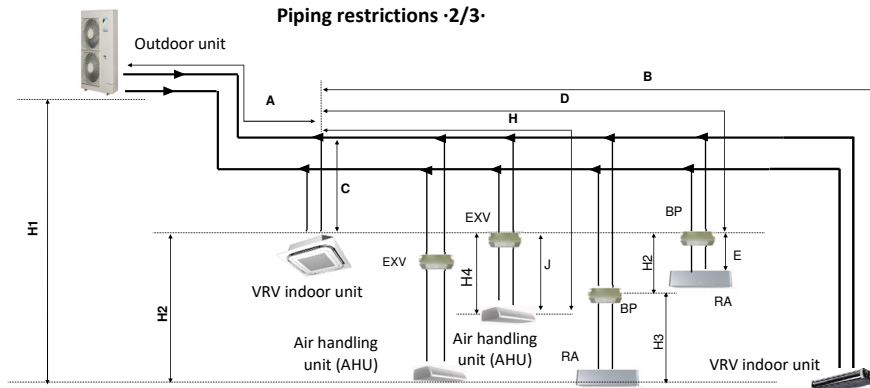

### Notes

- Schematic indication  
Illustrations may differ from the actual appearance of the unit.
- This is only to illustrate piping length limitations.  
Refer to combination table ·3D097983· for details about the allowed combinations.

		Allowed piping length		Maximum height difference	
		·BP· to ·RA· (E)	·EXV· to ·AHU· (J)	·BP· to ·RA· (H3)	·EXV· to ·AHU· (H4)
·RA· connection		2~15m	-	5m	-
Air handling unit (AHU)	Pair	-	≤5m	-	5m
	Multi <sup>(1)</sup>	-	≤5m	-	5m
Connection	Mix <sup>(2)</sup>	-	≤5m	-	5m

### Notes

- Multiple air handling units (·AHU·)(·EKEXV· + ·EKEQ· kits).
- Mix of air handling units (·AHU·) and ·VRV DX· indoor units.

3D097984C

# 12 Installation

## 12 - 2 Refrigerant Pipe Selection

12

RXYSQ-TY1

RXYSQ-TY9

RXYSQ-TV9

RXYSQ-TV1

VRV4-S

Heat pump

Piping restrictions :3/3·

System pattern Allowed connection ratio (CR) Other combinations are not allowed.	Total		Allowed capacity		
	Capacity	Maximum allowed amount of connectable indoor units (·VRV, RA, AHU·) Excluding ·BP· units and including ·EXV· kits.	VRV DX indoor unit	·RA DX· indoor unit	Air handling unit (AHU)
·VRV DX· indoor units only	50~130%	Maximum ·64·	50~130%	-	-
·RA DX· indoor units only	80~130%	Maximum ·32· <sup>(1)</sup>	-	80~130%	-
·VRV DX· indoor unit + ·AHU· Mix	50~110% <sup>(3)</sup>	Maximum ·64· <sup>(2)</sup>	50~110%	-	0~110%
·AHU· only Pair + multi <sup>(4)</sup>	90~110% <sup>(3)</sup>	Maximum ·64· <sup>(2)</sup>	-	-	90~110%

### Notes

- There is no restriction on the number of connectable ·BP· boxes.
- EKEXV· kits are also considered indoor units.
- Restrictions regarding the air handling unit capacity
- Pair AHU = system with 1 air handling unit connected to one outdoor unit  
Multi AHU = system with multiple air handling units connected to one outdoor unit

### About ventilation applications

- FXMQ\_MF· units are considered air handling units, following air handling unit limitations.
  - Maximum connection ratio when combined with ·VRV DX· indoor units: ·CR ≤ 30·%.
  - Maximum connection ratio when only air handling units are connected: ·CR ≤ 100·%.
  - Minimum connection ratio when only ·FXMQ\_MF· units are connected: ·CR ≥ 50·%
For information on the operation range, refer to the documentation of the ·FXMQ\_MF· unit.
- Biddle· air curtains are considered air handling units, following air handling unit limitations:
For information on the operation range, refer to the documentation of the ·Biddle· unit.
- EKEXV + EKEQ· units combined with an air handling unit are considered air handling units, following air handling unit limitations.
For information on the operation range, refer to the documentation of the ·EKEXV-EKEQ· unit.
- VKM· units are considered to be regular ·VRV DX· indoor units.
For information on the operation range, refer to the documentation of the ·VKM· unit.
- Because there is no refrigerant connection with the outdoor unit (only communication F1/F2), ·VAM· units do not have connection limitations.  
However, since there is communication via F1/F2, count them as regular indoor unit when calculating the maximum allowed number of connectable indoor units.

3D097984C

# 13 Operation range


## 13 - 1 Operation Range

### RXYSQ8-12TY1


#### Notes

- These figures assume the following operation conditions  
Indoor and outdoor units  
Equivalent piping length: 5m  
Level difference: 0m
- Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
- To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
- Operation range is valid in case direct expansion indoor units are used.  
If other indoor units are used, refer to the documentation of the respective indoor units.
- Unit operation is possible, but no guaranteed capacity
- If the unit is selected to operate at ambient temperatures  $< -5^{\circ}\text{C}$  for 5 days or more, with relative humidity levels  $> 95\%$ , it is recommended to apply a Daikin range specifically designed for such application.  
For more information, contact your dealer.

#### Cooling

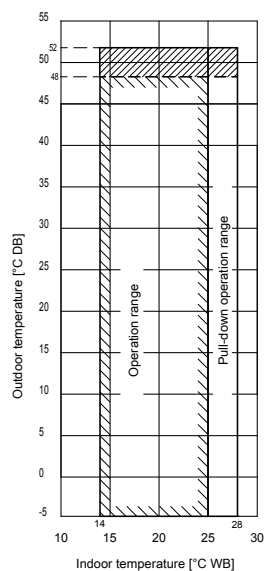

#### Heating

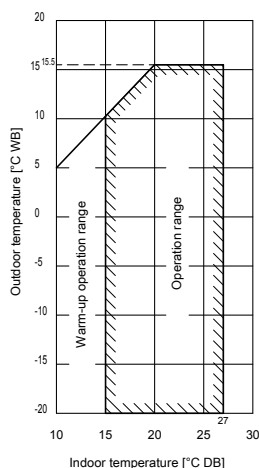

3D094665A

# 14 Appropriate Indoors

## 14 - 1 Appropriate Indoors

RXYSQ-TY1

RXYSQ-TY9

RXYSQ-TV9

RXYSQ-TV1

Recommended indoor units for ·RXYSQ\*T\* AND RXYSQ\*T\*· outdoor units

· HP	4	5	6	8	10	12
	3xFXSQ25 1xFXSQ32	4xFXSQ32	2xFXSQ32 2xFXSQ40	4xFXMQ50	4xFXMQ63	6xFXMQ50

For details about the allowed combinations, see the engineering databook.

Appropriate indoor units for ·RXYSQ\*T\* AND RXYSQ\*T\*· outdoor units

### Covered by ·ENER LOT21·

FXFQ20-25-32-40-50-63-80-100-125  
 FXZQ15-20-25-32-40-50  
 FXCQ20-25-32-40-50-63-80-125  
 FXKQ25-32-40-63  
 FXDQ15-20-25-32-40-50-63  
 FXSQ15-20-25-32-40-50-63-80-100-125-140  
 FXMQ50-63-80-100-125-200-250  
 FXAQ15-20-25-32-40-50-63  
 FXHQ32-63-100  
 FXUQ71-100  
 FXNQ20-25-32-40-50-63  
 FXLQ20-25-32-40-50-63


### Outside the scope of ·ENER LOT21·

EKEXV50-63-80-100-125-140-200-250 + EKEQM / EKEQF  
 VKM50-80-100  
 CYVS100-150-200-250  
 CYVM100-150-200-250  
 CYVL100-150-200-250  
 EKVDX32-50-80-100 + VAMJ8

### Covered by ·ENER LOT10·

FTXJ25-35-50  
 FTXA20-25-35-42-50  
 FTXM20N-25N-35N-42N-50N-60N-71N  
 FTXM20R-25R-35R-42R-50R-60R-71R  
 CTXM15N  
 CTXM15R  
 FLXS25-35-50-60  
 FVXM25F-35F-50F  
 FVXG25-35-50  
 FNA25-35-50-60  
 FDXM25-30-50-60  
 FFA25-35-50-60  
 FCAG35-50-60-71  
 FHA35-50-60-71  
 FBA35-50-60-71  
 CVXM20A  
 FVXM25A-35A-50A

3D113977F



09/2022



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.