




R410A/R32

Commercial Air Conditioners

Engineering Data

Arc Duct VRF IDU

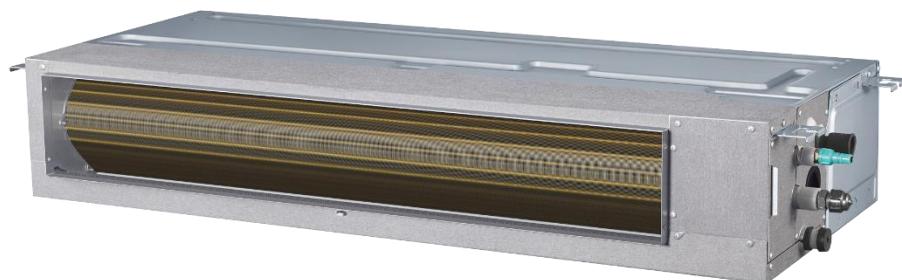

MIH15T3HN18 MIH56T3HN18

MIH22T3HN18 MIH71T3HN18

MIH28T3HN18 MIH80T3HN18

MIH36T3HN18 MIH90T3HN18

MIH45T3HN18 MIH112T3HN18

Arc Duct

1 Specifications	4
2 Dimensions	7
3 Unit Placement	9
4 Piping Diagram.....	10
5 Wiring Diagram	11
6 Capacity Tables.....	12
7 Electrical Characteristics.....	13
8 Sound Levels	14
9 Fan Performance	16

1 Specifications

Table 1.1: MIH15(22,28)T3HN18 specifications

Model			MIH15T3HN18	MIH22T3HN18	MIH28T3HN18
Power supply			1-phase, 220-240V, 50/60Hz		
Cooling ¹	Capacity	kW	1.5	2.2	2.8
		kBtu/h	5.1	7.5	9.6
	Power input	W	21	22	28
Heating ²	Capacity	kW	1.8	2.5	3.2
		kBtu/h	6.1	8.5	10.9
	Power input	W	21	22	28
Fan motor type			DC		
Indoor coil	Number of rows ³		2&3	2&3	2&3
	Tube pitch ³	mm	14&18		
	Fin spacing and type	mm	1.33 Hydrophilic aluminum		
	Tube OD and type	mm	Φ5 Inner-groove		
	Dimensions (LxHxW)	mm	380×170×95		
	Number of circuits		4	4	4
Air flow rate ⁴		m ³ /h	340/335/329/320/307 /298/290	370/347/339/322/314 /306/295	460/431/413/380/351 /323/300
External static pressure ⁵		Pa	10 (10-50)		
Sound pressure level ⁶		dB(A)	27/26/25.5/24.5/23.5 /22.5/22	28/27.5/26.5/25.5/24.5 /23.5/22	30/29.5/28.5/27.5/26 /24.5/22
Sound power level		dB(A)	43.5/43/42.5/42/41.5/41 /40	46/45/44/43/42/41/40	50.5/49/47/45.5/43.5 /42/40
Unit	Net dimensions ⁷ (W×H×D)	mm	653×199×470		
	Packed dimensions (W×H×D)	mm	715×275×525		
	Net/Gross weight	kg	11.5/13.5		
Refrigerant type			R410A/R32		
Throttle type			Electronic expansion valve		
Design pressure (H/L)		MPa	4.4/1.5		
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/Φ12.7		
	Drain pipe	mm	OD Φ25		

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Arc Duct adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
4. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
5. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
6. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.5m below the unit in an anechoic chamber.
7. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.
8. All specifications are measured at standard external static pressure.
9. G1 air filter is standard for Arc Duct.

Table 1.2: MIH36(45,56,71)T3HN18 specifications

Model			MIH36T3HN18	MIH45T3HN18	MIH56T3HN18	MIH71T3HN18		
Power supply			1-phase, 220-240V, 50/60Hz					
Cooling ¹	Capacity	kW	3.6	4.5	5.6	7.1		
		kBtu/h	12.3	15.4	19.1	24.2		
	Power input	W	31	43	58	65		
Heating ²	Capacity	kW	4	5	6.3	8		
		kBtu/h	13.7	17.1	21.5	27.3		
	Power input	W	31	43	58	65		
Fan motor type			DC					
Indoor coil	Number of rows ³		2&3	2&3	2&3	2&3		
	Tube pitch ³	mm	14&18					
	Fin spacing and type	mm	1.33 Hydrophilic aluminum					
	Tube OD and type	mm	Φ5 Inner-groove					
	Dimensions (L×H×W)	mm	530×170×95	730×170×95		930×170×95		
Number of circuits			4	6	6	8		
Air flow rate ⁴		m ³ /h	605/557/508/453 /414/365/320	800/770/701/629 /557/506/435	900/800/761/682 /603/549/470	1145/1033/957/ 860/763/671/580		
External static pressure ⁵		Pa	10 (10-50)					
Sound pressure level ⁶		dB(A)	30/29.5/28.5/27.5 26.5/25.5/25	33/32.5/32/30.5/ 29/27.5/26	36/34.5/33.5/32.5 /31/29/27	37/35/34/32.5/31 /30/29		
Sound power level		dB(A)	50.5/49.5/48/47 /45.5/44.5/43	52/50.5/49/47.5 /46/44.5/43	56/54/52/50/48 /46/44	57/55.5/54/52/ 50.5/49/47		
Unit	Net dimensions ⁷ (W×H×D)	mm	803×199×470		1003×199×470			
	Packed dimensions (W×H×D)	mm	865×275×525		1065×275×525			
	Net/Gross weight	kg	13.0/15.5		16.5/19.5			
Refrigerant type			R410A/R32					
Throttle type			Electronic expansion valve					
Design pressure (H/L)		MPa	4.4/1.5					
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/Φ12.7			Φ9.52/Φ15.9		
	Drain pipe	mm	OD Φ25					

Notes:

- Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 5m with zero level difference.
- Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
- Arc Duct adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
- Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
- Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
- Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.5m below the unit in an anechoic chamber.
- Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.
- All specifications are measured at standard external static pressure.
- G1 air filter is standard for Arc Duct.

Table 1.3: MIH80(90,112)T3HN18 specifications

Model			MIH80T3HN18	MIH90T3HN18	MIH112T3HN18			
Power supply			1-phase, 220-240V, 50/60Hz					
Cooling ¹	Capacity	kW	8	9	11.2			
		kBtu/h	27.3	30.7	38.2			
	Power input	W	108	108	128			
Heating ²	Capacity	kW	9	10	12.5			
		kBtu/h	30.7	34.1	42.7			
	Power input	W	108	108	128			
Fan motor type			DC					
Indoor coil	Number of rows ³		2&3	2&3	2&3			
	Tube pitch ³	mm	14&18					
	Fin spacing and type	mm	1.33 Hydrophilic aluminum					
	Tube OD and type	mm	Φ5 Inner-groove					
	Dimensions (L×H×W)	mm	1405×170×95					
	Number of circuits		12					
Air flow rate ⁴ (20Pa)		m ³ /h	1400/1327/1249/1175 /1095/1026/960	1400/1327/1249/1175 /1095/1026/960	1620/1522/1433/1343 /1254/1170/1080			
External static pressure ⁵		Pa	20(10-80)					
Sound pressure level ⁶ (20Pa)		dB(A)	36.5/35.5/34/33/32/31.5 /30.5	36.5/35.5/34/33/32/31.5 /30.5	39.5/38/36.5/35/34/32.5 /31.5			
Sound power level(20Pa)		dB(A)	57/56/54.5/53.5/52/51 /49.5	57/56/54.5/53.5/52/51 /49.5	60.5/59/57.5/55.5/54 /52.5/50.5			
Unit	Net dimensions ⁷ (W×H×D)		1703×199×470					
	Packed dimensions (W×H×D)		1755×255×525					
	Net/Gross weight		28/32.5					
Refrigerant type			R410A/R32					
Throttle type			Electronic expansion valve					
Design pressure (H/L)		MPa	4.4/1.5					
Pipe connections	Liquid/Gas pipe	mm	Φ9.52/Φ15.9					
	Drain pipe	mm	OD Φ25					

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Arc Duct adopts a brand-new special-shaped heat exchanger with different number of rows and different Tube pitch at different positions.
4. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
5. Stable operation external static pressure range. (Note: setting external static pressure outside the unit's optimal static pressure range may lead to higher noise levels and lower airflow rate. For the optimal external static pressure range refer to the unit's installation manual.)
6. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured 1.5m below the unit in an anechoic chamber.
7. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.
8. All specifications are measured at standard external static pressure.
9. G1 air filter is standard for Arc Duct.

2 Dimensions

2.1 Unit Dimensions

Figure 2.1: Appearance and size of air outlet and fresh air outlet (unit: mm)

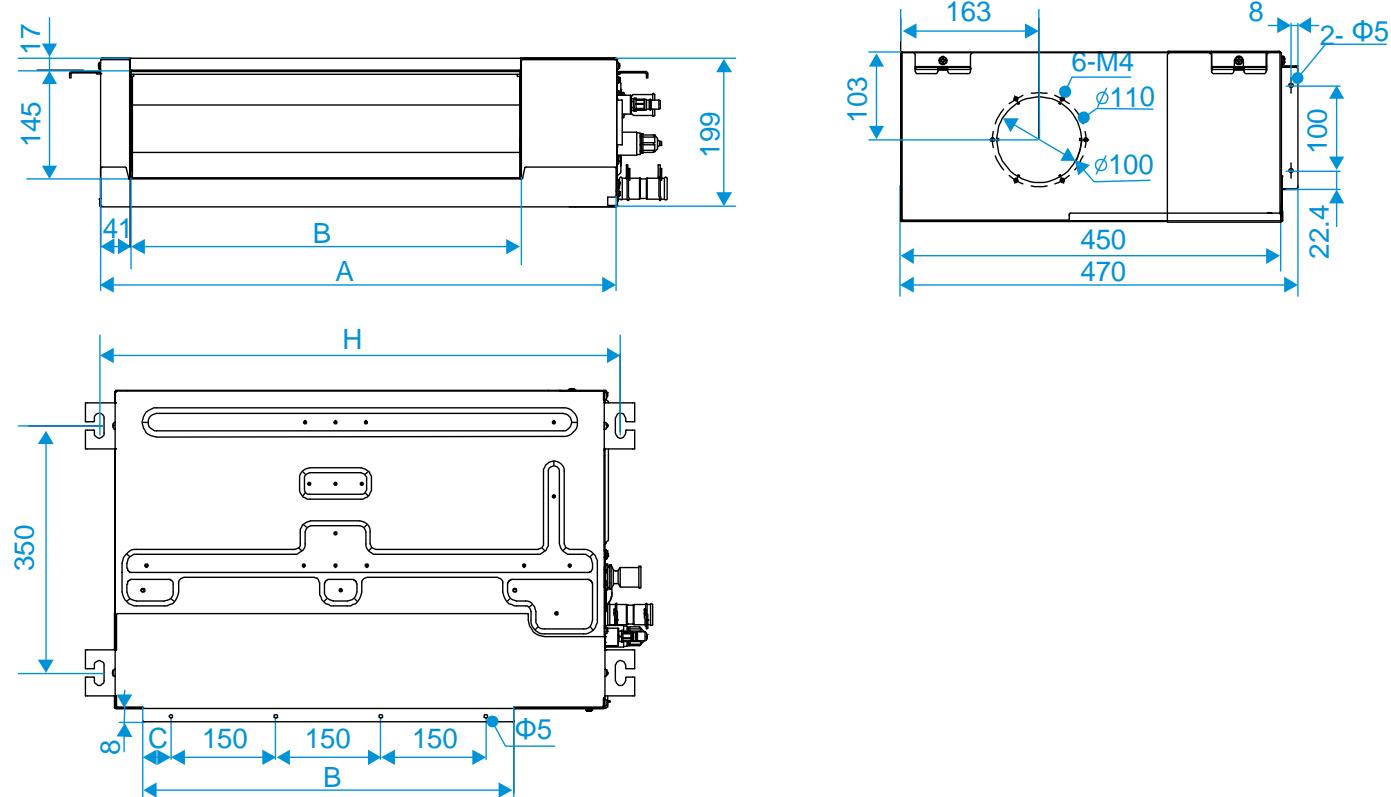


Figure 2.2: Size of return air inlet (rear air return mode): (unit: mm)


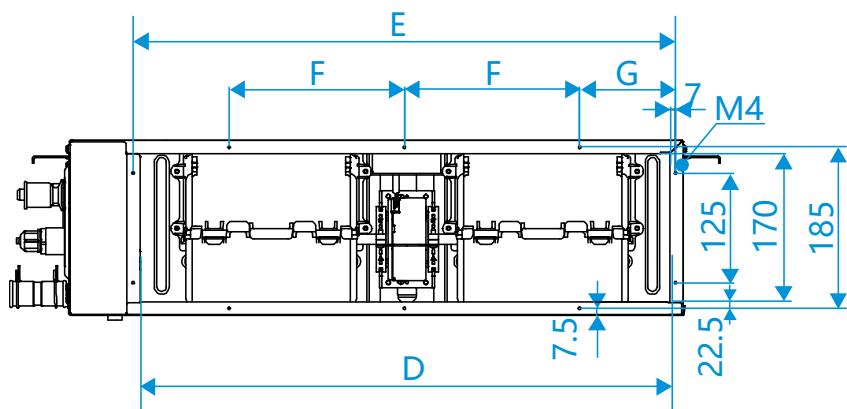


Table 2.1: Letter-Size Correspondence Table: (unit: mm)

Model	A	B	C	D	E	F	G	H	I	J
15~28	550	380	40	455	469	250	109.5	595		
36	700	530	40	605	619	200	109.5	745	7/16-20 UNF	3/4-16 UNF
45~56	900	730	65	805	819	200	109.5	945		
71	1100	930	15	1005	1019	200	109.5	1145	5/8-18 UNF	7/8-14 UNF
80~112	1600	1400	25	1505	1519	200	159.5	1645		


Figure 2.3: Size of return air inlet (lower air return mode) and distance between lifting lugs:(unit: mm)

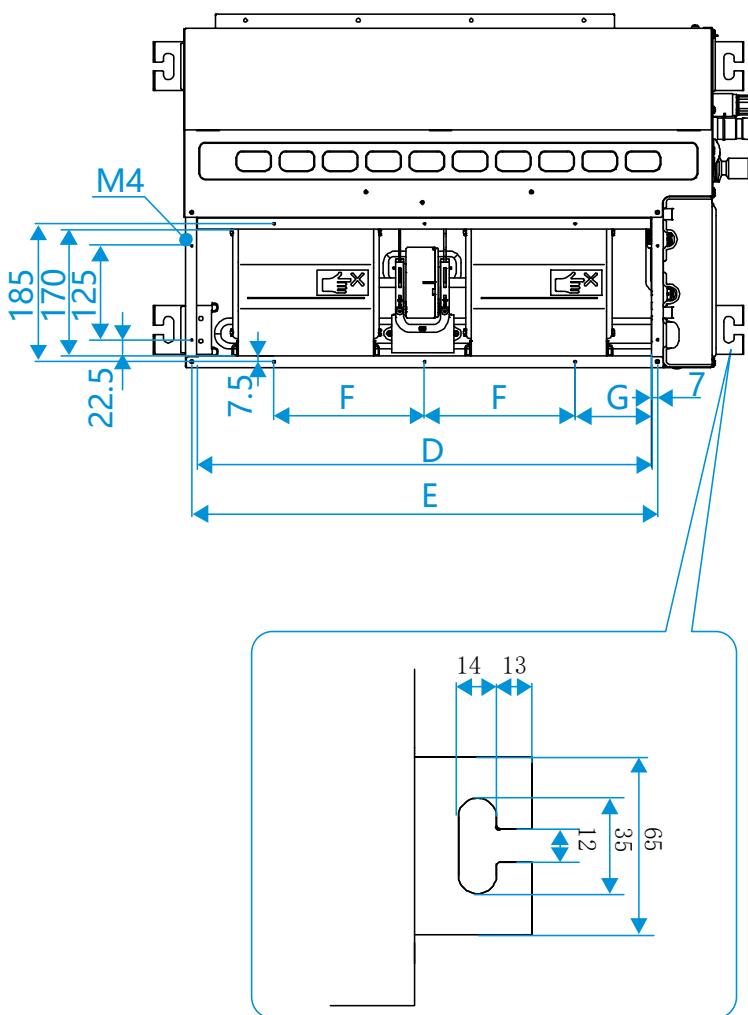

Notes:

- meaning of letters refer to *Table 2.1*

Figure 2.4: Piping and water pipe size:(unit: mm)

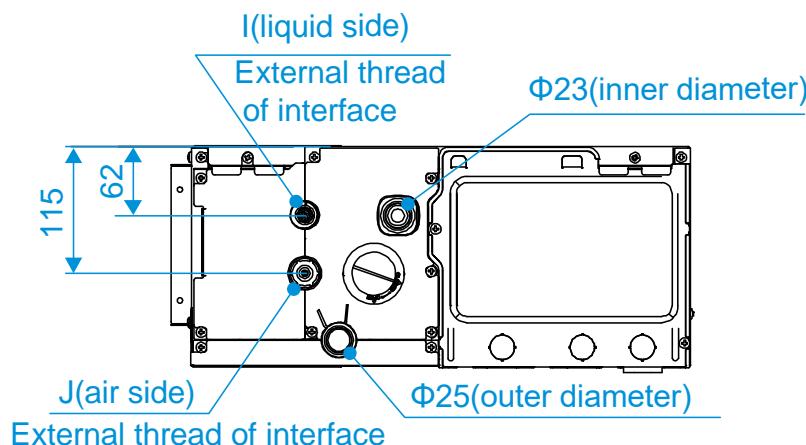

Notes:

- meaning of letters refer to *Table 2.1*

3 Unit Placement


3.1 Placement Considerations

Unit placement should take account of the following considerations:

- Units should not be installed in the following locations:
 - A place filled with mineral oil, fumes or mist, like a kitchen.
 - A place where there are corrosive gases, such as acid or alkaline gases..
 - A place exposed to combustible gases and using volatile combustible gases such as diluent or gasoline.
 - A place where there is equipment emitting electromagnetic radiation.
 - A place where there is a high salt content in the air like a coast.
 - Do not use the air conditioner in an environment where an explosion may occur.
 - Places like in vehicles or cabin rooms.
 - Factories with major voltage fluctuations in the power supplies.
 - Other special environmental conditions.
- Units should be installed in positions where:
 - Ensure that the airflow in and out of the IDU is reasonably organized to form an air circulation in the room.
 - Ensure IDU maintenance space.
 - The nearer the drainage pipe and copper pipe are to the ODU, the lower the pipe cost is.
 - Prevent the air conditioner from blowing directly to the human body.
 - The closer the wiring to the power cabinet, the lower the wiring cost is.
 - Keep the air-conditioning return air away from the setting sun of the room.
 - Be careful not to interfere with the light tank, fire pipe, gas pipe and other facilities.
 - The IDU should not be lifted in the places like load-bearing beam and columns that affect the structural safety of the house.
 - The wired controller and the IDU should be in the same installation space; otherwise, the sampling point setting of the wired controller need to be changed.

3.2 Space Requirements

Figure 3.1: Arc Duct space requirements (unit: mm)

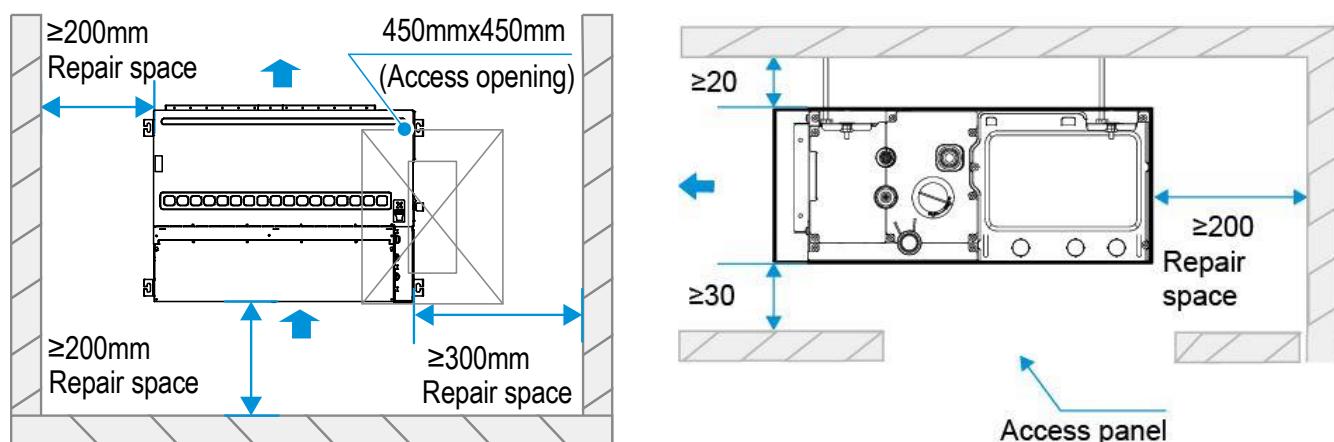


Notes:

1. The centerline of the maintenance hole should be in the same position as the centerline of the indoor unit.

4 Piping Diagram


Figure 4.1: Arc Duct piping diagram

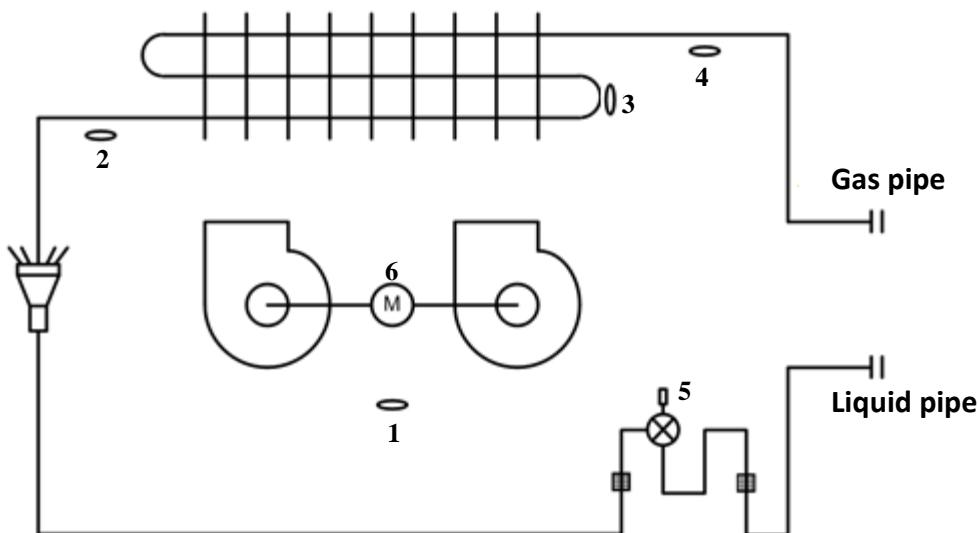

Legend	Code	Description
1	T1	Indoor ambient temperature sensor
2	T2A	Indoor heat exchanger liquid side temperature sensor
3	T2	Indoor heat exchanger mid-point temperature sensor
4	T2B	Indoor heat exchanger gas side temperature sensor
5	EEV	Electronic expansion valve
6	FAN	Fan motor

5 Wiring Diagram

Figure 5.1: Arc Duct wiring diagram

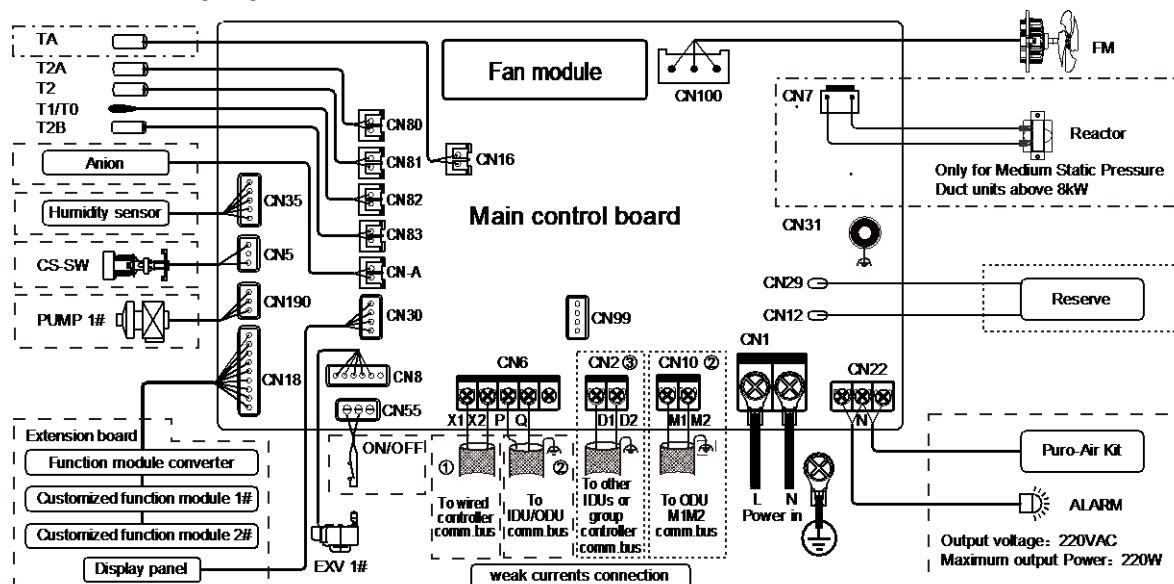

Code	Description	Code	Description	Code	Description
XS XP	Connectors	T2A	Evaporator inlet temperature sensor	ALARM	Alarm output
TA	Steam pipe temperature sensor*	T2	Indoor heat exchanger mid-point temp. sensor	FM	DC Fan motor
CS-SW	Water level switch	T1	Indoor ambient temp. sensor	ON/OFF	Remote on/off
EXV	Electronic expansion valve	T2B	Evaporator outlet temperature sensor		
Anion	Nel ion sterilization module	T0	Fresh air inlet air temperature sensor*		

* Indicates that this sensor is only available for Fresh Air Processing Unit

— : means optional parts or functions
---- : means customized parts or functions
--- : for specific models only

Attention:

- Power cords should be effectively fixed!
- Be sure to confirm the reliability of wiring connection before power on!
- The wiring diagram shown is for reference only!

Warning:

- All power supply circuits must be cut off before approaching the terminal blocks.

Notes:

- ① X1X2 communication ports can be connected to the wired controller or WiFi Kit module.
- ② PQ and M1M2 communication ports both are used for indoor and outdoor communication, and only one of them can be used at a time. Meanwhile, be sure to connect the same communication ports (PQ to PQ; M1M2 to M1M2) in case of damage of the main control board.
- ③ D1D2 communication ports are used for group control communication or can be connected to the central controller.

Notes for installers and service engineers

Caution

- All installation, servicing and maintenance must be carried out by competent and suitably qualified, certified and accredited professionals and in accordance with all applicable legislation.
- Units should be grounded in accordance with all applicable legislation. Metal and other conductive components should be insulated in accordance with all applicable legislation.
- Power supply wiring should be securely fastened at the power supply terminals – loose power supply wiring would represent a fire risk.
- After installation, servicing or maintenance, the electric control box cover should be closed. Failing to close the electric control box cover risks fire or electric shock.
- The dotted lines indicate the field wiring or optional function.
- PQ and M1M2 communication ports both are used for indoor and outdoor communication, and only one of them can be used at a time. Meanwhile, be sure to connect the same communication ports (PQ to PQ; M1M2 to M1M2) in case of damage of the main control board.
- D1D2 communication ports are used for group control communication. When connecting the group controller, the D1D2 port of the indoor units that are to be group controlled must be connected in daisy chain, and the group controller must be connected to the X1X2 port of one of the indoor units in the group control, and set to group control mode. In addition, D1D2 communication ports can also be connected to the central controller.

6 Capacity Tables

6.1 Cooling Capacity Table

Table 6.1: Arc Duct cooling capacity

Model	Indoor air temperature (°C WB/DB)													
	14/20		16/23		18/26		19/27		20/28		22/30		24/32	
	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC	TC	SC
MIH15T3HN18	0.8	0.7	1.1	0.9	1.4	1	1.5	1.1	1.6	1.1	2	1.2	2.3	1.3
MIH22T3HN18	1.2	1.1	1.6	1.4	2	1.6	2.2	1.6	2.4	1.7	2.8	1.7	3.2	1.8
MIH28T3HN18	1.5	1.3	2	1.6	2.5	1.8	2.8	1.9	3.1	2	3.7	2.2	4.4	2.3
MIH36T3HN18	1.9	1.8	2.5	2.1	3.2	2.4	3.6	2.5	4	2.6	4.7	2.8	5.5	3
MIH45T3HN18	2.5	2.2	3.3	2.7	4.1	3.1	4.5	3.2	4.9	3.3	5.8	3.5	6.7	3.6
MIH56T3HN18	3.2	2.9	4.1	3.4	5.1	4	5.6	4.1	6.1	4.2	7.1	4.4	8.1	4.5
MIH71T3HN18	3.6	3.2	5	4.1	6.4	4.8	7.1	5	7.4	5.2	8.4	5.4	9.2	5.6
MIH80T3HN18	4.8	4.5	6.2	5.4	7.4	6.1	8	6.2	8.2	6.2	9.2	6.3	10.2	6.4
MIH90T3HN18	5.4	5.1	6.9	6	8.3	6.8	9	7	9.2	7	10.3	7.1	11.4	7.2
MIH112T3HN18	6.8	6.6	8.7	7.7	10.3	8.7	11.2	8.9	11.5	8.9	12.8	9.1	14.1	9.2

Abbreviations:

TC: Total capacity (kW)

SC: Sensible capacity(kW)

Notes:

1.Shaded cells indicate rating condition.

6.2 Heating Capacity Table

Table 6.2: Arc Duct heating capacity

Model	Indoor air temperature (°C DB)					
	16		18		20	
	TC	TC	TC	TC	TC	TC
MIH15T3HN18	2.1	1.9	1.8	1.7	1.6	1.5
MIH22T3HN18	3	2.8	2.5	2.5	2.4	2.2
MIH28T3HN18	3.7	3.5	3.2	3.1	2.9	2.7
MIH36T3HN18	4.7	4.3	4	3.8	3.7	3.3
MIH45T3HN18	5.8	5.4	5	4.8	4.6	4.1
MIH56T3HN18	7.3	6.8	6.3	6	5.8	5.3
MIH71T3HN18	9.3	8.6	8	7.7	7.4	6.7
MIH80T3HN18	9.9	9.4	9	8.6	8.6	7.7
MIH90T3HN18	11	10.5	10	9.5	9.5	8.5
MIH112T3HN18	13.7	13.1	12.5	11.9	11.9	10.7

Abbreviations:

TC: Total capacity (kW)

SC: Sensible capacity(kW)

Notes:

1.Shaded cells indicate rating condition.

7 Electrical Characteristics

Table 7.1: Arc Duct electrical characteristics

Model name	Power supply						Indoor fan motors	
	Hz	Volts	Min. volts	Max. volts	MCA	MFA	Rated motor output (kW)	FLA
MIH15T3HN18	50/60	220-240	198	264	0.88	15	20	0.7
MIH22T3HN18	50/60	220-240	198	264	0.88	15	20	0.7
MIH28T3HN18	50/60	220-240	198	264	0.88	15	29	0.7
MIH36T3HN18	50/60	220-240	198	264	0.94	15	35	0.75
MIH45T3HN18	50/60	220-240	198	264	1.1	15	45	0.85
MIH56T3HN18	50/60	220-240	198	264	1.1	15	65	0.85
MIH71T3HN18	50/60	220-240	198	264	1.2	15	73	0.94
MIH80T3HN18	50/60	220-240	198	264	1.7	15	62	1.35
MIH90T3HN18	50/60	220-240	198	264	1.7	15	62	1.35
MIH112T3HN18	50/60	220-240	198	264	1.7	15	96	1.35

Abbreviations:

MCA: Minimum Circuit Amps

MFA: Maximum Fuse Amps

FLA: Full Load Amps

8 Sound Levels

8.1 Overall


Table 8.1: Arc Duct sound pressure levels¹

Model name	Sound pressure levels dB						
	SSH	SH	H	M	L	SL	SSL
MIH15T3HN18	27	26	25	24	23	22.5	22
MIH22T3HN18	28	27	26	25	24	23.5	22
MIH28T3HN18	30	29	28	27	26	25	22
MIH36T3HN18	30	29	28	27	26	25.5	25
MIH45T3HN18	33	32.5	32	30	29	28	26
MIH56T3HN18	36	34	33	32	31	30	27
MIH71T3HN18	37	35	34	32.5	31	30	29
MIH80T3HN18	36.5	35	34	33	32	31	30.5
MIH90T3HN18	36.5	35	34	33	32	31	30.5
MIH112T3HN18	39.5	38	36.5	35	34	32.5	31.5

Notes:

1. Sound pressure levels are measured 1.5m below the unit in an anechoic chamber at 0 Pa static pressure. During in-situ operation, sound pressure levels may be higher as a result of ambient noise.

Figure 8.2: Arc Duct sound pressure level measurement

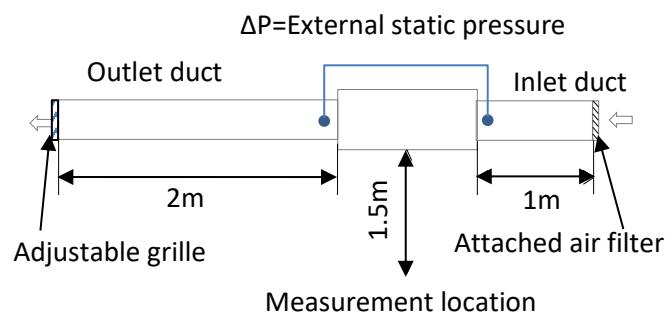

Connected to a top-discharge outdoor unit and measured in anechoic room. Adjusting the outlet grille to make the ΔP is equal to the rated static pressure, the data was recorded at 1.5m below the unit.

8.2 Octave Band Levels

Figure 8.3: MIH15T3HN18 octave band levels

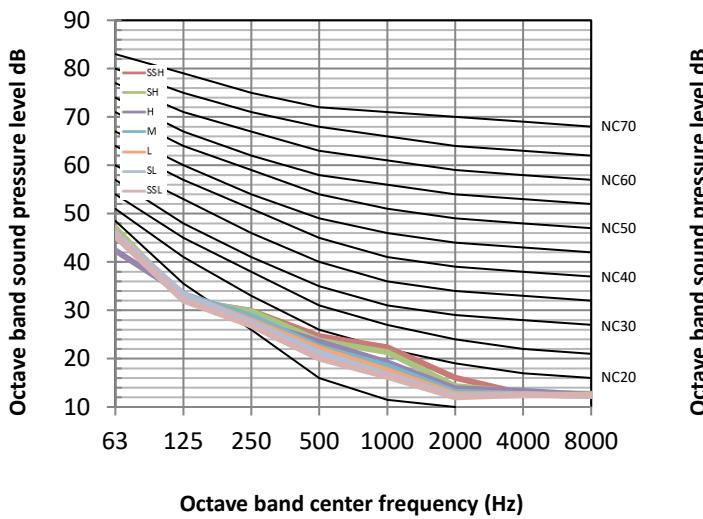


Figure 8.4: MIH22T3HN18 octave band levels

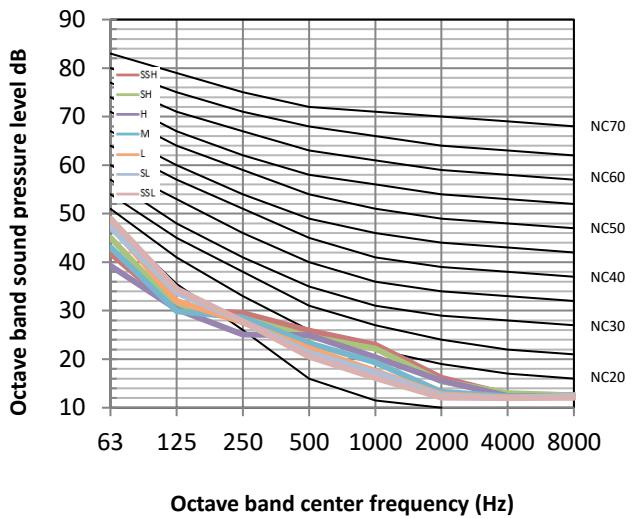


Figure 8.5: MIH28T3HN18 octave band levels

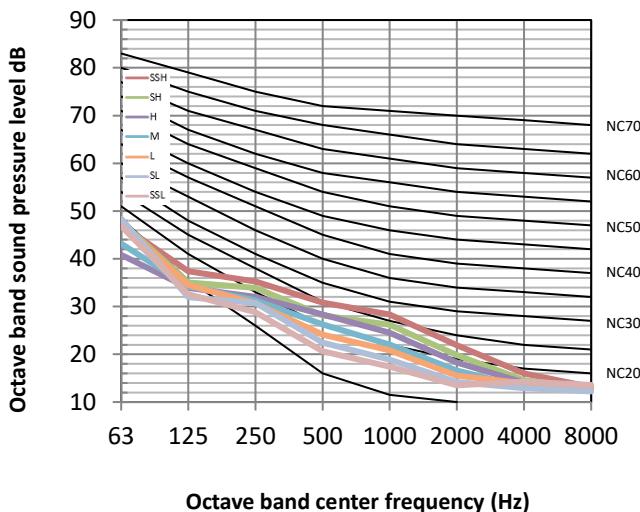


Figure 8.6: MIH36T3HN18 octave band levels

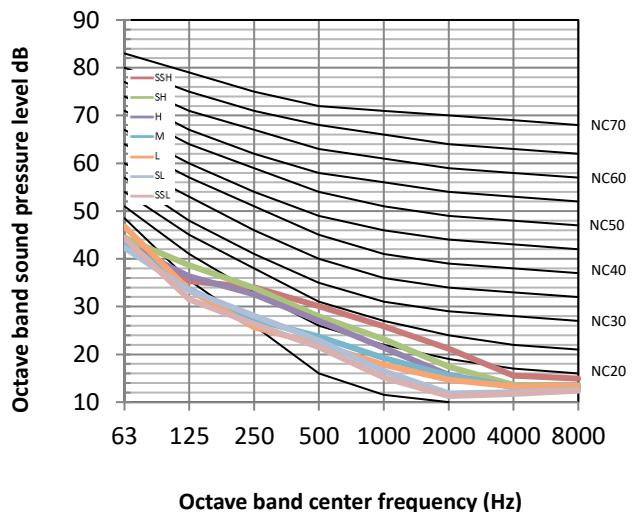


Figure 8.7: MIH45T3HN18 octave band levels

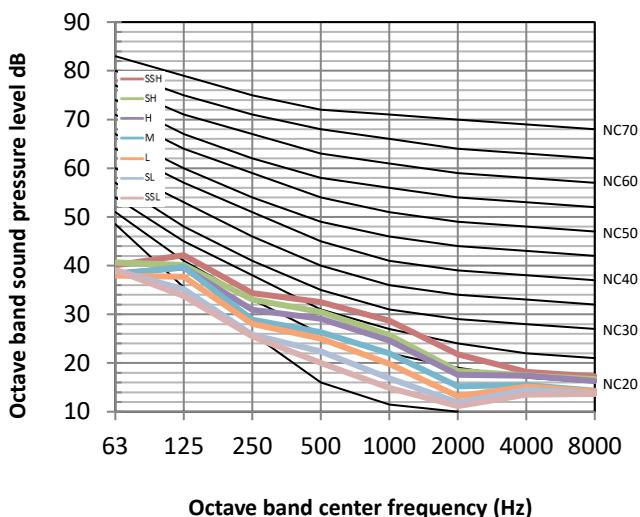


Figure 8.8: MIH56T3HN18 octave band levels

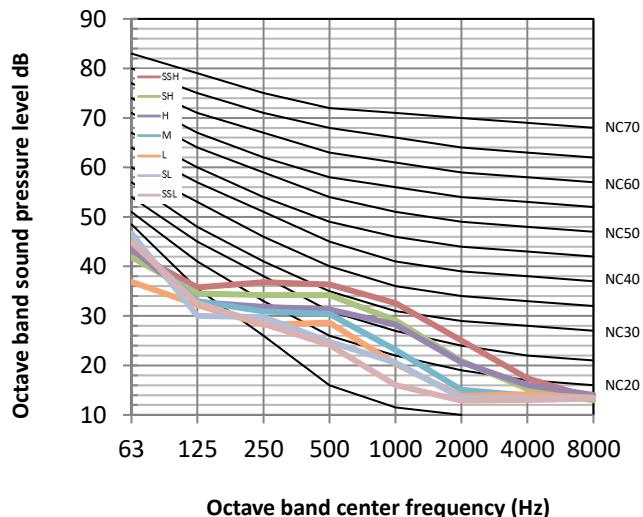


Figure 8.9: MIH71T3HN18 octave band levels

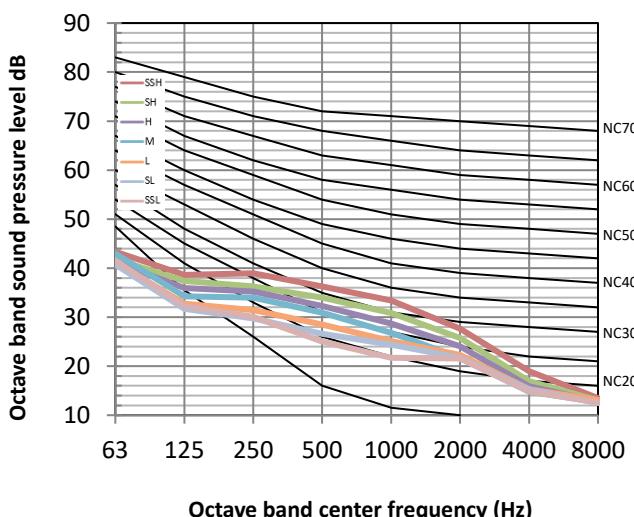


Figure 8.10: MIH80T3HN18 octave band levels

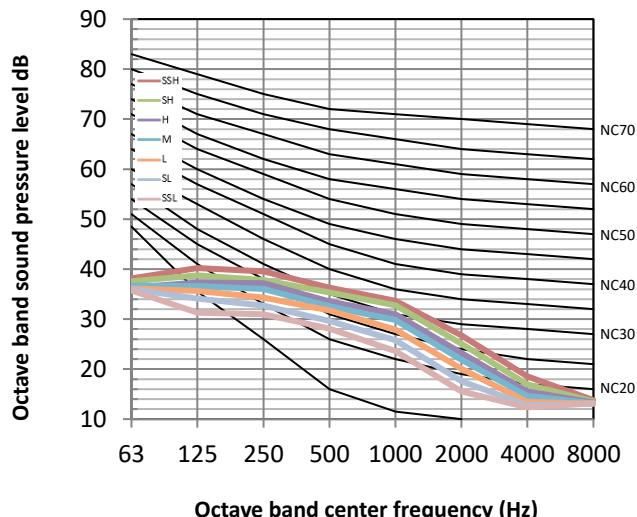


Figure 8.11: MIH90T3HN18 octave band levels


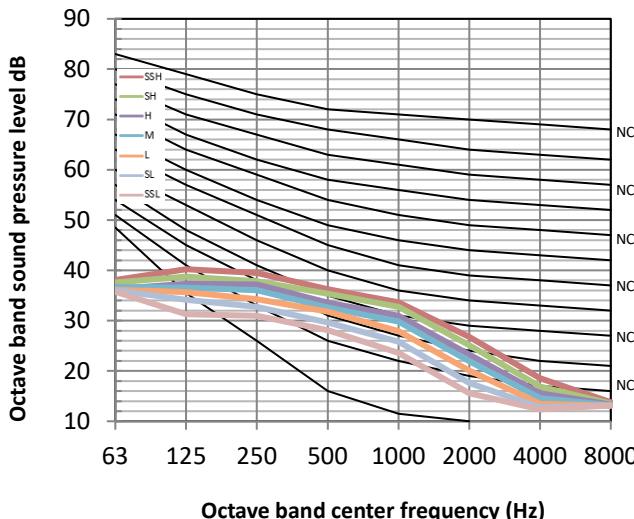


Figure 8.12: MIH112T3HN18 octave band levels

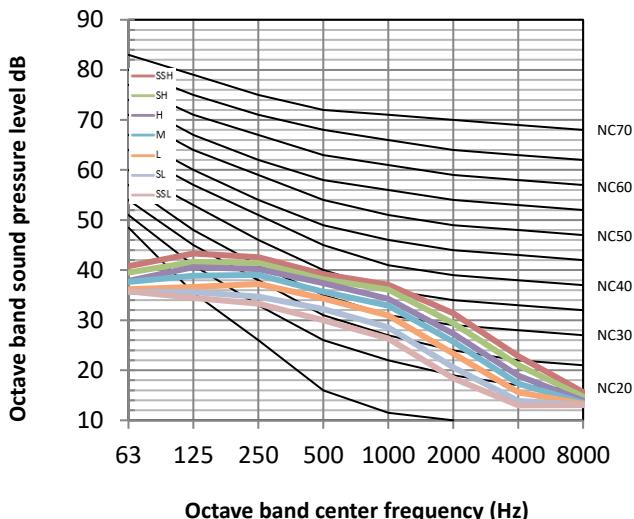

9 Fan Performance

9.1 How to switch between Constant Airflow mode and Constant Speed mode

① In the main interface, press "≡" + "OK" for 3 seconds at the same time, and the main interface will display "CC". Press the "▲" and "▼" to select the indoor unit ("n00-n63" is displayed, and the last two digits are the indoor unit addresses). Press the "OK" to enter the parameter setting interface, and "n00" will be displayed.

② Press the "▲" and "▼" until "N30" is displayed on the page, and then press the "OK" to enter the mode setting. Use the "▲" and "▼" keys to adjust to the demand mode parameter values, and press the "OK" to confirm.

③ Press the "OK" button to return to the previous menu and exit the parameter setting. Parameter setting will also exit after 60 s of no operation

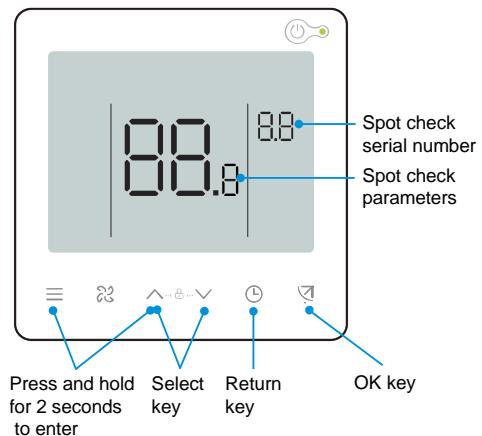


Table 9.1: Arc Duct mode setting

First level menu	Second level menu	Description	Default
n30	00	Constant Speed	-
	01	Constant Airflow	✓

9.2 Constant Airflow mode

9.2.1 Fan performance diagram

Figure 9.1: MIH15T3HN18

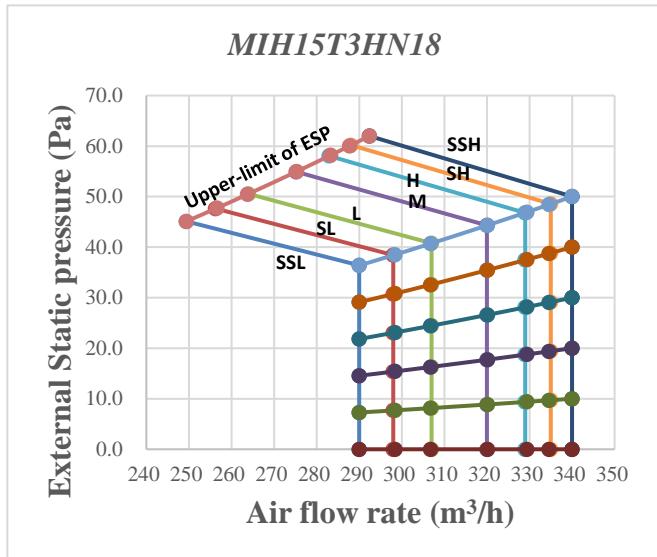


Figure 9.2: MIH22T3HN18

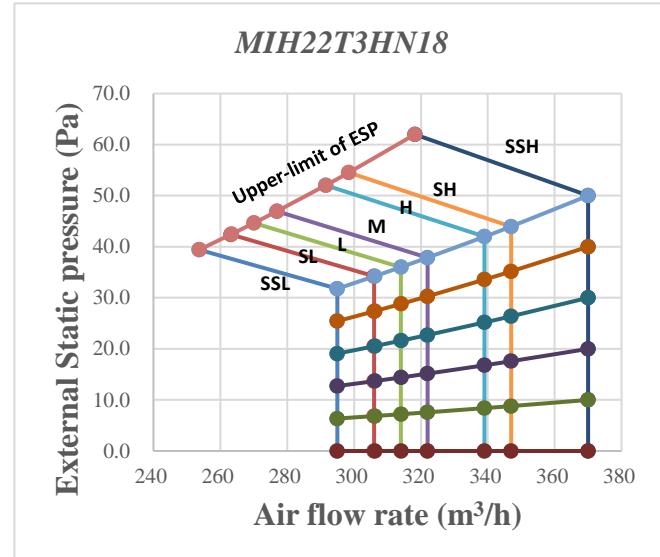


Figure 9.3: MIH28T3HN18

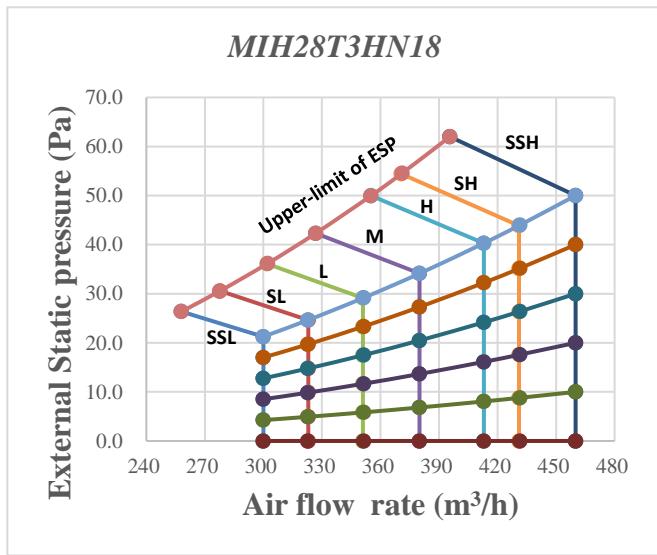


Figure 9.4: MIH36T3HN18

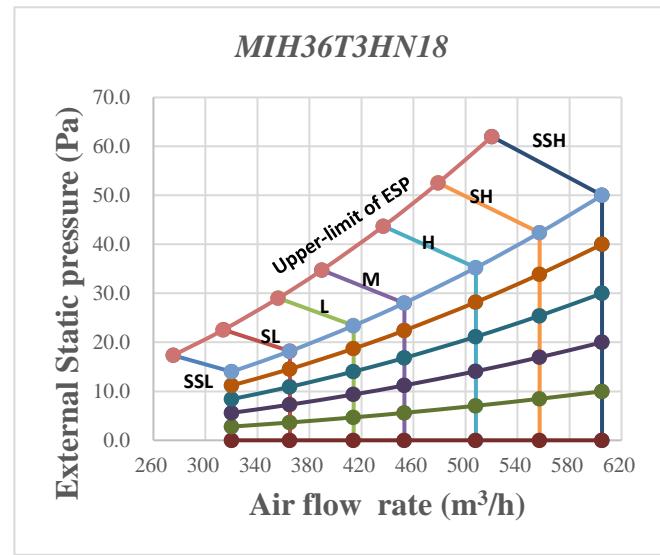


Figure 9.5: MIH45T3HN18

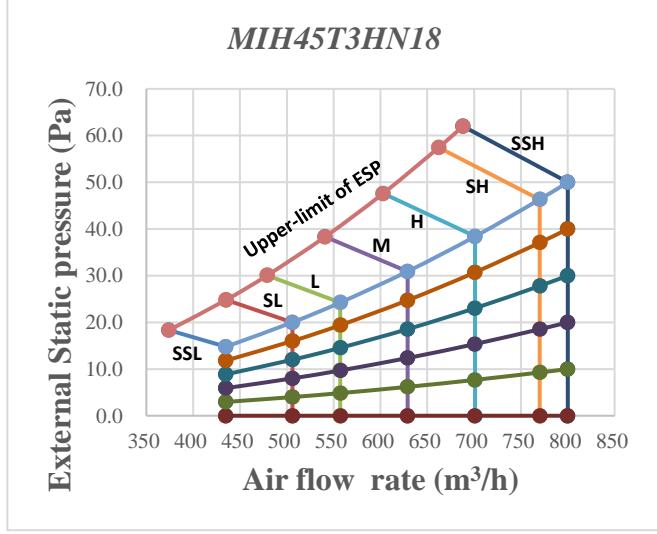


Figure 9.6: MIH56T3HN18

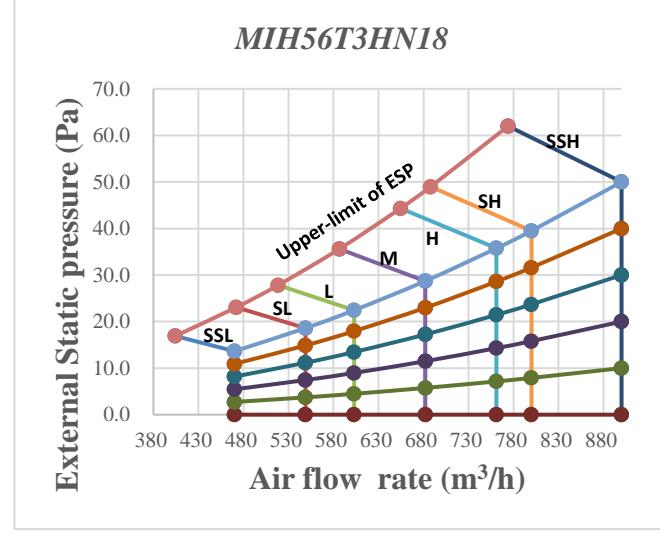


Figure 9.7: MIH71T3HN18

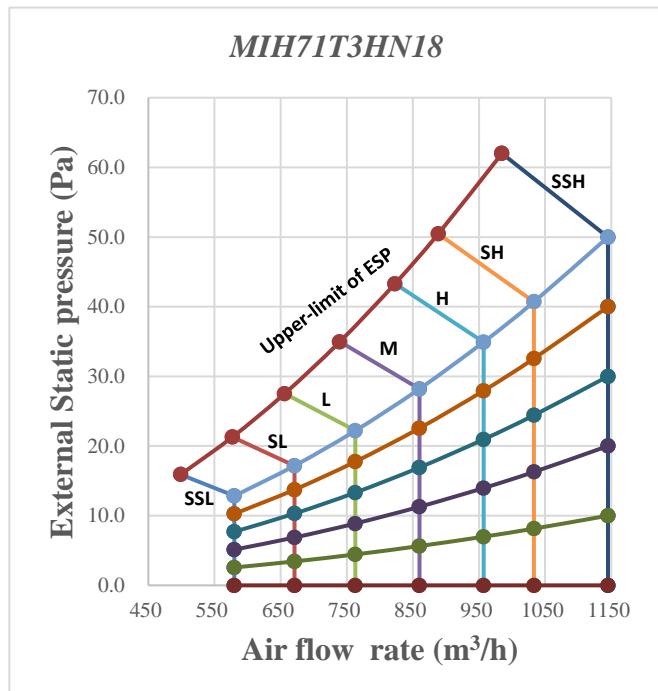


Figure 9.8: MIH80T3HN18

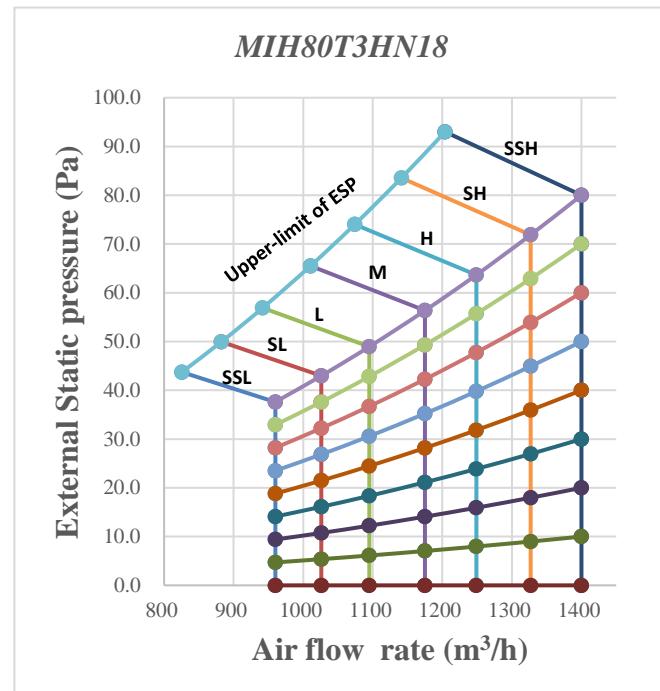


Figure 9.9: MIH90T3HN18


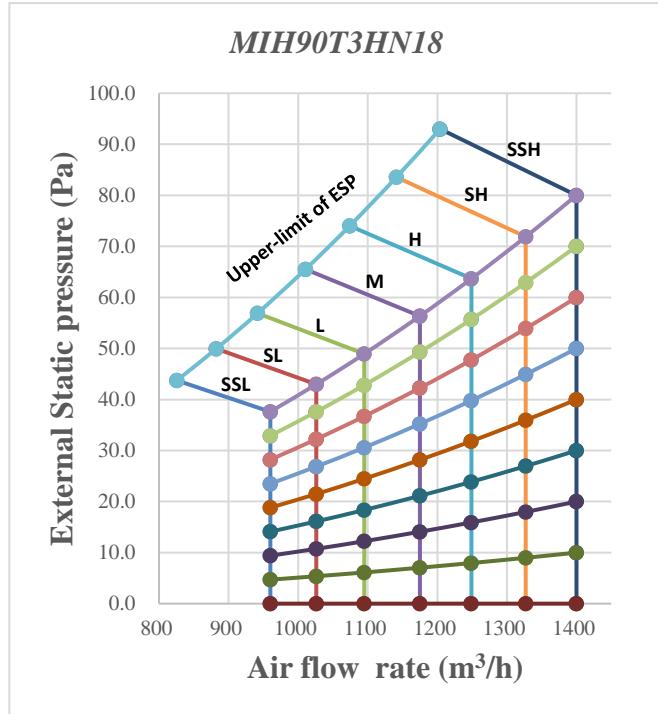


Figure 9.10: MIH112T3HN18

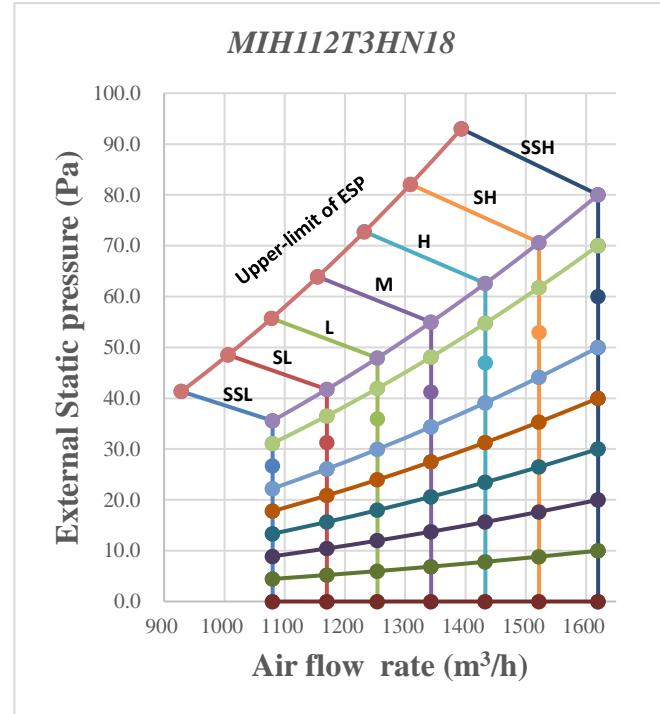

9.2.2 How to Read the Diagram

The vertical axis is the External Static Pressure (Pa) while the horizontal axis represents the Air Flow (m³/h). The characteristic curve for the "SSH", "SH", "H", "M", "L", "SL" and "SSL" fan speed control.

For MIH80T3HN18, in "H" windshield, when the external static pressure is less than 63.7 Pa, the air flow keeps 1249 m³/h, but when the external static pressure is greater than 63.7 Pa, the air flow begins to decline, and the allowable maximum external static pressure is 74 Pa.

9.3 Constant Speed mode

9.3.1 Fan performance diagram

Figure 9.11: MIH15T3HN18

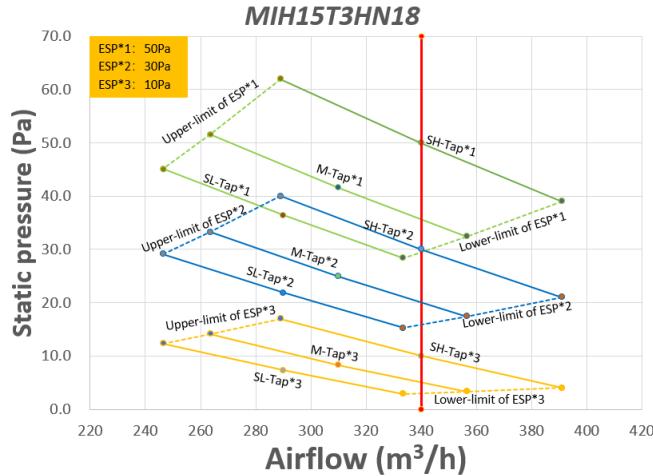


Figure 9.12: MIH22T3HN18

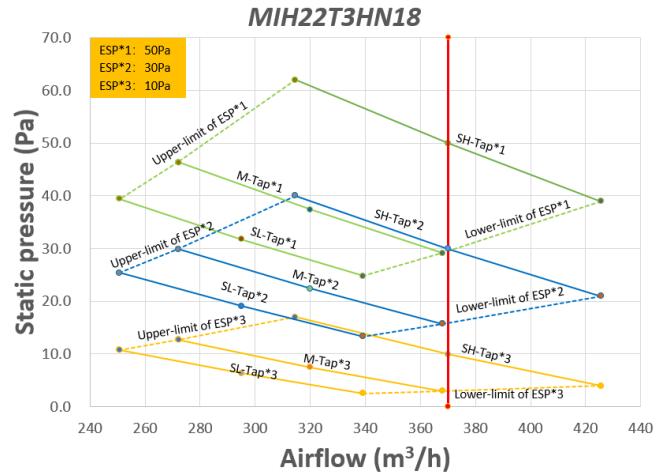


Figure 9.13: MIH28T3HN18

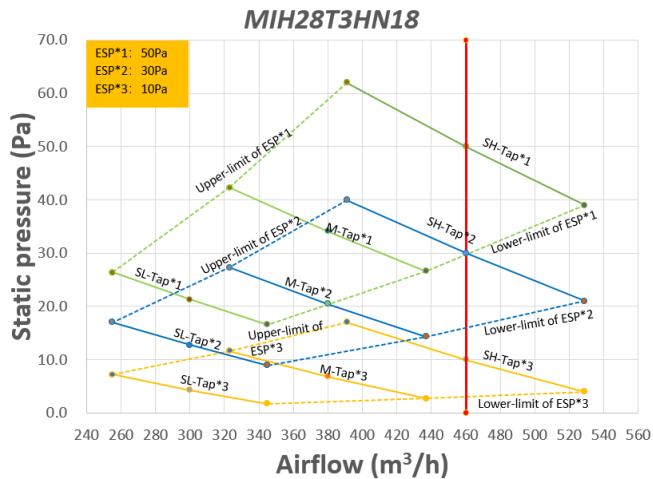


Figure 9.14: MIH36T3HN18

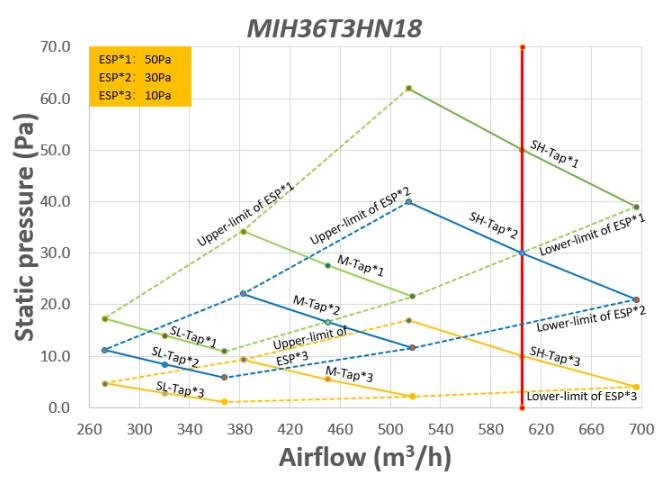


Figure 9.15: MIH45T3HN18

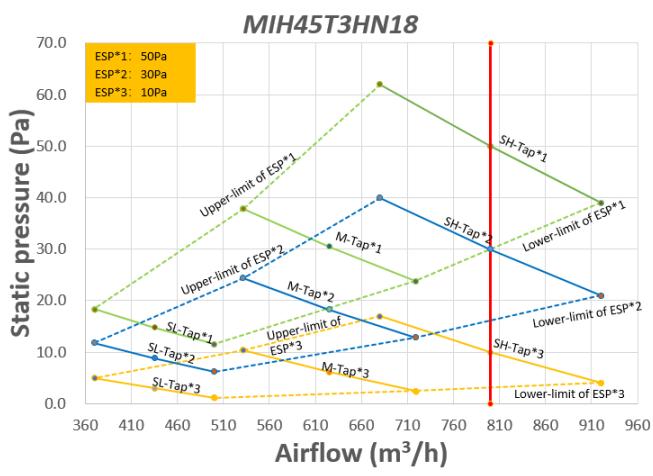


Figure 9.16: MIH56T3HN18

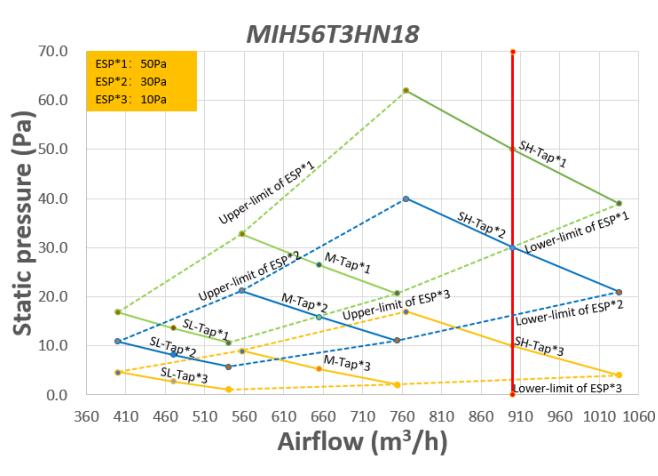


Figure 9.17: MIH71T3HN18

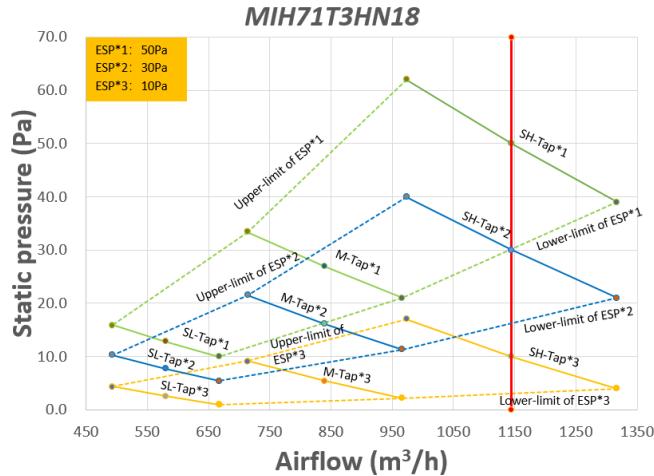


Figure 9.18: MIH80T3HN18

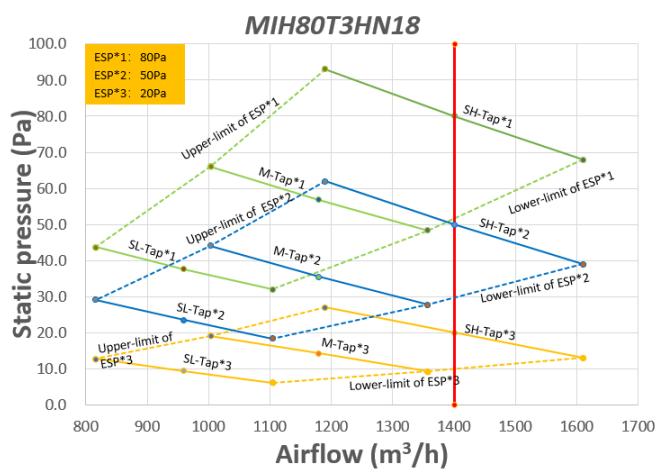


Figure 9.19: MIH90T3HN18


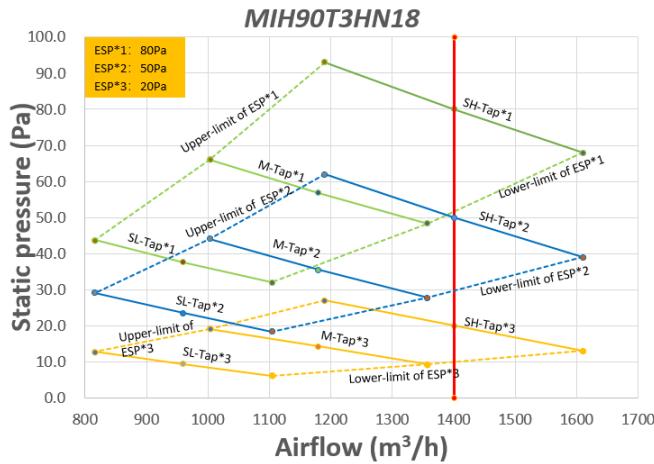


Figure 9.20: MIH112T3HN18

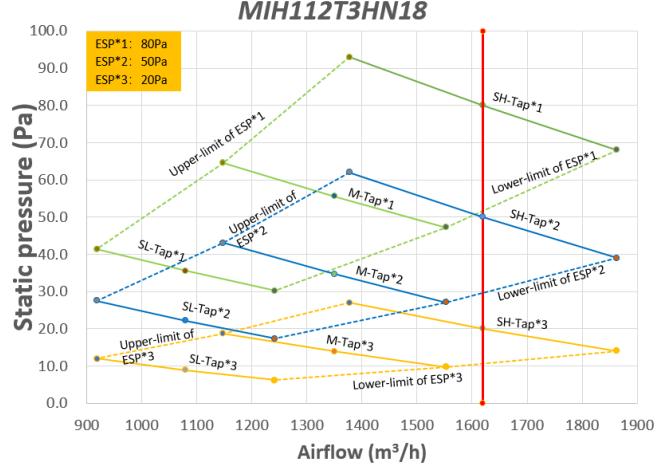

9.3.2 How to Read the Diagram

The vertical axis is the External Static Pressure (Pa) while the horizontal axis represents the Air Flow (m^3/h). The characteristic curve for the "SH", "M" and "SL" fan speed control.

The Air Flow decreases with the increase of the external static pressure. For MIH80T3HN18, in "SH" windshield and "50Pa" setting static pressure, when the external static pressure is 50Pa, the air flow is 1400 m^3/h , and the allowable external static pressure range is 39 to 62.

Midea Building Technologies Division
Midea Group

Add.: Midea Headquarters Building, 6 Midea Avenue, Shunde, Foshan, Guangdong, China

Postal code: 528311

mbt.midea.com / www.midea-group.com / tsp.midea.com/

Note: Product specifications change from time to time as product improvements and developments are released and may vary from those in this document.

