

2-way blow ceiling mounted cassette Air Conditioning Technical Data FXCQ-A



FXCQ20AVEB
FXCQ25AVEB
FXCQ32AVEB
FXCQ40AVEB
FXCQ50AVEB
FXCQ63AVEB
FXCQ80AVEB
FXCQ125AVEB

TABLE OF CONTENTS

FXCQ-A

1	Features	4
	FXCQ-A	4
2	Specifications	5
3	Electrical data	8
4	Safety device settings	9
5	Options	10
6	Capacity tables	11
	Cooling Capacity Tables	11
	Heating Capacity Tables	12
7	Dimensional drawings	13
8	Centre of gravity	15
9	Piping diagrams	16
10	Wiring diagrams	17
	Wiring Diagrams - Single Phase	17
11	Sound data	18
	Sound Pressure Spectrum	18

1 Features

1 - 1 FXCQ-A

Thin, lightweight design installs easily in narrow corridors

1

- › Depth of all units is 620mm, ideal for narrow spaces
- › Individual flap control: flexibility to suit every room layout without changing the location of the unit!
- › Reduced energy consumption thanks to specially developed small tube heat exchanger, DC fan motor and drain pump
- › Stylish unit blends easily with any interior. The flaps close entirely when the unit is not operating and there are no air intake grilles visible
- › Fresh air intake integrated in the same system thus reducing installation cost as no additional ventilation device is required
- › Optimum comfort guaranteed with automatic air flow adjustment to the required load
- › Maintenance operations can be performed by removing the front panel
- › Branch duct discharge allows to optimize air distribution in irregular shaped rooms or to supply air to small adjacent rooms
- › Standard drain pump with 580mm lift increases flexibility and installation speed



Home leave operation



Fan only



Auto cooling-heating changeover



Whisper quiet



Ceiling soiling prevention



Vertical auto swing



Fan speed steps (3 steps + auto)



Dry programme



Air filter



Weekly timer (optional)



Infrared remote control (optional)



Wired remote control (optional)



Centralised control (optional)



Auto-restart



Self diagnosis



Drain pump kit (standard)

2 Specifications

2 - 1 Specifications

Technical specifications				FXCQ20A	FXCQ25A	FXCQ32A	FXCQ40A
Cooling capacity	Sensible capacity	At high fan speed	kW	1.9	2.3	2.6	3.2
	Latent capacity	At high fan speed	kW	0.3	0.5	1.0	1.3
	Total capacity	At high fan speed	kW	2.2 (1)	2.8 (1)	3.6 (1)	4.5 (1)
Heating capacity	Total capacity	At high fan speed	kW	2.5 (2)	3.2 (2)	4.0 (2)	5.0 (2)
Power input - 50Hz	Cooling	At high fan speed	kW	0.031	0.039		0.041
	Heating	At high fan speed	kW	0.028	0.035		0.037
Dimensions	Unit	Height	mm	305			
		Width	mm	775			
		Depth	mm	620			
Weight	Unit		kg	19			
	Packed unit		kg	23.5	24	31	37
Casing	Material			Galvanised steel plate			
Heat exchanger	Rows	Quantity		2			
	Fin pitch			1.2			
	Face area			0.334			
Fan	Stages	Quantity		16			
	Type			Turbo fan			
	Air flow rate - 50Hz	Cooling	At high fan speed	m³/min	10.5	11.5	
At medium fan speed			m³/min	9	9.5		10.5
At low fan speed			m³/min	7.5	8		8.5
Fan motor	Output	High	W	46			
	Drive			Direct drive			
Sound power level	Cooling	At high fan speed	dBA	48	50		52
		At medium fan speed	dBA	46	47	48	49
		At low fan speed	dBA	44	45	46	47
Sound pressure level	Cooling	At high fan speed	dBA	32.0	34.0		36.0
		At medium fan speed	dBA	30.0	31.0	32.0	33.0
		At low fan speed	dBA	28.0	29.0	30.0	31.0
	Heating	At high fan speed	dBA	32.0	34.0		36.0
		At medium fan speed	dBA	30.0	31.0	32.0	33.0
		At low fan speed	dBA	28.0	29.0	30.0	31.0
Fan motor	Quantity		1				
	Model		QTS36A15M				
Refrigerant	Type		R-410A				
	GWP		2,087.5				
	Control		Electronic expansion valve				
Piping connections	Liquid	Type		Flare connection			
		OD	mm	6.35			
	Gas	Type		Flare connection			
		OD	mm	12.7			
Decoration panel	Drain			VP25 (O.D. 32 / I.D. 25)			
	Model			BYBCQ40HW1			
	Colour			Fresh white (6.5Y 9.5/0.5)			
	Dimensions	Height	mm	55			
		Width	mm	1,070			
		Depth	mm	700			
Air filter	Weight		kg	10			
	Type			Resin net with mold resistance			
Safety devices	Item	01		Fuse			
Control systems	Infrared remote control			BRC7CS2			
	Wired remote control			BRC1H52W/S/K / BRC1E53A / BRC1E53B / BRC1E53C / BRC1D52			
Temperature control				Microprocessor thermostat for cooling and heating			

Technical specifications				FXCQ50A	FXCQ63A	FXCQ80A	FXCQ125A
Cooling capacity	Sensible capacity	At high fan speed	kW	3.9	5.0	6.5	9.9
	Latent capacity	At high fan speed	kW	1.7	2.1	2.5	4.1
	Total capacity	At high fan speed	kW	5.6 (1)	7.1 (1)	9.0 (1)	14.0 (1)
Heating capacity	Total capacity	At high fan speed	kW	6.3 (2)	8.0 (2)	10.0 (2)	16.0 (2)
Power input - 50Hz	Cooling	At high fan speed	kW	0.059	0.063	0.090	0.149
	Heating	At high fan speed	kW	0.056	0.060	0.086	0.146
Dimensions	Unit	Height	mm	305			
		Width	mm	990			
		Depth	mm	620			
Weight	Unit		kg	22	25	33	38
	Packed unit		kg	38	41		56

2 Specifications

2 - 1 Specifications

Technical specifications					FXCQ50A	FXCQ63A	FXCQ80A	FXCQ125A
Casing	Material				Galvanised steel plate			
Heat exchanger	Rows	Quantity			2			
	Fin pitch	mm			1.2			
	Face area	m²			0.218		0.320	
	Stages	Quantity			16			
Fan	Type				Turbo fan			
	Air flow rate - 50Hz	Cooling	At high fan speed	m³/min	15	16	26	32
			At medium fan speed	m³/min	13	14	22.5	27.5
			At low fan speed	m³/min	10.5	11.5	18.5	22.5
Fan motor	Output	High	W	46	106	46	106	
	Drive				Direct drive			
Sound power level	Cooling	At high fan speed	dB(A)	53	55	58	62	
		At medium fan speed	dB(A)	51	53	54	58	
		At low fan speed	dB(A)	47	48	49	54	
Sound pressure level	Cooling	At high fan speed	dB(A)	37.0	39.0	42.0	46.0	
		At medium fan speed	dB(A)	35.0	37.0	38.0	42.0	
		At low fan speed	dB(A)	31.0	32.0	33.0	38.0	
	Heating	At high fan speed	dB(A)	37.0	39.0	42.0	46.0	
		At medium fan speed	dB(A)	35.0	37.0	38.0	42.0	
		At low fan speed	dB(A)	31.0	32.0	33.0	38.0	
Fan motor	Quantity	1				2		
	Model	QTS36A15M						
Fan motor 2	Output	High	W	-		46	106	
Refrigerant	Type	R-410A						
	GWP	2,087.5						
Refrigerant	Control				Electronic expansion valve			
Piping connections	Liquid	Type	Flare connection					
		OD	mm	6.35	9.52			
	Gas	Type	Flare connection					
		OD	mm	12.7	15.9			
Decoration panel	Drain				VP25 (O.D. 32 / I.D. 25)			
	Model				BYBCQ63HW1		BYBCQ125HW1	
	Colour				Fresh white (6.5Y 9.5/0.5)			
	Dimensions	Height	mm	55				
		Width	mm	1,285		1,740		
		Depth	mm	700				
Weight				11	13			
Air filter	Type				Resin net with mold resistance			
Safety devices	Item	01			Fuse			
Control systems	Infrared remote control				BRC7C52			
	Wired remote control				BRC1H52W/S/K / BRC1E53A / BRC1E53B / BRC1E53C / BRC1D52			
Heat exchanger 2	Face area	m²			0.218		0.320	
Temperature control					Microprocessor thermostat for cooling and heating			

Standard accessories: Operation manual;Quantity:;

Standard accessories: Installation manual;Quantity:;

Standard accessories: Declaration of conformity;Quantity:;

Standard accessories: Installation pattern;Quantity:;

Standard accessories: Washer for hanger bracket;Quantity:;

Standard accessories: Clamp metal;Quantity:;

Standard accessories: Drain hose;Quantity:;

Standard accessories: Joint insulating material;Quantity:;

Standard accessories: Washer clamp;Quantity:;

Standard accessories: Sealing material;Quantity:;

Standard accessories: Clamps;Quantity:;

Standard accessories: Screws;Quantity:;

Standard accessories: Insulation piping cover for drain piping;Quantity:;

Electrical specifications					FXCQ20A	FXCQ25A	FXCQ32A	FXCQ40A
Power supply	Name				VE			
	Phase				1~			
	Frequency				50			
	Voltage				220-240			
Current - 50Hz	Minimum circuit amps (MCA)			A	0.3			
	Maximum fuse amps (MFA)			A	16			
	Full load amps (FLA)			Total A	0.2			
Voltage range	Max.			%	10			
	Min.			%	-10			

2 Specifications

2 - 1 Specifications

Electrical specifications			FXCQ50A	FXCQ63A	FXCQ80A	FXCQ125A
Power supply	Name		VE			
	Phase		1~			
	Frequency	Hz	50			
	Voltage	V	220-240			
Current - 50Hz	Minimum circuit amps (MCA)	A	0.4	0.5	0.6	1.1
	Maximum fuse amps (MFA)	A	16			
	Full load amps (FLA) Total	A	0.3	0.4	0.5	0.9
Voltage range	Max.	%	10			
	Min.	%	-10			

(1)Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m (horizontal) |

(2)Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m (horizontal) |

Capacities are net, including a deduction for cooling (an addition for heating) for indoor fan motor heat. |

Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits. |

Maximum allowable voltage range variation between phases is 2%. |

MCA/MFA: MCA = 1.25 x FLA |

MFA ≤ 4 x FLA |

Next lower standard fuse rating minimum 16A |

Select wire size based on the value of MCA |

Instead of a fuse, use a circuit breaker |

Contains fluorinated greenhouse gases

3 Electrical data

3 - 1 Electrical Data

FXCQ-A

Model	Units			Power Supply		IFM		Input (W)	
	Hz	Volts	Voltage range	MCA	MFA	kW	FLA	Cooling	Heating
FXCQ20AVEB	50	220-240	Max. 264 Min. 198	0.3	16	0.046	0.2	31	28
FXCQ25AVEB				0.3	16	0.046	0.2	39	35
FXCQ32AVEB				0.3	16	0.046	0.2	39	35
FXCQ40AVEB				0.3	16	0.046	0.2	41	37
FXCQ50AVEB				0.4	16	0.046	0.3	59	56
FXCQ63AVEB				0.5	16	0.106	0.4	63	60
FXCQ80AVEB				0.6	16	0.046 + 0.046	0.5	90	86
FXCQ125AVEB				1.1	16	0.106 + 0.106	0.9	149	146

SYMBOLS

MCA : Min. Circuit Amps (A)
MFA : Max. Fuse Amps (See note 5)
kW : Fan Motor Rated Output (kW)
FLA : Full Load Amps (A)
IFM : Indoor Fan Motor

NOTES

- Voltage range
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.
- Maximum allowable voltage unbalanced between phase is 2%
- MCA/MFA
MCA = 1.25 x FLA
MFA ≤ 4 x FLA (Next lower standard fuse rating. Min. 16A)
- Select wire size based on the MCA.
- Instead of fuse, use Circuit Breaker.

Minimum Ssc value	kVA	EN61000-3-2 is applied.
-------------------	-----	-------------------------

4D080163B

4 Safety device settings

4 - 1 Safety Device Settings

FXCQ-A

	Safety devices	20	25	32	40	50	63	80	125
FXCQ~A	PC board fuse	250V 3,15A	250V 3,15A	250V 3,15A	250V 3,15A	250 3,15A	250V 3,15A	250V 3,15A	250V 3,15A
	PC board fuse (Fan driver)	---	---	---	---	---	---	250V 5A 250V 6,3A	250V 5A 250V 6,3A
	Drain pump thermal fuse	°C	---	---	---	---	---	---	---
	Fan motor thermal fuse	°C	---	---	---	---	---	---	---
	Fan motor thermal protector	°C	---	---	---	---	---	---	---

3D080241A

5 Options

5 - 1 Options

5

FXCQ-A

Options

Options		Model							
Item		FXCQ20	FXCQ25	FXCQ32	FXCQ40	FXCQ50	FXCQ63	FXCQ80	FXCQ125
Decoration panel		BYBCQ40HW1				BYBCQ63HW1		BYBCQ125HW1	
Filter related	Filter chamber for bottom suction	KDDFP53B50				KDDFP53B80		KDDFP53B160	
	Long life replacement filter	KAFF531C50				KAFF531C80		KAFF531C160	

Control systems

Control systems			Model							
Item			FXCQ20	FXCQ25	FXCQ32	FXCQ40	FXCQ50	FXCQ63	FXCQ80	FXCQ125
Remote control	Wired		BRC1D528, BRC1E51A7, BRC1E52A7, BRC1E52B7, BRC1H52W, BRC1H52K, BRC1H52S, BRC1H182W, BRC1H82K, BRC1H82S							
	Infrared	H/P	BRC7CA52							
		C/O	BRC7CA57							
Simplified remote control (with operation mode selector button)			BRC2E52C7 (note 4)							
Simplified remote control (without operation mode selector button)			BRC3E52C7 (note 4)							
Central remote control			DCS302C51							
Unified on/off control			DCS301B51							
Schedule timer			DST301B51							
Wiring adapter for electrical appendices (1)			KRP2A51 *							
Wiring adapter for electrical appendices (2)			KRP4AA51 *							
External control adapter for outdoor unit (must be installed on indoor units).			DTA104A61 *							
Installation box for adapter PCB. (note 2)			KRP1C96 (note 2, note 3)							
Remote sensor			KRCS01-4B							
Electrical box with earth terminal (3 blocks)			KJB311A							
Electrical box with earth terminal (2 blocks)			KJB212A							
Noise filter (for electromagnetic interface use only)			KEK26-1A							
Digital input adapter			BRP7A51 * (note 5)							

NOTES

1. Installation box is necessary for each adapter marked (*).
2. Up to 2 adapters can be fixed for each installation box.
3. Only 1 installation box can be installed for each indoor unit.
4. Included languages are:
Language pack 1: English, German, French, Dutch, Spanish, Italian and Portuguese.
With PC cable EKPCAB3 in combination with the updater PC software, you can additionally change the language to:

Language pack 2: English, Bulgarian, Croatian, Czech, Hungarian, Romanian and Slovenian.
Language pack 3: English, Greek, Polish, Russian, Serbian, Slovak and Turkish.
5. Only possible in combination with simplified remote control BRC2/3E52C7.

3D080164B

6 Capacity tables

6 - 1 Cooling Capacity Tables

FXCQ-A

Cooling Capacity

TC: Total capacity; kW
SHC: Sensible heat capacity; kW

Unit size	Indoor air temp.													
	14.0 °CWB		16.0 °CWB		18.0 °CWB		19.0 °CWB		20.0 °CWB		22.0 °CWB		24.0 °CWB	
	20 °CDB		23 °CDB		26 °CDB		27 °CDB		28 °CDB		30 °CDB		32 °CDB	
	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC	TC	SHC
20	1.5	1.4	1.8	1.7	2.1	1.9	2.2	1.9	2.2	1.8	2.3	1.7	2.3	1.7
25	1.9	1.7	2.3	2.0	2.6	2.2	2.8	2.3	2.8	2.2	2.9	2.1	3.0	2.1
32	2.4	2.0	2.9	2.3	3.4	2.6	3.6	2.6	3.6	2.6	3.7	2.6	3.8	2.5
40	3.0	2.5	3.6	2.9	4.2	3.2	4.5	3.2	4.6	3.1	4.7	3.0	4.8	3.0
50	3.8	3.0	4.5	3.5	5.2	3.9	5.6	3.9	5.7	3.8	5.8	3.6	5.9	3.1
63	4.8	3.9	5.7	4.9	6.6	5.0	7.1	5.0	7.2	5.4	7.4	5.3	7.5	5.9
80	6.1	4.9	7.2	5.7	8.4	6.3	9.0	6.5	9.1	6.3	9.3	6.1	9.5	6.1
125	9.4	7.5	11.3	8.7	13.1	9.7	14.0	9.9	14.2	9.8	14.5	9.5	14.9	9.1

NOTES - OPMERKINGEN - REMARQUES - ANMERKUNGEN - NOTAS - NOTE - ΣΗΜΕΙΩΣΕΙΣ - NOTLAR - ПРИМЕЧАНИЯ

- This table is for the selection of indoor equipment.
 - Deze tabel is bedoeld voor het kiezen van de binnenunit.
 - Ce tableau concerne la sélection de l'équipement intérieur.
 - Diese Tabelle ist für die Auswahl der Innenanlagen.
 - Esta tabla es para seleccionar el equipo interior.
 - Usare questa tabella per la selezione delle apparecchiature interne.
 - Αυτός ο πίνακας προορίζεται για την επιλογή εσωτερικού εξοπλισμού.
 - Bu tablo iç ünite ekipmanlarının seçimine yöneliktir.
 - Эта таблица предназначена для выбора устанавливаемого в помещении оборудования.
- In the event that conditions differ due to the design requirements after system selection, actual operating ability of the indoor equipment will differ from that noted in the table because of changes in the outdoor air temperature and load factor.
 - Als nadat u het systeem hebt gekozen de voorwaarden afwijken van de ontwerpvereisten, dan zal het reële bedrijfsvermogen van de binnenunit afwijken van de in de tabel vermelde gegevens, wegens de afwijkende buitenluchttemperatuur en de belastingsfactor.
 - Si les exigences de conception après la sélection du système entraînent une modification des conditions, les capacités opérationnelles réelles de l'équipement intérieur diffèrent de celles indiquées dans le tableau en raison de la modification de la température de l'air extérieure et du facteur de charge.
 - Falls Bedingungen aufgrund der Konstruktionsanforderungen nach der Systemauswahl abweichen, dann weicht aufgrund der Änderungen der Außenlufttemperatur und des Lastfaktors die tatsächliche Betriebsfähigkeit der Innenanlage von der in der Tabelle aufgeführten ab.
 - En caso de que las condiciones difieran debido a los requisitos de diseño tras seleccionar el sistema, la capacidad de funcionamiento real del equipo interior diferirá de la que se muestra en la tabla debido a los cambios de la temperatura de aire exterior y al factor de carga.
 - Nel caso in cui intervenissero dei cambiamenti nelle condizioni dovuti a requisiti di progettazione successivi alla selezione del sistema, la capacità operativa delle apparecchiature interne sarà diversa da quella indicata in tabella a causa della diversa temperatura dell'aria esterna e del fattore di carico.
 - Στην περίπτωση που οι συνθήκες διαφέρουν λόγω των απαιτήσεων σχεδιασμού μετά την επιλογή συστήματος, η πραγματική δυνατότητα του εσωτερικού εξοπλισμού θα διαφέρει από την αναφερόμενη στον πίνακα, λόγω των αλλαγών στην εξωτερική θερμοκρασία αέρα και στο συντελεστή φορτίου.
 - Sistem seçiminden sonra tasarım gerekleri nedeniyle koşulların değişmesi durumunda, dış hava sıcaklığı ve yük faktöründeki değişiklikler nedeniyle iç ekipmanın gerçek çalışma kapasitesi tabloda belirtilenden farklı olacaktır.
 - В случае, если реальные условия отличаются от проектных условий работы, используемых при выборе системы, фактические характеристики устанавливаемого в помещении оборудования будут отличаться от указанных в таблице вследствие изменения температуры воздуха снаружи и показателя нагрузки.
- In this case, use the ability table for the indoor equipment selected and correct for the ratio of change in ability.
 - Gebruik in dat geval de vermogenstabel van de gekozen binneninstallatie en kies het juiste vermogen.
 - Le cas échéant, utiliser le tableau de capacité de l'équipement intérieur sélectionner et corriger le rapport de modification de capacité.
 - Verwenden Sie in diesem Fall die Fähigkeit für die ausgewählte Innenanlage und korrigieren Sie das Verhältnis der Änderung in der Fähigkeit.
 - En este caso, utilice la tabla de capacidades del equipo interior seleccionado y corrija la relación de cambio en capacidad.
 - In questo caso, usare la tabella delle capacità per le apparecchiature interne selezionate ed apportare le modifiche del caso in base alla percentuale di cambiamento di capacità.
 - Σε αυτή την περίπτωση χρησιμοποιήστε τον πίνακα δυνατοτήτων για τον επιλεγμένο εσωτερικό εξοπλισμό και διορθώστε για την αναλογία αλλαγής στη δυνατότητα.
 - Bu durumda, seçilen iç ekipman için kapasite tablosunu kullanın ve kapasitedeki değişim oranına göre düzeltme yapın.
 - В этом случае используйте таблицу характеристик выбранного устанавливаемого в помещении оборудования и внесите необходимую поправку на их изменение.

6 Capacity tables

6 - 2 Heating Capacity Tables

FXCQ-A

Heating Capacity

Unit size	Indoor air temp. °CDB					
	16.0	18.0	20.0	21.0	22.0	24.0
	kW	kW	kW	kW	kW	kW
20	2.6	2.6	2.5	2.4	2.3	2.2
25	3.4	3.4	3.2	3.1	3.0	2.8
32	4.2	4.2	4.0	3.9	3.7	3.5
40	5.2	5.2	5.0	4.8	4.7	4.4
50	6.6	6.6	6.3	6.1	5.9	5.5
63	8.4	8.4	8.0	7.7	7.5	7.0
80	10.5	10.5	10.0	9.7	9.4	8.7
125	16.8	16.8	16.0	15.5	15.0	13.9


NOTES - OPMERKINGEN - REMARQUES - ANMERKUNGEN - NOTAS - NOTE - ΣΗΜΕΙΩΣΕΙΣ - NOTLAR - ПРИМЕЧАНИЯ

- This table is for the selection of indoor equipment.
 - Deze tabel is bedoeld voor het kiezen van de binnenunit.
 - Ce tableau concerne la sélection de l'équipement intérieur.
 - Diese Tabelle ist für die Auswahl der Innenanlagen.
 - Esta tabla es para seleccionar el equipo interior.
 - Usare questa tabella per la selezione delle apparecchiature interne.
 - Αυτός ο πίνακας προορίζεται για την επιλογή εσωτερικού εξοπλισμού.
 - Bu tablo iç ünite ekipmanlarının seçimine yöneliktir.
 - Эта таблица предназначена для выбора устанавливаемого в помещении оборудования.
- In the event that conditions differ due to the design requirements after system selection, actual operating ability of the indoor equipment will differ from that noted in the table because of changes in the outdoor air temperature and load factor.
 - Als nadat u het systeem hebt gekozen de voorwaarden afwijken van de ontwerpvereisten, dan zal het reële bedrijfsvermogen van de binnenunit afwijken van de in de tabel vermelde gegevens, wegens de afwijkende buitenluchttemperatuur en de belastingsfactor.
 - Si les exigences de conception après la sélection du système entraînent une modification des conditions, les capacités opérationnelles réelles de l'équipement intérieur diffèrent de celles indiquées dans le tableau en raison de la modification de la température de l'air extérieure et du facteur de charge.
 - Falls Bedingungen aufgrund der Konstruktionsanforderungen nach der Systemauswahl abweichen, dann weicht aufgrund der Änderungen der Außenlufttemperatur und des Lastfaktors die tatsächliche Betriebsfähigkeit der Innenanlage von der in der Tabelle aufgeführten ab.
 - En caso de que las condiciones difieran debido a los requisitos de diseño tras seleccionar el sistema, la capacidad de funcionamiento real del equipo interior diferirá de la que se muestra en la tabla debido a los cambios de la temperatura de aire exterior y al factor de carga.
 - Nel caso in cui intervenissero dei cambiamenti nelle condizioni dovuti a requisiti di progettazione successivi alla selezione del sistema, la capacità operativa effettiva delle apparecchiature interne sarà diversa da quella indicata in tabella a causa della diversa temperatura dell'aria esterna e del fattore di carico.
 - Στην περίπτωση που οι συνθήκες διαφέρουν λόγω των απαιτήσεων σχεδιασμού μετά την επιλογή συστήματος, η πραγματική δυνατότητα του εσωτερικού εξοπλισμού θα διαφέρει από την αναφερόμενη στον πίνακα, λόγω των αλλαγών στην εξωτερική θερμοκρασία αέρα και στο συντελεστή φορτίου.
 - Sistem seçiminden sonra tasarım gerekleri nedeniyle koşulların değişmesi durumunda, dış hava sıcaklığı ve yük faktöründeki değişiklikler nedeniyle iç ekipmanın gerçek çalışma kapasitesi tabloda belirtilenden farklı olacaktır.
 - В случае, если реальные условия отличаются от проектных условий работы, используемых при выборе системы, фактические характеристики устанавливаемого в помещении оборудования будут отличаться от указанных в таблице вследствие изменения температуры воздуха снаружи и показателя нагрузки.
- In this case, use the ability table for the indoor equipment selected and correct for the ratio of change in ability.
 - Gebruik in dat geval de vermogenstabel van de gekozen binneninstallatie en kies het juiste vermogen.
 - Le cas échéant, utiliser le tableau de capacité de l'équipement intérieur sélectionner et corriger le rapport de modification de capacité.
 - Verwenden Sie in diesem Fall die Fähigkeit für die ausgewählte Innenanlage und korrigieren Sie das Verhältnis der Änderung in der Fähigkeit.
 - En este caso, utilice la tabla de capacidades del equipo interior seleccionado y corrija la relación de cambio en capacidad.
 - In questo caso, usare la tabella delle capacità per le apparecchiature interne selezionate ed apportare le modifiche del caso in base alla percentuale di cambiamento di capacità.
 - Σε αυτή την περίπτωση χρησιμοποιήστε τον πίνακα δυνατοτήτων για τον επιλεγμένο εσωτερικό εξοπλισμό και διορθώστε για την αναλογία αλλαγής στη δυνατότητα.
 - Bu durumda, seçilen iç ekipman için kapasite tablosunu kullanın ve kapasitedeki değişim oranına göre düzeltme yapın.
 - В этом случае используйте таблицу характеристик выбранного устанавливаемого в помещении оборудования и внесите необходимую поправку на их изменение.


7 Dimensional drawings

7 - 1 Dimensional Drawings

FXCQ20-40A

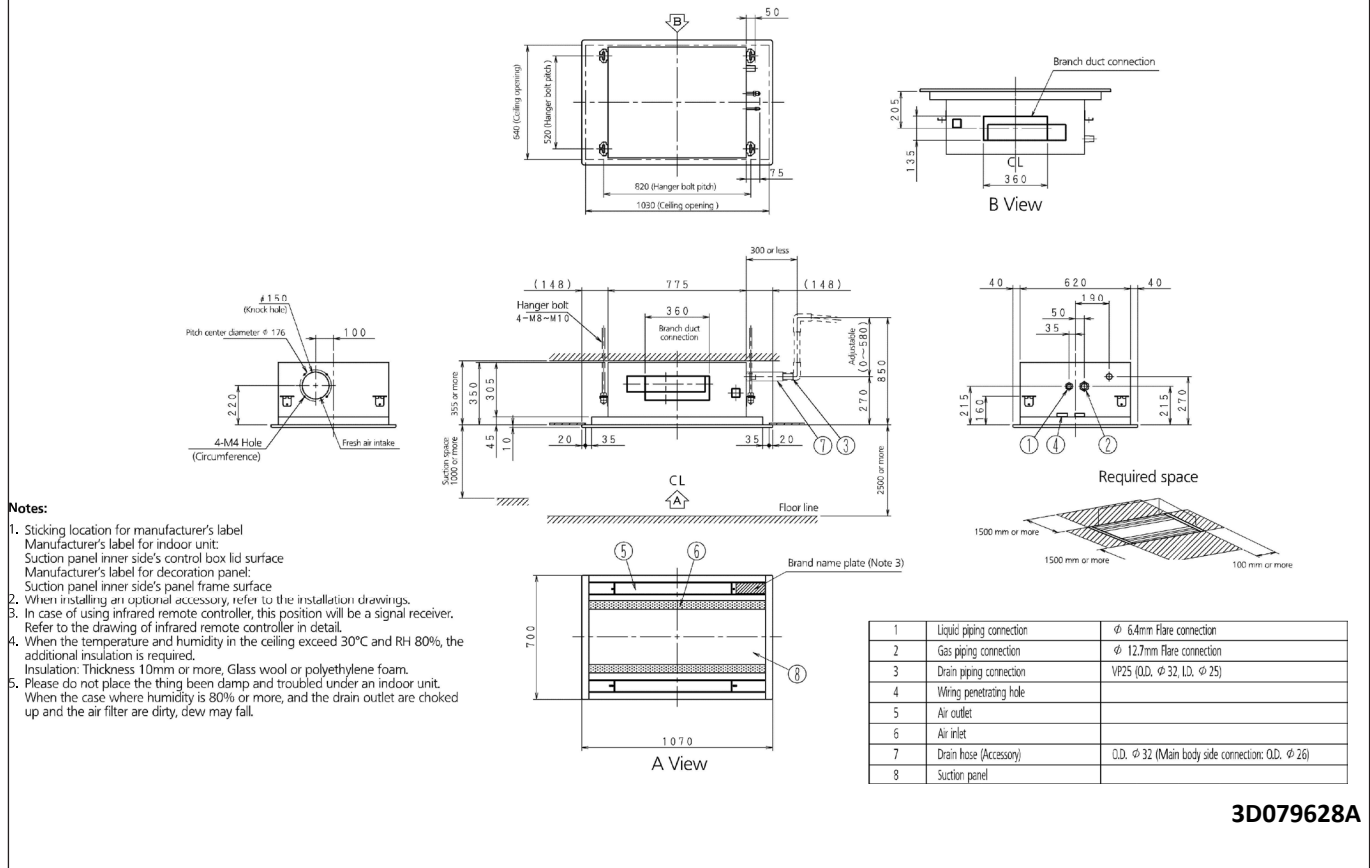


FXCQ50A

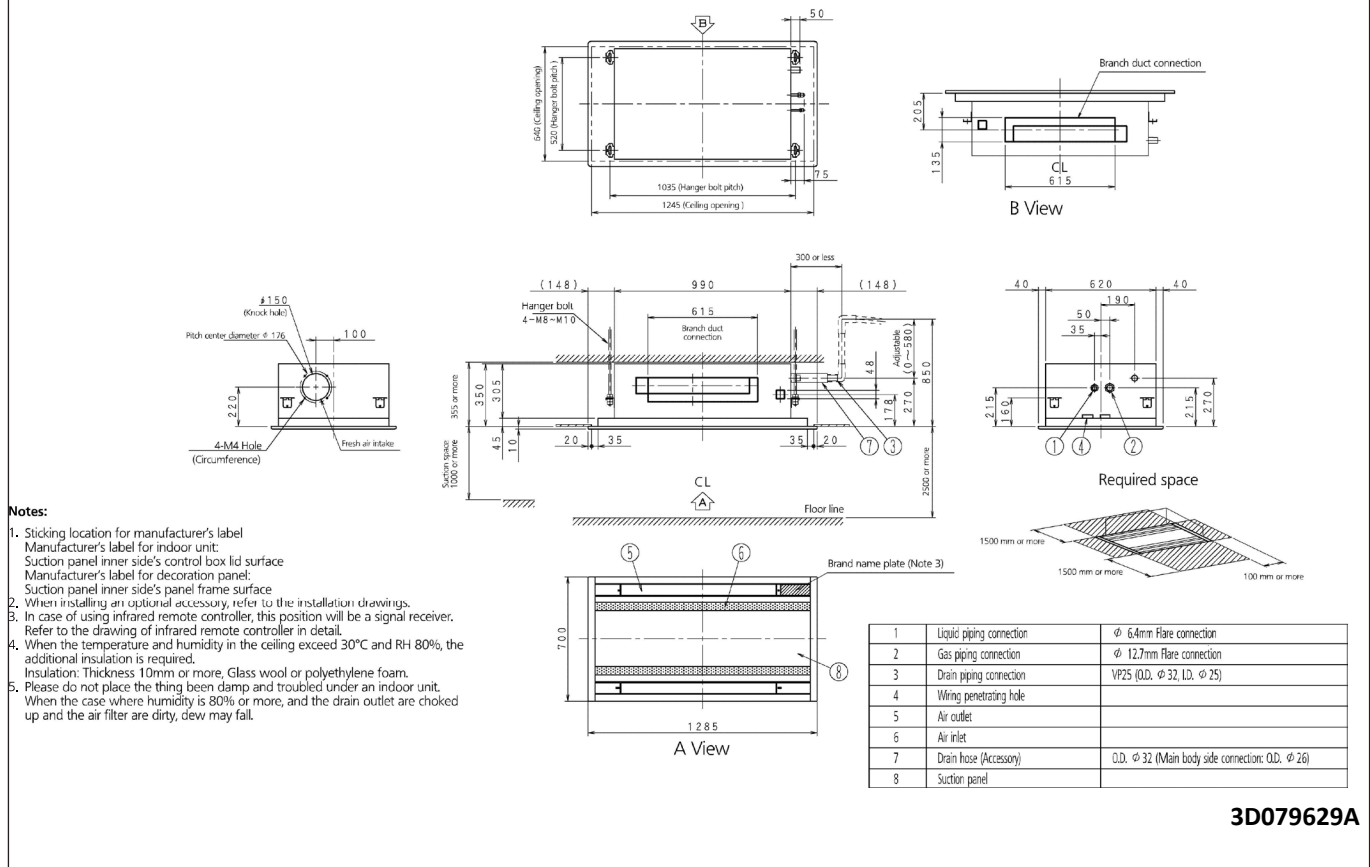


7 Dimensional drawings

7 - 1 Dimensional Drawings

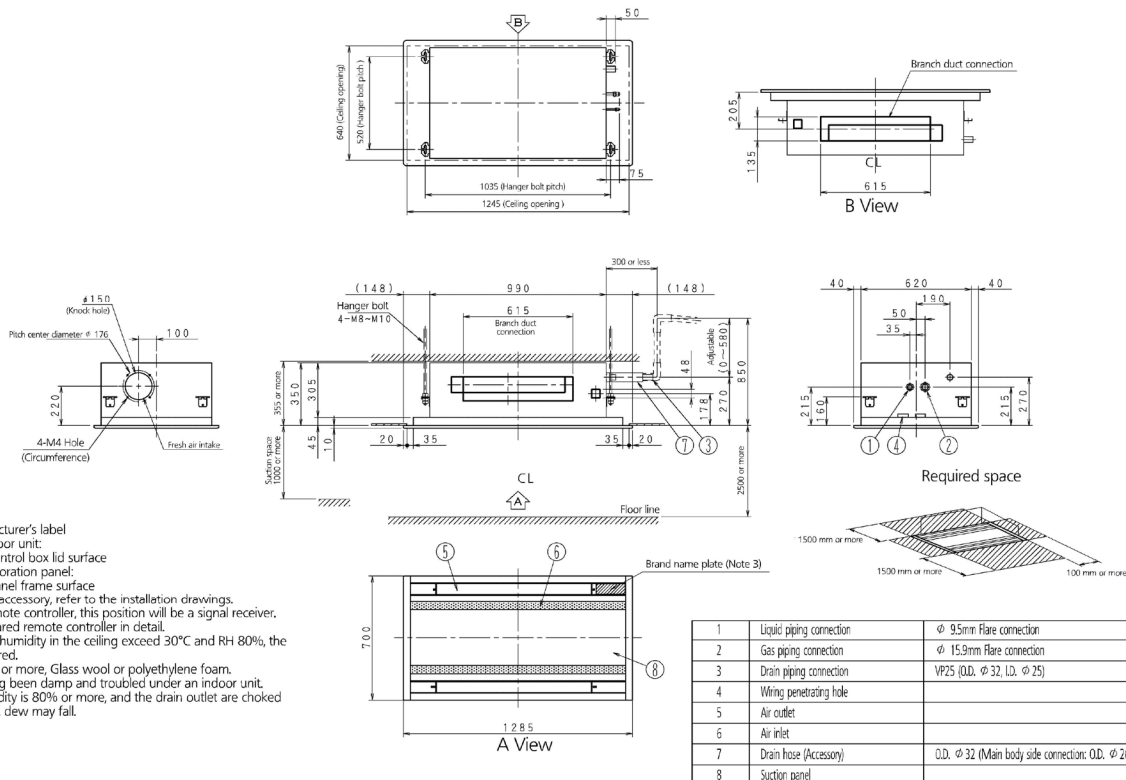FXCQ63A

3D079630A



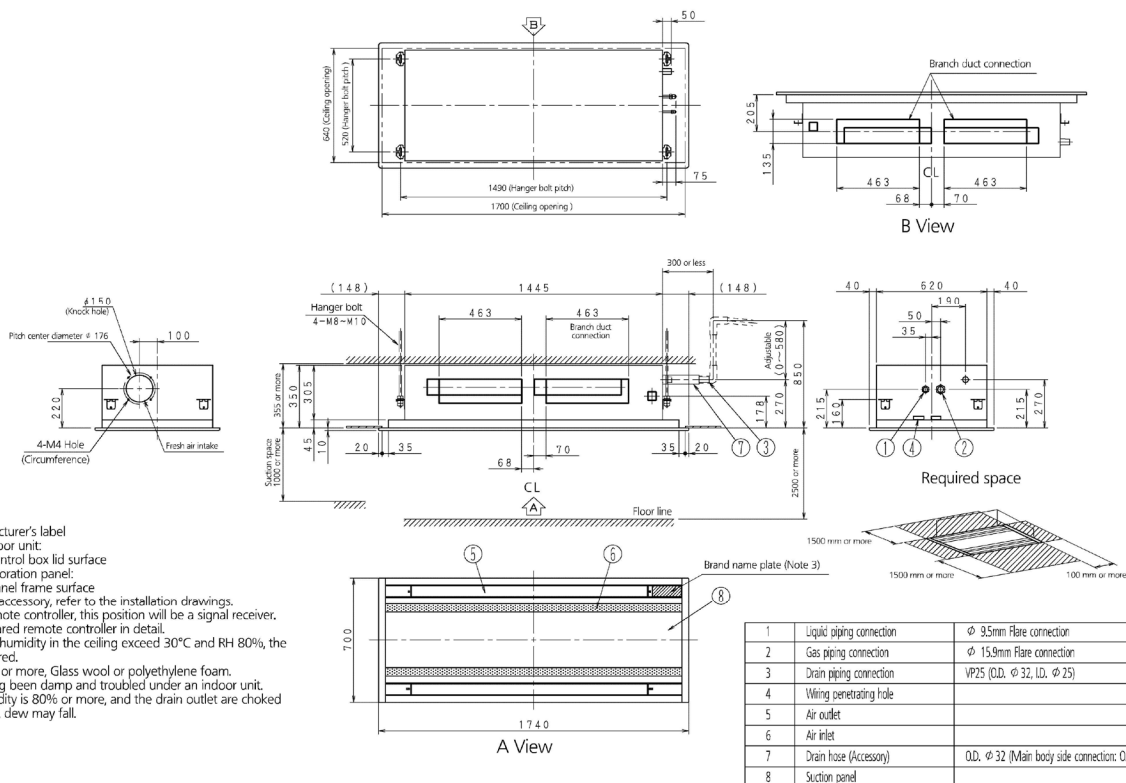
FXCQ80-125A

3D079631A

8 Centre of gravity

8 - 1 Centre of Gravity

FXCQ-A

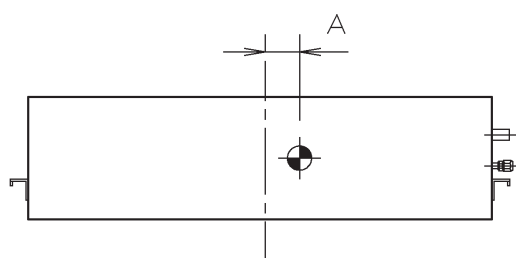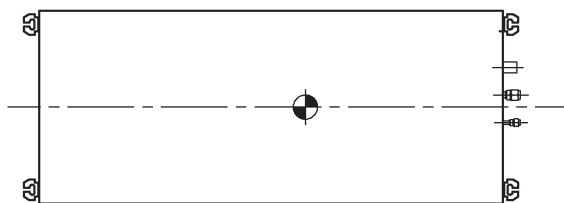


Model	A	B
FXCQ20•25•32•40A	30	120
FXCQ50•63A	40	120
FXCQ80•125A	15	110

4D080138A

9 Piping diagrams

9 - 1 Piping Diagrams

FXCQ-A

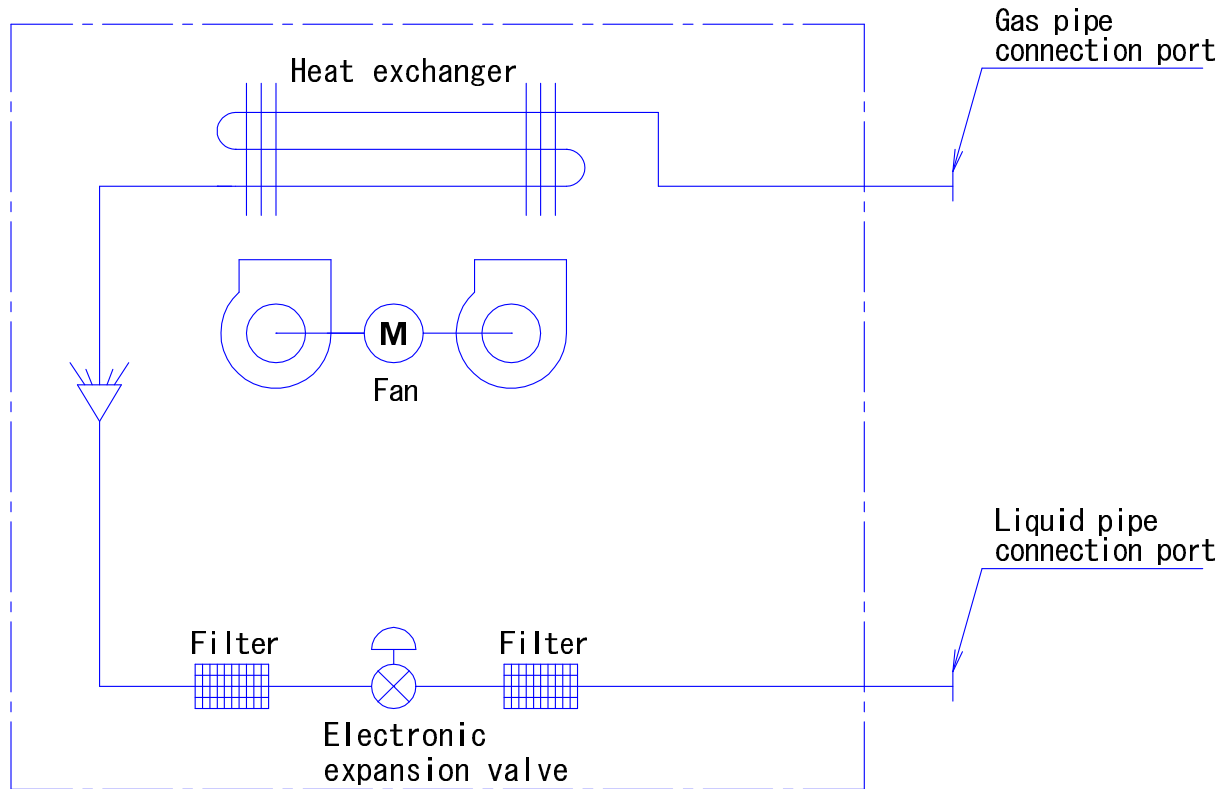

APPLICABLE MODEL

FXC, FXM, FXL, FXN
 FXH, FXK, FXS, FJSP
 CBXLS, FXSP, FXCP
 FZSP, FXNP, FJNP
 FHQ, FXA, FXMQ, FBQ
 FXAQ, FXSP~BA, FAQ, FCQ
 FZSP~BA (N), FSSP~BA,
 FQSP~BAN, FXUQ, FZCP, FZAP
 FXSQ~PV2S, FXSQ~T, FXSP~CA (N)
 FZSP~CA (N), FQSP~CAN
 FSSP~CA, FXSFP~AA, FSSFP~AA
 FXHQ

4D034245S

10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase

FXCQ-A

Wiring diagram

Indoor unit	
A1P-A2P	Printed circuit board
C105-C1	Capacitor
F1U	Fuse (T, 3.15A, 250V)
F2U	Fuse (T, 5A, 250V)
F4U	Fuse (T, 6.3A, 250V)
HAP	Flashing lamp (A1P, A2P) (service monitor green)
L1R	Reactor
M1F-M2F	Motor (indoor fan)
M1P	Motor (drain pump)
M1S-M2S	Motor (swing blade)
PS	Power supply circuit (A1P, A2P)
R1T	Thermistor (air)
R2T-R3T	Thermistor (coil)
S1L	Float switch
V1R	Diode bridge
X1M-X2M	Terminal block
Y1E	Electronic expansion valve
Z1C	Ferrite core
Z2C	Ferrite core
Z3C	Ferrite core
Z1F	Noise filter (A1P, A2P)
Wireless remote controller (Receiver/display unit)	
A3P-A4P	Printed circuit board
BS1	Push button switch (ON/OFF)
H1P	Pilot lamp (on-red)
H2P	Pilot lamp (timer-green)
H3P	Pilot lamp (filter sign-red)
H4P	Pilot lamp (defrost-orange)
SS1	Selector switch (main/sub)
SS2	Selector switch (wireless address set)
Connector for optional parts	
X24A	Connector (wireless remote controller)
X35A	Connector (power supply for adaptor)

NOTES


- : terminal block, ○○, □: connector, ---: field wiring
- In case using central remote controller, connect it to the unit in accordance with the attached installation manual.
- When connecting the input wiring from outside, forced off or on/off control operation can be selected by the remote controller, see installation manual for more details.
- In case of main/sub overcharge, see the installation manual attached to remote controller.
- Shows only in case of protected piping. Use H07RN-F in case of no protection.
- Symbols show as follows:
RED: red, BLK: black, WHT: white, YLW: yellow, GRN: green, ORG: orange, BRN: brown, PNK: pink, BLU: blue.

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ20A

11

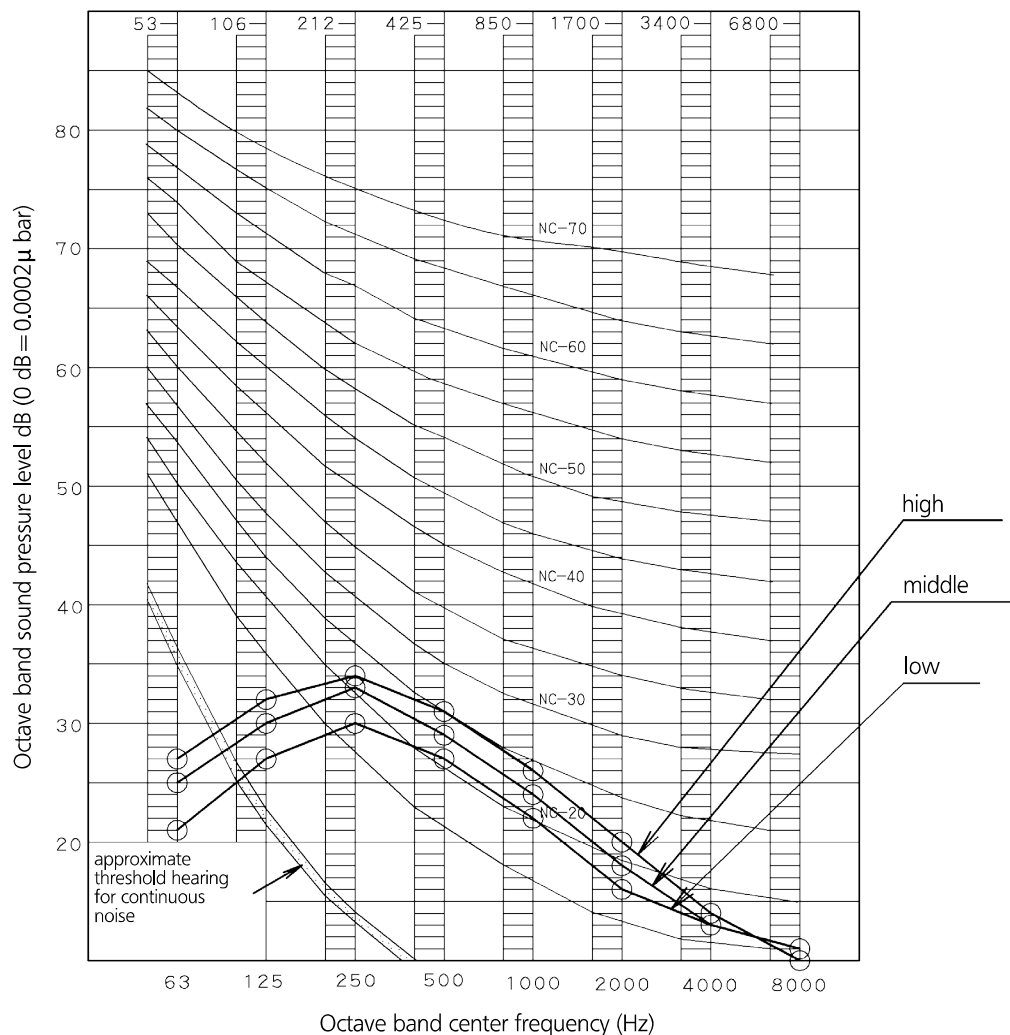


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	32.0	30.0	28.0
C	38.3	36.3	33.9

(B, C, N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080154A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ25A

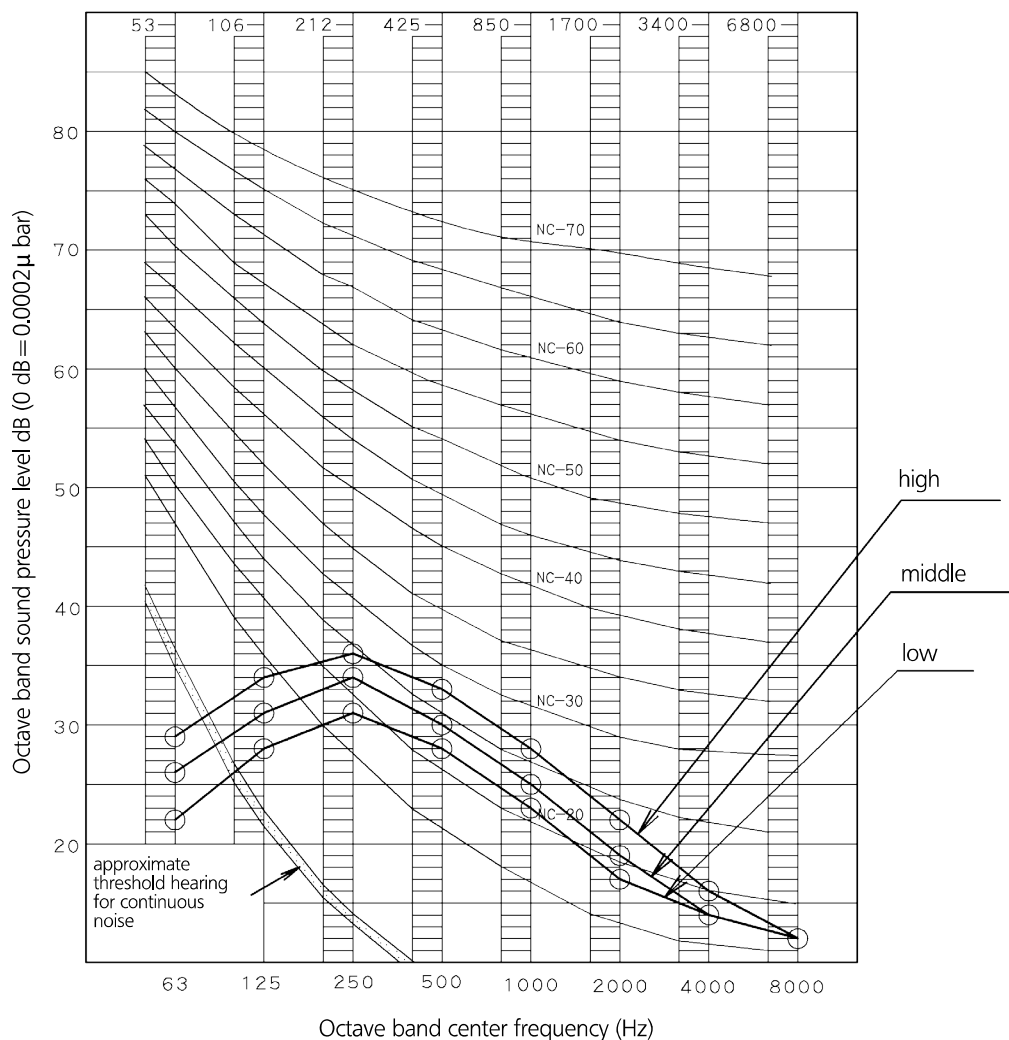


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	34,0	31,0	29,0
C	40,3	37,3	34,9

(B,G,N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080155A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ32A

11

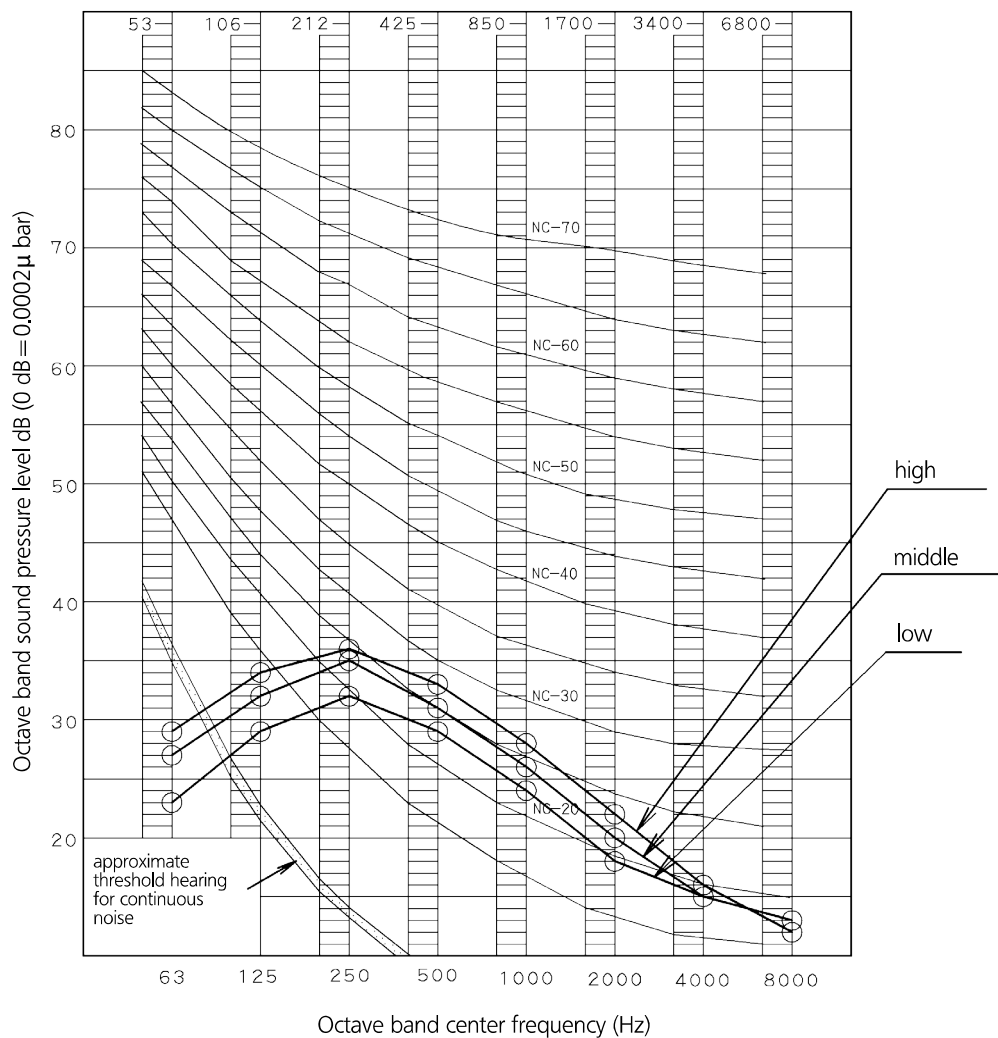


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	34.0	32.0	30.0
C	40.3	38.3	35.9

(B,G,N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080156A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ40A

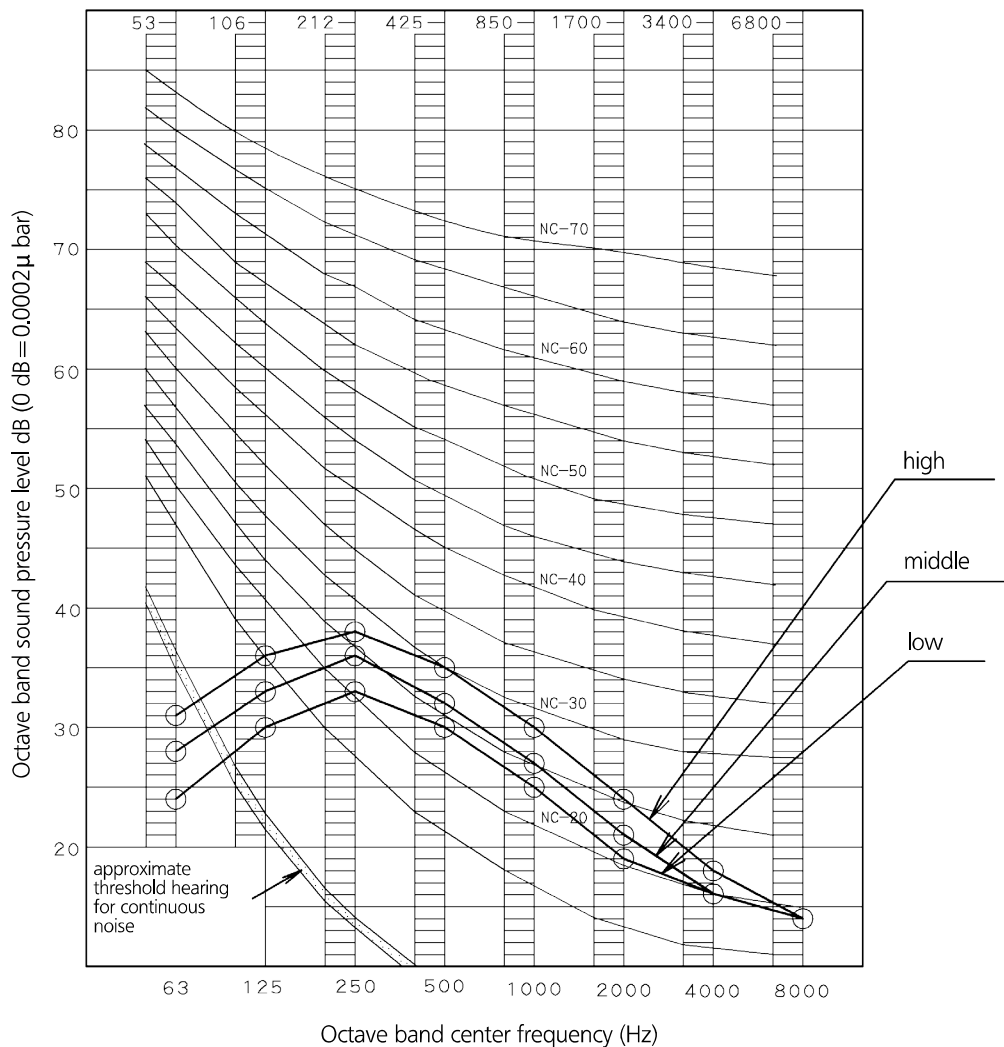


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	36.0	33.0	31.0
C	42.3	39.3	36.9

(B,G,N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080157A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ50A

11

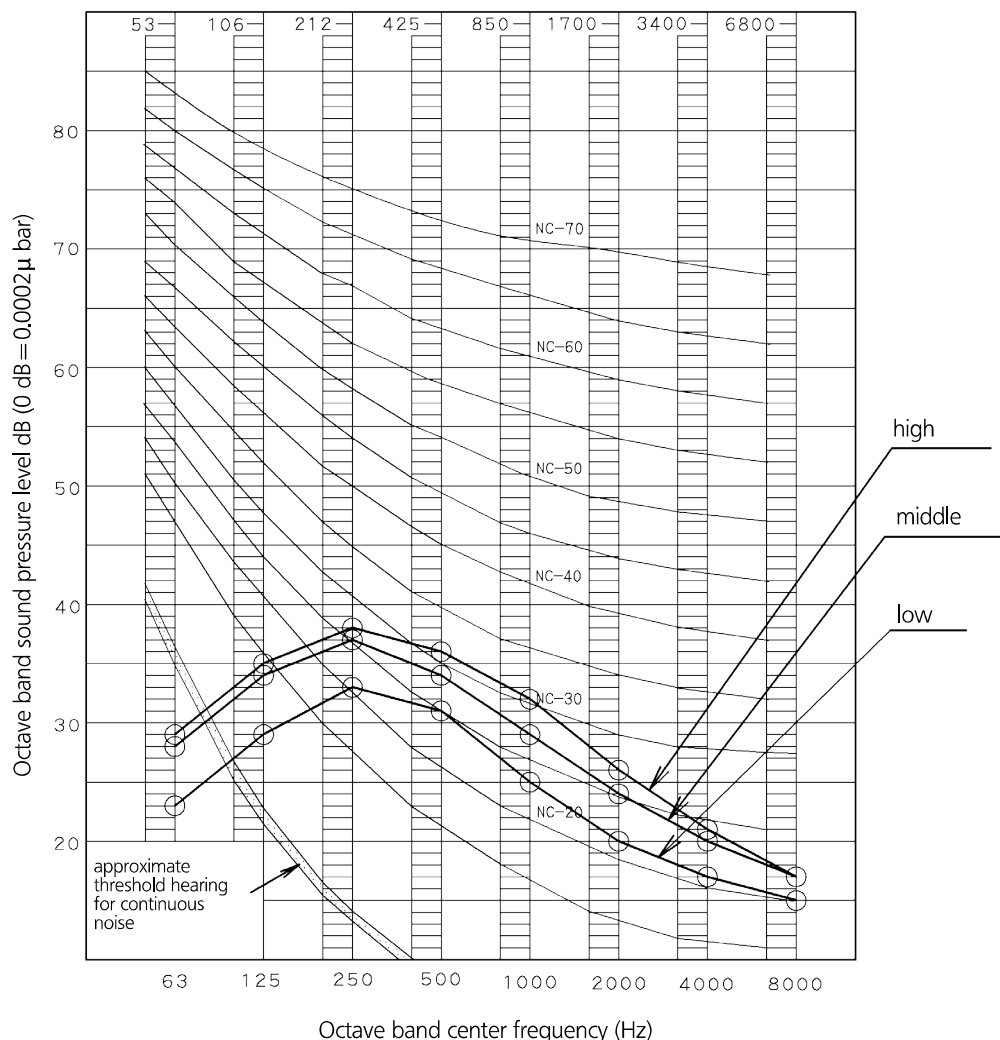


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	37.0	35.0	31.0
C	42.3	40.9	36.5

(B,G,N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080158A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ63A

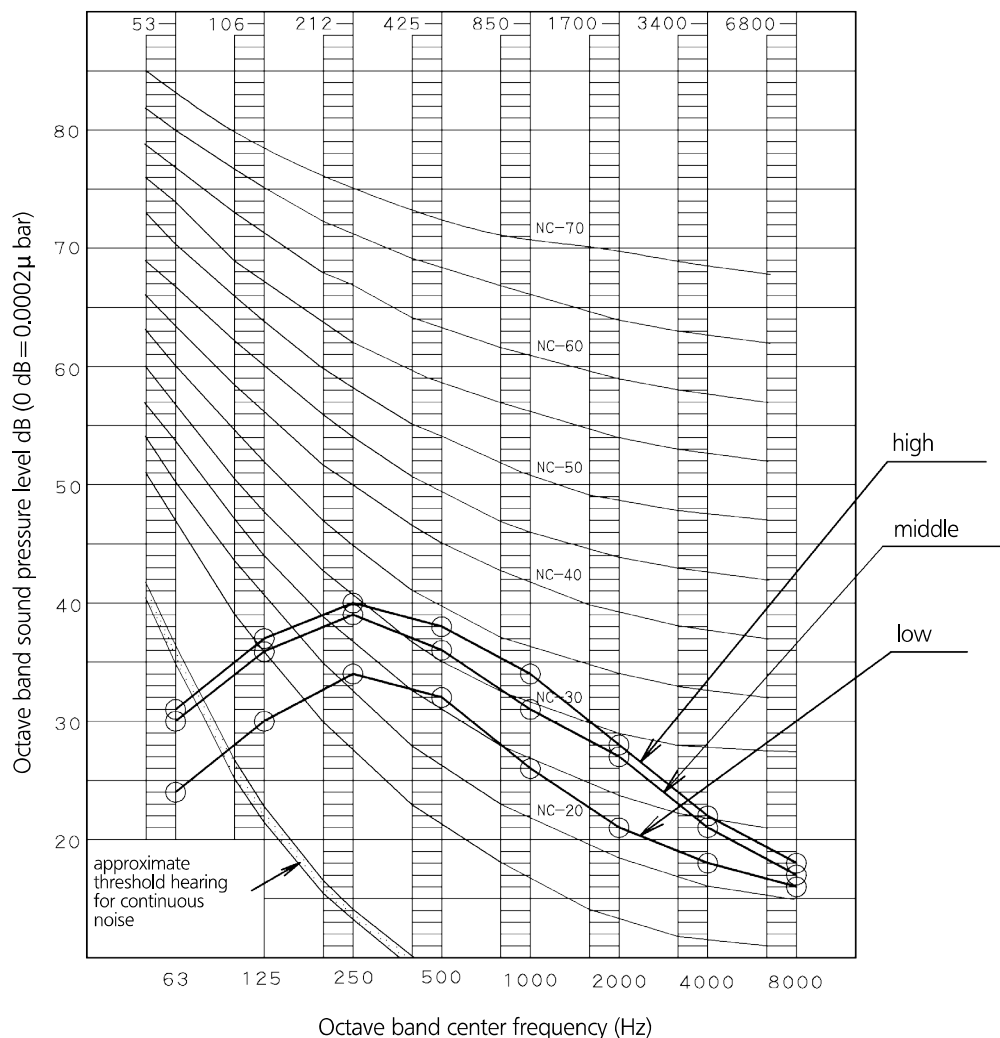


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	39.0	37.0	32.0
C	44.3	42.9	37.6

(B.G.N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080159A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ80A

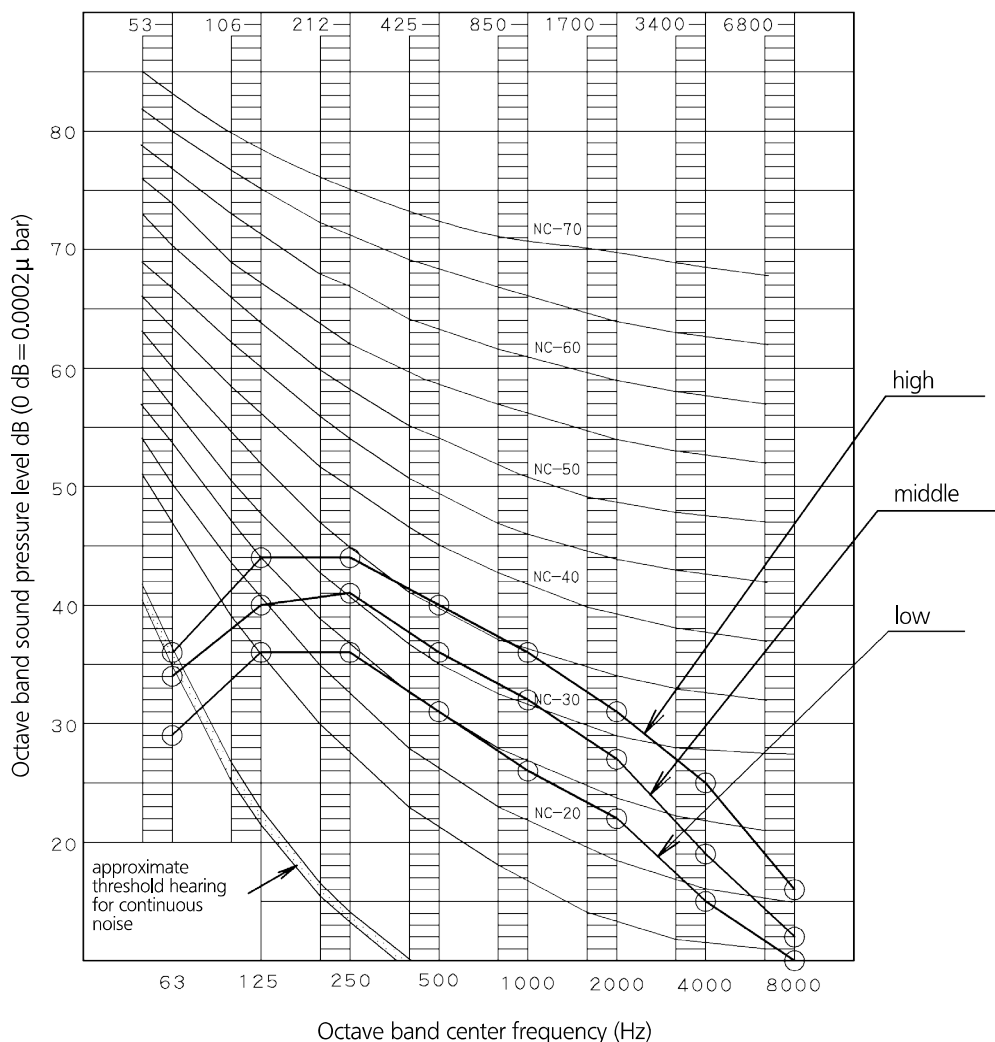


NOTES

1 Overall (dB)

Scale	Mode		
	high	middle	low
A	42.0	38.0	33.0
C	48.5	44.8	40.2

(B, G, N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone




4D080160A

11 Sound data

11 - 1 Sound Pressure Spectrum

FXCQ125A

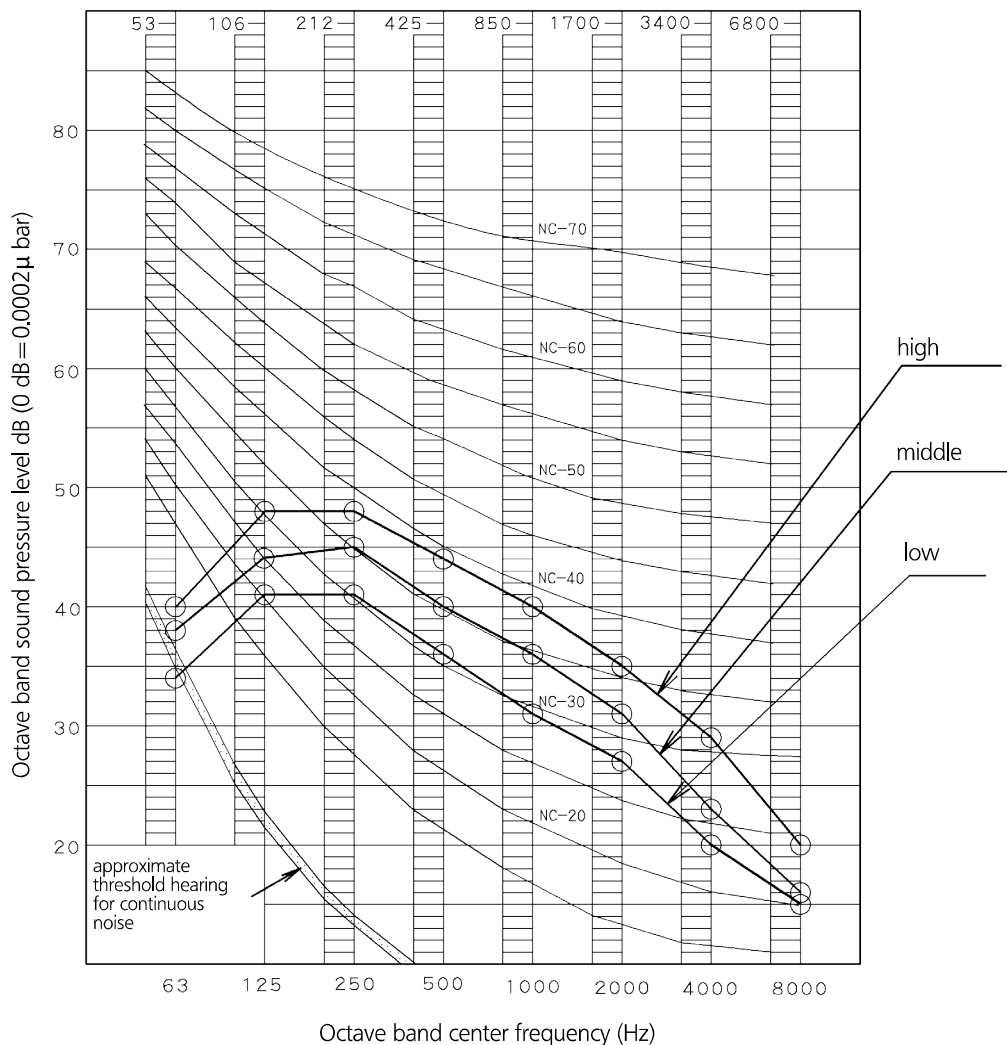


NOTES

1 Overall (dB)


Scale	Mode		
	high	middle	low
A	46.0	42.0	38.0
C	52.5	48.8	45.2

(B.G.N is already rectified)

- Measuring place: Anechoic chamber
- Operation noise differs with operation and ambient conditions.
- Operating conditions: Power source: 220-240V 50Hz
- Cooling: Return air temperature: 27°CDB, 19°CWB
Outdoor temperature: 35°CDB, 24°CWB
- Heating: Return air temperature: 20°CDB, 15°CWB
Outdoor temperature: 7°CDB, 6°CWB
- Location of microphone



4D080161A



EEDEN23

02/2023



The present publication is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. / Daikin Central Europe HandelsGmbH. Daikin Europe N.V. / Daikin Central Europe HandelsGmbH have compiled the content of this publication to the best of their knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. / Daikin Central Europe HandelsGmbH explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Europe N.V.