

Wall Mounted

1 Specifications	4
2 Dimensions	7
3 Unit Placement	8
4 Piping Diagram.....	9
5 Wiring Diagram	10
6 Capacity Tables.....	13
7 Electrical Characteristics.....	23
8 Sound Levels	24
9 Temperature and Airflow Distributions	26

1 Specifications

Table 1.1:MI2-17(22,28)GDN1 specifications

Model			MI2-17GDN1	MI2-22GDN1	MI2-28GDN1
Power supply			1 phase, 220-240V, 50Hz		
Cooling ¹	Capacity	kW	1.7	2.2	2.8
		kBtu/h	5.8	7.5	9.6
	Power input	W	28	28	28
Heating ²	Capacity	kW	2.2	2.4	3.2
		kBtu/h	7.5	8.2	10.9
	Power input	W	28	28	28
Fan motor	Model		ZKFP-20-8-6	ZKFP-20-8-6	ZKFP-20-8-6
	Type		DC		
Indoor coil	Number of rows		1	1	2
	Tube pitch × row pitch	mm	21x13.37		
	Fin spacing	mm	1.3		
	Fin type		Hydrophilic aluminum		
	Tube OD and type	mm	Φ9.53 Inner-groove		
	Dimensions (L×H×W)	mm	585×315×13.37	585×315×13.37	585×315×26.74
	Number of circuits		2	2	3
Air flow rate ³		m ³ /h	411/402/393/385/378/36 8/356	422/411/402/393/380/36 8/356	417/402/386/370/353/3 38/316
Sound pressure level ⁴		dB(A)	31/30/30/30/29/29/29	31/30/30/30/29/29/29	31/30/30/30/29/29/29
Sound power level		dB(A)	46/45/45/45/44/44/44	46/45/45/45/44/44/44	46/45/45/45/44/44/44
Unit	Net dimensions ⁵ (WxHxD)	mm	835×280×203	835×280×203	
	Packed dimensions (WxHxD)	mm	915×353×300	915×353×300	
	Net/Gross weight	kg	8.4/10.9	8.4/10.9	9.5/11.9
Refrigerant type			R410A		
Throttle		Type	Electronic expansion valve		
Design pressure (H/L)		MPa	4.4/2.6		
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/Φ12.7		
	Drain pipe	mm	OD Φ16		

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured in a semi-anechoic chamber.
5. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

MI2-36GDN1/ MI2-45GDN1/ MI2-56GDN1

Table 1.1: MI2-36(45,56)GDN1 specifications

Model			MI2-36GDN1	MI2-45GDN1	MI2-56GDN1		
Power supply			1 phase, 220-240V, 50Hz				
Cooling ¹	Capacity	kW	3.6	4.5	5.6		
		kBtu/h	12.3	15.4	19.1		
	Power input	W	30	40	45		
Heating ²	Capacity	kW	4	5	6.3		
		kBtu/h	13.6	17.1	21.5		
	Power input	W	30	40	45		
Fan motor	Model		ZKSP-58-8-1	ZKSP-58-8-1	ZKSP-58-8-1		
	Type		DC				
Indoor coil	Number of rows		1	2	2		
	Tube pitch × row pitch	mm	21×13.37				
	Fin spacing	mm	1.3		1.3		
	Fin type		Hydrophilic aluminum				
	Tube OD and type	mm	Φ9.53 Inner-groove				
	Dimensions (L×H×W)	mm	701×315×13.37	701×315×26.74	701×315×26.74		
	Number of circuits		3	5	5		
Air flow rate ³		m ³ /h	656/628/591/573/544/51 5/488	594/563/535/507/478/45 0/424	747/713/685/648/613/5 78/547		
Sound pressure level ⁴		dB(A)	33/32/32/31/31/30/30	35/34/33/33/32/31/31	38/37/36/36/35/34/34		
Sound power level		dB(A)	48/47/47/46/46/45/45	50/49/48/48/47/46/46	53/52/51/51/50/49/49		
Unit	Net dimensions ⁵ (WxHxD)	mm	990×315×223				
	Packed dimensions (WxHxD)	mm	1075×395×300				
	Net/Gross weight	kg	11.4/14.0	12.8/15.4			
Refrigerant type			R410A				
Throttle		Type	Electronic expansion valve				
Design pressure (H/L)		MPa	4.4/2.6				
Pipe connections	Liquid/Gas pipe	mm	Φ6.35/Φ12.7		Φ9.53/Φ15.9		
	Drain pipe	mm	OD Φ16				

Notes:

1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured in a semi-anechoic chamber.
5. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

The 2nd Generation DC Series VRF Indoor Units



MI2-71GDN1/ MI2-80GDN1/ MI2-90GDN1

Table 1.2: MI2-71(80,90)GDN1 specifications

Model			MI2-71GDN1	MI2-80GDN1	MI2-90GDN1
Power supply			1 phase, 220-240V, 50Hz		
Cooling ¹	Capacity	kW	7.1	8	9
		kBtu/h	24.2	27.3	30.7
	Power input	W	55	55	82
Heating ²	Capacity	kW	8	9	10
		kBtu/h	27.3	30.7	34.1
	Power input	W	55	55	82
Fan motor	Model		ZKSP-60-8-3	ZKSP-60-8-3	ZKSP-60-8-3
	Type		DC		
Indoor coil	Number of rows		2		
	Tube pitch × row pitch	mm	21×13.37		
	Fin spacing	mm	1.3		
	Fin type		Hydrophilic aluminum		
	Tube OD and type	mm	Φ9.53 Inner-groove		
	Dimensions (L×H×W)	mm	825×399×26.74	825×399×26.74	825×399×26.74
	Number of circuits		5		
Air flow rate ³		m ³ /h	1195/1130/1065/1005/ 940/875/809	1195/1130/1065/1005/ 940/875/809	1421/1300/1125/1067/ 1005/934/867
Sound pressure level ⁴		dB(A)	44/43/42/39/38/37/36	44/43/42/39/38/37/36	48/46/45/43/41/40/38
Sound power level		dB(A)	59/58/57/54/53/52/51	59/58/57/54/53/52/51	63/61/60/58/56/55/53
Unit	Net dimensions ⁵ (WxHxD)	mm	1194×343×262		
	Packed dimensions (WxHxD)	mm	1265×420×345		
	Net/Gross weight	kg	17.0/20.4		
Refrigerant type			R410A		
Throttle		Type	Electronic expansion valve		
Design pressure (H/L)		MPa	4.4/2.6		
Pipe connections	Liquid/Gas pipe	mm	Φ9.53/Φ15.9		
	Drain pipe	mm	OD Φ16		

Notes:


1. Indoor temperature 27°C DB, 19°C WB; outdoor temperature 35°C DB; equivalent refrigerant piping length 7.5m with zero level difference.
2. Indoor temperature 20°C DB; outdoor temperature 7°C DB, 6°C WB; equivalent refrigerant piping length 7.5m with zero level difference.
3. Fan motor speed and air flow rate are from the highest speed to the lowest speed, total 7 rates for each model.
4. Sound pressure level is from highest level to lowest level, total 7 levels for each model. Sound pressure level is measured in a semi-anechoic chamber.
5. Unit body dimensions given are the largest external dimensions of the unit, including hanger attachments.

2 Dimensions


2.1 Unit Dimensions

Figure 2.1: Wall mounted dimensions (unit: mm)


MI2-17GDN1, MI2-22GDN1, MI2-28GDN1

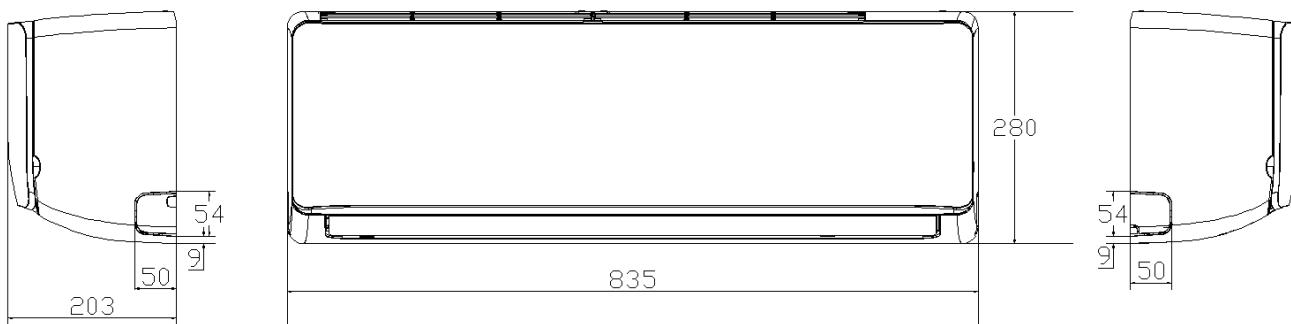

MI2-36GDN1, MI2-45GDN1, MI2-56GDN1

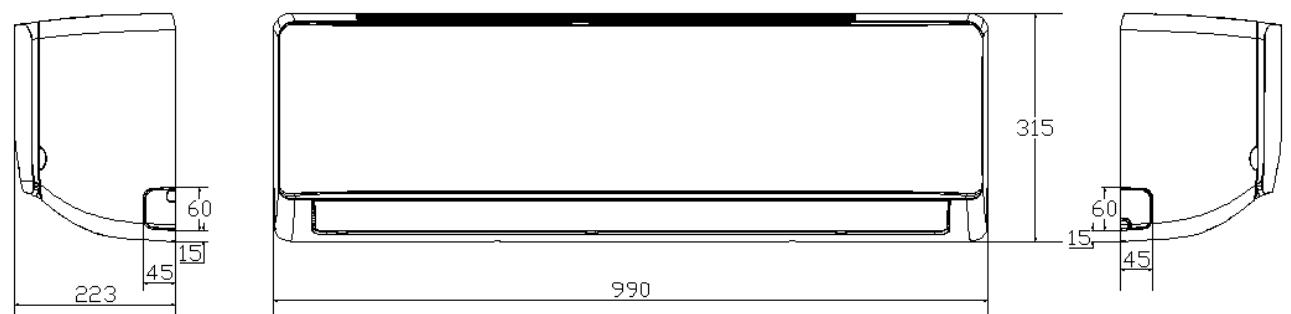

MI2-71GDN1, MI2-80GDN1, MI2-90GDN1

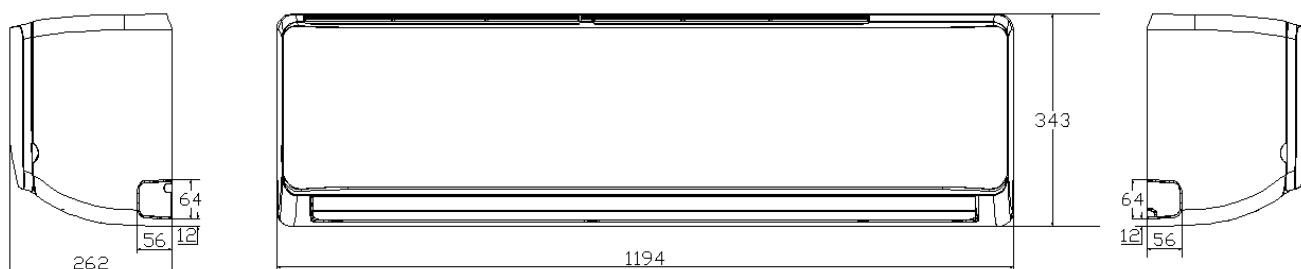

3 Unit Placement

3.1 Placement Considerations


Unit placement should take account of the following considerations:

- Units should not be installed in the following locations:
 - Where exposure to direct radiation from a high-temperature heat source or to interference from a source of electromagnetic radiation may occur.
 - Where dust or dirt may affect heat exchangers.
 - Where exposure to oil or to corrosive or harmful gases, such as acidic or alkaline gases, may occur.
 - Where exposure to salinity may occur, such as seaside locations.
 - Where highly flammable materials are present.
 - Where exposure to oily air may occur, such as a kitchen.
 - Where exposure to very high humidity may occur, such as a laundry.
- Units should be installed in positions where:
 - The ceiling is horizontal and is able to bear the unit's weight.
 - There are no obstructions that could impede the airflow into and out of the unit.
 - The airflow out of the unit can reach throughout the room.
 - There is sufficient space for access during installation, servicing and maintenance.
 - The refrigerant piping and drain piping can be easily connected to the refrigerant piping and drain piping systems.
 - Short-circuit ventilation (where outlet air returns quickly to a unit's air inlet) will not occur.


3.2 Space Requirements

Figure 3.1: Wall mounted space requirements (unit: mm)


MI2-17GDN1, MI2-22GDN1, MI2-28GDN1

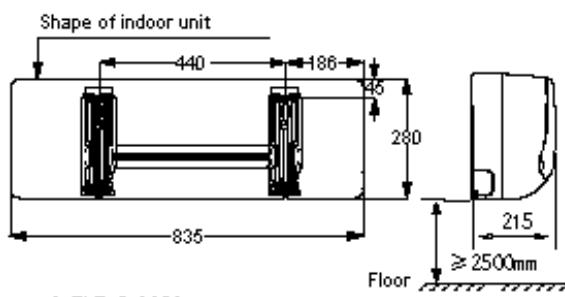

MI2-36GDN1, MI2-45GDN1, MI2-56GDN1

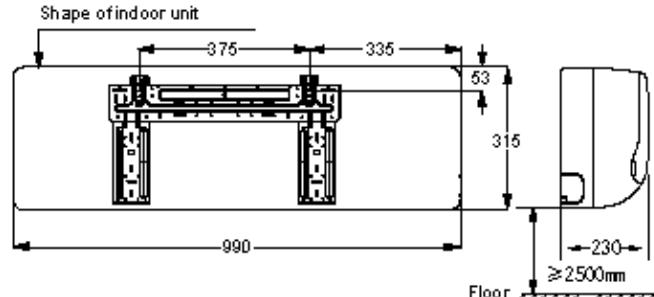


MI2-71GDN1, MI2-80GDN1, MI2-90GDN1

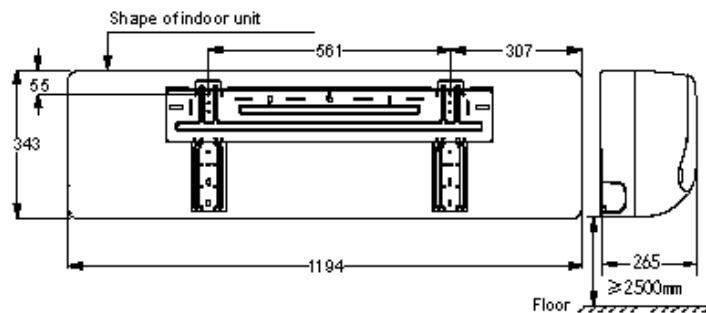

4 Piping Diagram

Figure 4.1: Wall mounted piping diagram

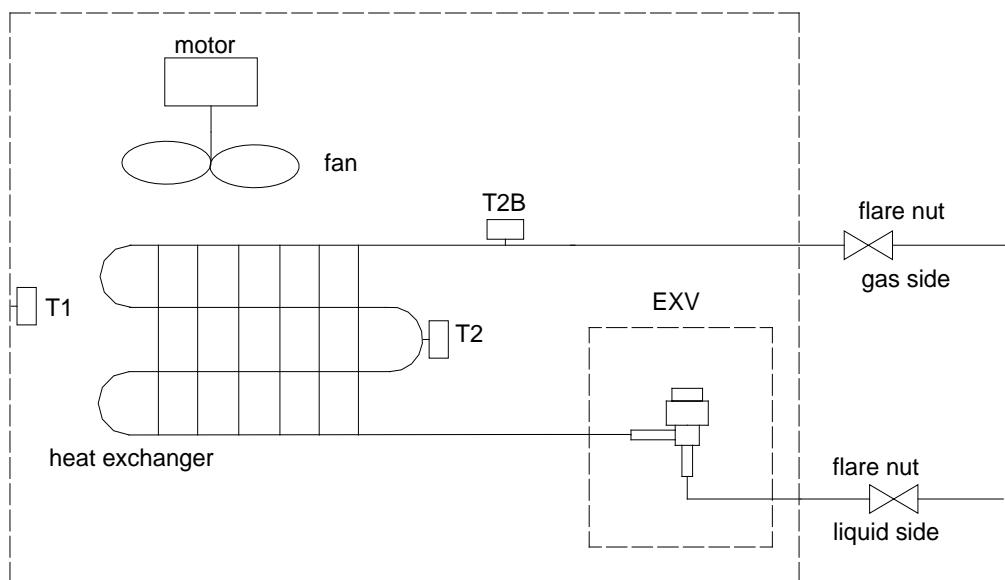

Legend	
T1	Indoor ambient temperature sensor
T2	Indoor heat exchanger mid-point temperature sensor
T2B	Indoor heat exchanger outlet temperature sensor

5 Wiring Diagram

Figure 5.1: 1.7/2.2/2.8kW Wall mounted wiring diagram


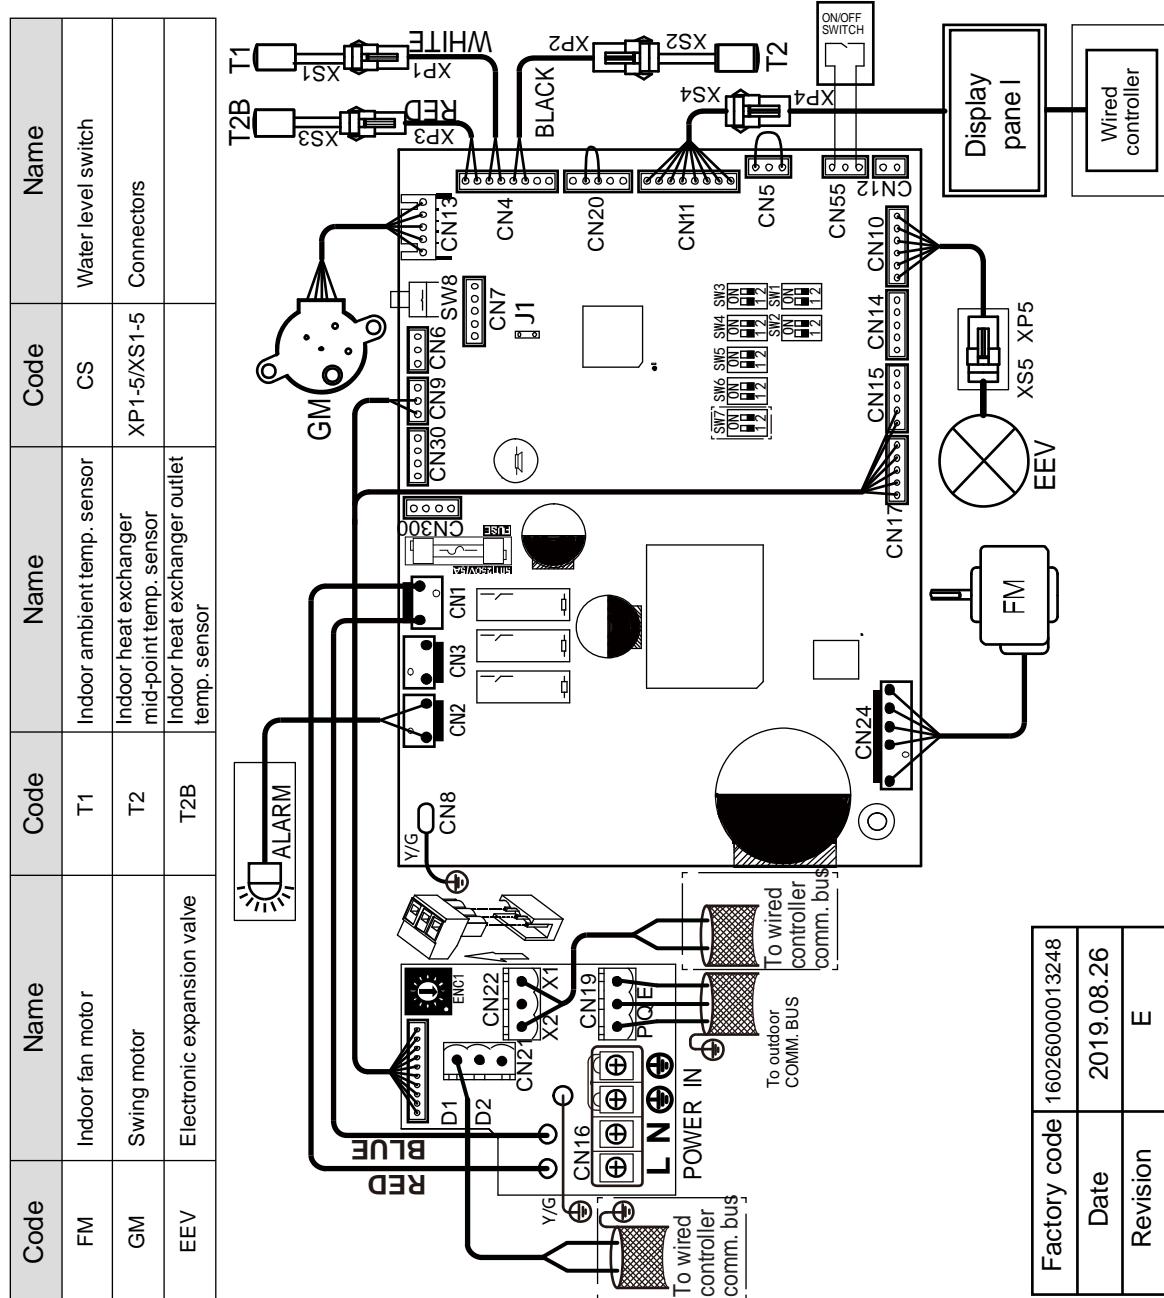



Figure 5.2: 3.6/4.5/5.6kW Wall mounted wiring diagram

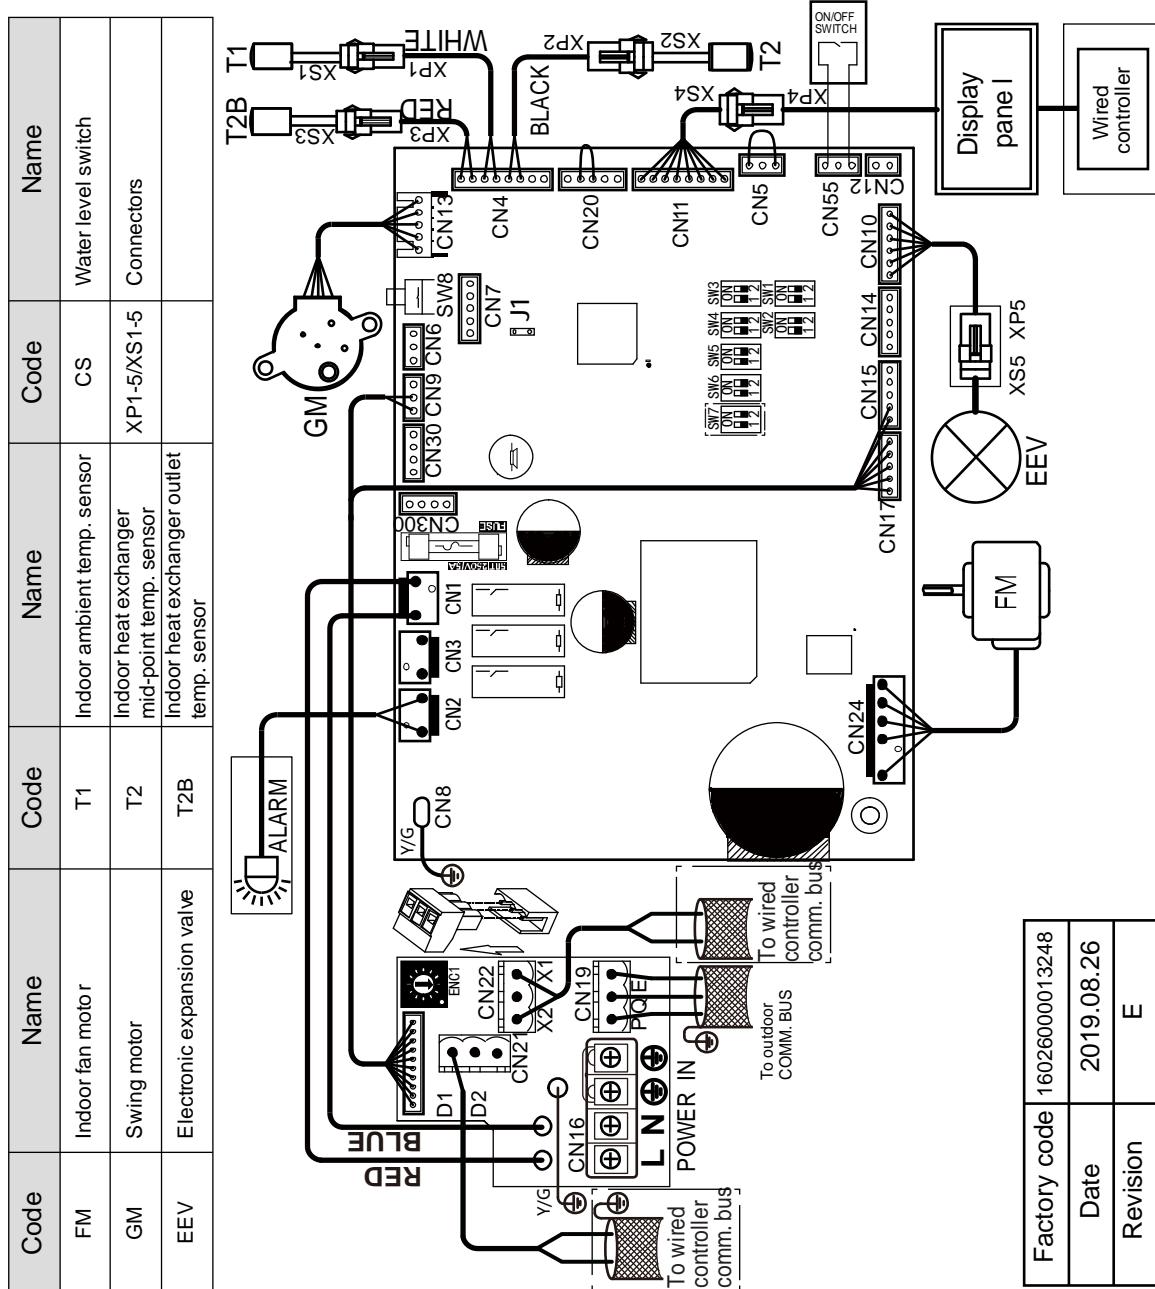

The 2nd Generation DC Series VRF Indoor Units



Figure 5.3: 7.1/8.0/9.0kW Wall mounted wiring diagram

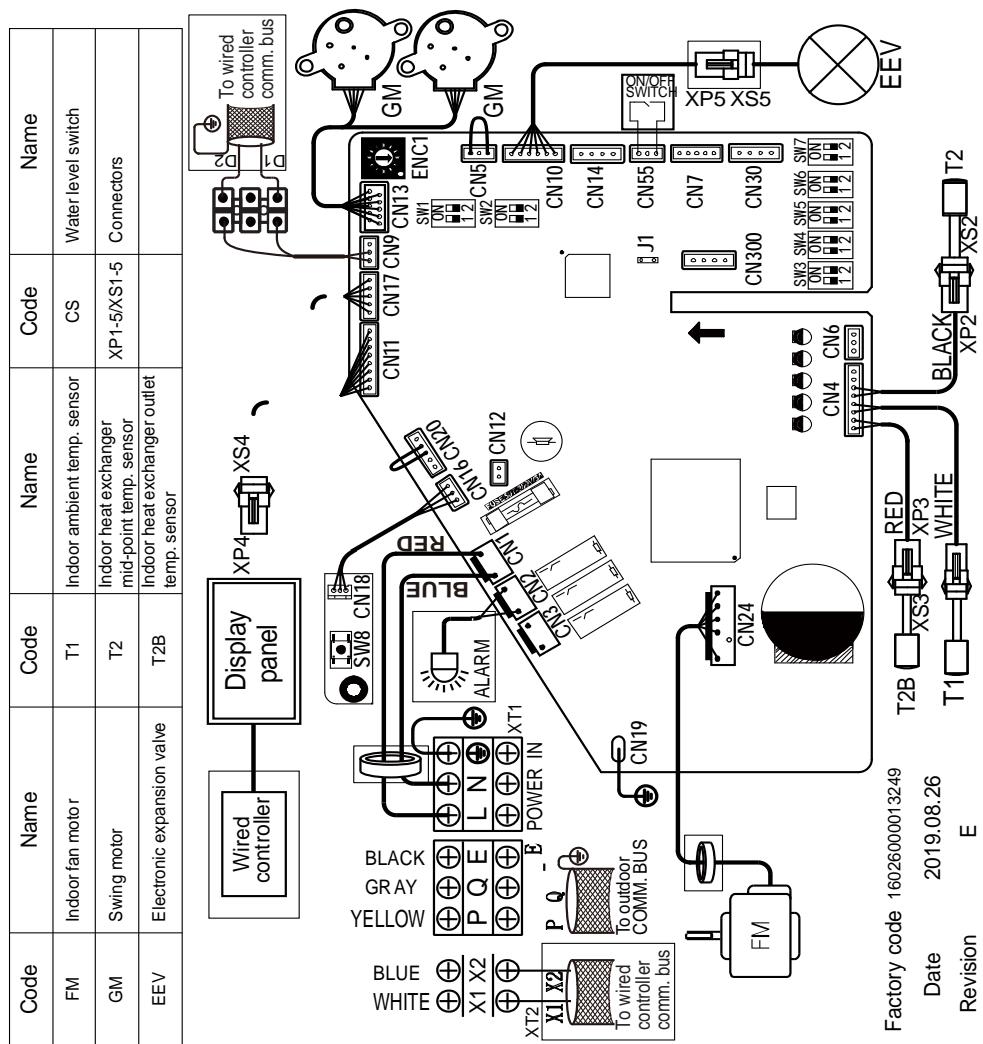

Notes for installers and service engineers

Caution

- All installation, servicing and maintenance must be carried out by competent and suitably qualified, certified and accredited professionals and in accordance with all applicable legislation.
 - Units should be grounded in accordance with all applicable legislation. Metal and other conductive components should be insulated in accordance with all applicable legislation.
 - Power supply wiring should be securely fastened at the power supply terminals – loose power supply wiring would represent a fire risk.
 - After installation, servicing or maintenance, the electric control box cover should be closed. Failing to close the electric control box cover risks fire or electric shock.
 - Switch ENC1 (indoor unit capacity setting) is factory-set and its setting should normally not be changed. The only circumstances in which a switch ENC1 might need to be set in the field is when replacing a main PCB. When replacing a main PCB, ensure that the capacity setting on switch ENC1 on the new PCB is consistent with the unit capacity given on the unit's nameplate.

6 Capacity Tables

6.1 Cooling Capacity Table

Table 6.1: Wall mounted cooling capacity

Capacity (kW)	Outdoor air temperature (°CDB)	Indoor air temperature (°CWB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW
1.7	10.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.2	1.2
	12.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.2	1.2
	14.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.2	1.2
	16.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.2	1.2
	18.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.2	1.1
	20.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.1	1.1
	21.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	2.0	1.2	2.1	1.1
	23.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.2	2.1	1.1
	25.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.2	2.0	1.1
	27.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.2	2.0	1.1
	29.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.1	1.9	1.1
	31.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.1	1.9	1.1
	33.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.9	1.1	1.9	1.1
	35.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.8	1.0	1.9	1.1
	37.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.8	1.2	1.8	1.0	1.8	1.1
	39.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.7	1.2	1.8	1.0	1.8	1.1
	42.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.7	1.2	1.8	1.0	1.8	1.1
	44.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.7	1.2	1.8	1.0	1.8	1.1
	46.0	1.2	1.0	1.4	1.1	1.6	1.2	1.7	1.2	1.7	1.2	1.8	1.0	1.8	1.1
2.2	10.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.9	1.5
	12.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.8	1.5
	14.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.8	1.5
	16.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.8	1.5
	18.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.8	1.4
	20.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.7	1.4
	21.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.6	1.6	2.7	1.4
	23.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.5	1.5	2.7	1.4
	25.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.5	1.5	2.6	1.4
	27.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.5	1.5	2.6	1.4
	29.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.4	1.4	2.5	1.4
	31.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.4	1.4	2.5	1.4
	33.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.4	1.4	2.4	1.4
	35.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.3	1.3	2.4	1.4
	37.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.3	1.6	2.3	1.3	2.3	1.4
	39.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.2	1.5	2.3	1.3	2.3	1.4
	42.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.2	1.5	2.3	1.3	2.3	1.4
	44.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.2	1.5	2.3	1.3	2.3	1.4
	46.0	1.5	1.3	1.8	1.4	2.1	1.5	2.2	1.5	2.2	1.5	2.3	1.3	2.3	1.4

Abbreviations:

TC: Total capacity

SC: Sensible capacity

Notes:

- Shaded cells indicate rating condition.

Table continued on next page ...

The 2nd Generation DC Series VRF Indoor Units



Table 6.1: Wall mountedcooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW
2.8	10.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.7	2.0
	12.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.6	2.0
	14.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.6	2.0
	16.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.5	1.9
	18.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.5	1.9
	20.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.4	1.9
	21.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.4	1.9
	23.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.3	2.0	3.4	1.9
	25.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.2	1.9	3.3	1.9
	27.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.2	1.9	3.3	1.9
	29.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.1	1.8	3.2	1.8
	31.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.1	1.8	3.2	1.7
	33.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	3.0	1.9	3.1	1.8	3.1	1.7
	35.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.8	3.1	1.7
	37.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.8	3.0	1.7
	39.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.9	3.0	1.7
	42.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.9	3.0	1.7
	44.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.9	3.0	1.7
	46.0	1.9	1.6	2.3	1.8	2.6	1.9	2.8	1.9	2.9	1.9	3.0	1.9	3.0	1.7
3.6	10.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.7	2.5
	12.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.7	2.5
	14.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.6	2.4
	16.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.5	2.4
	18.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.5	2.4
	20.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.4	2.3
	21.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.3	2.4	4.4	2.3
	23.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.1	2.3	4.3	2.2
	25.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.1	2.3	4.2	2.2
	27.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.0	2.2	4.2	2.2
	29.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.0	2.2	4.1	2.2
	31.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.2	2.6	4.1	2.2
	33.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.2	2.6	3.9	2.1
	35.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.8	2.5	4.2	2.6	3.9	2.1
	37.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.7	2.4	3.8	2.3	3.9	2.1
	39.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.7	2.4	3.8	2.3	3.8	2.1
	42.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.7	2.4	3.8	2.3	3.8	2.1
	44.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.7	2.4	3.8	2.3	3.8	2.1
	46.0	2.5	1.9	2.9	2.1	3.4	2.3	3.6	2.4	3.7	2.4	3.8	2.3	3.8	2.1

Abbreviations:

TC: Total capacity

SC: Sensible capacity

Notes:

- Shaded cells indicate rating condition.

Table continued on next page ...

Table 6.1: Wall mounted cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW
4.5	10.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.9	3.0
	12.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.9	3.0
	14.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.8	3.0
	16.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.6	2.9
	18.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.7	3.0
	20.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.7	3.0
	21.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.6	3.0
	23.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.3	3.4	5.5	3.0
	25.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.2	3.0	5.4	2.9
	27.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.1	3.0	5.2	2.8
	29.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.1	2.9	5.2	2.8
	31.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	5.0	2.9	5.1	2.7
	33.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	4.9	2.8	5.1	2.7
	35.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	4.8	2.8	5.0	2.7
	37.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.8	3.0	4.8	2.9	4.9	2.6
	39.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.6	2.8	4.7	2.8	4.8	2.6
	42.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.6	2.8	4.7	2.8	4.8	2.6
	44.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.6	2.8	4.7	2.8	4.8	2.6
	46.0	3.1	2.4	3.7	2.6	4.2	2.8	4.5	2.9	4.6	2.8	4.7	3.1	4.8	2.6
5.6	10.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	7.3	3.5
	12.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	7.2	3.5
	14.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	7.1	3.5
	16.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	7.0	3.4
	18.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	6.8	3.4
	20.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	6.7	3.3
	21.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	6.6	3.3
	23.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	6.6	3.3
	25.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.6	3.6	6.5	3.2
	27.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.4	3.5	6.4	3.2
	29.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.3	3.5	6.4	3.3
	31.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.2	3.4	6.2	3.2
	33.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.2	3.4	6.2	3.2
	35.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	6.0	3.3	6.0	3.1
	37.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.9	3.5	5.9	3.2	6.0	3.1
	39.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.7	3.4	5.8	3.2	6.0	3.1
	42.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.7	3.4	5.8	3.2	6.0	3.1
	44.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.7	3.4	5.8	3.2	6.0	3.1
	46.0	3.9	2.7	4.6	3.0	5.3	3.3	5.6	3.4	5.7	3.7	5.8	3.2	6.0	3.1

Abbreviations:

TC: Total capacity

SC: Sensible capacity

Notes:

- Shaded cells indicate rating condition.

Table continued on next page ...

The 2nd Generation DC Series VRF Indoor Units



Table 6.1: Wall mountedcooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW
7.1	10.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	9.2	4.6
	12.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	9.1	4.5
	14.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	9.0	4.5
	16.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.9	4.4
	18.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.7	4.3
	20.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.5	4.2
	21.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.4	4.2
	23.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.3	4.1
	25.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.4	4.5	8.2	4.1
	27.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.4	8.1	4.3	8.2	4.1
	29.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.5	8.0	4.3	8.1	4.1
	31.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.5	7.9	4.3	7.8	4.0
	33.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.5	7.8	4.2	7.8	4.0
	35.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.5	4.5	7.6	4.1	7.7	3.9
	37.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.4	4.4	7.5	4.1	7.6	4.0
	39.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.2	4.3	7.4	4.1	7.6	4.0
	42.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.2	4.3	7.4	4.1	7.6	4.0
	44.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.2	4.3	7.4	4.1	7.6	4.0
	46.0	4.9	3.6	5.8	4.0	6.7	4.3	7.1	4.5	7.2	4.3	7.4	4.1	7.6	4.0
8.0	10.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.4	5.6
	12.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.2	5.5
	14.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.2	5.5
	16.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	10.0	5.4
	18.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.8	5.3
	20.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.6	5.2
	21.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.4	5.1
	23.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.4	5.1
	25.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.4	5.5	9.3	5.0
	27.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.4	9.1	5.3	9.2	5.1
	29.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	9.0	5.3	9.1	5.0
	31.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	8.9	5.2	8.8	4.8
	33.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	8.8	5.2	8.8	4.8
	35.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.4	5.5	8.6	5.1	8.6	4.8
	37.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.3	5.4	8.4	5.0	8.6	4.9
	39.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	42.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	44.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9
	46.0	5.5	4.4	6.6	4.9	7.5	5.3	8.0	5.5	8.1	5.3	8.3	5.0	8.6	4.9

Abbreviations:

TC: Total capacity

SC: Sensible capacity

Notes:

- Shaded cells indicate rating condition.

Table 6.1: Wall mounted cooling capacity (continued)

Capacity (kW)	Outdoor air temperature (°C DB)	Indoor air temperature (°C WB/DB)													
		14/20		16/23		18/26		19/27		20/28		22/30		24/32	
		TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW	TC kW	SC kW
9.0	10.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	11.7	6.0
	12.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	11.5	5.9
	14.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	11.4	5.9
	16.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	11.3	5.8
	18.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	11.0	5.8
	20.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	10.8	5.7
	21.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	10.6	5.6
	23.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	10.5	5.5
	25.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.6	6.1	10.4	5.5
	27.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.3	5.9	10.4	5.4
	29.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.1	5.7	10.3	5.4
	31.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	10.0	5.7	9.9	5.3
	33.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.6	6.0	9.9	5.6	9.9	5.3
	35.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.5	6.0	9.6	5.5	9.7	5.3
	37.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.3	5.8	9.5	5.4	9.6	5.3
	39.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.2	5.7	9.4	5.3	9.6	5.3
	42.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.2	5.7	9.4	5.3	9.6	5.3
	44.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.2	5.7	9.4	5.3	9.6	5.3
	46.0	6.2	4.9	7.3	5.3	8.4	5.8	9.0	5.9	9.2	5.7	9.4	5.3	9.6	5.3

Abbreviations:

TC: Total capacity

SC: Sensible capacity

Notes:

- Shaded cells indicate rating condition.

The 2nd Generation DC Series VRF Indoor Units



6.2 Heating Capacity Table

Table 6.2: Wall mounted heating capacity

Capacity (kW)	Outdoor air temperature(°C)		Indoor air temperature (°C DB)					
			16	18	20	21	22	24
	TC	TC	TC	TC	TC	TC	TC	TC
1.7	WB	DB	kW	kW	kW	kW	kW	kW
	-20	-19.8	1.23	1.23	1.23	1.23	1.23	1.23
	-19	-18.8	1.32	1.32	1.32	1.32	1.32	1.32
	-17	-16.7	1.38	1.38	1.38	1.38	1.38	1.38
	-15	-14.7	1.43	1.43	1.43	1.43	1.43	1.43
	-13.00	-12.60	1.52	1.52	1.52	1.52	1.52	1.52
	-11.00	-10.50	1.54	1.56	1.56	1.56	1.56	1.56
	-10.00	-9.50	1.60	1.60	1.60	1.60	1.60	1.60
	-9.10	-8.50	1.65	1.65	1.65	1.65	1.65	1.65
	-7.60	-7.00	1.67	1.67	1.67	1.67	1.67	1.67
	-5.60	-5.00	1.74	1.74	1.74	1.74	1.74	1.74
	-3.70	-3.00	1.82	1.82	1.82	1.82	1.82	1.82
	-0.70	0.00	1.96	1.96	1.96	1.96	1.96	1.85
	2.20	3.00	2.07	2.07	2.07	2.07	2.03	1.85
	4.10	5.00	2.14	2.14	2.14	2.14	2.03	1.85
	6.00	7.00	2.20	2.20	2.20	2.14	2.03	1.85
2.2	7.90	9.00	2.26	2.26	2.20	2.14	2.03	1.85
	9.80	11.00	2.33	2.33	2.20	2.14	2.03	1.85
	11.80	13.00	2.42	2.37	2.20	2.14	2.03	1.85
	13.70	15.00	2.48	2.37	2.20	2.14	2.03	1.85

Abbreviations:

TC: Total capacity

Notes:

- Shaded cells indicate rating condition.

Table continued on next page ...

Table 6.2: Wall mounted heating capacity(continued)

Capacity (kW)	Outdoor air temperature(°C)	Indoor air temperature (°C DB)					
		16	18	20	21	22	24
		TC	TC	TC	TC	TC	TC
WB	DB	kW	kW	kW	kW	kW	kW
2.8	-20	1.79	1.79	1.79	1.79	1.79	1.79
	-19	1.92	1.92	1.92	1.92	1.92	1.92
	-17	2.02	2.02	2.02	2.02	2.02	2.02
	-15	2.02	2.02	2.02	2.02	2.02	2.02
	-13.00	2.14	2.14	2.14	2.14	2.14	2.14
	-11.00	2.24	2.24	2.24	2.24	2.24	2.24
	-10.00	2.34	2.34	2.34	2.34	2.34	2.34
	-9.10	2.40	2.40	2.40	2.40	2.40	2.40
	-7.60	2.43	2.43	2.43	2.43	2.43	2.43
	-5.60	2.53	2.53	2.53	2.53	2.53	2.53
	-3.70	2.66	2.66	2.66	2.66	2.66	2.66
	-0.70	2.85	2.85	2.85	2.85	2.85	2.69
	2.20	3.01	3.01	3.01	3.01	2.94	2.69
	4.10	3.10	3.10	3.10	3.10	2.94	2.69
	6.00	3.20	3.20	3.20	3.10	2.94	2.69
	7.90	3.30	3.30	3.20	3.10	2.94	2.69
	9.80	3.39	3.39	3.20	3.10	2.94	2.69
3.6	11.80	3.52	3.46	3.20	3.10	2.94	2.69
	13.70	3.62	3.46	3.20	3.10	2.94	2.69
	-20	2.24	2.24	2.24	2.24	2.24	2.24
	-19	2.40	2.40	2.40	2.40	2.40	2.40
	-17	2.52	2.52	2.52	2.52	2.52	2.52
	-15	2.60	2.60	2.60	2.60	2.60	2.60
	-13.00	2.68	2.68	2.68	2.68	2.68	2.68
	-11.00	2.80	2.80	2.80	2.80	2.80	2.80
	-10.00	2.92	2.92	2.92	2.92	2.92	2.92
	-9.10	3.00	3.00	3.00	3.00	3.00	3.00
	-7.60	3.04	3.04	3.04	3.04	3.04	3.04
	-5.60	3.16	3.16	3.16	3.16	3.16	3.16
	-3.70	3.32	3.32	3.32	3.32	3.32	3.32
	-0.70	3.56	3.56	3.56	3.56	3.56	3.36
	2.20	3.76	3.76	3.76	3.76	3.68	3.36
	4.10	3.88	3.88	3.88	3.88	3.68	3.36
	6.00	4.00	4.00	4.00	3.88	3.68	3.36
	7.90	4.12	4.12	4.00	3.88	3.68	3.36
	9.80	4.24	4.24	4.00	3.88	3.68	3.36
	11.80	4.40	4.32	4.00	3.88	3.68	3.36
	13.70	4.52	4.32	4.00	3.88	3.68	3.36

Abbreviations:

TC: Total capacity

Notes:

1. Shaded cells indicate rating condition.

Table continued on next page ...

The 2nd Generation DC Series VRF Indoor Units



Table 6.2: Wall mounted heating capacity (continued)

Capacity (kW)	Outdoor air temperature(°C)	Indoor air temperature (°C DB)					
		16	18	20	21	22	24
		TC	TC	TC	TC	TC	TC
WB	DB	kW	kW	kW	kW	kW	kW
4.5	-20	-19.8	2.80	2.80	2.80	2.80	2.80
	-19	-18.8	3.00	3.00	3.00	3.00	3.00
	-17	-16.7	3.15	3.15	3.15	3.15	3.15
	-15	-14.7	3.25	3.25	3.25	3.25	3.25
	-13.00	-12.60	3.35	3.35	3.35	3.35	3.35
	-11.00	-10.50	3.50	3.50	3.50	3.50	3.50
	-10.00	-9.50	3.65	3.65	3.65	3.65	3.65
	-9.10	-8.50	3.75	3.75	3.75	3.75	3.75
	-7.60	-7.00	3.80	3.80	3.80	3.80	3.80
	-5.60	-5.00	3.95	3.95	3.95	3.95	3.95
	-3.70	-3.00	4.15	4.15	4.15	4.15	4.15
	-0.70	0.00	4.45	4.45	4.45	4.45	4.20
	2.20	3.00	4.70	4.70	4.70	4.60	4.20
	4.10	5.00	4.85	4.85	4.85	4.60	4.20
	6.00	7.00	5.00	5.00	5.00	4.85	4.60
	7.90	9.00	5.15	5.15	5.00	4.85	4.60
5.6	9.80	11.00	5.30	5.30	5.00	4.85	4.60
	11.80	13.00	5.50	5.40	5.00	4.85	4.60
	13.70	15.00	5.65	5.40	5.00	4.85	4.60
	-20	-19.8	3.53	3.53	3.53	3.53	3.53
	-19	-18.8	3.78	3.78	3.78	3.78	3.78
	-17	-16.7	3.97	3.97	3.97	3.97	3.97
	-15	-14.7	4.10	4.10	4.10	4.10	4.10
	-13.00	-12.60	4.22	4.22	4.22	4.22	4.22
	-11.00	-10.50	4.41	4.41	4.41	4.41	4.41
	-10.00	-9.50	4.60	4.60	4.60	4.60	4.60
	-9.10	-8.50	4.73	4.73	4.73	4.73	4.73
	-7.60	-7.00	4.79	4.79	4.79	4.79	4.79
	-5.60	-5.00	4.98	4.98	4.98	4.98	4.98
	-3.70	-3.00	5.23	5.23	5.23	5.23	5.23
	-0.70	0.00	5.61	5.61	5.61	5.61	5.29
	2.20	3.00	5.92	5.92	5.92	5.80	5.29
	4.10	5.00	6.11	6.11	6.11	5.80	5.29
	6.00	7.00	6.30	6.30	6.30	6.11	5.80
	7.90	9.00	6.49	6.49	6.30	6.11	5.80
	9.80	11.00	6.68	6.68	6.30	6.11	5.80
	11.80	13.00	6.93	6.80	6.30	6.11	5.80
	13.70	15.00	7.12	6.80	6.30	6.11	5.80

Abbreviations:

TC: Total capacity

Notes:

- Shaded cells indicate rating condition.

Table continued on next page ...

Table 6.2: Wall mounted heating capacity (continued)

Capacity (kW)	Outdoor air temperature(°C)	Indoor air temperature (°C DB)					
		16	18	20	21	22	24
		TC	TC	TC	TC	TC	TC
WB	DB	kW	kW	kW	kW	kW	kW
7.1	-20	4.48	4.48	4.48	4.48	4.48	4.48
	-19	4.80	4.80	4.80	4.80	4.80	4.80
	-17	5.04	5.04	5.04	5.04	5.04	5.04
	-15	5.20	5.20	5.20	5.20	5.20	5.20
	-13.00	5.36	5.36	5.36	5.36	5.36	5.36
	-11.00	5.60	5.60	5.60	5.60	5.60	5.60
	-10.00	5.84	5.84	5.84	5.84	5.84	5.84
	-9.10	6.00	6.00	6.00	6.00	6.00	6.00
	-7.60	6.08	6.08	6.08	6.08	6.08	6.08
	-5.60	6.32	6.32	6.32	6.32	6.32	6.32
	-3.70	6.64	6.64	6.64	6.64	6.64	6.64
	-0.70	7.12	7.12	7.12	7.12	7.12	6.72
	2.20	7.52	7.52	7.52	7.52	7.36	6.72
	4.10	7.76	7.76	7.76	7.76	7.36	6.72
	6.00	8.00	8.00	8.00	8.00	7.36	6.72
	7.90	8.24	8.24	8.00	7.76	7.36	6.72
	9.80	8.48	8.48	8.00	7.76	7.36	6.72
8.0	11.80	8.80	8.64	8.00	7.76	7.36	6.72
	13.70	9.04	8.64	8.00	7.76	7.36	6.72
	-20	5.04	5.04	5.04	5.04	5.04	5.04
	-19	5.40	5.40	5.40	5.40	5.40	5.40
	-17	5.67	5.67	5.67	5.67	5.67	5.67
	-15	5.85	5.85	5.85	5.85	5.85	5.85
	-13.00	6.03	6.03	6.03	6.03	6.03	6.03
	-11.00	6.30	6.30	6.30	6.30	6.30	6.30
	-10.00	6.57	6.57	6.57	6.57	6.57	6.57
	-9.10	6.75	6.75	6.75	6.75	6.75	6.75
	-7.60	6.84	6.84	6.84	6.84	6.84	6.84
	-5.60	7.11	7.11	7.11	7.11	7.11	7.11
	-3.70	7.47	7.47	7.47	7.47	7.47	7.47
	-0.70	8.01	8.01	8.01	8.01	8.01	7.56
	2.20	8.46	8.46	8.46	8.46	8.28	7.56
	4.10	8.73	8.73	8.73	8.73	8.28	7.56
	6.00	9.00	9.00	9.00	9.00	8.28	7.56
	7.90	9.27	9.27	9.00	8.73	8.28	7.56
	9.80	9.54	9.54	9.00	8.73	8.28	7.56
	11.80	9.90	9.72	9.00	8.73	8.28	7.56
	13.70	10.17	9.72	9.00	8.73	8.28	7.56

Abbreviations:

TC: Total capacity

Notes:

- Shaded cells indicate rating condition.

The 2nd Generation DC Series VRF Indoor Units



Table 6.2: Wall mounted heating capacity (continued)

Capacity (kW)	Outdoor air temperature(°C)	Indoor air temperature (°C DB)					
		16	18	20	21	22	24
		TC	TC	TC	TC	TC	TC
WB	DB	kW	kW	kW	kW	kW	kW
9.0	-20	5.60	5.04	5.60	5.60	5.60	5.60
	-19	6.00	5.40	6.00	6.00	6.00	6.00
	-17	6.30	6.30	6.30	6.30	6.30	6.30
	-15	6.50	6.50	6.50	6.50	6.50	6.50
	-13.00	6.70	6.70	6.70	6.70	6.70	6.70
	-11.00	7.00	7.00	7.00	7.00	7.00	7.00
	-10.00	7.30	7.30	7.30	7.30	7.30	7.30
	-9.10	7.50	7.50	7.50	7.50	7.50	7.50
	-7.60	7.60	7.60	7.60	7.60	7.60	7.60
	-5.60	7.90	7.90	7.90	7.90	7.90	7.90
	-3.70	8.30	8.30	8.30	8.30	8.30	8.30
	-0.70	8.90	8.90	8.90	8.90	8.90	8.40
	2.20	9.40	9.40	9.40	9.40	9.20	8.40
	4.10	9.70	9.70	9.70	9.70	9.20	8.40
	6.00	10.00	10.00	10.00	10.00	9.20	8.40
	7.90	10.30	10.30	10.00	9.70	9.20	8.40
	9.80	10.60	10.60	10.00	9.70	9.20	8.40
	11.80	11.00	11.00	10.80	10.00	9.70	9.20
	13.70	15.00	11.30	10.80	10.00	9.70	8.40

Abbreviations:

TC: Total capacity

Notes:

- Shaded cells indicate rating condition.

7 Electrical Characteristics

Table 7.1: Wall mounted electrical characteristics

Model	Power supply						Indoor fan motors	
	Hz	Volts	Min. volts	Max. volts	MCA	MFA	Rated motor output (kW)	FLA
MI2-17GDN1	50	220-240	198	264	0.32	15	0.02	0.25
MI2-22GDN1	50	220-240	198	264	0.32	15	0.02	0.25
MI2-28GDN1	50	220-240	198	264	0.32	15	0.02	0.25
MI2-36GDN1	50	220-240	198	264	0.45	15	0.058	0.36
MI2-45GDN1	50	220-240	198	264	0.47	15	0.058	0.37
MI2-56GDN1	50	220-240	198	264	0.58	15	0.058	0.46
MI2-71GDN1	50	220-240	198	264	0.90	15	0.06	0.72
MI2-80GDN1	50	220-240	198	264	0.90	15	0.06	0.72
MI2-90GDN1	50	220-240	198	264	1.10	15	0.06	0.88

Abbreviations:

MCA: Minimum Circuit Amps

MFA: Maximum Fuse Amps

FLA: Full Load Amps

8 Sound Levels

8.1 Overall


Table 8.1: Wall mounted sound pressure levels¹

Model name	Sound pressure levelsdB(A)						
	SSH	SH	H	M	L	SL	SSL
MI2-17GDN1	31	30	30	30	29	29	29
MI2-22GDN1	31	30	30	30	29	29	29
MI2-28GDN1	31	30	30	30	29	29	29
MI2-36GDN1	33	32	32	31	31	30	30
MI2-45GDN1	35	34	33	33	32	31	31
MI2-56GDN1	38	37	36	36	35	34	34
MI2-71GDN1	44	43	42	39	38	37	36
MI2-80GDN1	44	43	42	39	38	37	36
MI2-90GDN1	48	46	45	43	41	40	38

Notes:

1. Sound pressure levels are measured in a semi-anechoic chamber. During in-situ operation, sound pressure levels may be higher as a result of ambient noise.

Figure 8.1:Wall mounted sound pressure level measurement

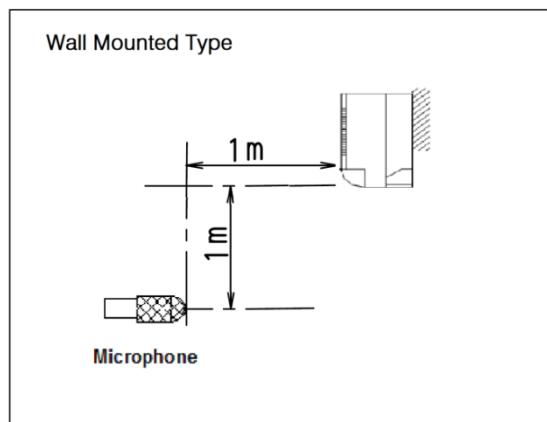

8.2 Octave Band Levels

Figure 8.2: MI2-17(22,28)GDN1 octave band levels

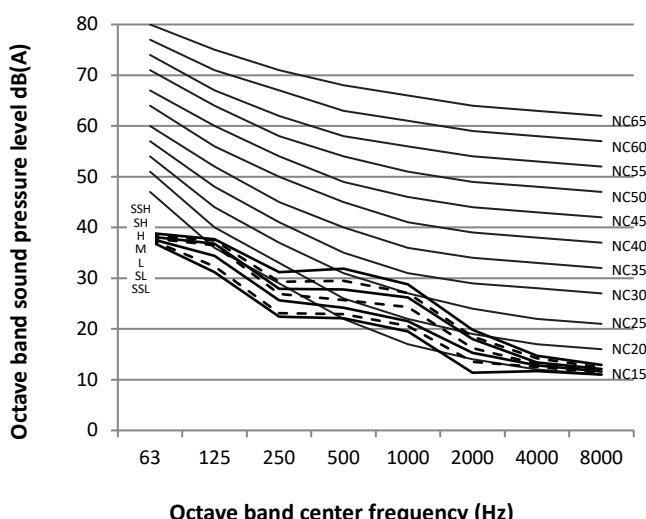


Figure 8.3: MI2-36GDN1 octave band levels

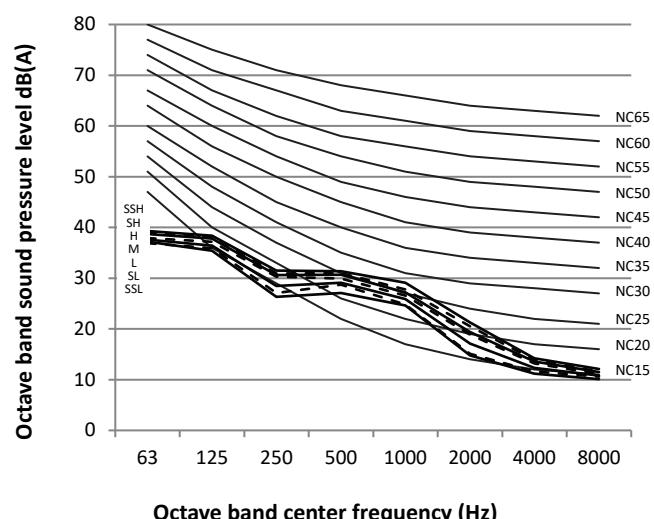


Figure 8.4: MI2-45GDN1 octave band levels

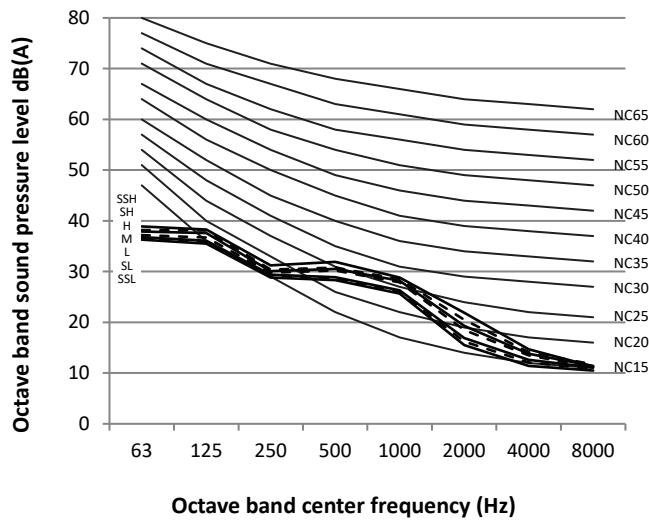


Figure 8.5: MI2-56GDN1 octave band levels

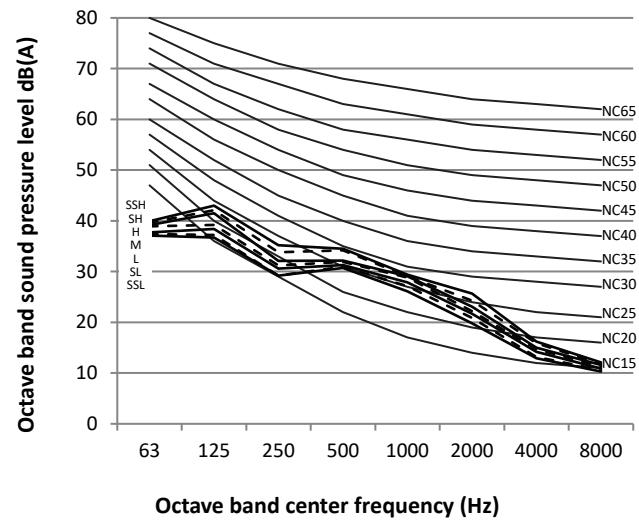


Figure 8.6: MI2-71(80)GDN1 octave band levels


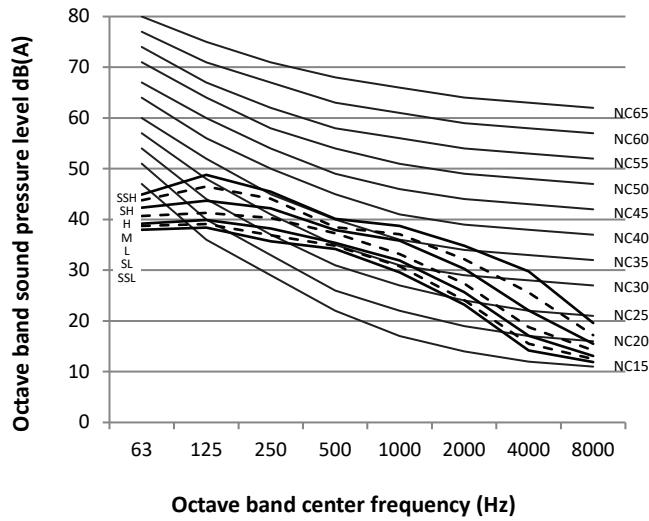


Figure 8.7: MI2-90GDN1 octave band levels

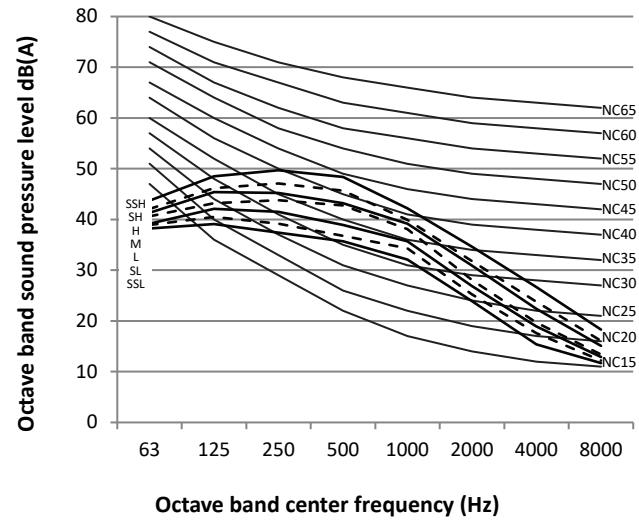

9 Temperature and Airflow Distributions

9.1 Simulate condition

Table 9.1: Ceiling and floor simulate condition

Model name	Room size (m)	Ceiling height (m)	Flow angle (Cooling/Heating)	Placing
MI2-17GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-22GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-28GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-36GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-45GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-56GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-71GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-80GDN1	4*4	2.7	38° /100°	Wall mounted
MI2-90GDN1	4*4	2.7	38° /100°	Wall mounted

Note:

- These figures are based on software simulation. They show typical temperature and airflow distributions in the conditions above. In the actual installation, they may differ from these figures under the influence of air temperature conditions, ceiling height, cooling/heating load, obstacles, etc.

9.2 Airflow distributions (unit: m/s)

Figure 9.1: MI2-17GDN1 cooling at 300S

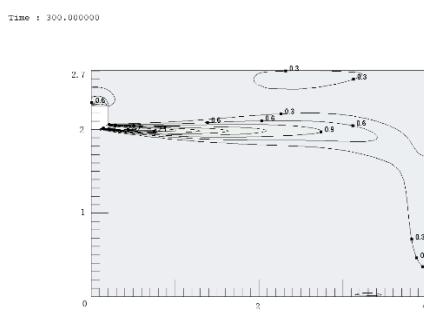


Figure 9.2: MI2-17GDN1 heating at 300S

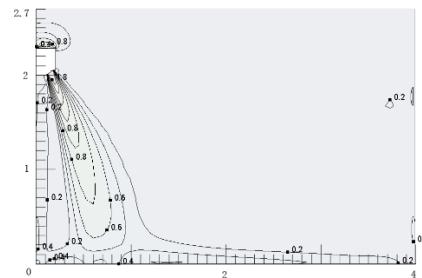


Figure 9.3: MI2-22GDN1 cooling at 300S

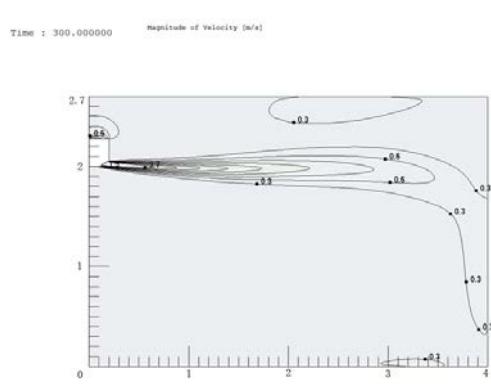


Figure 9.5: MI2-28GDN1 cooling at 300S

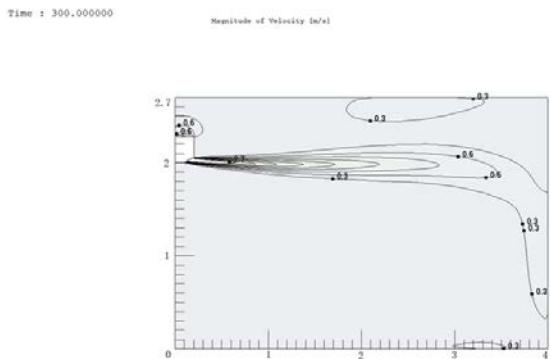


Figure 9.7: MI2-36GDN1 cooling at 300S

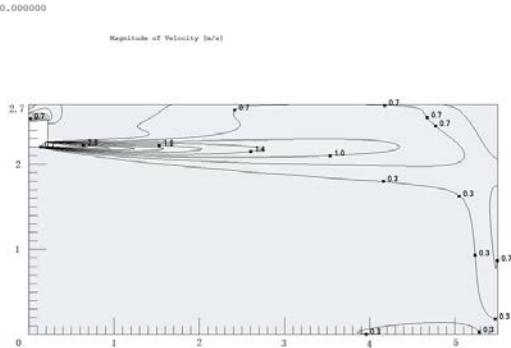


Figure 9.9: MI2-45GDN1 cooling at 300S

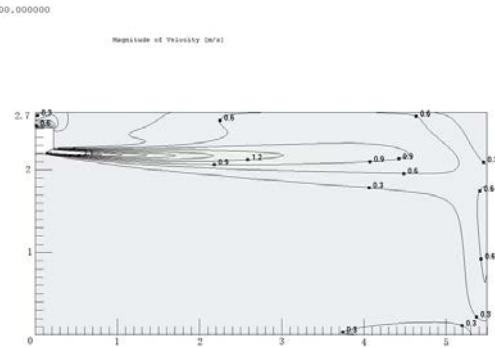


Figure 9.4: MI2-22GDN1 heating at 300S

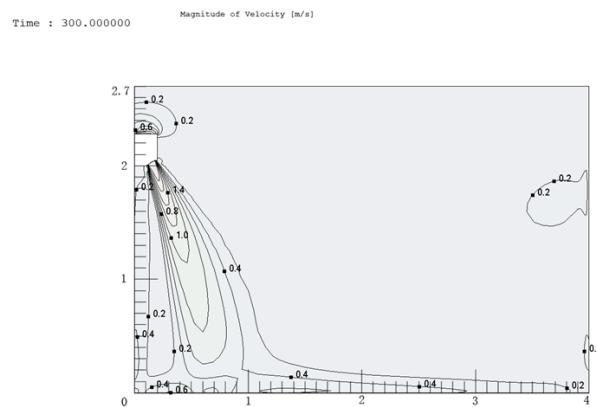


Figure 9.6: MI2-28GDN1 heating at 300S

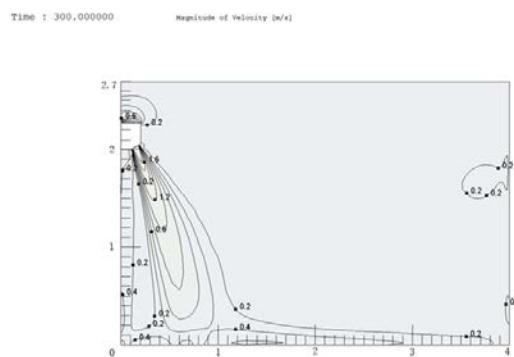


Figure 9.8: MI2-36GDN1 heating at 300S


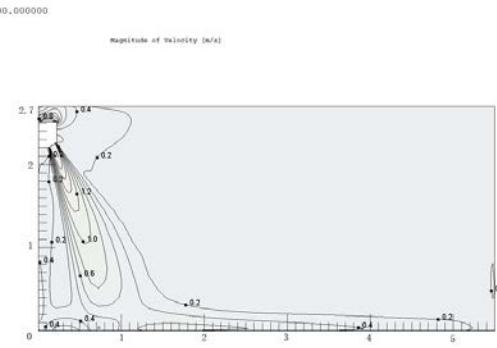


Figure 9.10: MI2-45GDN1 heating at 300S

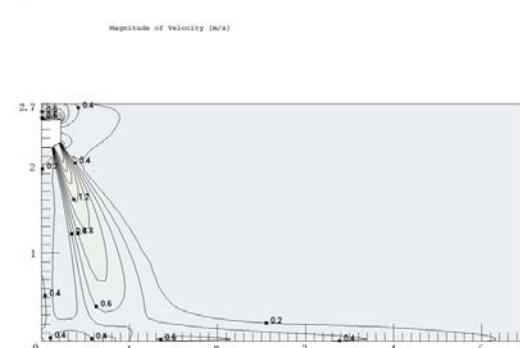

The 2nd Generation DC Series VRF Indoor Units



Figure 9.11: MI2-56GDN1 cooling at 300S

Figure 9.12: MI2-56GDN1 heating at 300S

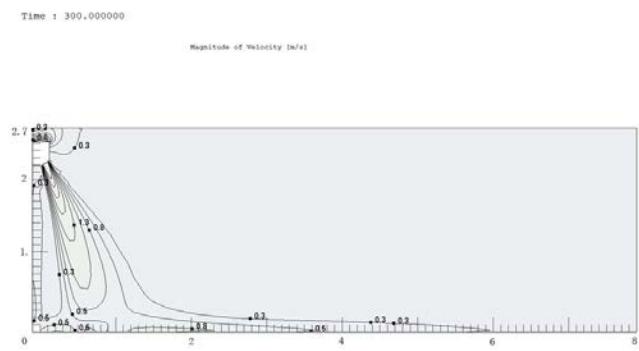
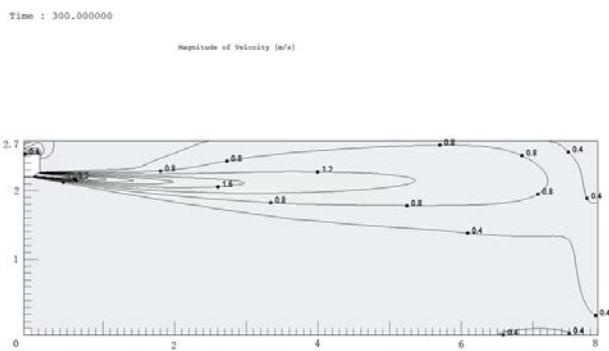


Figure 9.13: MI2-71GDN1 cooling at 300S

Figure 9.14: MI2-71GDN1 heating at 300S

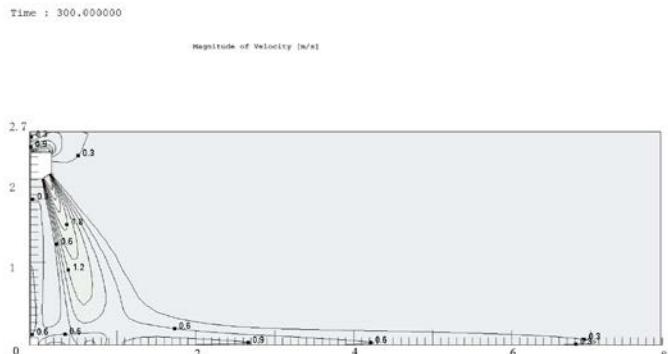
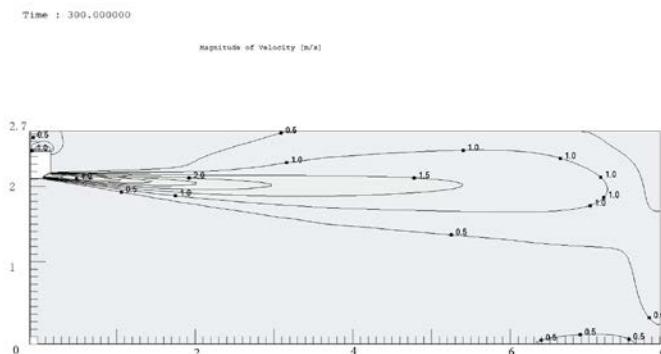


Figure 9.15: MI2-80GDN1 cooling at 300S

Figure 9.16: MI2-80GDN1 heating at 300S



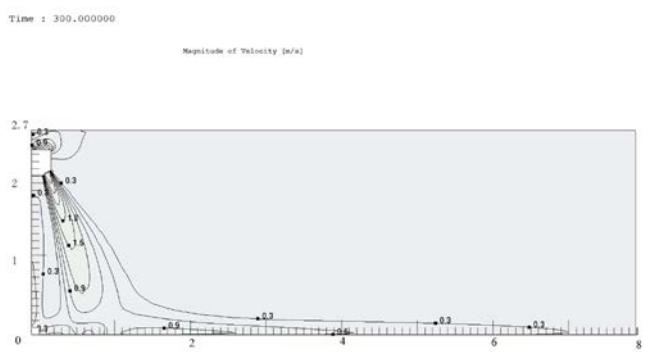


Figure 9.17: MI2-90GDN1 cooling at 300S

Figure 9.18: MI2-90GDN1 heating at 300S

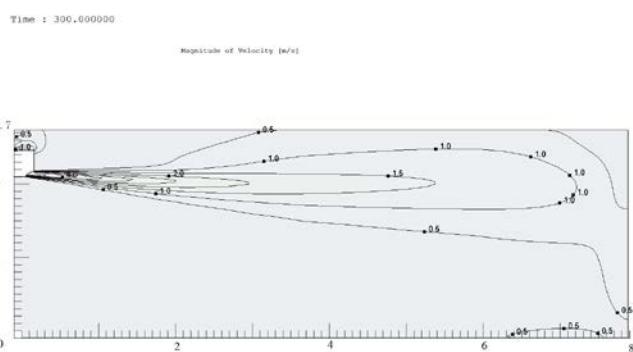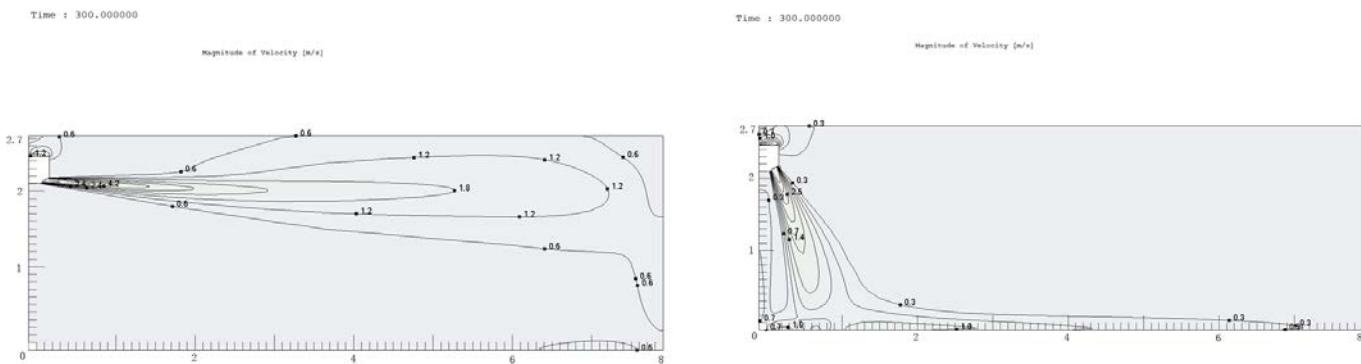

9.3 Temperature distributions

Figure 9.19: MI2-17GDN1 cooling at 300S

Figure 9.20: MI2-17GDN1 heating at 300S


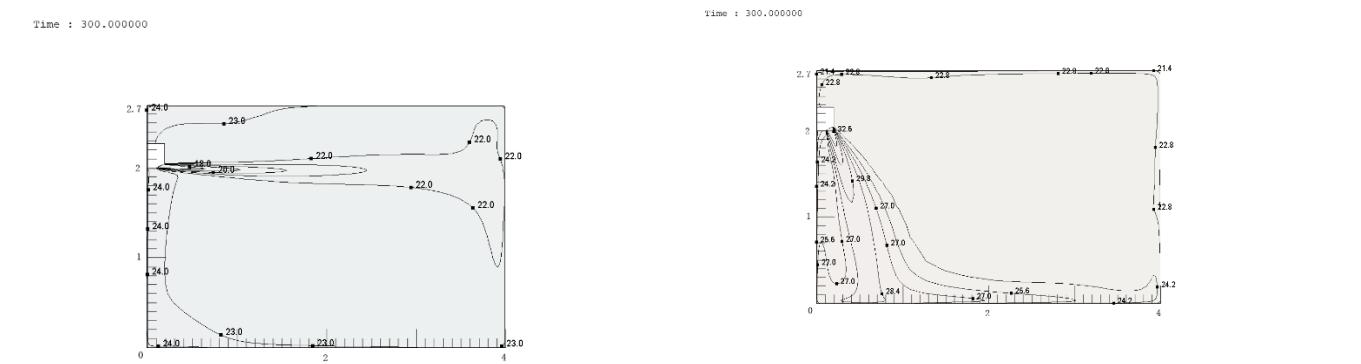


Figure 9.23: MI2-28GDN1 cooling at 300S

Figure 9.24: MI2-28GDN1 heating at 300S

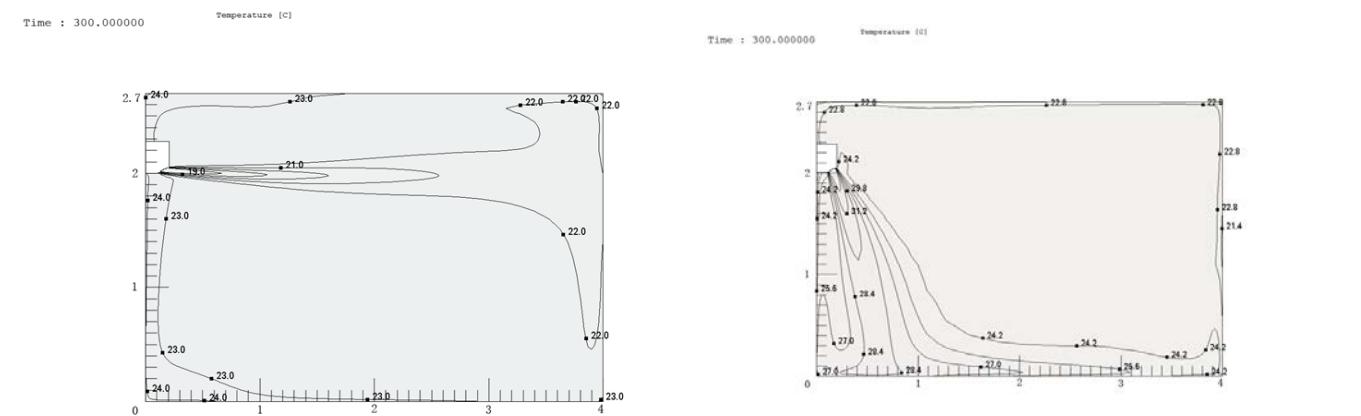

The 2nd Generation DC Series VRF Indoor Units

Midea

Time : 300.000000

Temperature [C]

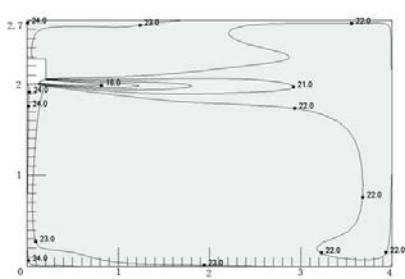


Figure 9.25: MI2-36GDN1 cooling at 300S

Time : 300.000000

Temperature [C]

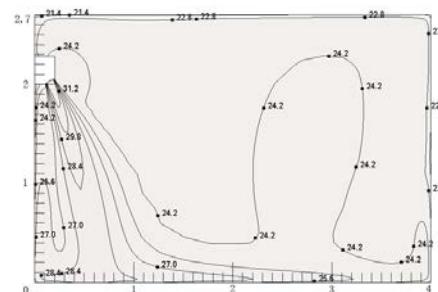


Figure 9.26: MI2-36GDN1 heating at 300S

Time : 300.000000

Temperature [C]

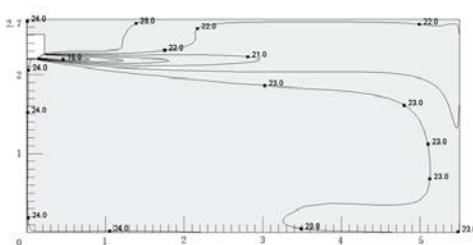


Figure 9.27: MI2-45GDN1 cooling at 300S

Time : 300.000000

Temperature [C]

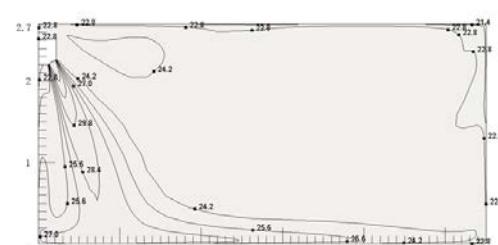


Figure 9.28: MI2-45GDN1 heating at 300S

Time : 300.000000

Temperature [C]

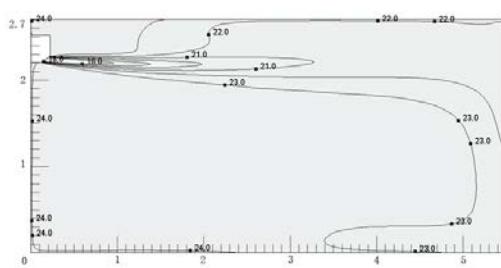


Figure 9.29: MI2-56GDN1 cooling at 300S

Time : 300.000000

Temperature [C]


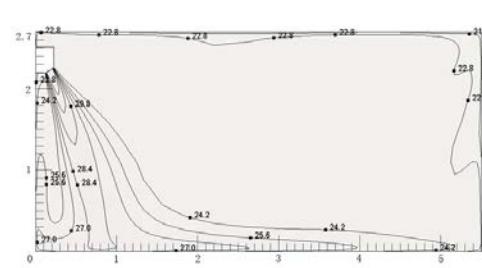


Figure 9.30: MI2-56GDN1 heating at 300S

Time : 300.000000

Temperature [C]

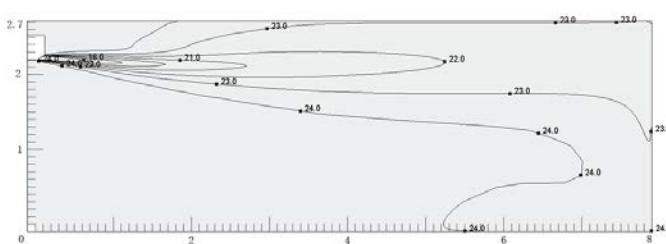

Time : 300.000000

Temperature [C]

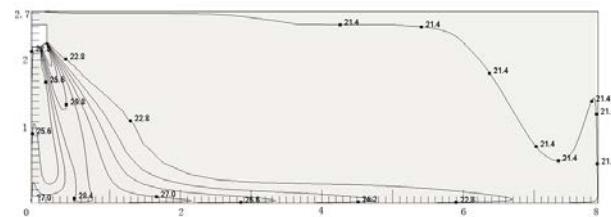


Figure 9.31: MI2-71GDN1 cooling at 300S

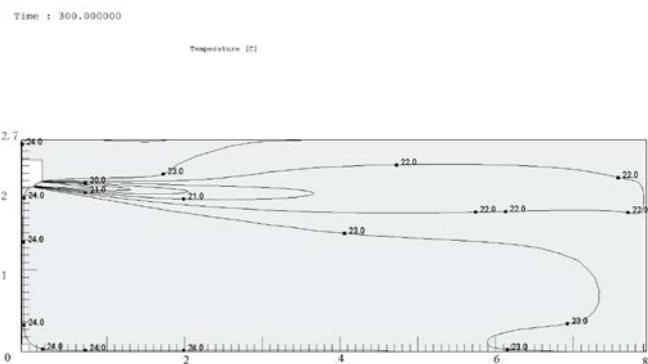


Figure 9.33: MI2-80GDN1 cooling at 300S

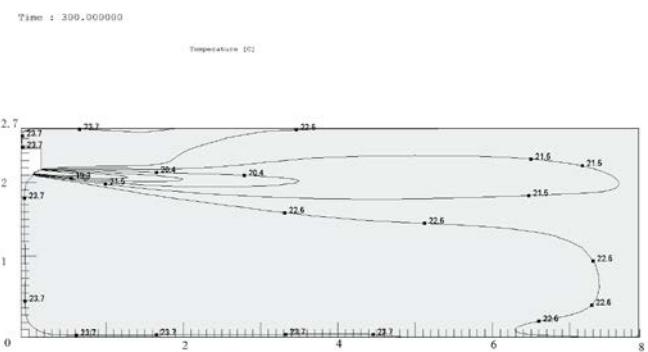


Figure 9.35: MI2-90GDN1 cooling at 300S

Figure 9.32: MI2-71GDN1 heating at 300S

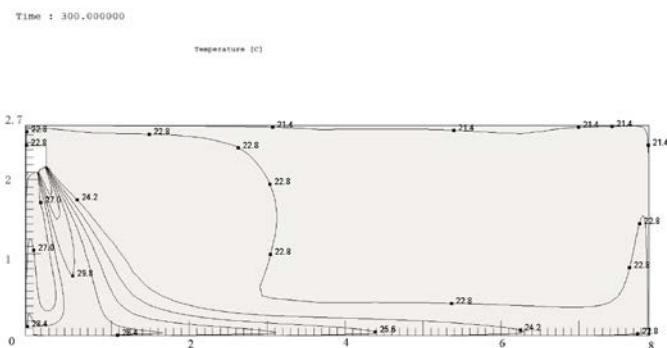


Figure 9.34: MI2-80GDN1 heating at 300S

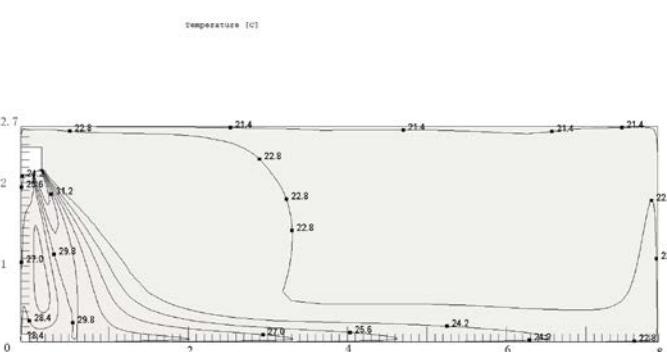


Figure 9.36: MI2-90GDN1 heating at 300S

